

DATE: 7/31/2024

Page: 6

BID NO.: 50-00145704

BID FORM
Non Public Works

All Public Work Projects are required to use the Louisiana Uniform Public Work Bid Form

All prices must be held firm unless an escalation provision is requested in this bid. Jefferson Parish will allow one escalation during the term of the contract, which may not exceed the U.S. Bureau of Labor Statistics National Index for all Urban Consumers, unadjusted 12 month figure. The most recently published figure issued at the time an adjustment is requested will be used. A request must be made in writing by the vendor, and the escalation will only be applied to purchases made after the request is made.

Are you requesting an escalation provision?

YES _____ NO ☒

MAXIMUM ESCALATION PERCENTAGE REQUESTED _____%

INITIAL BID PRICES WILL REMAIN FIRM THROUGH THE DATE OF 12/30/2024

For the purposes of comparison of bids when an escalation provision is requested, Jefferson Parish will apply the maximum escalation percentage quoted by the bidder to the period to which it is applied in the bid. The initial price and the escalation will be used to calculate the total bid price. It will be assumed, for comparison of prices only, that an equal amount of material or labor is purchased each month throughout the entire contract.

DELIVERY: FOB JEFFERSON PARISH

INDICATE DELIVERY DATE ON EQUIPMENT AND SUPPLIES

14-18 weeks

LOUISIANA CONTRACTOR'S LICENSE NO.: (if applicable) _____

THIS SECTION MUST BE COMPLETED BY BIDDER:

FIRM NAME: Better Pumps and Solutions, LLC

ADDRESS: 12203 Airline Hwy

CITY, STATE: Baton Rouge, LA ZIP: 70817

TELEPHONE: (225) 319-7260 FAX: (225) 319-7264

EMAIL ADDRESS: Sales@betterpumps.com

In the event that addenda are issued with this bid, bidders MUST acknowledge all addenda on the bid form. Bidder must acknowledge receipt of an addendum on the bid form by placing the addendum number as indicated. Failure to acknowledge any addendum on the bid form will result in bid rejection.

Acknowledge Receipt of Addenda: NUMBER: 1

NUMBER: 2

NUMBER: _____

NUMBER: _____

TOTAL PRICE OF ALL BID ITEMS: \$ 143,950.00

AUTHORIZED SIGNATURE: [Signature]

TITLE: President

Joseph Atol

Printed Name

SIGNING INDICATES YOU HAVE READ AND COMPLY WITH THE INSTRUCTIONS AND CONDITIONS.

NOTE: All bids should be returned with the BID NUMBER and BID OPENING DATE indicated on the outside of the envelope submitted to the Purchasing Department.

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00145704

SEALED BID


| ITEM NUMBER | QUANTITY | U/M | DESCRIPTION OF ARTICLES | UNIT PRICE QUOTED | TOTALS |
|----------------|----------|------|--|----------------------|----------------------|
| 1 | 1.00 | ONLY | <p>PURCHASE OF STATIONARY EMERGENCY STANDBY FLOOD CONTROL PUMP FOR THE JEFFERSON PARISH DEPARTMENT OF DRAINAGE</p> <p>0010 PURCHASE STATIONARY EMERGENCY STANDBY FLOOD CONTROL PUMPING EQUIPMENT</p> <p>**SEE ATTACHED SPECIFICAITONS**</p> <p>DELIVER TO: WESTBANK PUMP STATION WAREHOUSE 5100 ROCHESTER DR. MARRERO, LA 70072</p> | \$ <u>143,950.00</u> | \$ <u>143,950.00</u> |

CD300M Dri-Prime® Pump

The Godwin Dri-Prime CD300M pump offers flow rates to 5990 USGPM and has the capability of handling solids up to 3.7" in diameter.

The CD300M is able to automatically prime to 28' of suction lift from dry. Automatic or manual starting/stopping available through integral mounted control panel or optional wireless-remote access.

Indefinite dry-running is no problem due to the unique Godwin liquid bath mechanical seal design. Solids handling, dry-running, and portability make the CD300M the perfect choice for dewatering and bypass applications.

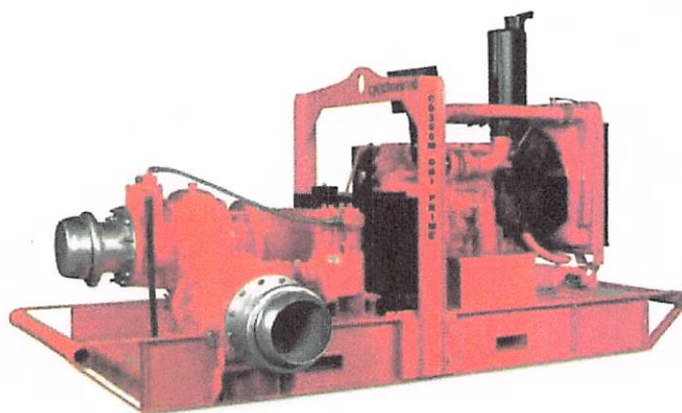

Features and Benefits

- Simple maintenance normally limited to checking fluid levels and filters.
- Dri-Prime (continuously operated Venturi air ejector priming device) requiring no periodic adjustment. Optional compressor clutch available.
- Extensive application flexibility handling sewage, slurries, and liquids with solids up to 3.7" in diameter.
- Dry-running high pressure liquid bath mechanical seal with high abrasion resistant solid silicon carbide faces.
- Pedestal-mounted centrifugal pump with Dri-Prime system coupled to a diesel engine.
All cast iron construction (stainless steel construction option available) with cast steel impeller.
- Caterpillar C7.1 (T3 Flex). Emergency stand-by diesel engine.


Specifications

| | |
|-----------------------|---------------------|
| Suction connection | 12" 125# ANSI B16.1 |
| Delivery connection | 12" 150# ANSI B16.5 |
| Max capacity | 5990 USGPM † |
| Max solids handling | 3.7" |
| Max impeller diameter | 14.3" |
| Max operating temp | 176°F* |
| Max pressure | 88 psi |
| Max suction pressure | 58 psi |
| Max casing pressure | 132 psi |
| Max operating speed | 1800 rpm |

* Please contact our office for applications in excess of 176°F.

† Larger diameter pipes may be required for maximum flows.

Performance Curve

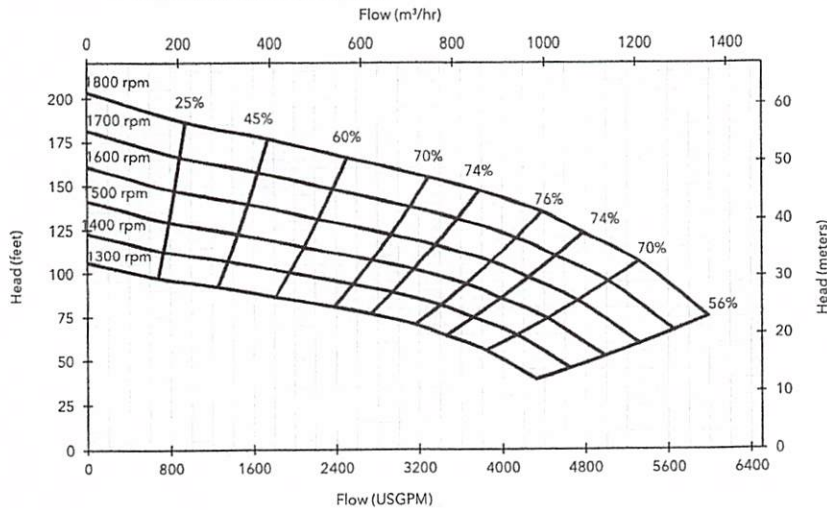

Engine

Caterpillar C7.1 (T3 Flex), Emergency Stand-by 170 HP @ 1800 rpm

Impeller diameter 14.3"

Pump speed 1800 rpm

Materials

| | |
|-----------------------------|--|
| Pump casing & suction cover | Cast iron BS EN 1561 - 1997 |
| Wearplates | High Chromium Cast Iron HC403:1977 |
| Pump Shaft | Carbon steel BS 970 - 1991 817M40T |
| Impeller | Cast Steel BS3100 A5 Hardness to 200 HB Brinell |
| Non-return valve body | Cast iron BS EN 1561 - 1997 |
| Mechanical seal | Double Mech seal; Silicon carbide face; Viton elastomers; Stainless steel body |

Max Fuel consumption @ 1800 rpm: 12.1 US Gal/hr



Max Fuel consumption @ 1600 rpm: 10.3 US Gal/hr

Weight (Dry): 9,500 lbs

Weight (Wet): 11,230 lbs

Dim.: (L) 160" x (W) 71" x (H) 97"

Performance data provided in tables is based on water tests at sea level and 20°C ambient. All information is approximate and for general guidance only. Please contact the factory or office for further details.

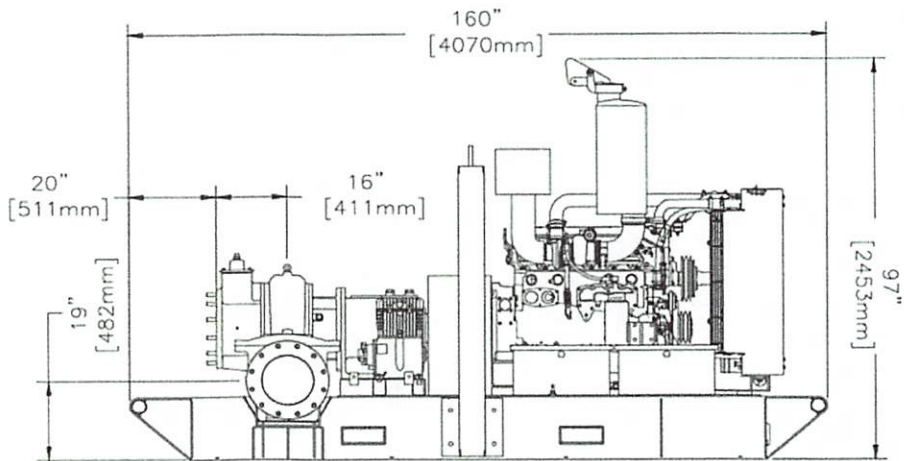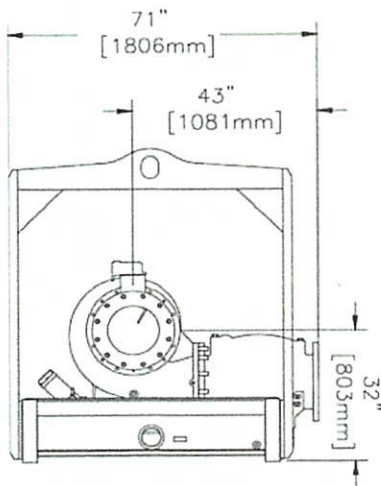

xylem
Let's Solve Water

84 Floodgate Road
Bridgeport, NJ 08014 USA
(856) 467-3636 . Fax (856) 467-4841
Email: sales@godwinpumps.com

Reference number : 95-1018-3000

Date of issue : February 26, 2014

Issue : 5

www.godwinpumps.com

© 2014 Xylem, Inc. All rights reserved. Godwin is a trademark of Xylem Dewatering Solutions, Inc., a wholly-owned subsidiary of Xylem Inc. Specifications and illustrations are subject to revision without notice. Xylem makes no representation regarding the completeness or accuracy of this information and is not liable for any direct or indirect damages arising from or relating to this information or its use.

Non-Public Works Bid

AFFIDAVIT

STATE OF Louisiana

PARISH/COUNTY OF East Baton Rouge

BEFORE ME, the undersigned authority, personally came and appeared: abe

Abel, (Affiant) who after being by me duly sworn, deposed and said that he/she is the fully authorized President of Better Housing Solutions LLC (Entity), the party who submitted a bid in response to Bid Number 50-00145704 to the Parish of Jefferson.

Affiant further said:

Campaign Contribution Disclosures

(Choose A or B, if option A is indicated please include the required attachment):


Choice A _____ Attached hereto is a list of all campaign contributions, including the date and amount of each contribution, made to current or former elected officials of the Parish of Jefferson by Entity, Affiant, and/or officers, directors and owners, including employees, owning 25% or more of the Entity during the two-year period immediately preceding the date of this affidavit or the current term of the elected official, whichever is greater. Further, Entity, Affiant, and/or Entity Owners have not made any contributions to or in support of current or former members of the Jefferson Parish Council or the Jefferson Parish President through or in the name of another person or legal entity, either directly or indirectly.

Choice B ✓ there are **NO** campaign contributions made which would require disclosure under Choice A of this section.

Debt Disclosures

(Choose A or B, if option A is indicated please include the required attachment):

Choice A _____ Attached hereto is a list of all debts owed by the affiant to any elected or appointed official of the Parish of Jefferson, and any and all debts owed by any elected or appointed official of the Parish to the Affiant.


Choice B  _____ There are **NO** debts which would require disclosure under Choice A of this section.

Affiant further said:

That Affiant has employed no person, corporation, firm, association, or other organization, either directly or indirectly, to secure the public contract under which he received payment, other than persons regularly employed by the Affiant whose services in connection with the construction, alteration or demolition of the public building or project or in securing the public contract were in the regular course of their duties for Affiant; and

[The remainder of this page is intentionally left blank.]

That no part of the contract price received by Affiant was paid or will be paid to any person, corporation, firm, association, or other organization for soliciting the contract, other than the payment of their normal compensation to persons regularly employed by the Affiant whose services in connection with the construction, alteration or demolition of the public building or project were in the regular course of their duties for Affiant.

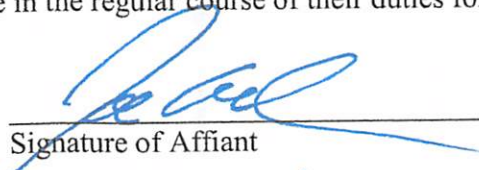
Signature of Affiant

Joe H. H. H.
Printed Name of Affiant


SWORN AND SUBSCRIBED TO BEFORE ME
ON THE 21st DAY OF August, 2024


Notary Public

Blane Wilson
Printed Name of Notary

36970
Notary/Bar Roll Number

My commission expires @ Death.

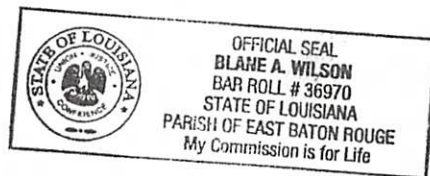

**RESOLUTION OF THE MEMBERS
OF
BETTER PUMPS & SOLUTIONS, LLC**

A meeting of the Members of Better Pumps & Solutions, LLC was held on the 24 day of August, 2015 at which time the Members waived all requirements of notice of the date, time and place, as well as the purpose of the meeting and after being called to order by Brad Dutruch, Manager, the following resolutions were unanimously adopted:

ON MOTION DULY MADE AND SECONDED, IT WAS UNANIMOUSLY RESOLVED, that Joseph Atol, IV, is hereby appointed as a Manager of Better Pumps & Solutions, LLC. There being no further business before the Members, the meeting was adjourned.

There being no further business before the Members, the meeting was adjourned.


Brad Dutruch, Manager

CERTIFICATE

The above and foregoing is a true and correct copy of the Resolutions that were unanimously adopted by the Members of Better Pumps & Solutions, LLC. at a special meeting of the Members which was held the 24 day of August, 2015 attended by the Members after they had specifically waived all requirements for notice of the meeting and had consented for any business to be brought up before the meeting; and, since the adoption of this Resolution, it has neither been rescinded, vacated, nor set aside and accordingly remains in full force and effect.

Baton Rouge, Louisiana this 24 day of August, 2015.


Brad Dutruch, Manager