

DATE: 8/06/2018

INVITATION TO BID  
THIS IS NOT AN ORDER

Page: 4

BID NO.: 50-00123835

### JEFFERSON PARISH

PURCHASING DEPARTMENT  
P.O. BOX 9  
GRETNA, LA. 70054-0009  
504-364-2678

VENDOR: 27118 BLANK BID COPY VENDOR

BUYER: DMEVANS

As per LSA-RS 47:301 et seq., all governmental bodies are excluded from payment of sales taxes to any Louisiana taxing body. Quotations shall be based on F.O.B. Agency warehouse or jobsite, anywhere within the Parish as designated by the Purchasing Department.

JEFFERSON PARISH reserves the right to cancel all or any part of an order if not shipped promptly. No charges will be allowed for parking or cartage unless specified in quotation. The order must not be filled at a higher price than quoted. JEFFERSON PARISH reserves the right to cancel at any time and for any reason by issuing a THIRTY (30) day written notice to the contractor.

JEFFERSON PARISH is expecting all products to be new and all work to be done in workman-like manner, according to standard practices. Any deviations or alteration from the specifications must be indicated on the bid form for each item and upon request, product data for same must be submitted by the time specified by the Purchasing Department.

<b>DELIVERY: FOB JEFFERSON PARISH</b>	
INDICATE DELIVERY DATE ON EQUIPMENT AND SUPPLIES	<u>30 DAYS OR LESS</u>
INDICATE STARTING TIME (IN DAYS) FOR CONSTRUCTION WORK	_____
INDICATE COMPLETION TIME (IN DAYS) FOR CONSTRUCTION WORK	_____

In the event that addenda are issued with this bid, bidders MUST acknowledge all addenda on the bid form. Bidder must acknowledge receipt of an addendum on the bid form as indicated. Failure to acknowledge any addendum on the bid form will result in bid rejection.

Acknowledge Receipt of Addenda: NUMBER: \_\_\_\_\_  
 NUMBER: \_\_\_\_\_  
 NUMBER: \_\_\_\_\_  
 NUMBER: \_\_\_\_\_

LOUISIANA CONTRACTOR'S LICENSE NO.: (if applicable) \_\_\_\_\_

<b>*** ALL BIDDERS MUST COMPLETE SECTION BELOW ***</b>	
FIRM NAME:	<u>LED LIGHTING WHOLESALERS INC.</u>
SIGNATURE: (Must be signed here)	<u>Erich Adelbert</u> TITLE: <u>PRESIDENT</u>
PRINT OR TYPE NAME:	<u>ERICH ADELBERT</u>
ADDRESS:	<u>400 E. Cork St.</u>
CITY, STATE:	<u>KALAMAZOO, MI</u> ZIP: <u>49001</u>
TELEPHONE:	<u>(269) 532-1020</u> FAX: <u>( ) N/A</u>
EMAIL ADDRESS:	<u>CODY@LEDLIGHTINGWHOLESALERS.COM</u>

TOTAL PRICE OF ALL BID ITEMS: \$ 15,137.60

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00123835

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
1	1.00	EA	ONE TIME PURCHASE OF VARIOUS ELECTRICAL ITEMS	N/A	N/A
			0010 SQD QO320L125GRB Load Center, 3 Phase		
2	8.00	EA	MUST BE SQUARE D TO MATCH EXISTING	N/A	N/A
			0020 SQD QO215 2P-120/240V-15A CB		
3	1.00	EA	MUST BE SQUARE D TO MATCH EXISTING	N/A	N/A
			0030 SQD QO11624L125GRB LOAD CENTER		
4	16.00	EA	MUST BE SQUARE D TO MATCH EXISTING	N/A	N/A
			0040 SQD QO215 2P-120/240V-15A CB		
5	1.00	EA	MUST BE SQUARE D TO MATCH EXISTING	N/A	N/A
			0050 SQD H361RB 30A-600V-3P RT SW		
6	3.00	EA	MUST BE SQUARE D TO MATCH EXISTING	N/A	N/A
			0060 GLDS TRS15RID 600V 15A RK5 Fuse Delay With Smartspot Indicator		
7	1.00	EA	MUST BE SQUARE D TO MATCH EXISTING	N/A	N/A
			0070 SQD NF418L1C NF 125ACU4W600		
8	1.00	EA	MUST BE SQUARE D TO MATCH EXISTING	N/A	N/A
			0080 SQD MH26WP Panelboard Box		
9	4.00	EA	MUST BE SQUARE D TO MATCH EXISTING	N/A	N/A
			0090 SQD QO215 2P-120/240V-15A CB		
10	2.00	EA	MUST BE SQUARE D TO MATCH EXISTING	N/A	N/A
			0100 SQD NF418L1C NF 125ACU4W600		
			MUST BE SQUARE D TO MATCH EXISTING		

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00123835

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
11	2.00	EA	0110 SQD MH26WP Panelboard Box  MUST BE SQUARE D TO MATCH EXISTING	N/A	N/A
12	14.00	EA	0120 SQD QO215 2P-1250/240V-15A CB  MUST BE SQUARE D TO MATCH EXISTING	N/A	N/A
13	18.00	EA	0130 LTH TSP-1000M-GP24M-480-SCWA  MUST BE LITHONIA BRAND TO MATCH EXISTING	442.96	7,973.28
14	16.00	EA	0140 LTH TSP-1000M-GP24M-TB-SCWA  MUST BE LITHONIA BRAND TO MATCH EXISTING  Needed for electrical division	447.77	7,164.32



# Estimate

Date	Estimate #
8/7/2018	3684

Name / Address
Jefferson Parish Department of Purchasing 504-364-2678

Project

Item	Description	Qty	Price	Total
TSP-1000M-GP24M-480-SCWA		18	442.96	7,973.28T
TSP-1000M-GP24M-TB-SCWA		16	447.77	7,164.32T

<b>Subtotal</b>		\$15,137.60
<b>Sales Tax (0.0%)</b>		\$0.00
<b>Total</b>		\$15,137.60

4203 Portage St. Kalamazoo, MI 49001  
 1-877-LED-5554 or 269-532-1313  
 www.LEDLightingWHOLESALEinc.com

## FEATURES & SPECIFICATIONS

**INTENDED USE** — Use for stadiums, fields, arenas, tracks or courts.

**CONSTRUCTION** — Two-piece die-cast aluminum ballast housing mounted to galvanized steel trunnion. Ballast is removable and hinged with captive fastener. Steel trunnion features vertical and horizontal aiming scale with vertical repositioning stop. All external hardware is stainless steel.

Finish: White corrosion resistant polyester powder finish standard (DWH); other architectural colors available.

**OPTICS** — Heavy-gauge anodized reflector with five distributions available. "Flux manager" available for optimal glare and spill light control. Transverse mounting of lamp. Lamp support included. Optical chamber sealed to inhibit entrance of contaminants. Hinged lens is thermal-, shock- and impact-resistant tempered glass. Lens frame is galvanized and secured by stainless steel spring clips for servicing of lamp. Aiming device included to assist in positioning luminaire. **US Patent no. 6,190,023. Canada Patent no. 2,212,014.**

**ELECTRICAL** — All electrical components are thermally isolated from the optical assembly, promoting longer life. Ballast is high power factor, constant-wattage autotransformer and 100% factory tested. Super CWA Pulse Start ballasts, DOE2017 compliant, are required for 400W (must order SCWA option) for US shipments only. CSA, NOM or INTL required for probe start shipments outside of the U.S.

Die-cast socket housing. Mogul-base porcelain socket with copper alloy, nickel-plated screw shell and spring-loaded center contact. U.L. listed 1500W - 600V.


**INSTALLATION** — Fixture mounted by securing trunnion directly to cross arm. No additional adaptors required. Mounting hardware provided.

**LISTINGS** — UL listed, suitable for wet locations. Below horizontal aiming orientation only. Listed and labeled to comply with Canadian Standards (see Options).

**WARRANTY** — 1-year limited warranty. Complete warranty terms located at: [www.acuitybrands.com/CustomerResources/Terms\\_and\\_conditions.aspx](http://www.acuitybrands.com/CustomerResources/Terms_and_conditions.aspx)

**Note:** Actual performance may differ as a result of end-user environment and application. Specifications subject to change without notice.


Catalog Number
Notes
Type



Sportslighting

# TSP

METAL HALIDE: 400W, 1000W, 1500W  
Below Horizontal Aiming Orientation Only



EPA: 3.3 ft<sup>2</sup> (0.31m<sup>2</sup>)  
Diameter: 24-1/2 (62.2)  
Length: 20 (50.8)  
\*Max. Weight: 55 lbs. (24.9 kg)

All dimensions are inches (centimeters) unless otherwise indicated.  
\*Weight as configured in example below.

### ORDERING INFORMATION

For shortest lead times, configure product using **standard options (shown in bold)**.

**Example: TSP 1500M GP24N TB**






Series	Wattage	Distribution	Voltage	Ballast	Mounting	
TSP	400M <sup>1</sup> <b>1000M<sup>2</sup></b> 1500M	General purpose <b>GP24N</b> GP24NFX <b>GP24M</b> GP24MFX <b>GP24W</b> GP24WFX	Heavy duty <sup>3</sup> HD24N HD24NFX HD24M HD24MFX HD24W HD24WFX	120 208 <sup>4</sup> 240 <sup>4</sup> 277 347 <b>480<sup>4</sup></b> <b>TB<sup>5</sup></b> 23050HZ <sup>6</sup>	<b>(blank)</b> Magnetic ballast CWI Constant wattage isolated <sup>6</sup> <b>Pulse Start</b> SCWA Super constant wattage autotransformer <sup>7</sup> Note: For shipments to U.S. territories, SCWA must be specified to comply with EISA.	<b>Shipped installed</b> <b>(blank)</b> Yoke <b>Shipped separately<sup>8</sup></b> FPMB Pipe mounting bracket FSAB Steel angle bracket for FTS FRWB Radius wall bracket for FTS FCRA Cross arm adapter <b>FCRA45</b> Cross arm adapter (45° mount) <sup>9</sup> FTS Tenon slipfitter
Options					Finish <sup>13</sup>	
<b>Shipped installed in fixture</b>					<b>(blank)</b> White DDB Dark bronze DBL Black DMB Medium bronze DNA Natural aluminum CR Enhanced corrosion-resistance CRT Non-stick protective coating <sup>14</sup>	
SF	Single fuse (120, 277, 347V) N/A TB		CF	Charcoal filter (heavy duty only) <sup>12</sup>		
DF	Double fuse (208, 240, 480V) N/A TB		SLR	Stainless steel lens ring		
QRS	Quartz restrrike system <sup>10</sup>		WC	Wood cross arm mounting bolt (5/8"-11 UNC x 7")		
C62	2 ft. of 16/3 SEO cable pre-wired		<b>CSA</b>	Listed and labeled to comply with Canadian Standards (120, 277, 347V only)		
C42	2 ft. of 14/3 SEO cable pre-wired		INTL	Available for MH probe start shipping outside the U.S.		
C22	2 ft. of 12/3 SEO cable pre-wired		REGC1	California Title 20 effective 1/1/2010		
CV3P	3 ft. of 16/3 SEO cable pre-wired with three-prong plug for use with pre-wired cages and cross-arms <sup>11</sup>		<b>NOM</b>	NOM certified <sup>6</sup>		

#### Notes

- These wattages require the REGC1 option to be chosen for shipments into California for Title 20 compliance.
- SCWA required.
- Heavy-duty anodized aluminum shroud painted to match fixture.
- Must specify CWI in Canada. 400M 480V not available with probe start.
- Optional multi-tap ballast (120, 208, 240, 277V). (120, 277, 347V in Canada).
- Consult factory for available wattages.
- Not available with 1500M.
- May be ordered as an accessory. Must specify finish.
- Ships standard with all fixtures in matching finish.
- Maximum allowable wattage lamp included.
- Must use mating receptacle, provided by others. Not available with 1500W-120V.
- HD option must be ordered.
- See [www.lithonia.com/archcolors](http://www.lithonia.com/archcolors) for additional color options.
- Black finish only.

# TSP Metal Halide Sportlighting

— Vertical Candlepower  
 — Horizontal Candlepower

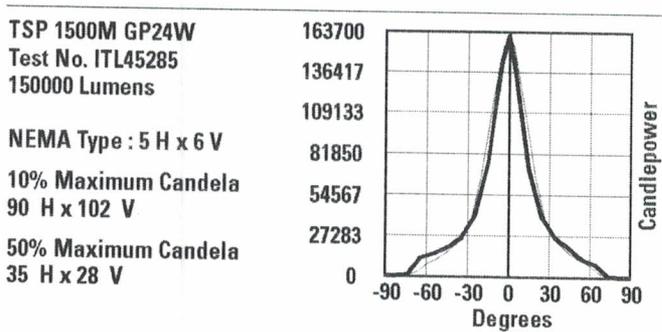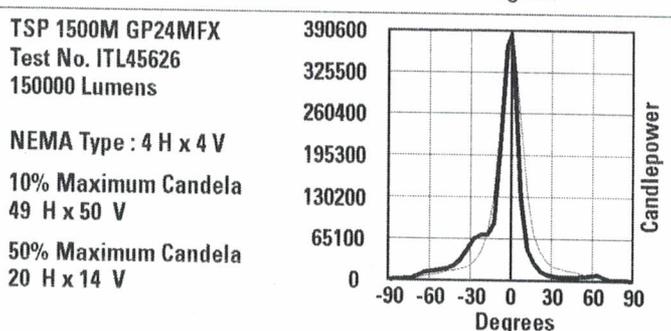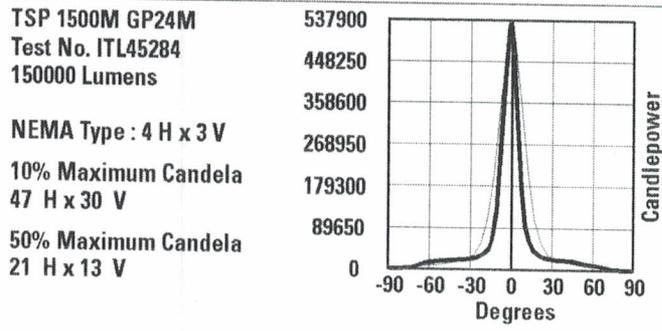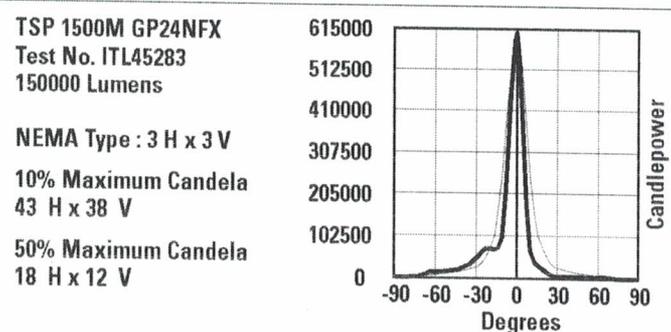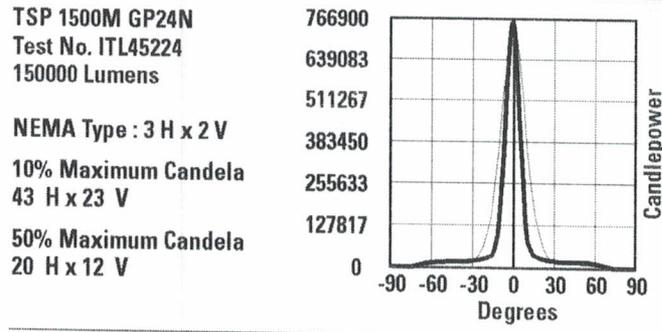

**Notes**

- 1 For electrical characteristics, consult outdoor technical data specifications on [www.lithonia.com](http://www.lithonia.com).
- 2 Tested to current IES and NEMA standards under stabilized laboratory conditions. Various operating factors can cause differences between laboratory and actual field measurements. Dimensions and specifications are based on the most current data and are subject to change.
- 3 Photometric data for other distributions can be accessed from [www.lithonia.com](http://www.lithonia.com).



TSP-M