

DATE: 4/14/2021

Page: 6

BID NO.: 50-00134166

BID FORM
Non Public Works

All Public Work Projects are required to use the Louisiana Uniform Public Work Bid Form

All prices must be held firm unless an escalation provision is requested in this bid. Jefferson Parish will allow one escalation during the term of the contract, which may not exceed the U.S. Bureau of Labor Statistics National Index for all Urban Consumers, unadjusted 12 month figure. The most recently published figure issued at the time an adjustment is requested will be used. A request must be made in writing by the vendor, and the escalation will only be applied to purchases made after the request is made.

Are you requesting an escalation provision?

YES _____ NO X

MAXIMUM ESCALATION PERCENTAGE REQUESTED _____%

INITIAL BID PRICES WILL REMAIN FIRM THROUGH THE DATE OF

August 5, 2021

For the purposes of comparison of bids when an escalation provision is requested, Jefferson Parish will apply the maximum escalation percentage quoted by the bidder to the period to which it is applied in the bid. The initial price and the escalation will be used to calculate the total bid price. It will be assumed, for comparison of prices only, that an equal amount of material or labor is purchased each month throughout the entire contract.

DELIVERY: FOB JEFFERSON PARISH

INDICATE DELIVERY DATE ON EQUIPMENT AND SUPPLIES

4-6 weeks

LOUISIANA CONTRACTOR'S LICENSE NO.: (if applicable) _____

THIS SECTION MUST BE COMPLETED BY BIDDER:

FIRM NAME: Wastecorp Pumps LLC
ADDRESS: 2391 Baseline Rd #70
CITY, STATE: Grand Island, NY ZIP: 14072
TELEPHONE: (888) 829 - 2783 FAX: (888) 883 - 3320
EMAIL ADDRESS: info@wastecorp.com

In the event that addenda are issued with this bid, bidders MUST acknowledge all addenda on the bid form. Bidder must acknowledge receipt of an addendum on the bid form by placing the addendum number as indicated. Failure to acknowledge any addendum on the bid form will result in bid rejection.

Acknowledge Receipt of Addenda: NUMBER: _____
NUMBER: _____
NUMBER: _____
NUMBER: _____

TOTAL PRICE OF ALL BID ITEMS: \$ 29,000

AUTHORIZED SIGNATURE: [Signature]
TITLE: President

Daniel Sog
Printed Name

SIGNING INDICATES YOU HAVE READ AND COMPLY WITH THE INSTRUCTIONS AND CONDITIONS.

NOTE: All bids should be returned with the BID NUMBER and BID OPENING DATE indicated on the outside of the envelope submitted to the Purchasing Department.


CORPORATE RESOLUTION

EXCERPT FROM MINUTES OF MEETING OF THE BOARD OF DIRECTORS OF
WASTECORP PUMPS LLC.
INCORPORATED.

AT THE MEETING OF DIRECTORS OF WASTECORP PUMPS LLC.,
INCORPORATED, DULY NOTICED AND HELD ON APRIL 30, 2021
A QUORUM BEING THERE PRESENT, ON MOTION DULY MADE AND SECONDED.
IT WAS:

RESOLVED THAT DANIEL SOJA, BE AND IS HEREBY APPOINTED,
CONSTITUTED AND DESIGNATED AS AGENT AND ATTORNEY-IN-
FACT OF THE CORPORATION WITH FULL POWER AND AUTHORITY TO ACT ON
BEHALF OF THIS CORPORATION IN ALL NEGOTIATIONS, BIDDING, CONCERNS
AND TRANSACTIONS WITH THE PARISH OF JEFFERSON OR ANY OF ITS AGENCIES,
DEPARTMENTS, EMPLOYEES OR AGENTS, INCLUDING BUT NOT LIMITED TO, THE
EXECUTION OF ALL BIDS, PAPERS, DOCUMENTS, AFFIDAVITS, BONDS, SURETIES,
CONTRACTS AND ACTS AND TO RECEIVE ALL PURCHASE ORDERS AND NOTICES
ISSUED PURSUANT TO THE PROVISIONS OF ANY SUCH BID OR CONTRACT, THIS
CORPORATION HEREBY RATIFYING, APPROVING, CONFIRMING, AND ACCEPTING
EACH AND EVERY SUCH ACT PERFORMED BY SAID AGENT AND ATTORNEY-IN-
FACT.

I HEREBY CERTIFY THE FOREGOING TO BE
A TRUE AND CORRECT COPY OF AN
EXCERPT OF THE MINUTES OF THE ABOVE
DATED MEETING OF THE BOARD OF
DIRECTORS OF SAID CORPORATION, AND
THE SAME HAS NOT BEEN REVOKED OR
RESCINDED.



SECRETARY-TREASURER

May 1, 2021

DATE

Non-Public Works Bid

AFFIDAVIT

STATE OF New York

PARISH/COUNTY OF Manhattan

BEFORE ME, the undersigned authority, personally came and appeared: David S.

_____, (Affiant) who after being by me duly sworn, deposed and said that he/she is the fully authorized President of Wastecorp Pumps LLC (Entity), the party who submitted a bid in response to Bid Number 5000134166, to the Parish of Jefferson.

Affiant further said:

Campaign Contribution Disclosures

(Choose A or B, if option A is indicated please include the required attachment):

Choice A _____ Attached hereto is a list of all campaign contributions, including the date and amount of each contribution, made to current or former elected officials of the Parish of Jefferson by Entity, Affiant, and/or officers, directors and owners, including employees, owning 25% or more of the Entity during the two-year period immediately preceding the date of this affidavit or the current term of the elected official, whichever is greater. Further, Entity, Affiant, and/or Entity Owners have not made any contributions to or in support of current or former members of the Jefferson Parish Council or the Jefferson Parish President through or in the name of another person or legal entity, either directly or indirectly.

Choice B ☒ there are NO campaign contributions made which would require disclosure under Choice A of this section.

Debt Disclosures

(Choose A or B, if option A is indicated please include the required attachment):

Choice A _____ Attached hereto is a list of all debts owed by the affiant to any elected or appointed official of the Parish of Jefferson, and any and all debts owed by any elected or appointed official of the Parish to the Affiant.

Choice B ✓ _____ There are NO debts which would require disclosure under Choice A of this section.

Affiant further said:

That Affiant has employed no person, corporation, firm, association, or other organization, either directly or indirectly, to secure the public contract under which he received payment, other than persons regularly employed by the Affiant whose services in connection with the construction, alteration or demolition of the public building or project or in securing the public contract were in the regular course of their duties for Affiant; and

[The remainder of this page is intentionally left blank.]

That no part of the contract price received by Affiant was paid or will be paid to any person, corporation, firm, association, or other organization for soliciting the contract, other than the payment of their normal compensation to persons regularly employed by the Affiant whose services in connection with the construction, alteration or demolition of the public building or project were in the regular course of their duties for Affiant.




Signature of Affiant

Daniel Soja

Printed Name of Affiant

SWORN AND SUBSCRIBED TO BEFORE ME
ON THE 4th DAY OF May, 2021

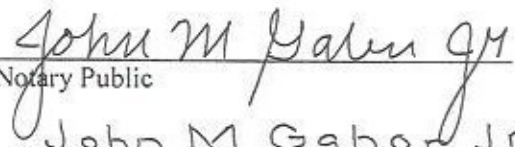


Notary Public
John M Gabor Jr


Printed Name of Notary

01GA6332762

Notary/Bar Roll Number

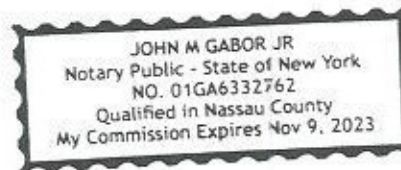

My commission expires 11/9/23



NSAI

Certificate of Registration of Quality Management System to ISO 9001:2015

The National Standards Authority of Ireland certifies that:

Wastecorp Pumps Inc.

has been assessed and deemed to comply with the
requirements of the above standard in respect of the scope
of operations given below:

Design, Engineering, Manufacturing and Servicing of Pumps and Pump Systems

Approved by:
Geraldine Larkin
Chief Executive Officer

Approved by:
Lisa Greenleaf
Operations Manager

Registration Number: 19.8349
Certification Granted: September 13, 2019
Effective Date: September 13, 2019
Expiry Date: January 24, 2022



National Standards Authority of Ireland, 20 Trafalgar Square, Nashua, New Hampshire, NH 03063, USA T +1 603 882 4412



TRASH FLOW® SELF PRIMING TRASH PUMPS TFCC-6™

FEATURES

TRANSFER UP TO
1500 GPM (341m³)

MAX. HEAD 115 FT (35m)

PUMP UP TO 3" (76.2 MM)
SOLIDS

ADJUSTABLE &
SHIMLESS IMPELLER
CLEARANCE

HEAVY DUTY BEARINGS
AND CASTINGS

EASILY REMOVABLE
ROTATING ASSEMBLY

FULL IMPELLER ACCESS

SOLIDS HANDLING
IMPELLER

QUICK SELF PRIMING
CAPABILITIES

DOUBLE FLOATING
MECHANICAL SEAL

DUAL LIP SEAL BEARING
PROTECTION*

*optional

WASTECORP.COM

6"x6"




OUT MUSCLE TOUGH FLUID HANDLING APPLICATIONS.


Along with the unparalleled ease-of-maintenance and quality, we've add some serious productivity enhancements to the Trash Flow TFCC-6 Series. More powerful drive systems with energy savings built in help you pump more with less energy. And, with fluid handling capabilities up to 1500 GPM and max head up to 115 ft, the TFCC-6 is your long term partner for pumping wastewater and solids handling applications

TRASH FLOW® CONFIGURATIONS



FLEX COUPLED



BELT DRIVE VERTICAL



BELT DRIVE PIGGY BACK

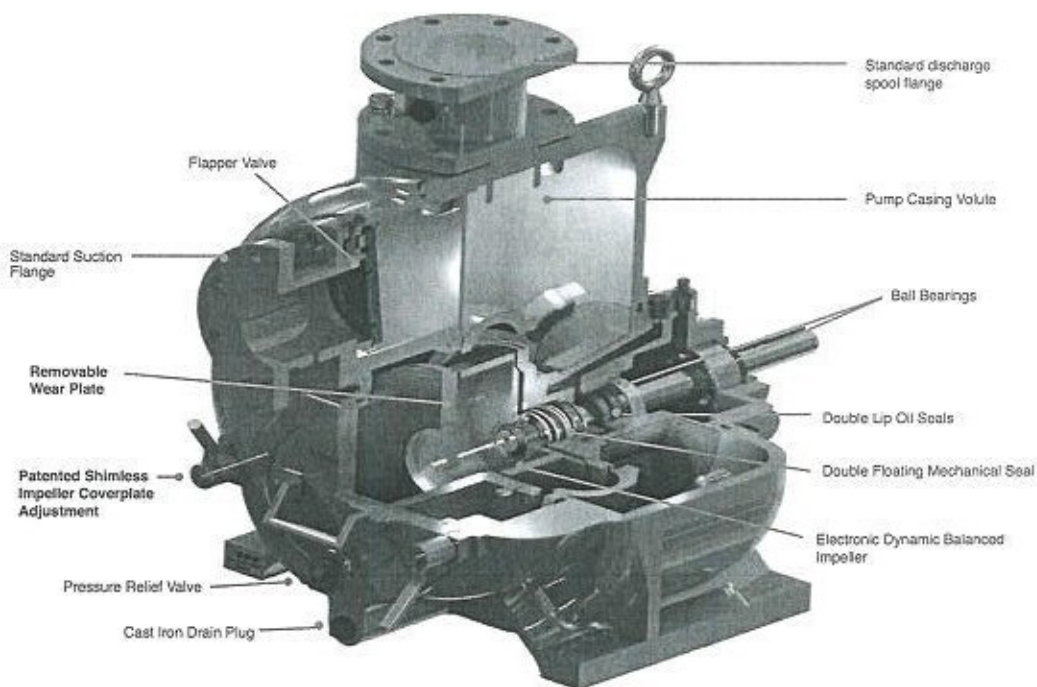

TRASH FLOW® SELF PRIMING TRASH PUMPS

• info@wastecorp.com • 1-888-829-2783

rev: ect 2 2020

TRASH FLOW® SELF PRIMING TRASH PUMPS TFCC-6™

WASTECORP.
Pumps®

FEATURES



REMOVABLE ROTATING ASSEMBLY
Experience less downtime and maintenance hassles with the Trash Flow's removable rotating assembly. The pump volute and piping are not disturbed during maintenance.



DOUBLE FLOATING MECHANICAL SEAL
Wastecorp's mechanical seals are designed for the harsh pumping conditions in today's municipal and industrial solids handling jobs.



SOLIDS HANDLING IMPELLERS
Trash Flow pumps feature our standard premium two-vane solids handling impellers with solids handling capabilities up to 3" (75mm).



OPTIONAL SUCTION AND DISCHARGE GAUGES
Monitor operating pressure easily with Wastecorp's optional suction and discharge gauges.

OPTIONAL CONFIGURATIONS




SEWAGE LIFT STATIONS
Let our pump designers engineer the ultimate lift station for your facility. We offer complete packaged solutions including control panels, valves and more.



TRAILER OR SKID MOUNT ENGINE
With our trailer or skid mounted diesel engine trash pumps, you'll get a DOT approved solution for mobile wastewater transfer.

BARE PUMP DIMENSIONS

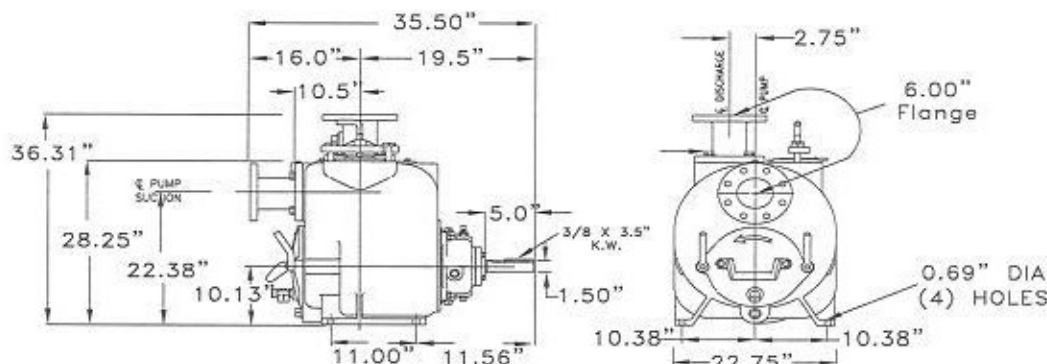

Dimensions and weight are approximate. Wastecorp Pumps reserves the right to make changes in design, materials and operating ranges without notice.

Pump Size	6" x 6" [150 mm x 150 mm] ANSI/DIN
Pump Casing	Cast Iron Class 30
Operating Pressure	Maximum 120 psi (797 kPa)
Impeller	Open type, two vane. Material: Ductile Iron Pumps 3" (76.2 mm) spherical solids
Impeller Shaft	416 Stainless Steel
Wear Plate, Replaceable	Hardened Steel
Cover Plate	Removable/Adjustable Cast Iron Class 30
Flapper Valve	Neoprene with steel reinforcing ring
Bearing Housing	Cast Iron
Seal Plate	Cast Iron
Shaft Sleeve	ANSI 17-4PH SST
Radial Bearing	Open single ball
Thrust Bearing	Open double ball
Bearing/Seal Cavity Lubrication	SAE No. 30 oil
Flanges	125# Ductile Iron ANSI or DIN
Gaskets	Buna-N, compressed synthetic fibers, vegetable fiber, PTFE, cork, and rubber
O-Rings	Buna-N Teflon coated
Hardware	Plated steel/grade 8/SST
Pressure Release Valve	Brass
Oil Level Sight Gauges	Bearing and Seal Cavity
Net Weight	925 lbs/420 KG


Optional Equipment and Materials: Stainless Steel. Automatic air release valve, 120V/240V casing heater. High pump temperature shutdown kit, moisture probe, gauge kit, NPT & DIN standard suction and discharge flanges. Other elastomers available.

Seal Specifications: Mechanical oil-lubricated, double floating, self-aligning seal. Titanium & Tungsten Carbide rotating and stationary faces. Stainless steel metal components. Maximum temperature of liquid pumped 180°F/83°C.

Note: Consult factory for applications exceeding maximum pressure and/or temperature indicated.

TRASH FLOW®
SELF PRIMING TRASH PUMPS
TFCC-6™

WASTECORP.
Pumps

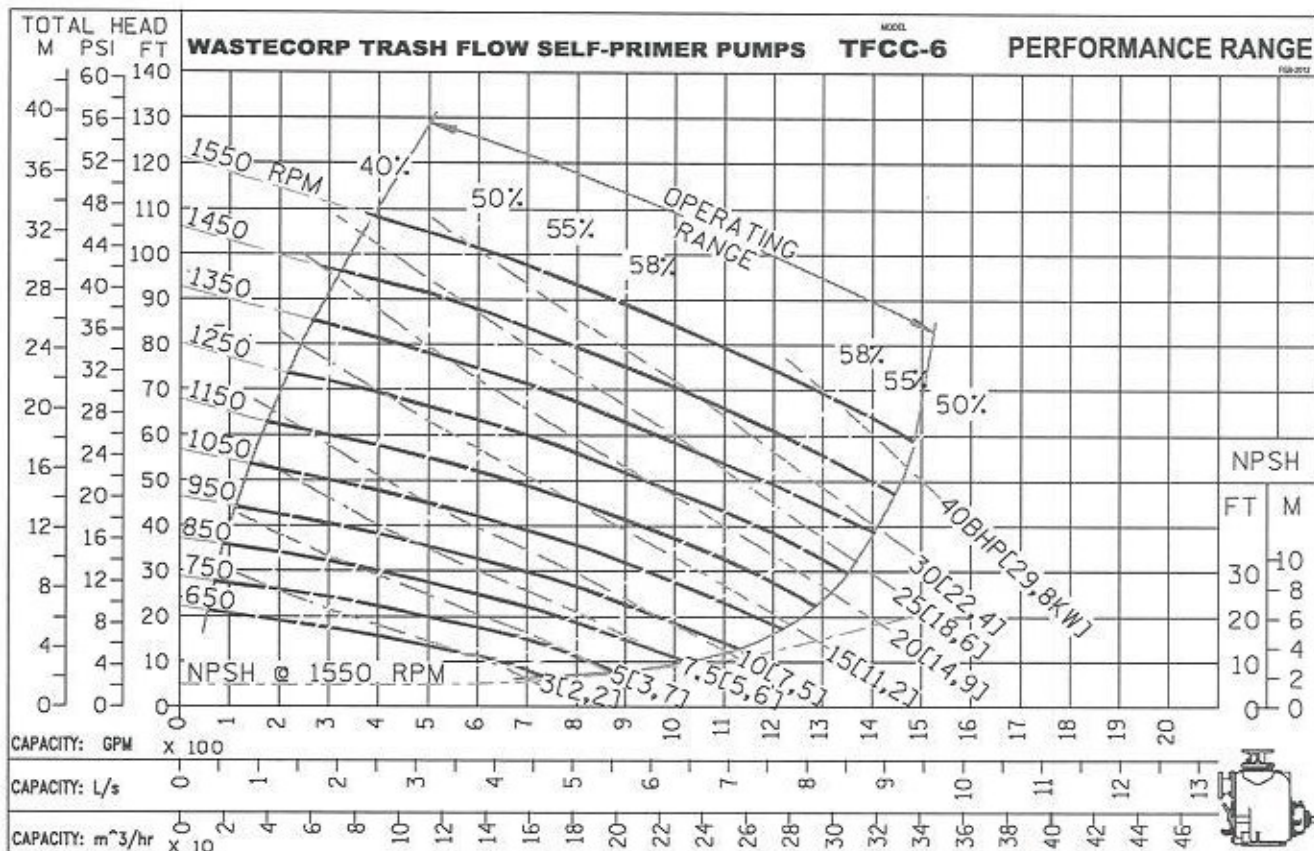

REPRIMING LIFTS			
PUMP SPEED	8 FL.	PUMP SPEED	21 FL.
650 RPM	8 FL.	1250 RPM	21 FL.
750 RPM	9 FL.	1350 RPM	22 FL.
850 RPM	12 FL.	1450 RPM	23 FL.
950 RPM	14 FL.	1550 RPM	25 FL.
1050 RPM	18 FL.		
1150 RPM	21 FL.		

Determine NPSH prior to using repriming table. Do not use as available suction lift.

$$BHP = \frac{GPM \times FT \times SG}{3960 \times Efficiency} \quad KW = \frac{M^3/HR \times M \times SG}{367 \times Efficiency}$$

Suction lift is limited by the available NPSH which is the corrected atmospheric pressure minus the dynamic suction lift, vapor pressure loss and 2 foot safety factor.

WASTECORP.
Pumps

www.wastecorp.com

CURVE NO.: 62921-00 **MODEL:** TFCC-6
SIZE: 6" x 6" **IMPELLER DIA:** 12.38"
RPM: VARIOUS **SP. GR.:** 1.0 @ 68°F

Factory certified tests are performed using Hydraulic Institute acceptance Level B.
The performance curve shown were taken from actual tests of standard production pumps, and reflect an average performance of the pumps included.
Wastecorp reserves the right to make changes in design, materials and working ranges without notice.

CONSULT FACTORY FOR OPERATING CURVES 1750 RPM AND ABOVE.


WASTECORP.
Pumps
WASTECORP.COM

Wastecorp Pumps USA
P.O. Box 70
Grand Island, New York 14072 | USA
Tel: 888.829.2783 | Fax: 888-883-3320
sales@wastecorp.com


Wastecorp Pumps Canada Inc.
50 Shorncliffe Road
Toronto, Ontario M8Z 5K1 | Canada
Tel: 416.233.3000 | Fax: 416.233.2300
info@wastecorp.com

Wastecorp Pumps International
P.O. Box 70
Grand Island, New York 14072 | USA
Tel: 201.445.2882 | Fax: 201.445.3252
techsupport@wastecorp.com


IN DOUBT,
ASK

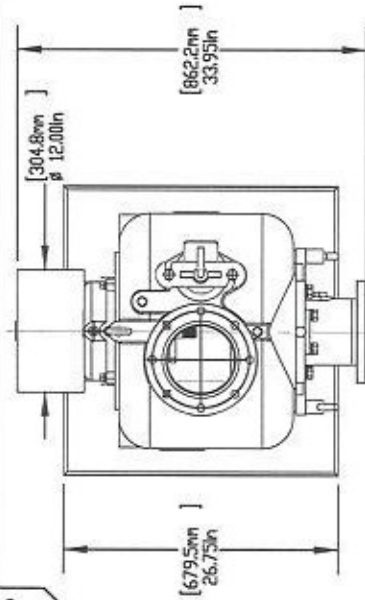


PLAN VIEW

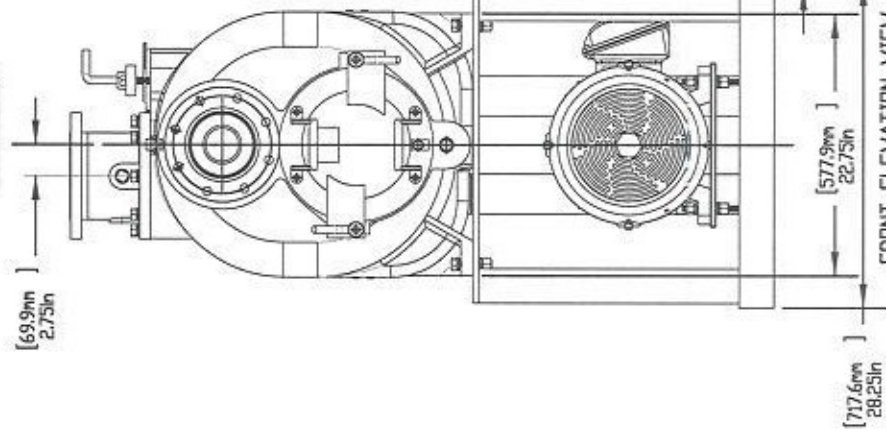

FRONT ELEVATION VIEW

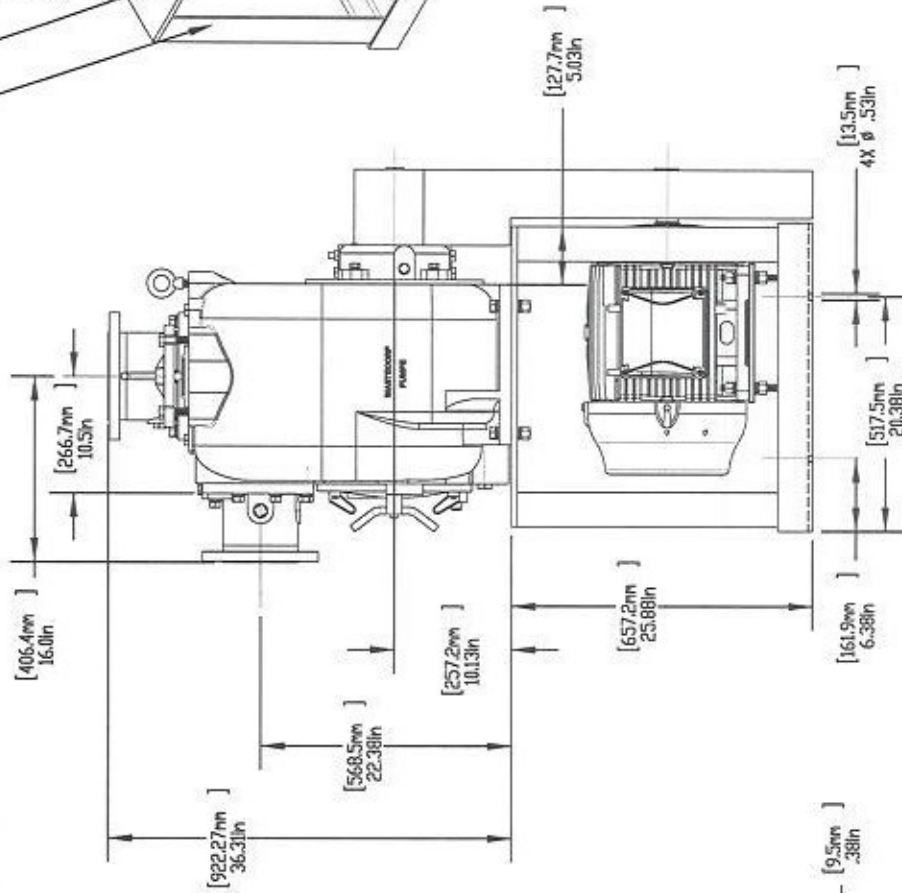

SIDE ELEVATION VIEW

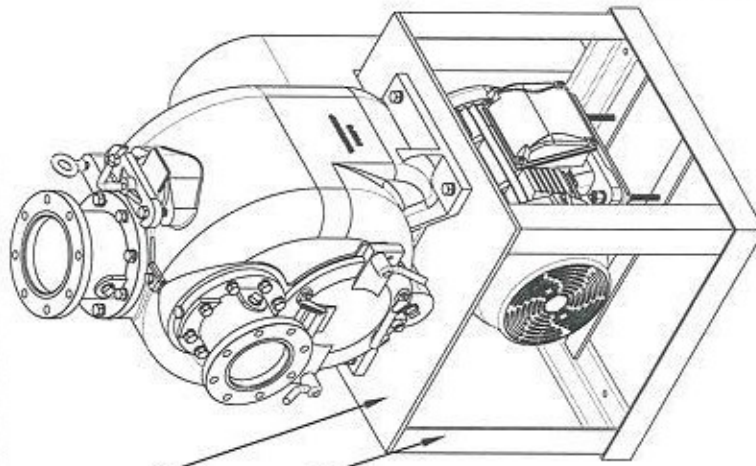

ISO ELEVATION VIEW

NOTES:

1. CUSTOMER RESPONSIBLE FOR ALL INSTALLATION WORK, PROVIDE CONCRETE FOUNDATION AND ANCHOR BOLTS.
2. NOT FOR CONSTRUCTION PURPOSE UNLESS CERTIFIED.
3. PIPING TO PUMP MUST BE COMPLETELY SELF-SUPPORTING TO PREVENT STRAIN ON PUMP CASTINGS.

[698.5mm] [27.5in] 26" X 0.50" PLATE
[76.2mm] [3.0in] 3" X 3/8" ANGLE IRON


ALL INFORMATION CONTAINED IN THIS DOCUMENT IS BOTH CONFIDENTIAL AND PROPRIETARY TO WASTECORP. NO LICENSE, EXPRESSED OR IMPLIED, UNDER ANY PATENT, COPYRIGHT, OR TRADE SECRET IS GRANTED OR IMPLIED BY THE CONVEYANCE OF THIS DOCUMENT. NO PART OF THIS DOCUMENT MAY BE REPRODUCED, TRANSMITTED, TRANSCRIBED, STORED IN A RETRIEVAL SYSTEM, TRANSLATED TO ANY LANGUAGE OR COMPUTER LANGUAGE, IN ANY FORM BY ANY MEANS ELECTRONIC, MECHANICAL, OR OTHERWISE WITHOUT WASTECORP CONSENT.

TITLE
TFCC-6
PIGGY BACK BELT DRIVE

DATE	FEB/22/2013
SCALE	1:1
PR ENG	MD
PP	MD
CHKD	MD
INJ	MD

WASTECORP.
Pumps

DRAWING NUMBER
63448
SHEET 1 OF 1

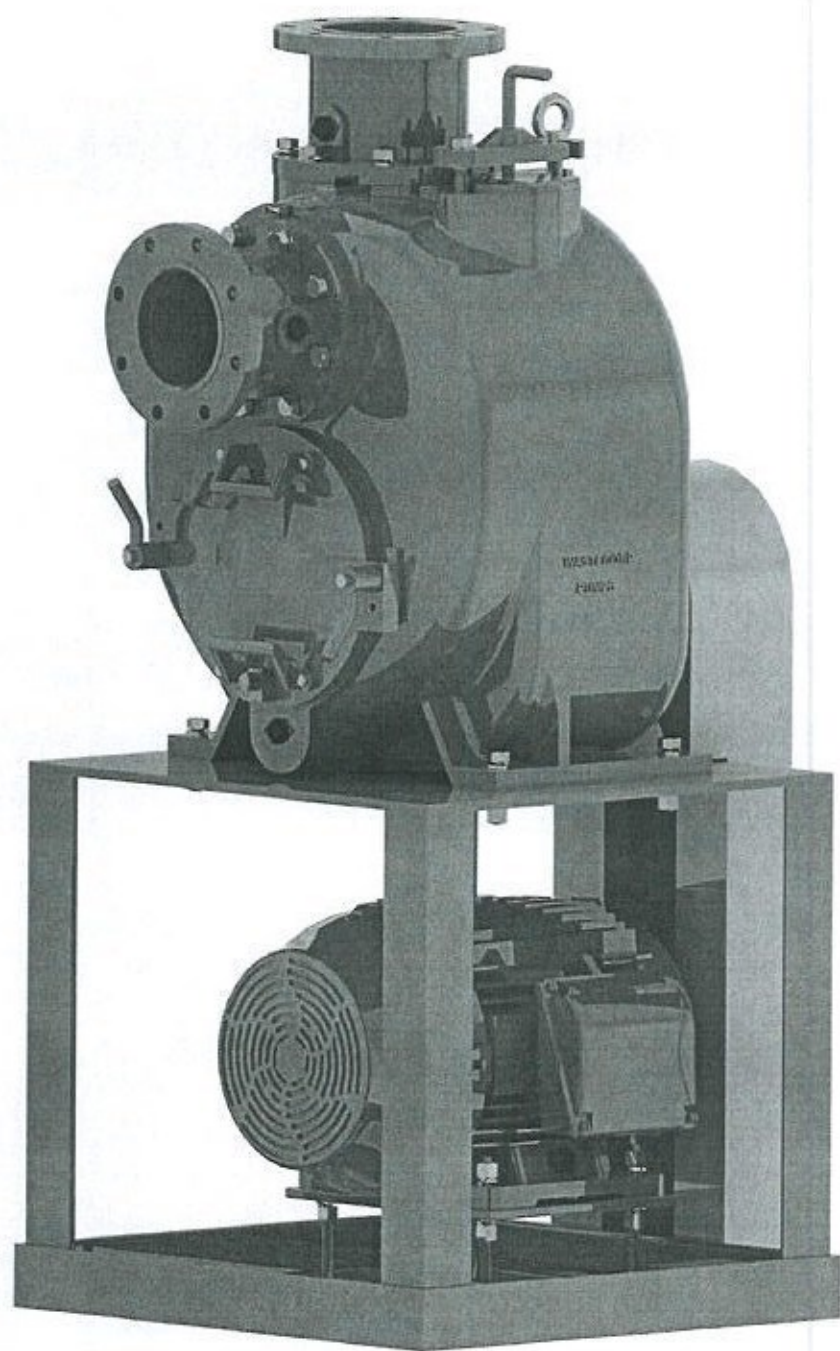

contagious COVID-19 10 days after your symptoms began if your symptoms have significantly improved and you have not had a fever for at least 24 hours (without using fever reducing medications like acetaminophen or ibuprofen).

MONITOR YOUR SYMPTOMS: If you develop any new symptoms (such as fever, cough, body aches, loss of smell or taste), existing symptoms worsen or you have new known exposures to COVID-19, please return or seek other medical care.

Please continue to follow all personal safety practices including (a) wearing a nose and mouth covering at all times when around people outside of your household, (b) social distancing, (c) hand hygiene, and (d) avoidance of contact with people with known or possible COVID-19.

This email contains protected health information. If you received this information in error, please delete the email, do not print, or share this information with anyone.

Summary of Today's Visit for - Soja, Daniel DOB: 02/15/1975 Account No: 1156317

West 88th 2398 Broadway New York, NY 516-342-7075



Secured by Paubox - HITRUST CSF Certified