



**CENTRALBIDDING**  
FROM CENTRAL AUCTION HOUSE

**5000131017 PURCHASE OF SELF-PRIMING CENTRIFUGAL PUMPS FOR  
THE PUBLIC WORKS DEPARTMENT OF SEWERAGE**  
Jefferson Parish Government

Project documents obtained from [www.CentralBidding.com](http://www.CentralBidding.com)  
28-May-2020 03:36:38 AM



**BID 50-131017**  
**PURCHASE OF SELF-PRIMING CENTRIFUGAL PUMPS FOR**  
**THE PUBLIC WORKS DEPARTMENT OF SEWERAGE**

**JUNE 3, 2020 @ 11:00 A.M.**

**ATTENTION VENDORS!!!**

**Please review all pages and respond accordingly, complying with all provisions in the technical specifications and Jefferson Parish Instructions for Bidders and General Terms and Conditions. All bids must be received in the Purchasing Department by the bid due date and time.**

**Jefferson Parish Purchasing Department**  
**200 Derbigny Street, Suite 4400**  
**Gretna, LA 70053**  
**Please Email Any Questions To:**  
**Mark BATTERY**  
**MBATTERY@JEFFPARISH.NET**  
**504-364-2810**

INVITATION TO BID  
THIS IS NOT AN ORDER

Page: 1

DATE: 5/22/2020

BID NO.: 50-00131017

**JEFFERSON PARISH**  
PURCHASING DEPARTMENT  
P.O. BOX 9  
GRETNA, LA. 70054-0009  
504-364-2678

VENDOR: Technology International, Inc.

BUYER: MBUTTERY@jeffparish.net

**Bids will be received until 11:00 AM, 6/03/2020 via online at [www.jeffparishbids.net](http://www.jeffparishbids.net) or by hand delivery, USPS mail or other courier service to Purchasing Department, 200 Derbigny Street (General Government Building), Suite 4400, Gretna, LA 70053. For convenience, bidders may also submit bids in the East Bank Purchasing Department, Suite 404, Jefferson Parish Joseph S. Yenni Building, 1221 Elmwood Park Blvd., Jefferson LA 70123. However, if submitting bids on the day of bid opening, bidders must submit at the West Bank location only.**

All bids submitted are subject to these instructions and general conditions and any special conditions and specifications contained herein, all of which are made part of this bid proposal reference. By submitting a bid, vendor agrees to comply with all provisions of Louisiana Law, as well be in compliance with the Jefferson Parish Code of Ordinances, Louisiana Code of Ethics, applicable Jefferson Parish ethical standards and Jefferson Parish Resolution No. 113646 and/or Resolution No. 113647. A copy of these resolutions may be obtained from the Office of the Parish Clerk, Suite 6700, Jefferson Parish General Government Building, 200 Derbigny Street, Gretna, LA 70053. You may also obtain a copy by visiting the Purchasing Department webpage at [purchasing.jeffparish.net](http://purchasing.jeffparish.net) and clicking on On-line forms.

All vendors submitting bids should register as a Jefferson Parish vendor if not already yet registered. Registration forms may be downloaded from <http://purchasing.jeffparish.net> and by clicking on Vendor Information. Current W-9 forms with respective Tax Identification numbers and vendor applications may be submitted at any time; however, if your company is not registered and/or a current W-9 form is not on file, vendor registration is mandatory. Vendors may experience a delay in payment if your company is not a registered vendor with Jefferson Parish.

As per LSA-RS 47:301 et seq., all governmental bodies are excluded from payment of sales taxes to any Louisiana taxing body. Quotations shall be based on F.O.B. Delivered, anywhere within the Parish as designated by the Purchasing Department. JEFFERSON PARISH WILL ACCEPT ONE BID ONLY FROM EACH VENDOR. Items bid must meet specifications. JEFFERSON PARISH will accept one price for each item unless otherwise indicated. Two or more prices for one item will result in bid rejection. Bidders are required to complete, sign and return the bid form and/or complete and return the associated line item pricing forms as indicated. The price quoted for work shall be stated in figures. In the event there is a difference in unit prices and totals, the unit prices shall prevail.

JEFFERSON PARISH reserves the right to award contracts or place orders on a lump sum or individual item basis, or such combination, as shall in its judgment be in the best interest of JEFFERSON PARISH. Every contract or order shall be awarded to the LOWEST RESPONSIVE and RESPONSIBLE BIDDER, taking into consideration the CONFORMITY WITH THE SPECIFICATIONS and the DELIVERY AND/OR COMPLETION DATE

PROTESTS: Only those vendors that submit bids in response to this solicitation may protest any element of the procurement, in writing to the Director of the Purchasing Department. Written protest must be received within 48 hours of the release of the bid tabulation by the Purchasing Department. After consultation, the Parish Attorney's Office will then respond to protests in writing. (For more information, please see Chapter 2, Article VII, Division 2, Sec. 2-914.1 of the Jefferson Parish Code of Ordinances.)

JEFFERSON PARISH reserves the right to cancel all or any part of an order if not shipped promptly. No charges will be allowed for parking or cartage unless specified in the quotation. The order must not be filed at a higher price than quoted. JEFFERSON PARISH reserves the right to cancel at any time and for any reason by issuing a THIRTY (30) day written notice to the contractor.

JEFFERSON PARISH requires all products to be new (current) and all work must be performed according to standard practices for the project. Unless otherwise specified, no aftermarket parts will be accepted. Unless otherwise specified, all workmanship and materials must have at least one (1) year guaranty, in writing, from the date of delivery and/or acceptance of the project. Any deviations or alteration from the specifications must be indicated on the bid form for each item and upon request, product data for same must be submitted by the time specified by the Purchasing Department.

If this bid requires a pre-bid conference (see Additional Requirements section), bidders are advised that such conference will be held to allow bidders the opportunity to identify any discrepancies in the bid specifications and seek further clarification regarding instructions. The Purchasing Department will issue a written response to bidders' questions in the form of an Addendum.

All formal Addenda require written acknowledgment on the bid form by the bidder. Failure to acknowledge an Addendum on the bid form shall cause the bid to be rejected; JEFFERSON PARISH reserves the right to award bid to next lowest responsive and responsible bidder in this event.

USE OF BRAND NAMES AND STOCK NUMBERS: Where brand names and stock numbers are specified, it is for the purpose of establishing certain minimum standards of quality. Bids may be submitted for products of equal quality, provided brand names and stock numbers are specified. Complete product data may be required prior to award.

Quantities listed are for bidding purposes only. Actual requirements may be more or less than quantities listed.

Bidders are not to exclude from participation in, deny the benefits of, or subject to discrimination under any program or activity, any person in the United States on the grounds of race, color, national origin, or sex; nor discriminate on the basis of age under the Age Discrimination Act of 1975, or with respect to an otherwise qualified handicapped individual as provided in Section 504 of the Rehabilitation Act of 1973, or on the basis of religion, except that any exemption from such prohibition against discrimination on the basis of religion as provided in the Civil Rights Act of 1964, or Title VI and VII of the Act of April 11, 1968, shall also apply. This assurance includes compliance with the administrative requirements of the Revenue Sharing final handicapped discrimination provisions contained in Section 51.55 (c), (d), (e), and (k)(5) of the Regulations. New construction or renovation projects must comply with Section 504 of the 1973 Rehabilitation Act, as amended, in accordance with the American National Standard Institute's specifications (ANSI A117.1-1961).

Jefferson Parish and its partners as the recipients of federal funds are fully committed to awarding a contract(s) to firm(s) that will provide high quality services and that are dedicated to diversity and to containing costs. Thus, Jefferson Parish strongly encourages the involvement of minority and/or woman-owned business enterprises (DBE's, including MBE's, WBE's and SBE's) to stimulate participation in procurement and assistance programs.

**INSTRUCTIONS FOR BIDDERS AND GENERAL CONDITIONS**

**IN ACCORDANCE WITH STATE REGULATIONS JEFFERSON PARISH OFFERS ELECTRONIC PROCUREMENT TO ALL VENDORS**

This electronic procurement system allows vendors the convenience of reviewing and submitting bids online. This is a secure site and authorized personnel have limited read access only. Bidders are encouraged to submit electronically using this free service; while the website accepts various file types, one single PDF file containing all appropriate and required bid documents is preferred. Bidders submitting uploaded images of bid responses are solely responsible for clarity. If uploaded images/documents are not legible, then bidder's submission will be rejected. Please note all requirements contained in this bid package for electronic bid submission.

Please visit our E-Procurement Page at [www.jeffparishbids.net](http://www.jeffparishbids.net) to register and view Jefferson Parish solicitations. For more information, please visit the Purchasing Department page at <http://purchasing.jeffparish.net>.

**ADDITIONAL REQUIREMENTS FOR THIS BID**

PLEASE MATCH THE NUMBERS PRINTED IN THIS BOX WITH THE CORRESPONDING INSTRUCTIONS BELOW.

13

1. All bidders must attend the MANDATORY pre-bid conference and will be required to sign in and out as evidence of attendance. In accordance with LSA R.S. 38:2212(I), all prospective bidders shall be present at the beginning of the MANDATORY pre-bid conference and shall remain in attendance for the duration of the conference. Any prospective bidder who fails to attend the conference or remain for the duration shall be prohibited from submitting a bid for the project.
2. Attendance to this pre-bid conference is optional. However, failure to attend the pre-bid conference shall not relieve the bidder of responsibility for information discussed at the conference. Furthermore, failure to attend the pre-bid conference and inspection does not relieve the successful bidder from the necessity of furnishing materials or performing any work that may be required to complete the work in accordance with the specification with no additional cost to the owner.
3. Contractor must hold current applicable JEFFERSON PARISH licenses with the Department of Inspection and Code Enforcement. Contractor shall obtain any and all permits required by the JEFFERSON PARISH Department of Inspection and Code Enforcement. The contractor shall be responsible for the payment of these permits. All permits must be obtained prior to the start of the project. Contractor must also hold any and all applicable Federal and State licenses. Contractor shall be responsible for the payment of these permits and shall obtain them prior to the start of the project.
4. A LA State Contractor's License will be required in accordance with LSA R.S. 37-2150 et. seq. and such license number will be shown on the outside of the bid envelope. Failure to comply will cause the bid to be rejected. Additionally if submitting the bid electronically, then the license number must be entered in the appropriate field in the Electronic Procurement system. Failure to comply will cause the bid to be rejected.
5. It is the bidder's responsibility to visit the job site and evaluate the job before submitting a bid.
6. Job site must be clean and free of all litter and debris daily and upon completion of the contract. Passageways must be kept clean and free of material, equipment, and debris at all times. Flammable material must be removed from the job site daily because storage will not be permitted on the premises. Precautions must be exercised at all times to safeguard the welfare of JEFFERSON PARISH and the general public.

**INSTRUCTIONS FOR BIDDERS AND GENERAL CONDITIONS**

7. PUBLIC WORKS BIDS: All awards for public works in excess of \$5,000.00 will be reduced to a formal contract which shall be recorded at the contractor's expense with the Clerk of Court and Ex-Officio Recorder of Mortgages for the Parish of Jefferson. A price list of recordation costs may be obtained from the Clerk of Court and Ex-Officio Recorder of Mortgages for the Parish of Jefferson. All awards in excess of \$25,000.00 will require both a performance and a payment bond. Unless otherwise stated in the bid specifications, the performance bond requirements shall be 100% of the contract price. Unless otherwise state in the bid specifications, the payment bond requirements shall be 100% of the contract price. Both bonds shall be supplied at the signing of the contract.
8. NON-PUBLIC WORKS BIDS: A performance bond will be required for this bid. The amount of the bond will be 100% of the contract price unless otherwise indicated in the specifications. The performance bond shall be supplied at the signing of the contract.
9. NON-PUBLIC WORKS BIDS: A payment bond will be required for this bid. The amount of the bond will be 100% of the contract price unless otherwise indicated in the specifications. The payment bond shall be supplied at the signing of the contract.
10. All bidders must comply with the requirements stated in the attached "Standard Insurance Requirements" sheet attached to this bid solicitation. Failure to comply with this instruction will result in bid rejection.
11. A bid bond will be required with bid submission in the amount of 5% of the total bid, unless otherwise stated in the bid specifications. Acceptable forms shall be limited to cashier's check, certified check, or surety bid bond. All sureties must be in original format (no copies). If submitting a bid online, vendors must submit an electronic bid bond through the respective online clearinghouse bond management system(s) as indicated in the electronic bid solicitation on Central Auction House. No scanned paper copies of any bid bond will be accepted as part of the electronic bid submission.
12. This is a requirements contract to be provided on an as needed basis. JEFFERSON PARISH makes no representations on warranties with regard to minimum guaranteed quantities unless otherwise stated in the bid specifications.
13. Freight charges should be included in total cost when quoting. If not quoted FOB DELIVERED, freight must be quoted as a separate item. Bid may be rejected if not quoted FOB DELIVERED or if freight charges are not indicated on bid form.
14. PUBLIC WORKS BIDS - Completed, Signed and Properly Notarized Affidavits Required; This applies to all solicitations for construction, alteration or demolition of public buildings or projects, in conformity with the provisions contained in LSA-RS 38:2212.9, LSA-RS 38:2212.10, LSA-RS 38:2224, and Sec 2-923.1 of the Jefferson Parish Code of Ordinances. For bidding purposes, all bidders must submit with bid submission COMPLETED, SIGNED and PROPERLY NOTARIZED Affidavits, including: Non-Conviction Affidavit, Non-Collusion Affidavit, Campaign Contribution Affidavit, Debt Disclosures Affidavit and E-Verify Affidavit. For the convenience of vendors, all affidavits have been combined into one form entitled PUBLIC WORKS BID AFFIDAVIT. This affidavit must be submitted in its original format, and without material alteration, in order to be compliant and for the bid to be considered responsive. A scanned copy of the completed, signed and properly notarized affidavit may be submitted with the bid, however, the successful bidder must submit the original affidavit in its original format and without material alteration upon contract execution. Failure to comply will result in the bid submission being rejected as non-responsive. The Parish reserves the right to award bid to the next lowest responsive and responsible bidder in this event.
15. NON PUBLIC WORK BIDS - Completed, Signed and Properly Notarized Affidavits Required in conformity with the provisions contained in LSA – RS 38:2224 and Sec 2-923.1 of the Jefferson Parish Code of Ordinances. For bidding purposes, all bidders must submit with bid submission COMPLETED, SIGNED and PROPERLY NOTARIZED Affidavits, including: Non-Collusion Affidavit, Debt Disclosures Affidavit and Campaign Contribution Affidavit. For the convenience of vendors, all affidavits have been combined into one form entitled NON PUBLIC WORKS BID AFFIDAVIT. This affidavit must be submitted in its original format, and without material alteration, in order to be compliant and for the bid to be considered responsive. A scanned copy of the completed, signed and properly notarized affidavit may be submitted with the bid, however, the successful bidder must submit the original affidavit in its original format and without material alteration upon contract execution. Failure to comply will result in the bid submission being rejected as non-responsive. The Parish reserves the right to award bid to the next lowest responsive and responsible bidder in this event.
16. The ensuing contract for this bid solicitation may be eligible for FEMA reimbursement and/or Federal funding/reimbursement. As such, the referenced appendix will be applicable accordingly and shall be considered a part of the bid documents. All applicable certifications must be duly completed, signed and submitted with bid submission. Failure to submit applicable certifications with bid submission will result in bid rejection.

**It shall be the duty of every parish officer, employee, department, agency, special district, board, and commission: and the duty of every contractor, subcontractor, and licensee of the parish, and the duty of every applicant for certification of eligibility for a parish contract or program, to cooperate with the Inspector General in any investigation, audit, inspection, performance review, or hearing pursuant to JPCO 2-155.10(19). By signing this document, every corporation, partnership, or person contracting with PARISH, whether by cooperative endeavor, intergovernmental agreement, bid, proposal, application or solicitation for a parish contract, and every application for certification of eligibility for a parish contract or program, attests that it understands and will abide by all provisions of JPCO 2-155.10.**

DATE: 5/22/2020

INVITATION TO BID  
THIS IS NOT AN ORDER

Page: 4

BID NO.: 50-00131017

**JEFFERSON PARISH**  
PURCHASING DEPARTMENT  
P.O. BOX 9  
GRETNA, LA. 70054-0009  
504-364-2678

VENDOR: Technology International, Inc.

BUYER: MBUTTERY

As per LSA-RS 47:301 et seq., all governmental bodies are excluded from payment of sales taxes to any Louisiana taxing body. Quotations shall be based on F.O.B. Agency warehouse or jobsite, anywhere within the Parish as designated by the Purchasing Department.

JEFFERSON PARISH reserves the right to cancel all or any part of an order if not shipped promptly. No charges will be allowed for parking or cartage unless specified in quotation. The order must not be filled at a higher price than quoted. JEFFERSON PARISH reserves the right to cancel at any time and for any reason by issuing a THIRTY (30) day written notice to the contractor.

JEFFERSON PARISH is expecting all products to be new and all work to be done in workman-like manner, according to standard practices. Any deviations or alteration from the specifications must be indicated on the bid form for each item and upon request, product data for same must be submitted by the time specified by the Purchasing Department.

<b>DELIVERY: FOB JEFFERSON PARISH</b>	
INDICATE DELIVERY DATE ON EQUIPMENT AND SUPPLIES	<u>See Attached</u>
INDICATE STARTING TIME (IN DAYS) FOR CONSTRUCTION WORK	_____
INDICATE COMPLETION TIME (IN DAYS) FOR CONSTRUCTION WORK	_____

In the event that addenda are issued with this bid, bidders MUST acknowledge all addenda on the bid form. Bidder must acknowledge receipt of an addendum on the bid form as indicated. Failure to acknowledge any addendum on the bid form will result in bid rejection.

Acknowledge Receipt of Addenda: NUMBER: None

NUMBER: \_\_\_\_\_

NUMBER: \_\_\_\_\_

NUMBER: \_\_\_\_\_

LOUISIANA CONTRACTOR'S LICENSE NO.: (if applicable) \_\_\_\_\_

<b>*** ALL BIDDERS MUST COMPLETE SECTION BELOW ***</b>	
FIRM NAME: <u>Technology International, Inc.</u>	
SIGNATURE: (Must be signed here) <u>Rifat Habib</u>	TITLE: <u>Business Development Exec.</u>
PRINT OR TYPE NAME: <u>Rifat Habib</u>	
ADDRESS: <u>1349 South International Pkwy, Suite 2411,</u>	
CITY, STATE: <u>Lake Mary, Florida</u>	ZIP: <u>32746</u>
TELEPHONE: <u>( 407 ) 359-2373</u>	FAX: <u>( 407 ) 359-2372</u>
EMAIL ADDRESS: <u>tii@tii-usa.com</u>	

TOTAL PRICE OF ALL BID ITEMS: \$ 25,496.00

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00131017

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
1	2.00	ONLY	<p><b>PURCHASE OF SELF-PRIMING CENTRIFUGAL PUMPS FOR THE PUBLIC WORKS DEPARTMENT OF SEWERAGE</b></p> <p>0010 - Gorman Rupp Super T-Series self-priming centrifugal pumps, Model T6A71S-B/F, GR Hard Iron ADI fitted pump, mounted on sturdy fab steel base in the vertical v-belt arrangement with v-belt drive w/guard and driven by a 25-HP TEFC, NEMA Premium Efficiency motor for Lift Station Q-11-10 (Carol Sue and Rue Marcel)</p> <p>Note: Pump to be mounted on base w/belt drive and motor</p> <p>Pricing includes all freight charges to Jefferson Parish</p> <p>Please see attached specifications</p> <p>Deliver to: West Bank Sewerage Shop Building 1450 River Park Road Bridge City, LA 70094 Attn: Shane Dickerson</p> <p>***Please see our Equipment Proposal TII/LA/0620/14221 attached.</p>	\$12,748.00	\$25,496.00

**SPECIFICATIONS  
HORIZONTAL SELF-PRIMING CENTRIFUGAL PUMP  
JEFFERSON PARISH DEPT. OF SEWERAGE  
CAROL SUE & RUE MARCEL (Q-11-10)**

**PART 1 – GENERAL**

**1.0 DESCRIPTION**

The vendor shall provide two (2) Gorman Rupp SUPER T-Series Model T6A71S-B/F, self-priming centrifugal pumps and all appurtenances, or approved equal, as specified for the Carol Sue and Rue Marcel sewer lift station. The pumps shall be quoted by the factory authorized Gorman Rupp agent for Jefferson Parish, Louisiana, or for the brand being submitted for bid. The pumps shall match up to and utilize the existing system, with no modifications to the existing station or system. Any bids submitted for pump manufacturers, other than that as specified, must include in their bid all information needed to fully demonstrate complete compliance with requirements of these specifications and dimensional duplicity of the existing pumps. Jefferson Parish reserves the right to reject any bids that are incomplete, or do not demonstrate that they are equal to the requirements of these specifications. It is the bidder's responsibility to provide adequate information necessary for the complete evaluation of their proposed equipment. Jefferson Parish shall be the sole judge as to the equality of any alternate manufacturer's offering.

**1.01 PERFORMANCE CRITERIA**

- A. The pump manufacturer must be ISO 9001:2008 revision certified, with scope of registration including design control and service after sales activities.
- B. The pump manufacturer must be registered to the ISO 14001 Environmental Management System standard.
- C. Pumps must be designed to handle raw, unscreened, domestic sanitary sewage. Pumps shall have 6 inch suction connection, and 6 inch discharge connection. Each pump shall perform under following operating conditions:
  - 1. Capacity (GPM) 900
  - 2. Total Dynamic Head (FT) 50
- D. Pump Performance Certifications
  - 1. Solids Handling Capability
    - a. All internal passages, impeller vanes, and recirculation ports shall pass a 3 inch spherical solid. Smaller internal passages that create a maintenance nuisance or interfere with priming and pump performance will not be accepted. Upon request, manufacturer's certified drawings showing size and location of the recirculation port(s) shall be submitted for approval.

#### E. Reprime Performance

1. Consideration shall be given to the sanitary sewage service anticipated, in which debris is expected to lodge between the suction check valve and its seat, resulting in the loss of the pump suction leg, and siphoning of liquid from the pump casing to the approximate center line of the impeller. Such occurrence shall be considered normal, and the pump must be capable of automatic, unattended operation with an air release line installed.
2. During unattended operation, the pump shall retain adequate liquid in the casing to insure automatic repriming while operating at its rated speed in a completely open system. The need for a suction check valve or external priming device shall not be required.
3. Pump must reprime 16 vertical feet at the specified speed and impeller diameter. Reprime lift is defined as the static height of the pump suction above the liquid, while operating with only one-half of the liquid remaining in the pump casing. The pump must reprime and deliver full capacity within five minutes after the pump is energized in the reprime condition. Reprime performance must be confirmed with the following test set-up:
  - a. A check valve to be installed down stream from the pump discharge flange. The check valve size shall be equal (or greater than) the pump discharge diameter.
  - b. A length of air release pipe shall be installed between pump and the discharge check valve. This line shall be open to atmosphere at all times duplicating the air displacement rate anticipated at a typical pump station fitted with an air release valve.
  - c. The pump suction check valve shall be removed. No restrictions in the pump or suction piping will prevent the siphon drop of the suction leg. Suction pipe configuration for reprime test shall incorporate a 2 feet minimum horizontal run, a 90 degree elbow and vertical run at the specified lift. Pipe size shall be equal to the pump suction diameter.
  - d. Impeller clearances shall be set as recommended in the pump service manual.
  - e. Repeatability of performance shall be demonstrated by testing five consecutive reprime cycles. Full pump capacity (flow) shall be achieved within five minutes during each cycle.
  - f. Liquid to be used for reprime test shall be water.
  - g. Upon request from the Owner, certified reprime performance test results, prepared by the manufacturer, and certified by a registered professional engineer, shall be submitted for approval prior to shipment.

#### F. Manufacturer's Warranty

1. The pump manufacturer shall warrant the pump equipment to be of quality construction, free of defects in material and workmanship. A written warranty shall include specific details described below.
2. All equipment, apparatus, and parts furnished shall be warranted for sixty (60) months, excepting only those items that are normally consumed in service, such as oils, grease, packing, gaskets, O-rings, etc. The pump manufacturer shall be solely responsible for warranty of the pump equipment and all components.
3. Components failing to perform as specified by the engineer, or as represented by the manufacturer, or as proven defective in service during the warranty period, shall be replaced, repaired, or satisfactorily modified by the manufacturer.
4. It is not intended that the pump manufacturer assume liability for consequential damages or contingent liabilities arising from failure of any vendor supplied product or part which fails to properly operate, however caused. Consequential damages resulting from defects in design, or delays in delivery are also beyond the manufacturer's scope of liability.
5. This limited warranty shall be valid only when installation is made, and use/maintenance is performed in accordance with manufacturer recommendations. The warranty shall become effective on the date of acceptance by the purchaser or the purchaser's authorized agent, or sixty (60) days after installation, or ninety (90) days after shipment from the factory, whichever occurs first.

### **PART 2 - PRODUCT**

#### **2.01 PUMP DESIGN**

- A. Pumps shall be horizontal, self-priming centrifugal type, designed specifically for handling raw, unscreened, domestic sanitary sewage. Pump solids handling capability and performance criteria shall be in accordance with requirements listed under PART 1.
- B. The pump manufacturer must be ISO 9001:2008 revision certified, with scope of registration including design control and service after sales activities. Pumps shall be manufactured in the USA, with all castings from North America. Pump supplier shall be an authorized distributor of the product offered who maintains in house a factory authorized warranty service center. Field Start Up of pumps by a factory trained technician is required and shall be included in proposal.

### C. Materials and Construction Features

1. Pump casing shall be cast iron Class 30 with integral volute scroll. Casing shall incorporate following features:
  - a. Mounting feet sized to prevent tipping or binding when pump is completely disassembled for maintenance.
  - b. Fill port cover plate, 3½ inch diameter, shall be opened after loosening a hand nut/clamp bar assembly. In consideration for safety, hand nut threads must provide slow release of pressure, and the clamp bar shall be retained by detente lugs. A Teflon gasket shall prevent adhesion of the fill port cover to the casing.
  - c. Casing drain plug shall be at least 1¼ inch NPT to insure complete and rapid draining.
  - d. Liquid volume and recirculation port design shall be consistent with performance criteria listed under PART 1.
2. Cover plate shall be cast iron Class 30. Design must incorporate following maintenance features:
  - a. Retained by hand nuts for complete access to pump interior. Cover plate removal must provide ample clearance for removal of stoppages, and allow service to the impeller, seal, wear plate, or check valve without removing suction or discharge piping.
  - b. A replaceable GR Hard Iron wear plate secured to the cover plate by weld studs and nuts.
  - c. In consideration for safety, a pressure relief valve shall be supplied in the cover plate. Relief valve shall open at 75-200 PSI.
  - d. Two O-rings of Buna-N material shall seal cover plate to pump casing.
  - e. Pusher bolt capability to assist in removal of cover plate. Pusher bolt threaded holes shall be sized to accept same retaining cap screws as used in rotating assembly.
  - f. Easy-grip handle shall be mounted to face of cover plate.
3. Rotating assembly, which includes impeller, shaft, mechanical shaft seal, lip seals, bearings, seal plate, and bearing housing, must be removable as a single unit without disturbing the pump casing or piping. Design shall incorporate following features:
  - a. Seal plate shall be of Gorman Rupp Austempered Hard Iron and bearing housing shall be cast iron Class 30. Separate oil filled cavities, vented to

atmosphere, shall be provided for shaft seal and bearings. Cavities must be cooled by the liquid pumped. Three lip seals will prevent leakage of oil.

- 1) The bearing cavity shall have an oil level sight gauge and fill plug check valve. The clear sight gauge shall provide easy monitoring of the bearing cavity oil level and condition of oil without removal of the fill plug check valve. The check valve shall vent the cavity but prevent introduction of moist air to the bearings.
  - 2) The seal cavity shall have an oil level sight gauge and fill/vent plug. The clear sight gauge shall provide easy monitoring of the seal cavity oil level and condition of oil without removal of the fill/vent plug.
  - 3) Double lip seal shall provide an atmospheric path providing positive protection of bearings, with capability for external drainage monitoring.
- b. Impeller shall be Gorman Rupp Hard Iron, two-vane, semi-open, non-clog, with integral pump out vanes on the back shroud. Impeller shall thread onto the pump shaft and be secured with a lock screw and conical washer.
  - c. Shaft shall be AISI 4150 alloy steel unless otherwise specified.
  - d. Bearings shall be anti-friction ball type of proper size and design to withstand all radial and thrust loads expected during normal operation. Bearings shall be oil lubricated from a dedicated reservoir. Pump designs which use the same oil to lubricate the bearings and shaft seal will not be accepted.
  - e. Shaft seal shall be cartridge oil lubricated mechanical type. The stationary and rotating seal faces shall be tungsten titanium carbide alloy. Each mating surface shall be lapped to within three light bands flatness (35 millionths of an inch), as measured by an optical flat under monochromatic light. The stationary seal seat shall be double floating by virtue of a dual O-ring design; an external O-ring secures the stationary seat to the seal plate, and an internal O-ring holds the faces in alignment during periods of mechanical or hydraulic shock (loads which cause shaft deflection, vibration, and axial/radial movement). Elastomers shall be viton; cage and spring to be stainless steel. Seal shall be oil lubricated from a dedicated reservoir. The same oil shall not lubricate both shaft seal and shaft bearings. Seal shall be warranted in accordance with requirements listed under PART 1.
  - f. Pusher bolt capability to assist in removal of rotating assembly. Pusher bolt threaded holes shall be sized to accept same cap screws as used for retaining rotating assembly.
4. Adjustment of the impeller face clearance (distance between impeller and wear plate) shall be accomplished by external means.
    - a. Clearances shall be maintained by a four point external shimless cover plate adjustment system, utilizing a four collar and four adjusting screw design, allowing for incremental adjustment of clearances by hand as required. Each

of the four points shall be lockable to prevent inadvertent clearance increases or decreases due to equipment vibration or accidental operator contact. The four point system also allows for equal clearance gaps at all points between the impeller and wear plate. Requirement of realignment of belts, couplings, etc., will not be accepted. Cover plate shall be capable of being removed without disturbing clearance settings. Clearance adjustment systems that utilize less than four points will not be accepted.

- b. There shall be provisions for additional clearance adjustment in the event that adjustment tolerances have been depleted from the cover plate side of the pump. The removal of stainless steel shims from the rotating assembly side of the pump shall allow for further adjustment as described above.
  - c. Clearance adjustment which requires movement of the shaft only, thereby adversely affecting seal working length or impeller back clearance, will not be accepted.
5. Suction check valve shall be molded Neoprene with integral steel and nylon reinforcement. A blow-out center shall protect pump casing from hydraulic shock or excessive pressure. Removal or installation of the check valve must be accomplished through the cover plate opening, without disturbing the suction piping. Sole function of check valve shall be to save energy by eliminating need to reprime after each pumping cycle. Pumps requiring a suction check valve to assist reprime will not be accepted.
6. Spool flanges shall be one-piece cast iron, class 30 fitted to suction and/or discharge ports. Each spool shall have one 1 1/4 inch NPT and one 1/4 inch NPT tapped hole with pipe plugs for mounting gauges or other equipment.

#### D. Serviceability

- 1. The pump manufacturer shall demonstrate that consideration has been given to reducing maintenance costs.
- 2. No special tools shall be required for replacement of any components within the pump.

### 3.01 FIELD QUALITY CONTROL

#### A. Factory Hydraulic test

At the option of Jefferson Parish, the pumps shall be tested to Hydraulic Institute standards at the factory where manufactured. Certified Hydraulic Institute pump test report, certified by a registered Professional Engineer shall be submitted for approval. Pumps shall not be shipped until test reports are approved by Jefferson Parish.

## B. Operational Test

Prior to acceptance by Owner, the supplier's Factory Trained and Authorized start up technician shall perform field start-up of pumps, with an operational test of all pumps and drives conducted to determine if the installed equipment meets the purpose and intent of the specifications. Tests shall demonstrate that all equipment is electrically, mechanically, structurally, and otherwise acceptable; it is safe and in optimum working condition; and conforms to the specified operating characteristics.

### 4.01 Pump Base

The pumps shall be mounted on sturdy fab steel bases in the vertical v-belt arrangement, complete with v-belt drive system with required sheaves and belts, belt guard, and driven by a 25-HP, 3-phase, NEMA Premium electric motor with cast iron frame.



**Technology International, Inc.**  
 1349 South International Pkwy, Suite 2411  
 Lake Mary, FL 32746  
 Tel: (407) 359-2373  
 Fax: (407) 359-2372  
 E-mail: [tii@tii-usa.com](mailto:tii@tii-usa.com)  
 Website: [www.tii-usa.com](http://www.tii-usa.com)

## Equipment Proposal

**Description:** Purchase of Self-Priming Centrifugal Pumps for the Public Works Department of Sewerage

**Solicitation #:** 5000131017

**Agency:** Jefferson Parish Government

**TII Ref:** TII/LA/0620/14221

**Date:** 06/02/2020

In response to your quote request for Purchase of Self-Priming Centrifugal Pumps for the Public Works Department of Sewerage, Technology International, Inc. is pleased to submit the following for consideration:

ITEM NO.	QTY	DESCRIPTION/ MODEL NO.	UNIT PRICE	EXTD. PRICE
1	1	Phantom Model # XT-6 Pump with CD4 Impeller and Plate for Superior Wear Resistance	\$12,748.00	\$25,496.00
See attached data sheets				
<b>Total.....</b>			<b><u>\$25,496.00</u></b>	

**Warranty:** Manufacturer’s standard warranty applies. One (1) year from startup warranty.

**Delivery:**

- Estimated delivery is **12 Weeks** after receipt of order and approved submittal.
- Please note, due to COVID-19 there may be unanticipated disruptions and delays in the supply chains globally, for parts, components, equipment and internal manufacturing services such as engineering, production allocation, and logistics. This may result in manufacturing & delivery delays out of our control. We will do our best to communicate all such impacts and reduce the effects of any such delays.
- All delivery dates quoted are subject to manufacturer’s confirmation at time of order.
- Submittal data will be provided for approval after receipt of order (if applicable)

- Customer to provide equipment and personnel to unload
- TII will provide MSO at time of payment confirmation. Customer is responsible for all titling and registration of trailer (If Applicable)

**Freight:** Included to Bridge City, LA 70094

**Payment Terms:** NET 30

**Prompt Payment discount:** 1/4 % 10 days

**Quote Validity:** 30 days.

**\*\*\* Notes:**

- Quoted price is an offer for a lump sum contract.

**Technology International, Inc. Corporate data:**

We are a small business and our Tax Payer Identification Number (TIN): 650342335. The price quoted does not include any sales, excise or similar taxes.


We trust that this proposal will meet your requirements and we look forward to hearing from you.

If you have any questions or need more information, please contact us by phone at 407-359-2373, fax at 407-359-2372 or email us at [tii@tii-usa.com](mailto:tii@tii-usa.com)

Respectfully submitted,




Rifat Habib  
Business Development Exec.  
Technology International, Inc.


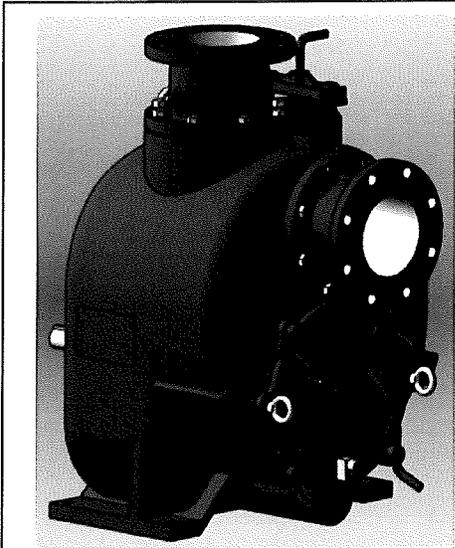


DATA SHEET	
NET WEIGHT	364kg (802lbs)
SHIPPING WEIGHTS	391kg (862lbs)
IMPELLER DIA.	314.32mm (12.3/8")
R.P.M.	FROM 650 rpm TO 1550rpm
MAX. SOLIDS	76.2mm(3")
SELF-PRIMING	
650 RPM	2.4m (8ft) - 750 rpm 2.7m (9ft)
850 RPM	3.6m (12ft) - 950 rpm 4.2m (14ft)
1050 RPM	5.5m (18ft) - 1150 rpm 6.4m (21ft)
1250 RPM	6.4m (21ft) - 1350 rpm 6.7m (22ft)
1450 RPM	7.0m (23ft) - 1550 rpm 7.6m (25ft)
BEFORE USING THIS TABLE,CHECK THE NPSH.	

**PERFORMANCE CURVE 6"X6"**

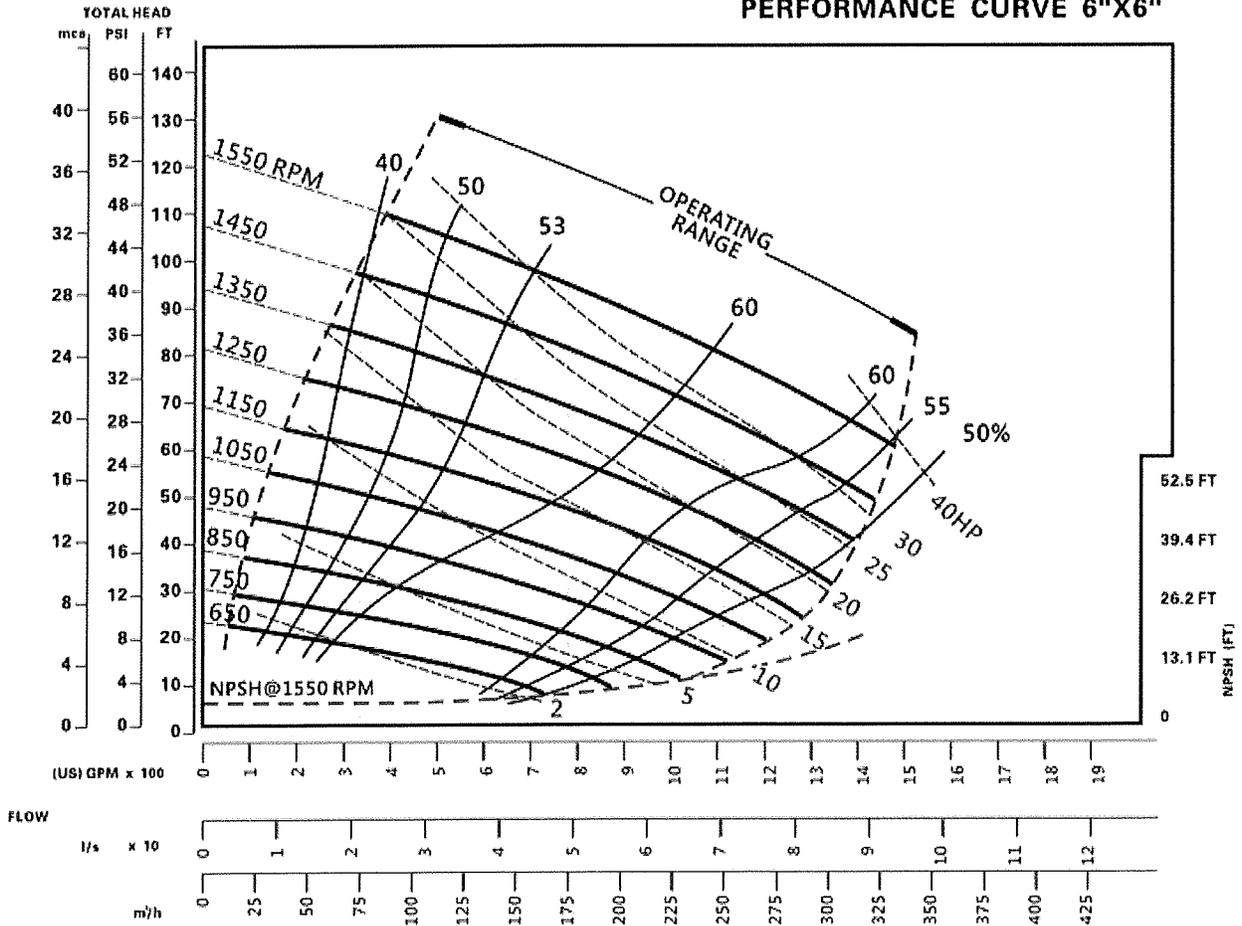

(888) 614.1232 | Fax (863) 533-4907 | 1550 Centennial Blvd | Bartow, FL 33830 | PhantomPumps.com

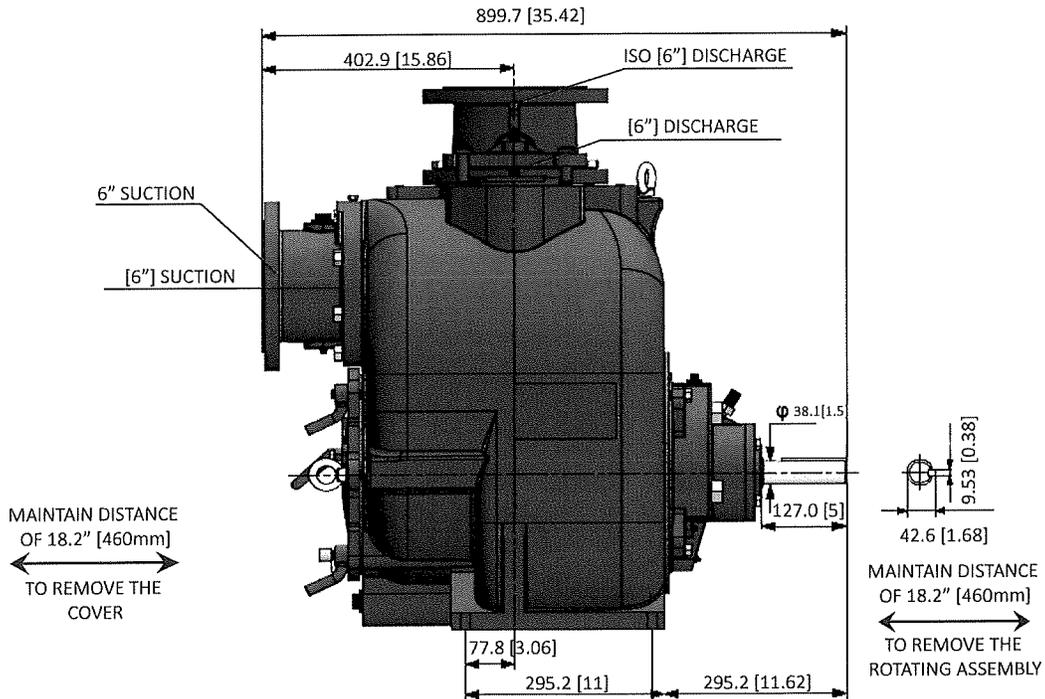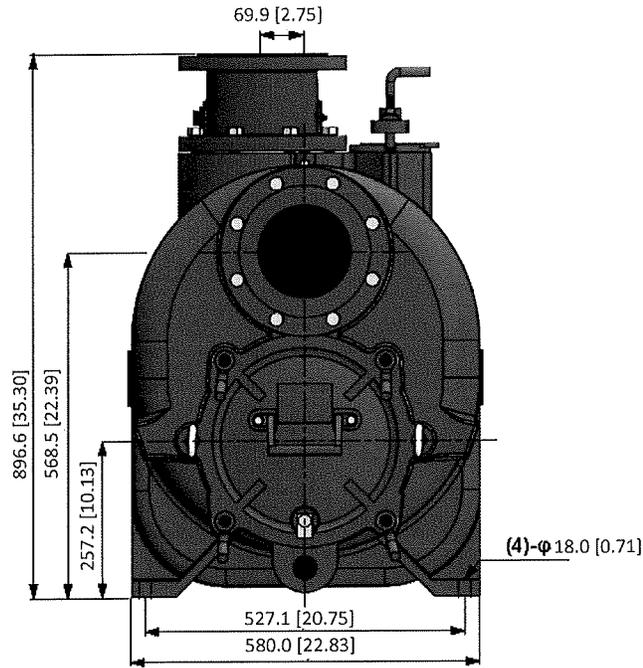

COMPONENT	MATERIALS OF CONSTRUCTION								
	STD	CI/316SS	CI/CD4MCU	CI/ADI	CI/HCI	ADI	316SS	CD4MCU	
Casing			A48CL30			ADI	316SS	CD4MCU	
Impeller	A60-40-18	316SS	CD4MCU	ADI	HCI	ADI	316SS	CD4MCU	
Wear Plate	A48CL30	316SS	CD4MCU	ADI	HCI	ADI	316SS	CD4MCU	
Cover Plate			A48CL30			ADI	316SS	CD4MCU	
Bearing Housing			A48CL30			ADI	316SS	CD4MCU	
Seal Plate	A48CL30	316SS	CD4MCU	ADI	HCI	ADI	316SS	CD4MCU	
Flap Valve		NEOPRENE					VITON		
Impeller Shaft	ANSI140HT	ANSI17-4PH							
Seal Sleeve	ANSI140HT	ANSI17-4PH							
Flanges		A48CL30				ADI	316SS	CD4MCU	
O-rings		BUNA					VITON		
Mechanical Seal		316SS,BUNA,TUNGS/TITANIUM CARBIDE				316SS,VTON,TUNGS/TITANIUM CARBIDE			