



**Bid Number 50 - 132543**

**ONE TIME PURCHASE OF THREE YEOMAN SERIES YP 9100 MODEL 8154  
PUMPS FOR JEFFERSON PARISH SEWERAGE DEPARTMENT.**

**November 3, 2020 AT 2:00 PM**

**ATTENTION VENDORS!!!**

**Please review all pages and respond accordingly, complying with all provisions  
in the technical specifications and Jefferson Parish Instructions for Bidders and  
General Terms and Conditions. All bids must be received in the Purchasing  
Department by the bid due date and time.**

**Jefferson Parish Purchasing Department  
200 Derbigny Street  
General Government Building, Suite 4400  
Gretna, LA 70053  
Donna Reamey  
Dreamey@Jeffparish.net  
504-364-2684**

BID NO.: 50-00132543

**BID FORM**  
Non-Public Works**All Public Work Projects are required to use the Louisiana Uniform Public Work Bid Form**

All prices must be held firm unless an escalation provision is requested in this bid. Jefferson Parish will allow one escalation during the term of the contract, which may not exceed the U.S. Bureau of Labor Statistics National Index for all Urban Consumers, unadjusted 12-month figure. The most recently published figure issued at the time an adjustment is requested will be used. A request must be made in writing by the vendor, and the escalation will only be applied to purchases made after the request is made.

Are you requesting an escalation provision?

YES \_\_\_\_\_ NO XMAXIMUM ESCALATION PERCENTAGE REQUESTED N/A %INITIAL BID PRICES WILL REMAIN FIRM THROUGH THE DATE OF AWARD.

For the purposes of comparison of bids when an escalation provision is requested, Jefferson Parish will apply the maximum escalation percentage quoted by the bidder to the period to which it is applied in the bid. The initial price and the escalation will be used to calculate the total bid price. It will be assumed, for comparison of prices only, that an equal amount of material or labor is purchased each month throughout the entire contract.

**DELIVERY: FOB JEFFERSON PARISH**

INDICATE DELIVERY DATE ON EQUIPMENT AND SUPPLIES

14-16 weeks after approved submittalsLOUISIANA CONTRACTOR'S LICENSE NO.: (if applicable) N/A**THIS SECTION MUST BE COMPLETED BY BIDDER:**FIRM NAME: WASTEWATER SOLUTIONS, LLCADDRESS: 102 NE 2ND ST, SUITE 510CITY, STATE: BOCA RATON, FL ZIP: 33432TELEPHONE: 954 ) 483-9269 FAX: ( ) N/AEMAIL ADDRESS: meredith@wws-llc.com

In the event that addenda are issued with this bid, bidders MUST acknowledge all addenda on the bid form. Bidder must acknowledge receipt of an addendum on the bid form by placing the addendum number as indicated. Failure to acknowledge any addendum on the bid form will result in bid rejection.

Acknowledge Receipt of Addenda: NUMBER: NONE

NUMBER: \_\_\_\_\_

NUMBER: \_\_\_\_\_

NUMBER: \_\_\_\_\_

TOTAL PRICE OF ALL BID ITEMS: \$ 49,593.00AUTHORIZED  
SIGNATURE: ARTURO GARCIA

Printed Name

TITLE: PRESIDENT/OWNER

SIGNING INDICATES YOU HAVE READ AND COMPLY WITH THE INSTRUCTIONS AND CONDITIONS.

**NOTE:** All bids should be returned with the **BID NUMBER** and **BID OPENING DATE** indicated on the outside of the electronic envelope submitted to the Purchasing Department.

## INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00132543

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
1	3.00	EA	<p>ONE TIME PURCHASE OF THREE YEOMAN SERIES YP 9100 MODEL 8154 PUMPS FOR JEFFERSON PARISH SEWERAGE DEPARTMENT.</p> <p>0010 - Yeoman Pumps Series YP 9100, Model 8154, 30 HP, 1160 RPM, S/N 264136, Discharge: 8 inches, Solids Size: 5 inches, Cast Iron Casing and Impeller, 400 Series Stainless Steel Casing and Impeller Wear Rings, Moisture Detection Sensors, Thermal Protection, Class H Insulation, 1.15 Service Factor, Inverter Duty, 100 Foot Power Cable, and 416 Stainless Steel Shaft for Morningside and Carol Sue (Lift Station Q-11-1)</p> <p>SUBMITTING CAPRARI EXPLOSION PROOF SUBMERSIBLE PUMP MODEL KSD200NL+025042X1/4EF AS EQUAL.</p> <p>PLEASE SEE ATTACHED QUOTE AND SUBMITTALS</p>	\$16,531.00	\$49,593.00

\*\*FOB DELIVERY INCLUDED PER SPECIFICATIONS\*\*

## **CORPORATE RESOLUTION**

EXCERPT FROM MINUTES OF MEETING OF THE BOARD OF DIRECTORS OF  
WASTEWATER SOLUTIONS, LLC

---

INCORPORATED.

AT THE MEETING OF DIRECTORS OF WASTEWATER SOLUTIONS, LLC  
INCORPORATED, DULY NOTICED AND HELD ON January 14, 2020,  
A QUORUM BEING THERE PRESENT, ON MOTION DULY MADE AND SECONDED. IT  
WAS:

RESOLVED THAT ARTURO GARCIA, BE AND IS HEREBY  
APPOINTED, CONSTITUTED AND DESIGNATED AS AGENT AND ATTORNEY-IN-  
FACT OF THE CORPORATION WITH FULL POWER AND AUTHORITY TO ACT ON  
BEHALF OF THIS CORPORATION IN ALL NEGOTIATIONS, BIDDING, CONCERNS  
AND TRANSACTIONS WITH THE PARISH OF JEFFERSON OR ANY OF ITS AGENCIES,  
DEPARTMENTS, EMPLOYEES OR AGENTS, INCLUDING BUT NOT LIMITED TO, THE  
EXECUTION OF ALL BIDS, PAPERS, DOCUMENTS, AFFIDAVITS, BONDS, SURETIES,  
CONTRACTS AND ACTS AND TO RECEIVE ALL PURCHASE ORDERS AND NOTICES  
ISSUED PURSUANT TO THE PROVISIONS OF ANY SUCH BID OR CONTRACT, THIS  
CORPORATION HEREBY RATIFYING, APPROVING, CONFIRMING, AND ACCEPTING  
EACH AND EVERY SUCH ACT PERFORMED BY SAID AGENT AND ATTORNEY-IN-  
FACT.

I HEREBY CERTIFY THE FOREGOING TO BE  
A TRUE AND CORRECT COPY OF AN  
EXCERPT OF THE MINUTES OF THE ABOVE  
DATED MEETING OF THE BOARD OF  
DIRECTORS OF SAID CORPORATION, AND  
THE SAME HAS NOT BEEN REVOKED OR  
RESCINDED.

MEREDITH RAE



---

**SECRETARY-TREASURER**

10/29/2020

---

**DATE**



## **Non-Public Works Bid Affidavit Instructions**

- Affidavit is supplied as a courtesy to Affiants, but it is the responsibility of the affiant to insure the affidavit they submit to Jefferson Parish complies, in both form and content, with federal, state and parish laws.
- Affidavit must be signed by an authorized representative of the entity or the affidavit will not be accepted.
- Affidavit must be notarized or the affidavit will not be accepted.
- Notary must sign name, print name, and include bar/notary number, or the affidavit will not be accepted.
- Affiant **MUST** select either A or B when required or the affidavit will not be accepted.
- Affiants who select choice A must include an attachment or the affidavit will not be accepted.
- If both choice A and B are selected, the affidavit will not be accepted.
- Affidavit marked N/A will not be accepted.
- It is the responsibility of the Affiant to submit a new affidavit if any additional campaign contributions are made after the affidavit is executed but prior to the time the council acts on the matter.

*Instruction sheet may be omitted when submitting the affidavit*

**Non-Public Works Bid**

**AFFIDAVIT**

**STATE OF** FLORIDA

**PARISH/COUNTY OF** PALM BEACH

BEFORE ME, the undersigned authority, personally came and appeared: ARTURO GARCIA  
\_\_\_\_\_, (Affiant) who after being by me duly sworn, deposed and said that  
he/she is the fully authorized PRESIDENT/OWNER of WASTEWATER SOLUTIONS, LLC (Entity),  
the party who submitted a bid in response to Bid Number 50-132543, to the Parish of  
Jefferson.

Affiant further said:

Campaign Contribution Disclosures

**(Choose A or B, if option A is indicated please include the required attachment):**

**Choice A** \_\_\_\_\_ Attached hereto is a list of all campaign contributions, including the date and amount of each contribution, made to current or former elected officials of the Parish of Jefferson by Entity, Affiant, and/or officers, directors and owners, including employees, owning 25% or more of the Entity during the two-year period immediately preceding the date of this affidavit or the current term of the elected official, whichever is greater. Further, Entity, Affiant, and/or Entity Owners have not made any contributions to or in support of current or former members of the Jefferson Parish Council or the Jefferson Parish President through or in the name of another person or legal entity, either directly or indirectly.

**Choice B** X there are **NO** campaign contributions made which would require disclosure under Choice A of this section.

Debt Disclosures

**(Choose A or B, if option A is indicated please include the required attachment):**

**Choice A** \_\_\_\_\_ Attached hereto is a list of all debts owed by the affiant to any elected or appointed official of the Parish of Jefferson, and any and all debts owed by any elected or appointed official of the Parish to the Affiant.

**Choice B** X There are **NO** debts which would require disclosure under Choice A of this section.

Affiant further said:

That Affiant has employed no person, corporation, firm, association, or other organization, either directly or indirectly, to secure the public contract under which he received payment, other than persons regularly employed by the Affiant whose services in connection with the construction, alteration or demolition of the public building or project or in securing the public contract were in the regular course of their duties for Affiant; and

*[The remainder of this page is intentionally left blank.]*

That no part of the contract price received by Affiant was paid or will be paid to any person, corporation, firm, association, or other organization for soliciting the contract, other than the payment of their normal compensation to persons regularly employed by the Affiant whose services in connection with the construction, alteration or demolition of the public building or project were in the regular course of their duties for Affiant.

Arturo Garcia

Signature of Affiant

ARTURO GARCIA

Printed Name of Affiant

SWORN AND SUBSCRIBED TO BEFORE ME

ON THE 29 DAY OF October, 2020.

Meredith Rae

Notary Public

Meredith Rae

Printed Name of Notary

Notary/Bar Roll Number



MEREDITH RAE

Commission # GG 268690

Expires November 13, 2022

Bonded Thru Budget Notary Services

My commission expires \_\_\_\_\_.





102 NE 2nd Street  
Suite 510  
Boca Raton FL 33432  
(954) 483 9269 Cell  
arturo@wws-llc.com  
meredith@wws-llc.com  
wws-llc.com

September 8, 2020

**BID: 50-132543**

DUE DATE: November 3, 2020 AT 1:00 PM

Jefferson Parish Purchasing Department  
P.O. Box 9  
Gretna, LA 70054

RE: WASTEWATER SOLUTIONS, LLC OWNERSHIP

To Whom it May Concern:

Please be advised that I, ARTURO GARCIA, am the Owner and President of Wastewater Solutions, LLC, located at 102 N.E. 2nd St., #510, Boca Raton, FL 33432.

As such, I have total and complete authority, in any and all capacities, to enter into any and all contracts that may result from any bids submitted by Wastewater Solutions, LLC to the Jefferson County Parish.

Thank you,

A handwritten signature in blue ink, appearing to read 'Arturo Garcia', is positioned above the printed name.

Arturo Garcia  
President, Wastewater Solutions, LLC



# WASTEWATER SOLUTIONS LLC

**Wastewater Solutions LLC**  
102 NE 2nd Street Suite 510  
Boca Raton, FL 33432 US  
(954) 483-9269  
arturo@wws-llc.com  
wws-llc.com

## Quote

### ADDRESS

Donna Reamey  
Jefferson Parish Purchasing  
Department  
200 Derbigny Street  
General Government Building,  
Suite 4400  
Gretna, LA 70053  
Dreamey@jeffparish.net  
504-364-2684

**QUOTE # 5248**

**DATE 10/28/2020**

**ONE TIME PURCHASE OF THREE YEOMAN  
SERIES YP 9100 MODEL 8154 PUMPS FOR  
JEFFERSON PARISH SEWEAGE  
DEPARTMENT  
BID NUMBER 50-132543**

### DELIVERY:

14 - 16 WEEKS

DESCRIPTION	QTY	RATE	AMOUNT
ITEM NUMBER 1			
CAPRARI EXPLOSION PROOF SUBMERSIBLE PUMP MODEL KSD200NL+025042X1/4EF	3	16,531.00	49,593.00
CONDITIONS: 1750 GPM AT 40 FT OF HEAD 34 HP 3/60/460V 1770 RPM 8" DISCHARGE CAST IRON IMPELLER STAINLESS STEEL SHAFT SILICON CARBIDE / SILICON CARBIDE MECHANICAL SEAL ON MOTOR SIDE SILICON CARBIDE / SILICON CARBIDE MECHANICAL SEAL ON PUMP SIDE KLIXON BIMETALLIC THERMAL PROTECTION ATEX II 2G EXD IIB T4 EXPLOSION PROOF CONDUCTIVITY PROBE INCLUDED 100 FT OF POWER CABLE 316 SS CHAINS / 100 FT			
MPE PUMP MONITOR RELAY MODEL MPR1			
120VAC / 7 VA MAX INPUT POWER 8A RESISTIVE @ 120VAC OUTPUT RATING 6.6 VDC TEMP SENSOR VOLTAGE 4.7 VAC LEAK SENSOR VOLTAGE MOTOR OVER TEMPERATURE ALARM			

DESCRIPTION	QTY	RATE	AMOUNT
-------------	-----	------	--------

SEAL LEAKAGE ALARM  
-20C TO + 65C OPERATING TEMPERATURE  
WHITE LEXAN ENCLOSURE  
PHENOLIC BASE

STARTUP AND TRAINING INCLUDED AS PER SPECIFICATIONS.

SEE ATTACHED SCOPE AND SPECIFICATIONS.

A FORMAL SET OF SUBMITTALS WILL BE PROVIDED AFTER INTENT TO  
AWARD IS RECEIVED.

WARRANTY: 5 YEAR PRORATED WARRANTY.

DELIVERY INCLUDED AS PER SPECIFICATIONS


ONE TIME PURCHASE OF THREE YEOMAN SERIES YP 9100 MODEL 8154 PUMPS FOR JEFFERSON PARISH SEWEAGE DEPARTMENT BID NUMBER 50-132543	TOTAL	<b>\$49,593.00</b>
--	-------	--------------------

WASTEWATER SOLUTIONS LLC  
CAGE CODE: 7TWY1  
DUNS NUMBER: 079918568  
EIN: 47-1877641

Accepted By

Accepted Date


Flow rate	1750 US	Head requ.	40 ft
Model	KSD200NL+025042X1/4EF		

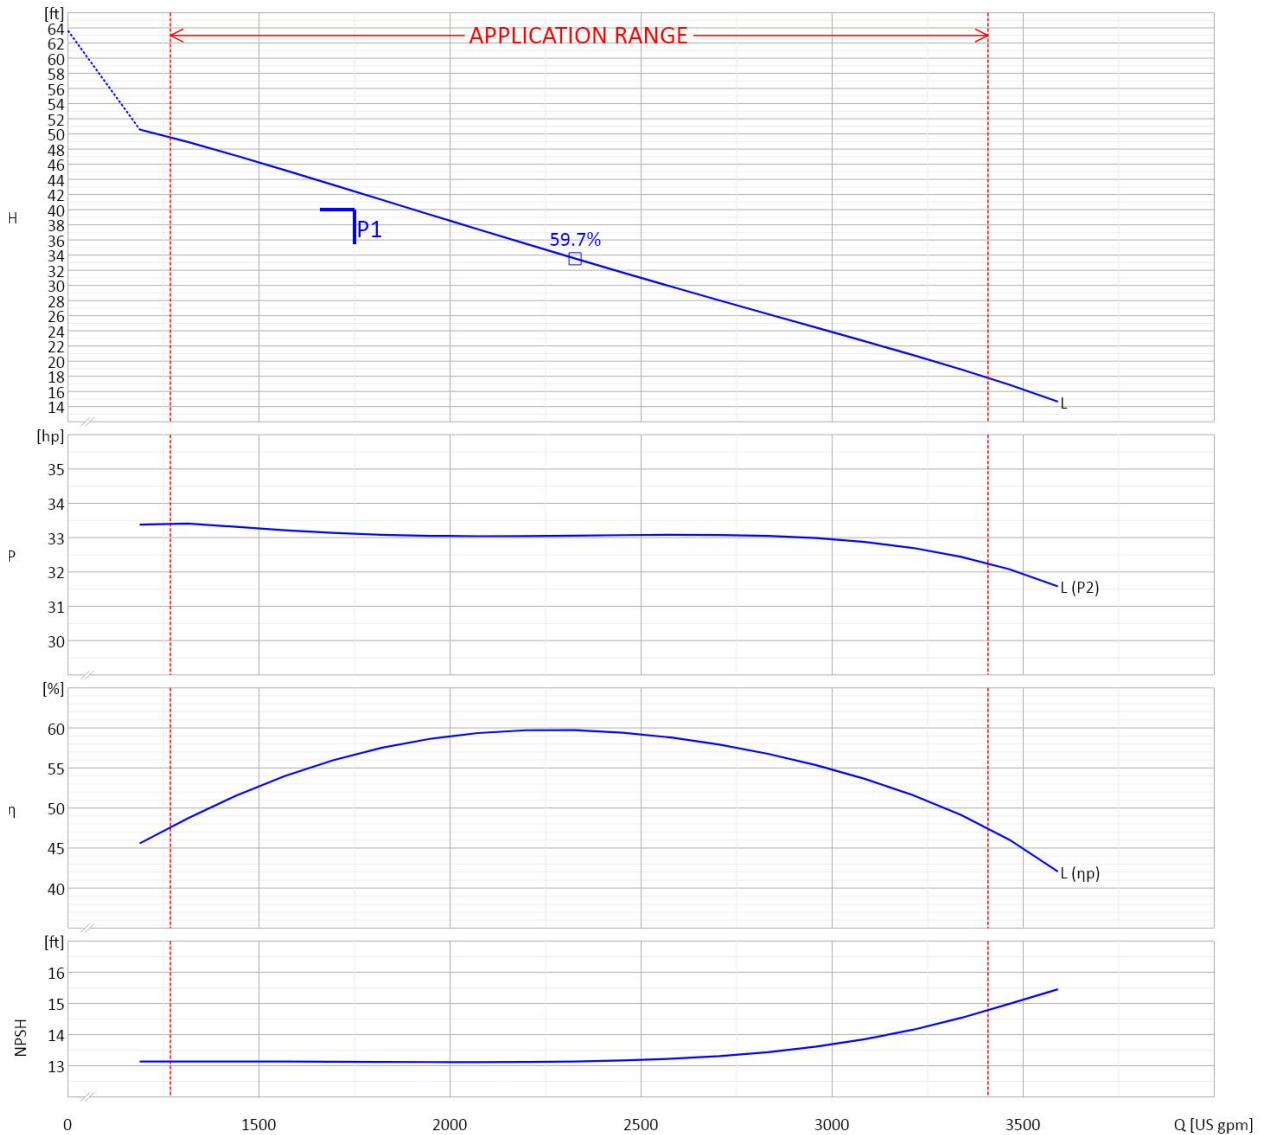

**OPERATING DATA- ISO 9906:2012 3B -**

Q [US gpm]	H [ft]	P [hp]	η [%]	NPSH [ft]	Speed [rpm]

Flow rate	1750 US	Head	40 ft
Model	<b>KSD200NL+025042X1/4EF</b>		

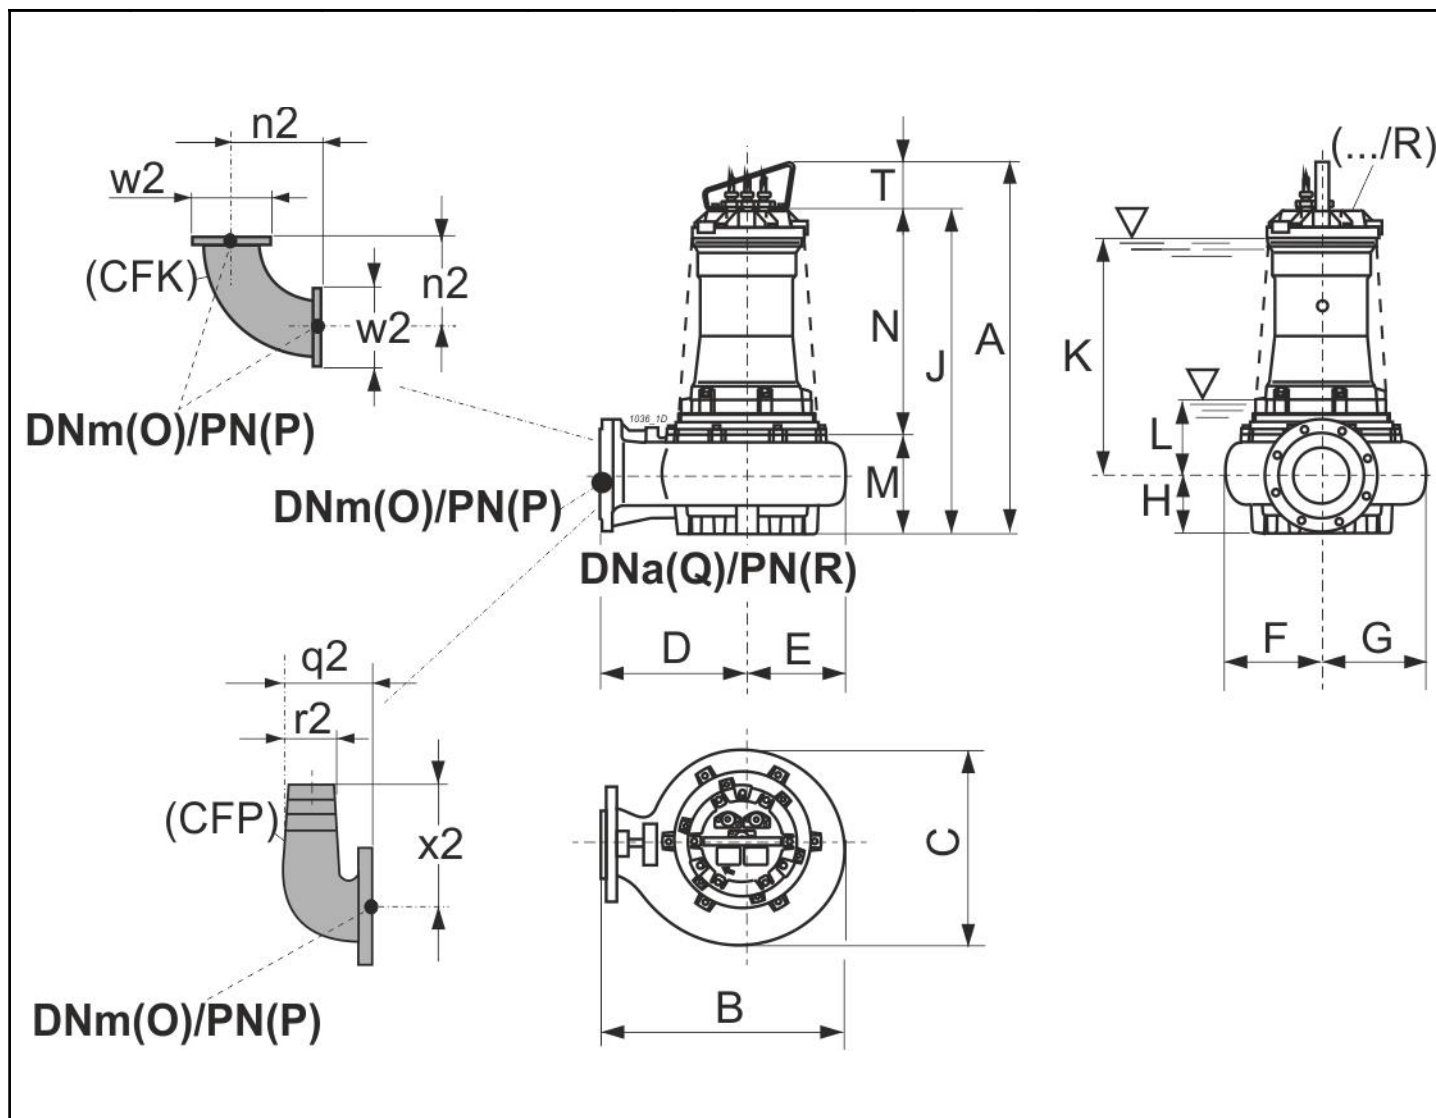



Dimensions [inch]

A	42.9	r2	7.9		
B	33.1	T	6.7		
C	22.8	w2	13.4		
D	21.7	x2	18.9		
E	11.4				
F	9.4				
G	13.4				
H	6.7				
J	36.2				
K	25.6				
L	4.7				
M	11.2				
N	25				
n2	12.2				
O	7.9				
P	0.4				
Q	7.9				
q2	16.5				
R	0.4				





<b>Customer:</b>				<b>Ref.:</b>			
Item	1	Quantity	1	Required flow rate	1750 US	Required head	40 ft
Type	SUBMERSIBLE ELECTRIC PUMP FOR WASTE WATER			Model	KSD200NL+025042X1/4EF		

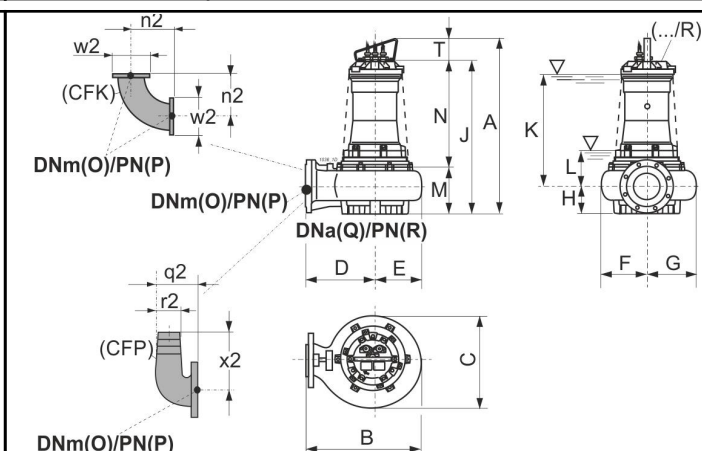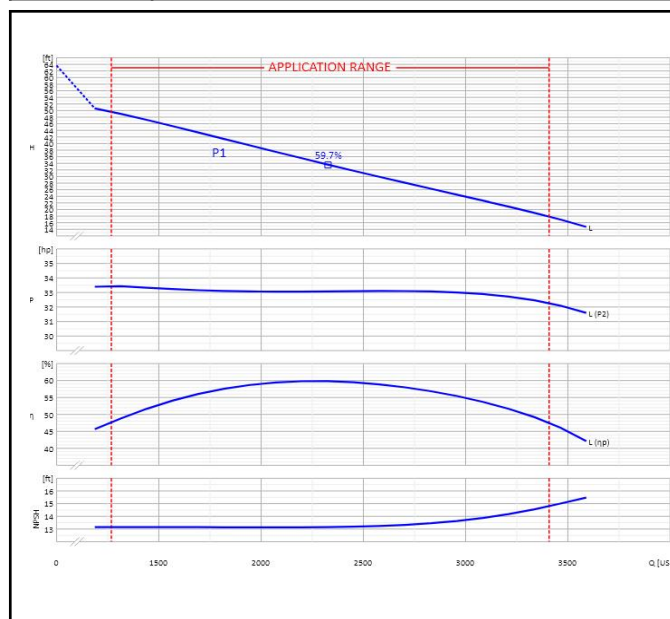


Dimensioni [mm]							
A	42.9	J	36.2	Q	7.9		
B	33.1	K	25.6	q2	16.5		
C	22.8	L	4.7	R	0.4		
D	21.7	M	11.2	r2	7.9		
E	11.4	N	25	T	6.7		
F	9.4	n2	12.2	w2	13.4		
G	13.4	O	7.9	x2	18.9		
H	6.7	P	0.4				

OPERATING DATA- ISO 9906:2012 3B -					CONSTRUCTION CHARACTERISTICS			
Q [US gpm]	H [ft]	P [hp]	$\eta$ [%]	NPSH [ft]	Delivery diameter	7.87	inch	
					Type of Impeller	Double channel		
					Moment of inertia	0.5038 Kgm <sup>2</sup>		
					Electric pump weight	Installation	400	- Kg
					Seal on pump side	Motor side	Mechanical	Mechanical
					Type of installation	-	-	
					Operation	Continuous (S1)		

OPERATING LIMITS				OPERATING CHARACTERISTICS			
Pumped liquid	Waste water			Service flow rate	1788.6	US gpm	
Max. temperature of pumped liquid	104	°F		Service head	41.8	ft	
Maximum density	62.427962	lb/ft <sup>3</sup>		H (Q=0)	63.6	49.5	ft
Maximum viscosity	1.08E-05	ft <sup>2</sup> /s		Qmin	1268	3407.8	US gpm
Max. solid content	4	%		Power consumption at duty point	33.1	hp	
Max. number of starts/hr	10			Max power consumption	33.4	hp	
Free passage	100x110	mm		Pump efficiency	57.05	496.4	%
Minimum immersion depth	25.59	inch		Sense of rotation (*)	Clockwise		
ELECTRIC PUMP MATERIALS				Number of pumps installed	Operating	Stand-by	
					1	0	

Delivery body	Cast iron	ELECTRIC MOTOR CHARACTERISTICS					
Support bearing	Cast iron						
Impeller	Cast iron	Nominal power	34	hp			
Oil box	Cast iron	Rated frequency	60	Hz			
Head cover	Cast iron	Rated voltage	460	V			
Ring impeller seat	Steel/Rubber	Rated current	41.4	A			
Cable clamp	Cast iron	No. Poles	4	1770	rpm		
Motor casing	Cast iron	Type of motor	3 ~				
Shaft	Stainless steel	Efficiency 4/4	87.0 %				
Handle	Stainless steel	Power factor 4/4	0.870				
Conductivity probe	Included	Is/In	8.7	Ts/Tn	-		
Mechanical seal on pump side	Silicon carbide/silicon carbide	Thermal protection	Klixon				
Mechanical seal on motor side	Silicon carbide/silicon carbide	Insulation class	F				
Screws and nuts	Stainless steel	Protection class	IP68				
		Explosion-proof	ATEX II 2G Exd IIB T4				
		Power supply cable	Length	NSSHO	30	m	
		Efficiency class	S.F			1.15	



# Pump Monitor Relay PMR1

MADE IN  
THE U.S.A.



UL FILE #E101681

## OPERATION

The Pump Monitor Relay provides Motor Over Temperature and Seal Leakage alarms for Submersible Pumps.



**Motor Over Temperature Alarm** - The unit applies a low voltage DC signal to the Motor Thermal Sensor to check its status. If the unit detects that the Motor Thermal Sensor contacts are closed (normal condition), the Overtemp indication remains off, and the Overtemp Relay is energized closing the contacts between terminals 2 and 11.

If the Motor Thermal Sensor contacts open (Over Temperature condition), the Overtemp Indication is turned on and the Overtemp Alarm Relay is de-energized opening the contacts between terminals 2 and 11 and closing the contacts between terminals 2 and 1.

When the High Motor Temperature condition has cleared, the unit will reset based on the position of Alarm Reset Mode Select Switch (Auto or Manual). When in the Auto position, the Overtemp Alarm resets automatically. If the switch is in the Manual position, the Overtemp Reset Push-button must be pushed for approximately 1.5 seconds to clear the alarm.

**Seal Leakage Alarm** - The unit detects moisture inside a pump motor by using a low voltage AC signal to measure the resistance between a single (or dual) Leakage Probe(s) and the grounded motor housing, or across two Leakage Probes. A Seal Leakage condition is considered present when the amount of moisture in the motor causes the resistance between terminal 6 and 5 to drop below the setting on the potentiometer. When this occurs the unit turns on the Leakage Indication and energizes the Leakage Alarm Relay closing the contacts between terminals 9 and 10.

The alarm trip point may be set by the following procedure: Isolate the Leakage Probe(s) from terminals 5 and 6. Connect a resistor, with the desired trip value, across terminals 5 and 6. Slowly adjust the potentiometer to the point where the alarm turns on. Remove the resistor and reconnect to the Leakage Probe(s).

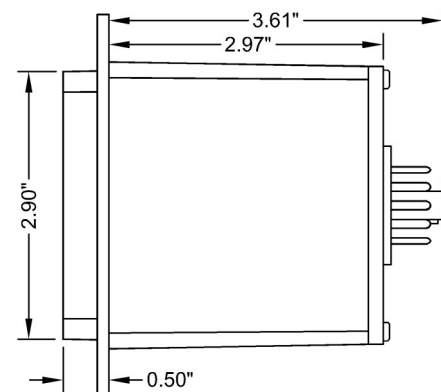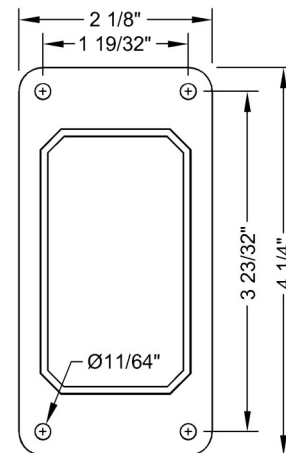

## SPECIFICATIONS

Input Power:	120 VAC $\pm 10\%$ , 7.0 VA max
Output Rating:	8A Resistive @ 120VAC
Operating Temp:	-20°C to +65 °C
Storage Temp:	-45°C to +85 °C
Temp Sensor Voltage:	6.6 VDC $\pm 10\%$
Leak Sensor Voltage:	4.7 VAC $\pm 10\%$
Enclosure:	White Lexan
Base:	Phenolic


## ORDERING INFORMATION

Part Number: PMR1


# Pump Monitor Relay

## CONNECTION DIAGRAMS


### CHECKS RESISTANCE BETWEEN ONE PROBE AND MOTOR HOUSING

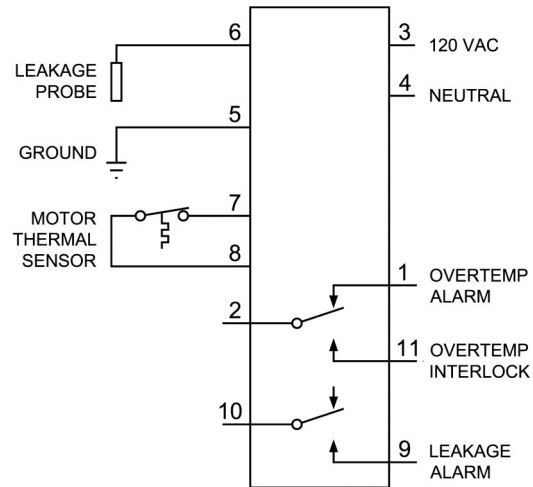

### CHECKS RESISTANCE BETWEEN TWO PROBES AND MOTOR HOUSING

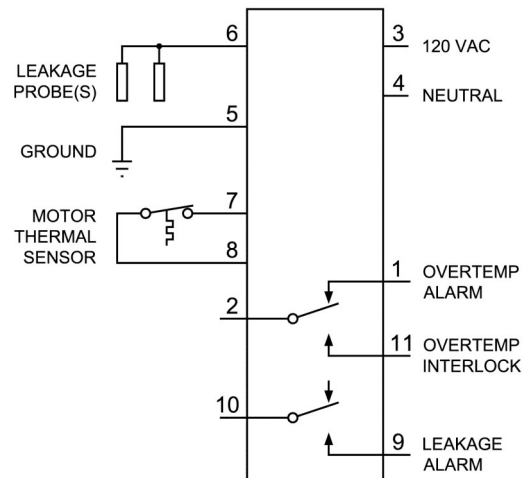

### CHECKS RESISTANCE BETWEEN TWO PROBES

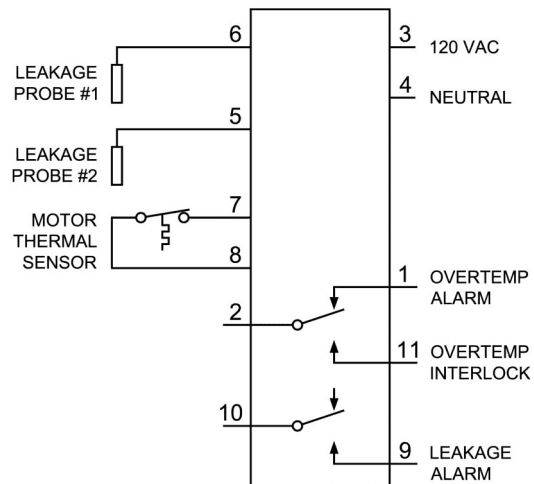



102 NE 2nd Street  
Suite 510  
Boca Raton FL 33432  
(954) 483 9269 Cell  
arturo@wws-llc.com  
meredith@wws-llc.com  
wws-llc.com

## WASTEWATER SOLUTIONS REFERENCES OF PAST PERFORMANCE

Shelly D. Glenn  
Contract Specialist, Branch III, Div V  
U.S. DEPARTMENT OF THE INTERIOR  
7301 W. Mansfield Ave, MS D2940  
Lakewood, CO 80235  
Phone: 303-980-3875  
Email: shelly\_glenn@ibc.doi.gov

Jennifer Garcia  
BUREAU OF RECLAMATION  
HOOVER DAM  
Lower Colorado Region-Yuma Area Office  
7301 Calle Agua Salada  
Yuma, AZ 85634  
Phone: 928-343-8128  
Email: jgarcia@usbr.gov

Andres Delgado  
Director Of Public Works  
CITY OF HIALEAH GARDENS  
13601 N.W. 107th Avenue  
Hialeah Gardens, Florida 33018  
Phone: 305-877-8273  
Email: adelgado@cityofhialeahgardens.com

Luis Montoya  
Water Treatment Plant Operations Superintendent  
CITY OF HOLLYWOOD  
DEPARTMENT OF PUBLIC UTILITIES  
3441 Hollywood Blvd.  
Hollywood, Florida 33021  
Phone: 954-967-4230  
Email: lmontoya@hollywoodfl.org

Meg Ankrom  
Contract Performance Specialist  
US ARMY CORPS OF ENGINEERS  
ICE HARBOR PROJECT  
2763 Monument Drive  
Burbank, WA 99323  
Phone: 509-543-3255  
Email: Meg.m.ankrom@usace.army.mil

Rick Giangrande  
Fleet Acquisition Specialist  
PASCO COUNTY  
7578 State Street  
New Port Richey, Florida 34654  
Phone: 727-834-3739 Ext.7536  
Email: [Rgiangrande@pascocountyfl.net](mailto:Rgiangrande@pascocountyfl.net)

SK3 Chelsea Pincay  
US COAST GUARD  
USCG BASE NEW ORLEANS  
1790 Saturn Blvd.  
New Orleans LA 70129  
Phone: 504-253-4896  
Email: Chelsea.L.Pincay@uscg.mil

Lonnie Sullivan  
Maintenance Mechanic  
NATIONAL FISH AND WILDLIFE SERVICE  
COLEMAN FISH HATCHERY  
24411 Coleman Fish Hatchery Rd  
Anderson, California 96007  
Phone: 530 365-8622  
Email: Lonnie\_Sullivan@fws.gov

Derek R. Sanders  
Maintenance supervisor  
HENDERSON WATER UTILITY  
205 Drury Lane  
Henderson, KY 42420  
Phone: 270-869-6595  
Email: sandersd@hkywater.org



Jeremy Chaja  
Chief Plant Operator  
LAGUNA COUNTY SANITATION DISTRICT  
SANTA BARBARA COUNTY, CALIFORNIA  
3500 BLACK RD  
SANTA MARIA, CA 93455  
Phone: 805-934-6282  
Email: jchaja@cosbpw.net

Jayne I. Prindible  
AMPS, INC.  
AQUIFER MAINTENANCE & PERFORMANCE SYSTEMS, INC.  
7146 Haverhill Road N.  
West Palm Beach, FL 33407  
Phone: 954-967-4230  
Email: ampsjlp@gmail.com

Kyle Wilson  
Utilities Maintenance Manager  
UTILITIES & ENERGY – CPFM  
UNIVERSITY OF OREGON  
1295 Franklin Avenue  
Eugene, Oregon 97403  
Phone: 541-346-2246  
Email: rwilson2@uoregon.edu

Marcus Spiegelberg  
Director Of Operations  
DOUGLAS ORR PLUMBING  
301 Flagler Drive Miami Springs, FL 33166  
Phone: (305) 887-1687  
Email: [marcus@orrplumbing.com](mailto:marcus@orrplumbing.com)

Ronnie S. Navarro,  
Pe Deputy Director / City Engineer  
CITY OF DANIA BEACH  
rnavarro@daniabeachfl.gov  
Public Services Department  
1201 Stirling Road  
Dania Beach, FL 33004  
Phone: 954-924-6808

Robert Shaw  
FLORIDA POWER AND LIGHT  
700 Universe Blvd.  
Juno Beach, FL 33408  
Phone: 561-818-1668  
Email: robert.shaw@fpl.com

FOR OFFICIAL USE ONLY / SOURCE SELECTION INFORMATION - SEE FAR 2.101, 3.104, AND 42.1503

**CONTRACTOR PERFORMANCE ASSESSMENT REPORT (CPAR)****Nonsystems****Name/Address of Contractor:**

Company Name: WASTEWATER SOLUTIONS LLC

Division Name:

Street Address: 14031 SW 143 CT STE 6

City: MIAMI

State/Province: FL Zip Code: 331865745

Country: USA

CAGE Code:

DUNS Number: 079918568

PSC: 4320 NAICS Code: 333996

**Evaluation Type:** Final**Contract Percent Complete:****Period of Performance Being Assessed:** 06/19/2018 - 11/16/2018**Contract Number:** 140R3018P0065 **Business Sector & Sub-Sector:** Nonsystems - Facilities Supplies**Contracting Office:** LOWER COLORADO REGIONAL OFFICE **Contracting Officer:** VIRGINIA TOLEDO **Phone Number:** 928-343-8136**Location of Work:****Award Date:** 06/19/2018 **Effective Date:** 06/19/2018**Completion Date:** 11/09/2018 **Estimated/Actual Completion Date:** 11/16/2018**Total Dollar Value:** **Current Contract Dollar Value:****Complexity:** Low **Termination Type:** None**Competition Type:** Competed under SAP **Contract Type:** Firm Fixed Price**Key Subcontractors and Effort Performed:****DUNS:****Effort:****DUNS:****Effort:****DUNS:****Effort:****Project Number:****Project Title:**

Replacement of Vertical Turbine Pumps

**Contract Effort Description:**

Supply three vertical turbine pumps for the Hoover Dam sump

**Small Business Subcontracting:**

Does this contract include a subcontracting plan? No

Date of last Individual Subcontracting Report (ISR) / Summary Subcontracting Report (SSR): N/A

**Evaluation Areas****Past Rating****Rating**

Quality:	N/A	Satisfactory
Schedule:	N/A	Satisfactory
Cost Control:	N/A	N/A
Management:	N/A	Satisfactory
Small Business Subcontracting:	N/A	N/A
Regulatory Compliance:	N/A	Satisfactory

Other Areas:

(1) : N/A

(2) : N/A

(3) : N/A

FOR OFFICIAL USE ONLY

FOR OFFICIAL USE ONLY / SOURCE SELECTION INFORMATION - SEE FAR 2.101, 3.104, AND 42.1503

**Variance (Contract to Date):**

Current Cost Variance (%): Variance at Completion (%):

Current Schedule Variance (%):

**Assessing Official Comments:**

QUALITY: Contractor furnished equipment that met all salient characteristics

SCHEDULE: Contractor delivered the equipment within a week of the Period of Performance

MANAGEMENT: Contractor communicated in a cordial manner; sought clarifications and Government approval of design as needed; and sent periodic progress updates.

REGULATORY COMPLIANCE: The Contractor complied with all contractual requirements.

**RECOMMENDATION:**

Given what I know today about the contractor's ability to perform in accordance with this contract or order's most significant requirements, I would recommend them for similar requirements in the future.

**Name and Title of Assessing Official:**

Name: VIRGINIA TOLEDO

Title: Contracting Officer

Organization: BOR - Yuma Area Office

Phone Number: (928) 343-8136 Email Address: vtoledo@usbr.gov

Date: 11/28/2018

**Contractor Comments:**

ADDITIONAL/OTHER: Contractor agrees with the ratings assigned.

CONCURRENCE: I concur with this evaluation.

**Name and Title of Contractor Representative:**

Name: MEREDITH RAE

Title: Vice President

Phone Number: 6467653799 Email Address: meredith@wws-llc.com

Date: 11/28/2018

**Review by Reviewing Official:**

Review by Reviewing Official not required.

**Name and Title of Reviewing Official:**

Name:

Title:

Organization:

Phone Number: Email Address:

Date:

FOR OFFICIAL USE ONLY


# State of Florida

## Minority Business Certification

### Wastewater Solutions, LLC

Is certified under the provisions of  
287 and 295.187, Florida Statutes, for a period from:

02/22/2019 to 02/22/2021

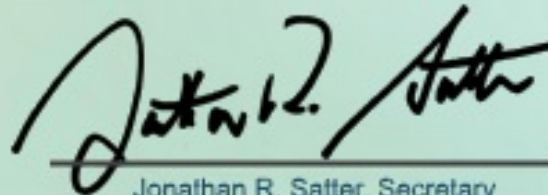

Jonathan R. Satter, Secretary  
Florida Department of Management Services



FLORIDA DEPARTMENT OF MANAGEMENT SERVICES  
office of supplier  
**DIVERSITY**  
We serve those who serve Florida



# *State of Florida*

## *Department of State*

I certify from the records of this office that WASTEWATER SOLUTIONS LLC is a limited liability company organized under the laws of the State of Florida, filed on August 14, 2014.

The document number of this limited liability company is L14000127855.

I further certify that said limited liability company has paid all fees due this office through December 31, 2020, that its most recent annual report was filed on January 17, 2020, and that its status is active.

*Given under my hand and the  
Great Seal of the State of Florida  
at Tallahassee, the Capital, this  
the Seventeenth day of January,  
2020*



*Randy Be*  
**Secretary of State**

Tracking Number: 7005790363CC

To authenticate this certificate, visit the following site, enter this number, and then follow the instructions displayed.

<https://services.sunbiz.org/Filings/CertificateOfStatus/CertificateAuthentication>



# CERTIFICATE OF LIABILITY INSURANCE

DATE (MM/DD/YYYY)

12/16/2019

THIS CERTIFICATE IS ISSUED AS A MATTER OF INFORMATION ONLY AND CONFERS NO RIGHTS UPON THE CERTIFICATE HOLDER. THIS CERTIFICATE DOES NOT AFFIRMATIVELY OR NEGATIVELY AMEND, EXTEND OR ALTER THE COVERAGE AFFORDED BY THE POLICIES BELOW. THIS CERTIFICATE OF INSURANCE DOES NOT CONSTITUTE A CONTRACT BETWEEN THE ISSUING INSURER(S), AUTHORIZED REPRESENTATIVE OR PRODUCER, AND THE CERTIFICATE HOLDER.

**IMPORTANT:** If the certificate holder is an ADDITIONAL INSURED, the policy(ies) must have ADDITIONAL INSURED provisions or be endorsed. If SUBROGATION IS WAIVED, subject to the terms and conditions of the policy, certain policies may require an endorsement. A statement on this certificate does not confer rights to the certificate holder in lieu of such endorsement(s).

<b>PRODUCER</b> Liberty Mutual Insurance PO Box 188065 Fairfield, OH 45018	<b>CONTACT NAME:</b>	<b>PHONE (A/C, No, Ext):</b> 800-962-7132	<b>FAX (A/C, No):</b> 800-845-3666
	<b>E-MAIL ADDRESS:</b> BusinessService@LibertyMutual.com		
<b>INSURED</b> Wastewater Solutions LLC 102 NE 2nd St Ste 510 Boca Raton FL 33432	<b>INSURER(S) AFFORDING COVERAGE</b>		<b>NAIC #</b>
	INSURER A : Ohio Security Insurance Company		24082
	INSURER B :		
	INSURER C :		
	INSURER D :		
	INSURER E :		
	INSURER F :		

**COVERAGES**

CERTIFICATE NUMBER: 52912225

REVISION NUMBER:

THIS IS TO CERTIFY THAT THE POLICIES OF INSURANCE LISTED BELOW HAVE BEEN ISSUED TO THE INSURED NAMED ABOVE FOR THE POLICY PERIOD INDICATED. NOTWITHSTANDING ANY REQUIREMENT, TERM OR CONDITION OF ANY CONTRACT OR OTHER DOCUMENT WITH RESPECT TO WHICH THIS CERTIFICATE MAY BE ISSUED OR MAY PERTAIN, THE INSURANCE AFFORDED BY THE POLICIES DESCRIBED HEREIN IS SUBJECT TO ALL THE TERMS, EXCLUSIONS AND CONDITIONS OF SUCH POLICIES. LIMITS SHOWN MAY HAVE BEEN REDUCED BY PAID CLAIMS.

INSR LTR	TYPE OF INSURANCE	ADDL INSD	SUBR WVD	POLICY NUMBER	POLICY EFF (MM/DD/YYYY)	POLICY EXP (MM/DD/YYYY)	LIMITS
A	<input checked="" type="checkbox"/> <b>COMMERCIAL GENERAL LIABILITY</b> <input type="checkbox"/> CLAIMS-MADE <input checked="" type="checkbox"/> OCCUR GEN'L AGGREGATE LIMIT APPLIES PER: <input checked="" type="checkbox"/> POLICY <input type="checkbox"/> PRO-JECT <input type="checkbox"/> LOC OTHER:			BKS58450670	12/5/2019	12/5/2020	EACH OCCURRENCE \$1,000,000 DAMAGE TO RENTED PREMISES (Ea occurrence) \$300,000 MED EXP (Any one person) \$15,000 PERSONAL & ADV INJURY \$1,000,000 GENERAL AGGREGATE \$2,000,000 PRODUCTS - COMP/OP AGG \$2,000,000 \$
	<b>AUTOMOBILE LIABILITY</b> <input type="checkbox"/> ANY AUTO <input type="checkbox"/> OWNED AUTOS ONLY <input type="checkbox"/> SCHEDULED AUTOS <input type="checkbox"/> HIRED AUTOS ONLY <input type="checkbox"/> NON-OWNED AUTOS ONLY						COMBINED SINGLE LIMIT (Ea accident) \$ BODILY INJURY (Per person) \$ BODILY INJURY (Per accident) \$ PROPERTY DAMAGE (Per accident) \$ \$
	<b>UMBRELLA LIAB</b> <input type="checkbox"/> OCCUR <b>EXCESS LIAB</b> <input type="checkbox"/> CLAIMS-MADE DED <input type="checkbox"/> RETENTION \$						EACH OCCURRENCE \$ AGGREGATE \$ \$
	<b>WORKERS COMPENSATION AND EMPLOYERS' LIABILITY</b> ANY PROPRIETOR/PARTNER/EXECUTIVE OFFICER/MEMBER EXCLUDED? (Mandatory in NH) <input type="checkbox"/> Y / N If yes, describe under DESCRIPTION OF OPERATIONS below		N / A				PER STATUTE <input type="checkbox"/> OTH-ER <input type="checkbox"/> E.L. EACH ACCIDENT \$ E.L. DISEASE - EA EMPLOYEE \$ E.L. DISEASE - POLICY LIMIT \$

DESCRIPTION OF OPERATIONS / LOCATIONS / VEHICLES (ACORD 101, Additional Remarks Schedule, may be attached if more space is required)

\*\*Proof of Insurance\*\*

**CERTIFICATE HOLDER**Wastewater Solutions LLC  
102 NE 2nd St Ste 510  
Boca Raton FL 33432**CANCELLATION**

SHOULD ANY OF THE ABOVE DESCRIBED POLICIES BE CANCELLED BEFORE THE EXPIRATION DATE THEREOF, NOTICE WILL BE DELIVERED IN ACCORDANCE WITH THE POLICY PROVISIONS.

AUTHORIZED REPRESENTATIVE

Stefano Paparella

© 1988-2015 ACORD CORPORATION. All rights reserved.

ACORD 25 (2016/03)

The ACORD name and logo are registered marks of ACORD