

DATE: 9/23/2016

INVITATION TO BID  
THIS IS NOT AN ORDER

Page: 4

BID NO.: 50-00117917

JEFFERSON PARISH

PURCHASING DEPARTMENT  
P.O. BOX 9  
GRETN, LA. 70054-0009  
504-364-2678

VENDOR: GEAU Enterprise

BUYER: SFOLSE

As per LSA-RS 47:301 et seq., all governmental bodies are excluded from payment of sales taxes to any Louisiana taxing body. Quotations shall be based on F.O.B. Agency warehouse or jobsite, anywhere within the Parish as designated by the Purchasing Department.

JEFFERSON PARISH reserves the right to cancel all or any part of an order if not shipped promptly. No charges will be allowed for parking or cartage unless specified in quotation. The order must not be filled at a higher price than quoted. JEFFERSON PARISH reserves the right to cancel at any time and for any reason by issuing a THIRTY (30) day written notice to the contractor.

JEFFERSON PARISH is expecting all products to be new and all work is to be done in a workman-like manner, according to standard practices. Any deviations or alterations from the specifications must be indicated and backup documentation supplied with your quotation.

**DELIVERY: FOB JEFFERSON PARISH**

INDICATE DELIVERY DATE ON EQUIPMENT AND SUPPLIES

3 weeks

INDICATE STARTING TIME (IN DAYS) FOR CONSTRUCTION WORK

INDICATE COMPLETION TIME (IN DAYS) FOR CONSTRUCTION WORK

In the event that addenda are issued with this bid, bidders MUST acknowledge all addenda on the bid form. Bidder must acknowledge receipt of an addendum on the bid form as indicated. Failure to acknowledge any addendum on the bid form will result in bid rejection.

Acknowledge Receipt of Addenda: NUMBER: \_\_\_\_\_

NUMBER: \_\_\_\_\_

NUMBER: \_\_\_\_\_

NUMBER: \_\_\_\_\_

LOUISIANA CONTRACTOR'S LICENSE NO.: (if applicable) \_\_\_\_\_

<b>*** ALL BIDDERS MUST COMPLETE SECTION BELOW ***</b>	
FIRM NAME:	<u>GEAU Enterprise, LLC</u>
SIGNATURE: (Must be signed here)	<u>Rf Gau</u> TITLE: <u>Owner</u>
PRINT OR TYPE NAME:	<u>Roger J. Gautreau</u>
ADDRESS:	<u>12292 Juliet Street</u>
CITY, STATE:	<u>Gonzales, LA</u> ZIP: <u>70737</u>
TELEPHONE:	<u>2251644-9910</u> FAX: <u>2251644-6656</u>
EMAIL ADDRESS:	<u>Roger@geaumenterprise.com</u>

TOTAL PRICE OF ALL BID ITEMS: \$ 10,950.00

DATE: 9/23/2016

INVITATION TO BID FROM JEFFERSON PARISH - continued

Page: 5

BID NO.: 50-00117917

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
1	30.00	EA	<p>SUMP PUMP NEEDED FOR THE JEFFERSON PARISH WB DEPARTMENT OF SEWERAGE</p> <p>0010 - PUMP, SUMP, 4/10 HORSEPOWER, 1-1/2 IN. DISCHARGE, AUTOMATIC, CAPACITY TO 80 GPM, 32 FT. SHUT OFF HEAD, 20 FT. CORD, CAST IRON BODY, MYERS MODEL NO. ME40PC-1 SK NUMBER 00-0570710</p> <p>We are offering an alternate pump per these specifications.</p> <p><b>Zoeller BN153</b></p>	365 <sup>00</sup>	10,950.00

*"QUALITY PUMPS SINCE 1939"*

Product information presented here reflects conditions at time of publication. Consult factory regarding discrepancies or inconsistencies.

**ZOELLER**  
PUMP CO.



MAIL TO: P.O. BOX 16347 • Louisville, KY 40256-0347  
SHIP TO: 3649 Cane Run Road • Louisville, KY 40211-1961  
(502) 778-2731 • 1 (800) 928-PUMP • FAX (502) 774-3624

visit our web site:  
[www.zoeller.com](http://www.zoeller.com)

SECTION: 3.20.014  
FM1919  
1108  
Supersedes  
1206

## ZOELLER ONSITE WASTEWATER PRODUCTS

### INTRODUCING ZOELLER ONSITE "DOSE-MATE" PUMPS

#### COMPARE THESE FEATURES

- Durable cast iron construction.
- Model 151 comes standard with a glass-filled polypropylene base.
- Corrosion resistant powder coated epoxy finish.
- Stainless steel lifting handle.
- Assembled with stainless steel bolts.
- Non-clogging engineered thermoplastic vortex impeller design.
- Model 151 - 1/3 HP passes 1/2" spherical solids.
- Model 152 - .4 HP passes 3/4" spherical solids.
- Model 153 - 1/2 HP passes 3/4" spherical solids.
- Motor - 60 Hz, 3450 RPM, oil-filled, hermetically sealed, automatic reset thermal overload protected.
- Carbon/Ceramic seals.
- Upper sleeve bearing and lower ball bearing running in bath of oil.
- 20 ft. UL Listed power cord with molded 3-wire plug.
- 1 1/2" NPT vertical discharge.
- BN and BE standard models include a 20 ft. variable level float switch.
- Operates at temperatures to 130°F (54°C) in effluent applications.
- All models include a 1 1/2" x 2" PVC adapter fitting.

**Note:** The sizing of effluent systems normally requires variable level float(s) controls and properly sized basins to achieve required pumping cycles or dosing timers with nonautomatic pumps.

**ZOELLER**  
PUMP CO.



Manufacturers of . . .

*"QUALITY PUMPS SINCE 1939"*

#### 151/152/153 EFFLUENT SERIES

(For Pump Prefix Identification see News & Views 0052)

## "DOSE-MATE"

FOR SEPTIC TANK - LOW PRESSURE PIPE (LPP)  
AND ENHANCED FLOW STEP SYSTEMS

**EFFLUENT**  
SUBMERSIBLE  
1 1/2" NPT DISCHARGE





**CS** US  
Listed to UL Standard UL778  
and Certified to CSA  
Standard C8A22.2 No. 108



Model N152/N153  
High Head  
Effluent


#### MODELS AVAILABLE

- N151/N152/N153 & E151/E152/E153 nonautomatic
- BN151/BN152/BN153 & BE151/BE152/BE153  
packaged with Piggyback Variable Level Float Switch
- 1/3, .4 & 1/2 HP, 1Ph 115V or 230V

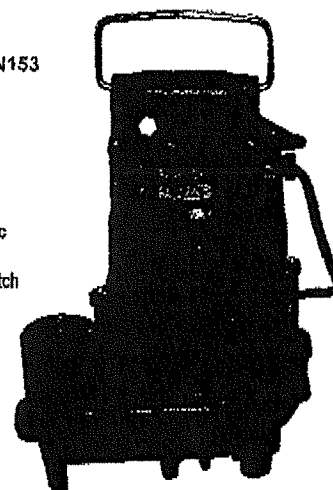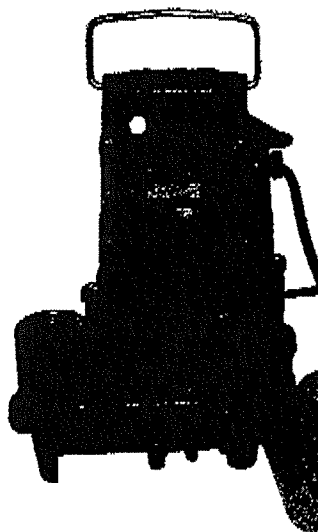

**POWDER  
COATED  
TOUGH™**

Model BN152/BN153  
High Head  
Effluent

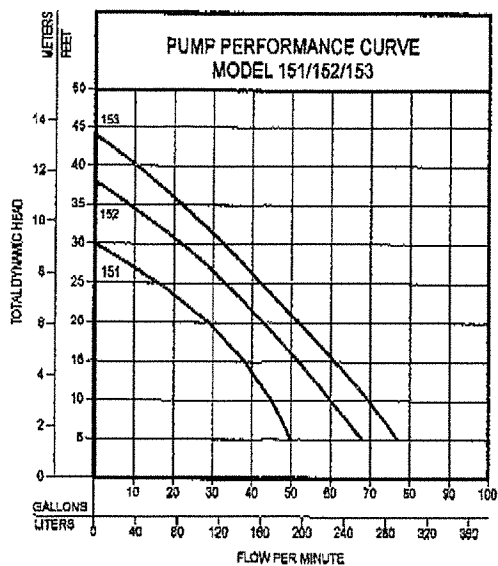

Q14508A

## CONSULT FACTORY FOR SPECIAL APPLICATIONS

- Timed dosing panels available.
- Electrical alternators, for duplex systems, are available and supplied with an alarm.
- Variable level control switches are available for controlling single phase systems.
- Double piggyback variable level float switches are available for variable level long and short cycle controls.
- Sealed Qwik-Box available for outdoor installations. See FM1420.
- Over 130°F (54°C) special quotation required.

### 151/152/153 Series

151/152/153 MODELS				Control Selection		
Model	Volts-Ph	Mode	Amps	Simplex	Duplex	
N151	115	1	Non	6.0	1	2 or 3
BN151	115	1	Auto	6.0	Included	2 or 3
E151	230	1	Non	3.2	1	2 or 3
BE151	230	1	Auto	3.2	Included	2 or 3
N152	115	1	Non	8.5	1	2 or 3
BN152	115	1	Auto	8.5	Included	2 or 3
E152	230	1	Non	4.3	1	2 or 3
BE152	230	1	Auto	4.3	Included	2 or 3
N153	115	1	Non	10.5	1	2 or 3
BN153	115	1	Auto	10.5	Included	2 or 3
E153	230	1	Non	5.3	1	2 or 3
BE153	230	1	Auto	5.3	Included	2 or 3

### SELECTION GUIDE

1. Single piggyback variable level float switch or double piggyback variable level float switch. Refer to FM0477.
2. See FM0712 for correct model of Electrical Alternator E-Pak.
3. Variable level control switch 10-0743 used as a control activator, specify duplex (3) or (4) float system.

#### CAUTION


All installation of controls, protection devices and wiring should be done by a qualified licensed electrician. All electrical and safety codes should be followed including the most recent National Electrical Code (NEC) and the Occupational Safety and Health Act (OSHA).

## TOTAL DYNAMIC HEAD/FLOW PER MINUTE EFFLUENT AND DEWATERING

MODEL		151		152		153	
Feet	Meters	Gal.	Liters	Gal.	Liters	Gal.	Liters
6	1.5	50	189	69	261	77	291
10	3.0	45	170	61	231	70	265
15	4.5	38	144	53	201	61	231
20	8.1	29	110	44	167	52	197
25	7.6	16	61	34	129	42	159
30	9.1	--	--	23	87	33	125
35	10.7	--	--	--	--	22	85
40	12.2	--	--	--	--	11	42
Shut-off Head:		30 ft. (9.1m)		38 ft. (11.6m)		44 ft. (13.4m)	


Q14508B

### Model 151

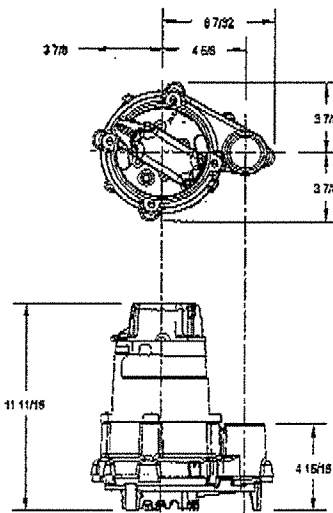


6K2144

### Models 152 / 153

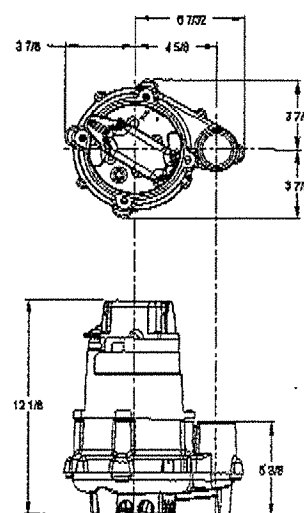

5K2084

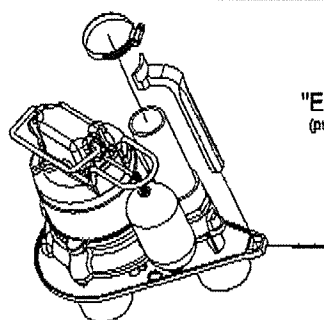

"Easy assembly"  
(pump & discharge pipe  
not included.)

### OPTIONAL PUMP STAND P/N 10-2213

- Reduces potential clogging by debris.
  - Replaces rocks or bricks under the pump.
  - Made of durable, noncorrosive ABS.
  - Raises pump 2" off bottom of basin.
  - Provides the ability to raise intake by adding sections of 1 1/2" or 2" PVC piping.
  - Attaches securely to pump.
  - Accommodates sump, dewatering and effluent applications.
- NOTE: Make sure float is free from obstruction.**

## RESERVE POWERED DESIGN

For unusual conditions a reserve safety factor is engineered into the design of every Zoeller pump.

DATE: 9/23/2016

INVITATION TO BID  
THIS IS NOT AN ORDER

Page: 4

BID NO.: 50-00117917

**JEFFERSON PARISH**PURCHASING DEPARTMENT  
P.O. BOX 9  
GRETN, LA. 70054-0009  
504-364-2678

VENDOR: \_\_\_\_\_

BUYER: SFOLSE

As per LSA-RS 47:301 et seq., all governmental bodies are excluded from payment of sales taxes to any Louisiana taxing body. Quotations shall be based on F.O.B. Agency warehouse or jobsite, anywhere within the Parish as designated by the Purchasing Department.

JEFFERSON PARISH reserves the right to cancel all or any part of an order if not shipped promptly. No charges will be allowed for parking or cartage unless specified in quotation. The order must not be filled at a higher price than quoted. JEFFERSON PARISH reserves the right to cancel at any time and for any reason by issuing a THIRTY (30) day written notice to the contractor.

JEFFERSON PARISH is expecting all products to be new and all work is to be done in a workman-like manner, according to standard practices. Any deviations or alterations from the specifications must be indicated and backup documentation supplied with your quotation.

**DELIVERY: FOB JEFFERSON PARISH**

INDICATE DELIVERY DATE ON EQUIPMENT AND SUPPLIES

3 weeks ARO

INDICATE STARTING TIME (IN DAYS) FOR CONSTRUCTION WORK

INDICATE COMPLETION TIME (IN DAYS) FOR CONSTRUCTION WORK

In the event that addenda are issued with this bid, bidders MUST acknowledge all addenda on the bid form. Bidder must acknowledge receipt of an addendum on the bid form as indicated. Failure to acknowledge any addendum on the bid form will result in bid rejection.

Acknowledge Receipt of Addenda: NUMBER: \_\_\_\_\_

NUMBER: \_\_\_\_\_

NUMBER: \_\_\_\_\_

NUMBER: \_\_\_\_\_


LOUISIANA CONTRACTOR'S LICENSE NO.: (if applicable) \_\_\_\_\_

**\*\*\* ALL BIDDERS MUST COMPLETE SECTION BELOW \*\*\***

FIRM NAME: John H. Carter dba D &amp; L Pumps

SIGNATURE:

(Must be signed here)



TITLE: Pump Products Manager

PRINT OR TYPE NAME: Alan Brown

ADDRESS: 2728 N. Arnoult Rd

CITY, STATE: Metairie, LA

ZIP: 70002

TELEPHONE: (504) 467-2490

FAX: (504) 467-3385

EMAIL ADDRESS: cathy.schwab@johnhcarter.com

TOTAL PRICE OF ALL BID ITEMS: \$ 7,230.00

DATE: 9/23/2016

Page: 5

## INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00117917

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
1	30.00	EA	SUMP PUMP NEEDED FOR THE JEFFERSON PARISH WB DEPARTMENT OF SEWERAGE  0010 - PUMP, SUMP, 4/10 HORSEPOWER, 1-1/2 IN. DISCHARGE, AUTOMATIC, CAPACITY TO 80 GPM, 32 FT. SHUT OFF HEAD, 20 FT. CORD, CAST IRON BODY, MYERS MODEL NO. ME40PC-1 SK NUMBER 00-0570710	241.00	7,230.00