

LOUISIANA UNIFORM PUBLIC WORK BID FORM

TO: Jefferson Parish Purchasing
200 Derbigny Street, Suite 4400
Gretna, LA 70053

BID FOR: Jefferson Parish Recreation Department
Eastbank Main Office Generator Project
Project No: 23015
Bid No. 50-00147321

(Owner to provide name and address of owner)

(Owner to provide name of project and other identifying information)

The undersigned bidder hereby declares and represents that she/he: a) has carefully examined and understands the Bidding Documents, b) has not received, relied on, or based his bid on any verbal instructions contrary to the Bidding Documents or any addenda, c) has personally inspected and is familiar with the project site, and hereby proposes to provide all labor, materials, tools, appliances and facilities as required to perform, in a workmanlike manner, all work and services for the construction and completion of the referenced project, all in strict accordance with the Bidding Documents prepared by: Ellis Engineering, LLC and dated: December 23, 2024

(Owner to provide name of entity preparing bidding documents.)

Bidders must acknowledge all addenda. The Bidder acknowledges receipt of the following ADDENDA: (Enter the number the Designer has assigned to each of the addenda that the Bidder is acknowledging) 1, 2

TOTAL BASE BID: For all work required by the Bidding Documents (including any and all unit prices designated "Base Bid" * but not alternates) the sum of:

ONE HUNDRED SEVENTY-NINE THOUSAND EIGHT HUNDRED NINETY-FIVE — Dollars (\$179,895.00)

ALTERNATES: For any and all work required by the Bidding Documents for Alternates including any and all unit prices designated as alternates in the unit price description.

Alternate No. 1 (Owner to provide description of alternate and state whether add or deduct) for the lump sum of:

N/A Dollars (\$)

Alternate No. 2 (Owner to provide description of alternate and state whether add or deduct) for the lump sum of:

N/A Dollars (\$)

Alternate No. 3 (Owner to provide description of alternate and state whether add or deduct) for the lump sum of:

N/A Dollars (\$)

NAME OF BIDDER:

ADDRESS OF BIDDER:

LOUISIANA CONTRACTOR'S LICENSE NUMBER:

NAME OF AUTHORIZED SIGNATORY OF BIDDER:

TITLE OF AUTHORIZED SIGNATORY OF BIDDER:

SIGNATURE OF AUTHORIZED SIGNATORY OF BIDDER **:

DATE:

THE FOLLOWING ITEMS ARE TO BE INCLUDED WITH THE SUBMISSION OF THIS LOUISIANA UNIFORM PUBLIC WORK BID FORM:

* The Unit Price Form shall be used if the contract includes unit prices. Otherwise it is not required and need not be included with the form. The number of unit prices that may be included is not limited and additional sheets may be included if needed.

** A CORPORATE RESOLUTION OR WRITTEN EVIDENCE of the authority of the person signing the bid for the public work as prescribed by LA R.S. 38:2212(B)(5).

BID SECURITY in the form of a bid bond, certified check or cashier's check as prescribed by LA R.S. 38:2218(A) attached to and made a part of this bid.

Bid Bond

CONTRACTOR:

(Name, legal status and address)

Craig's Electrical & Generator Service LLC
1322 24th Street
Kenner, LA 70062

SURETY:

(Name, legal status and principal place of business)

Arch Insurance Company
3 Harborside
210 Hudson Street, Suite 300
Jersey City, NJ 07311

OWNER:

(Name, legal status and address)

Jefferson Parish Purchasing Department
200 Derbigny Street
Gretna, LA 70053

This document has important legal consequences. Consultation with an attorney is encouraged with respect to its completion or modification.

Any singular reference to Contractor, Surety, Owner or other party shall be considered plural where applicable.

BOND AMOUNT: Five Percent(5%) of Total Amount Bid

PROJECT:

(Name, location or address, and Project number, if any)


Labor, Equipment and Materials needed to Install a Generator for the Jefferson Parish Department Recreation Project Number, if any: 23015

The Contractor and Surety are bound to the Owner in the amount set forth above, for the payment of which the Contractor and Surety bind themselves, their heirs, executors, administrators, successors and assigns, jointly and severally, as provided herein. The conditions of this Bond are such that if the Owner accepts the bid of the Contractor within the time specified in the bid documents, or within such time period as may be agreed to by the Owner and Contractor, and the Contractor either (1) enters into a contract with the Owner in accordance with the terms of such bid, and gives such bond or bonds as may be specified in the bidding or Contract Documents, with a surety admitted in the jurisdiction of the Project and otherwise acceptable to the Owner, for the faithful performance of such Contract and for the prompt payment of labor and material furnished in the prosecution thereof; or (2) pays to the Owner the difference, not to exceed the amount of this Bond, between the amount specified in said bid and such larger amount for which the Owner may in good faith contract with another party to perform the work covered by said bid, then this obligation shall be null and void, otherwise to remain in full force and effect. The Surety hereby waives any notice of an agreement between the Owner and Contractor to extend the time in which the Owner may accept the bid. Waiver of notice by the Surety shall not apply to any extension exceeding sixty (60) days in the aggregate beyond the time for acceptance of bids specified in the bid documents, and the Owner and Contractor shall obtain the Surety's consent for an extension beyond sixty (60) days.


If this Bond is issued in connection with a subcontractor's bid to a Contractor, the term Contractor in this Bond shall be deemed to be Subcontractor and the term Owner shall be deemed to be Contractor.

When this Bond has been furnished to comply with a statutory or other legal requirement in the location of the Project, any provision in this Bond conflicting with said statutory or legal requirement shall be deemed deleted herefrom and provisions conforming to such statutory or other legal requirement shall be deemed incorporated herein. When so furnished, the intent is that this Bond shall be construed as a statutory bond and not as a common law bond.

Signed and sealed this 24th day of April, 2025

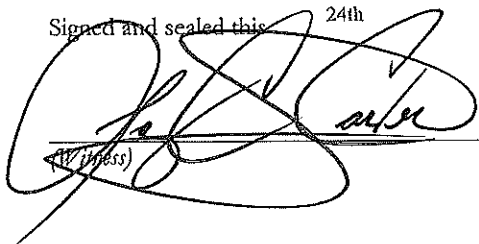

(Witness)


Craig's Electrical & Generator Service LLC

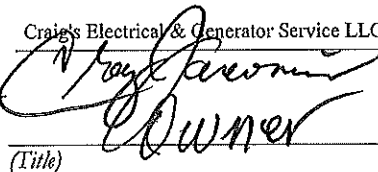
(Title)

Arch Insurance Company

(Surety)


(Witness)


(Title) Christopher Kolger, Attorney-in-Fact



By arrangement with the American Institute of Architects, the National Association of Surety Bond Producers (NASBP) (www.nasbp.org) makes this form document available to its members, affiliates, and associates in Microsoft Word format for use in the regular course of surety business. NASBP vouches that the original text of this document conforms exactly to the text in AIA Document A310-2010, Bid Bond. Subsequent modifications may be made to the original text of this document by users, so careful review of its wording and consultation with an attorney are encouraged before its completion, execution or acceptance.

This Power of Attorney limits the acts of those named herein, and they have no authority to bind the Company except in the manner and to the extent herein stated. Not valid for Note, Loan, Letter of Credit, Currency Rate, Interest Rate or Residential Value Guarantees.

POWER OF ATTORNEY

Know All Persons By These Presents:

That the Arch Insurance Company, a corporation organized and existing under the laws of the State of Missouri, having its principal administrative office in Jersey City, New Jersey (hereinafter referred to as the "Company") does hereby appoint:

Aaron Steffey and Chris Kolger of Houston, TX (EACH)

its true and lawful Attorney(s)in-Fact, to make, execute, seal, and deliver from the date of issuance of this power for and on its behalf as surety, and as its act and deed: Any and all bonds, undertakings, recognizances and other surety obligations, in the penal sum not exceeding **One Million Five Hundred Thousand Dollars (\$1,500,000.00)**. This authority does not permit the same obligation to be split into two or more bonds in order to bring each such bond within the dollar limit of authority as set forth herein.

The execution of such bonds, undertakings, recognizances and other surety obligations in pursuance of these presents shall be as binding upon the said Company as fully and amply to all intents and purposes, as if the same had been duly executed and acknowledged by its regularly elected officers at its principal administrative office in Jersey City, New Jersey.


This Power of Attorney is executed by authority of resolutions adopted by unanimous consent of the Board of Directors of the Company on December 11, 2020, true and accurate copies of which are hereinafter set forth and are hereby certified to by the undersigned Secretary as being in full force and effect:

"**VOTED**, That the Chairman of the Board, the President, or the Executive Vice President, or any Senior Vice President, of the Surety Business Division, or their appointees designated in writing and filed with the Secretary, or the Secretary shall have the power and authority to appoint agents and attorneys-in-fact, and to authorize them subject to the limitations set forth in their respective powers of attorney, to execute on behalf of the Company, and attach the seal of the Company thereto, bonds, undertakings, recognizances and other surety obligations obligatory in the nature thereof, and any such officers of the Company may appoint agents for acceptance of process."

This Power of Attorney is signed, sealed and certified by facsimile under and by authority of the following resolution adopted by the unanimous consent of the Board of Directors of the Company on December 11, 2020:

VOTED, That the signature of the Chairman of the Board, the President, or the Executive Vice President, or any Senior Vice President, of the Surety Business Division, or their appointees designated in writing and filed with the Secretary, and the signature of the Secretary, the seal of the Company, and certifications by the Secretary, may be affixed by facsimile on any power of attorney or bond executed pursuant to the resolution adopted by the Board of Directors on December 11, 2020, and any such power so executed, sealed and certified with respect to any bond or undertaking to which it is attached, shall continue to be valid and binding upon the Company. **In Testimony Whereof**, the Company has caused this instrument to be signed and its corporate seal to be affixed by their authorized officers, this **6th day of August, 2021**

Attested and Certified



Regan A. Shulman, Secretary




Arch Insurance Company




Stephen C. Ruschak, Executive Vice President

STATE OF PENNSYLVANIA SS
COUNTY OF PHILADELPHIA SS

I, Michele Tripodi, a Notary Public, do hereby certify that Regan A. Shulman and Stephen C. Ruschak personally known to me to be the same persons whose names are respectively as Secretary and Executive Vice President of the Arch Insurance Company, a Corporation organized and existing under the laws of the State of Missouri, subscribed to the foregoing instrument, appeared before me this day in person and severally acknowledged that they being thereunto duly authorized signed, sealed with the corporate seal and delivered the said instrument as the free and voluntary act of said corporation and as their own free and voluntary acts for the uses and purposes therein set forth.






Michele Tripodi, Notary Public
My commission expires 07/31/2025

CERTIFICATION

I, Regan A. Shulman, Secretary of the Arch Insurance Company, do hereby certify that the attached Power of Attorney dated **August 6, 2021** on behalf of the person(s) as listed above is a true and correct copy and that the same has been in full force and effect since the date thereof and is in full force and effect on the date of this certificate; and I do further certify that the said Stephen C. Ruschak, who executed the Power of Attorney as Executive Vice President, was on the date of execution of the attached Power of Attorney the duly elected Executive Vice President of the Arch Insurance Company.

IN TESTIMONY WHEREOF, I have hereunto subscribed my name and affixed the corporate seal of the Arch Insurance Company on this **24th of April, 2025**.



Regan A. Shulman, Secretary

This Power of Attorney limits the acts of those named therein to the bonds and undertakings specifically named therein and they have no authority to bind the Company except in the manner and to the extent herein stated.

PLEASE SEND ALL CLAIM INQUIRIES RELATING TO THIS BOND TO THE FOLLOWING ADDRESS:

Arch Insurance - Surety Division
3 Parkway, Suite 1500
Philadelphia, PA 19102



To verify the authenticity of this Power of Attorney, please contact Arch Insurance Company at SuretyAuthentic@archinsurance.com. Please refer to the above named Attorney-in-Fact and the details of the bond to which the power is attached.


CORPORATE RESOLUTION

EXCERPT FROM MINUTES OF MEETING OF THE BOARD OF DIRECTORS OF
Craig's Electrical and Generator Service
INCORPORATED.

AT THE MEETING OF DIRECTORS OF Craig's Electrical and Generator Service
INCORPORATED, DULY NOTICED AND HELD ON January 15, 2025
A QUORUM BEING THERE PRESENT, ON MOTION DULY MADE AND SECONDED. IT
WAS:

RESOLVED THAT Craig Jacomine, BE AND IS HEREBY
APPOINTED, CONSTITUTED AND DESIGNATED AS AGENT AND ATTORNEY-IN-
FACT OF THE CORPORATION WITH FULL POWER AND AUTHORITY TO ACT ON
BEHALF OF THIS CORPORATION IN ALL NEGOTIATIONS, BIDDING, CONCERNS
AND TRANSACTIONS WITH THE PARISH OF JEFFERSON OR ANY OF ITS AGENCIES,
DEPARTMENTS, EMPLOYEES OR AGENTS, INCLUDING BUT NOT LIMITED TO, THE
EXECUTION OF ALL BIDS, PAPERS, DOCUMENTS, AFFIDAVITS, BONDS, SURETIES,
CONTRACTS AND ACTS AND TO RECEIVE ALL PURCHASE ORDERS AND NOTICES
ISSUED PURSUANT TO THE PROVISIONS OF ANY SUCH BID OR CONTRACT, THIS
CORPORATION HEREBY RATIFYING, APPROVING, CONFIRMING, AND ACCEPTING
EACH AND EVERY SUCH ACT PERFORMED BY SAID AGENT AND ATTORNEY-IN-
FACT.

I HEREBY CERTIFY THE FOREGOING TO BE
A TRUE AND CORRECT COPY OF AN
EXCERPT OF THE MINUTES OF THE ABOVE
DATED MEETING OF THE BOARD OF
DIRECTORS OF SAID CORPORATION, AND
THE SAME HAS NOT BEEN REVOKED OR
RESCINDED.

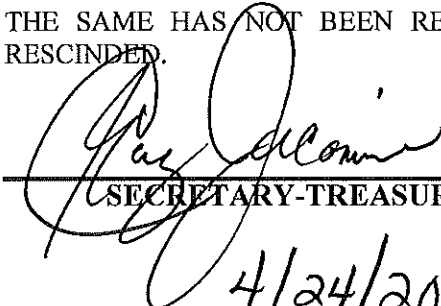

SECRETARY-TREASURER
4/24/2025

DATE

Public Works Bid

AFFIDAVIT

STATE OF LOUISIANA

PARISH/COUNTY OF JEFFERSON

BEFORE ME, the undersigned authority, personally came and appeared: GREGORY PALIARD, (Affiant) who after being by me duly sworn, deposed and said that he/she is the fully authorized SALES MANAGER of CRAIG'S ELECTRICAL (Entity), the party who submitted a bid in response to Bid Number 50-00147³²¹, to the Parish of Jefferson.

Affiant further said:

Campaign Contribution Disclosures

(Choose A or B, if option A is indicated please include the required attachment):

Choice A _____ Attached hereto is a list of all campaign contributions, including the date and amount of each contribution, made to current or former elected officials of the Parish of Jefferson by Entity, Affiant, and/or officers, directors and owners, including employees, owning 25% or more of the Entity during the two-year period immediately preceding the date of this affidavit or the current term of the elected official, whichever is greater. Further, Entity, Affiant, and/or Entity Owners have not made any contributions to or in support of current or former members of the Jefferson Parish Council or the Jefferson Parish President through or in the name of another person or legal entity, either directly or indirectly.

Choice B ✓ there are **NO** campaign contributions made which would require disclosure under Choice A of this section.

Affiant further said:

Debt Disclosures

(Choose A or B, if option A is indicated please include the required attachment):

- Choice A** _____ Attached hereto is a list of all debts owed by the affiant to any elected or appointed official of the Parish of Jefferson, and any and all debts owed by any elected or appointed official of the parish to the Affiant.
- Choice B** ☒ There are **NO** debts which would require disclosure under Choice A of this section.

Affiant further said:

That Affiant has employed no person, corporation, firm, association, or other organization, either directly or indirectly, to secure the public contract under which he received payment, other than persons regularly employed by the Affiant whose services in connection with the construction, alteration or demolition of the public building or project or in securing the public contract were in the regular course of their duties for Affiant; and

That no part of the contract price received by Affiant was paid or will be paid to any person, corporation, firm, association, or other organization for soliciting the contract, other than the payment of their normal compensation to persons regularly employed by the Affiant whose services in connection with the construction, alteration or demolition of the public building or project were in the regular course of their duties for Affiant.

Affiant further said:

Affiant personally has not been convicted of, nor has he/she entered into a plea of guilty or nolo contendere to any of the crimes or equivalent federal crimes listed below. No individual partner, incorporator, director, manager, officer, organizer, or member, who has a minimum of a ten percent ownership in the Bidding Entity, has been convicted of, or has entered a plea of guilty or nolo contendere to any of the crimes or equivalent federal crimes listed below. A conviction of or plea of guilty or nolo contendere to the following state crimes or equivalent federal crimes shall permanently bar any person or the bidding entity from bidding on public projects:

- (a) Public bribery (R.S. 14:118)
- (b) Corrupt influencing (R.S. 14:120)
- (c) Extortion (R.S. 14:66)
- (d) Money laundering (R.S. 14:230)

A conviction of or plea of guilty or nolo contendere to the following state crimes or equivalent federal crimes shall bar any person or the bidding entity from bidding on public projects for a period of five years from the date of conviction or from the date of the entrance of the plea of guilty or nolo contendere:


- (a) Theft (R.S. 14:67)
- (b) Identity Theft (R.S. 14:67, 16)
- (c) Theft of a business record (R.S. 14:67.20)
- (d) False accounting (R.S. 14:70)
- (e) Issuing worthless checks (R.S. 14:71)
- (f) Bank fraud (R.S. 14:71.1)
- (g) Forgery (R.S. 14:72)
- (h) Contractors; misapplication of payments (R.S. 14:202)
- (i) Malfeasance in office (R.S. 14:134)

The five-year prohibition provided for in this section shall apply only if the crime was committed during the solicitation or execution of a contract or bid awarded pursuant to these provisions. If evidence is submitted substantiating that a false attestation has been made and the project must be readvertised or the contract cancelled, the awarded entity making the false attestation shall be responsible to the public entity for the costs of rebidding, additional costs due to increased costs of bids and any and all delay costs due to the rebid or cancellation of this project.

[The remainder of this page is intentionally left blank.]

Affiant further said:

- (1) Entity is registered and participates in a status verification system to verify that all employees in the State of Louisiana are legal citizens of the United States or are legal aliens.
- (2) Entity shall continue, during the term of the contract, to utilize a status verification system to verify the legal status of all new employees in the State of Louisiana.
- (3) Entity shall require all subcontractors to submit to the Entity a sworn affidavit verifying compliance with statements (1) and (2).




Signature of Affiant

GREGORY PALIARO

Printed Name of Affiant

SWORN AND SUBSCRIBED TO BEFORE ME
ON THE 24 DAY OF APRIL, 2025.

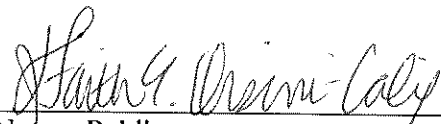

Notary Public


FAITH E. ORSINI-CALIX

Printed Name of Notary

160063

Notary/Bar Roll Number

My commission expires for life.

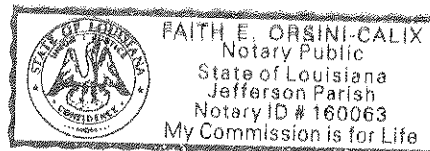

Request for Taxpayer Identification Number and Certification

Give Form to the
requester. Do not
send to the IRS.

► Go to www.irs.gov/FormW9 for instructions and the latest information.

Print or type.
See Specific Instructions on page 3.

1 Name (as shown on your income tax return). Name is required on this line; do not leave this line blank. Craig Jacomine	
2 Business name/disregarded entity name, if different from above Craig's Electrical and Generator Service, LLC	
3 Check appropriate box for federal tax classification of the person whose name is entered on line 1. Check only one of the following seven boxes. <input type="checkbox"/> Individual/sole proprietor or single-member LLC <input type="checkbox"/> C Corporation <input type="checkbox"/> S Corporation <input type="checkbox"/> Partnership <input type="checkbox"/> Trust/estate <input checked="" type="checkbox"/> Limited liability company. Enter the tax classification (C=C corporation, S=S corporation, P=Partnership) ► S Note: Check the appropriate box in the line above for the tax classification of the single-member owner. Do not check LLC if the LLC is classified as a single-member LLC that is disregarded from the owner unless the owner of the LLC is another LLC that is not disregarded from the owner for U.S. federal tax purposes. Otherwise, a single-member LLC that is disregarded from the owner should check the appropriate box for the tax classification of its owner. <input type="checkbox"/> Other (see instructions) ►	
4 Exemptions (codes apply only to certain entities, not individuals; see instructions on page 3): Exempt payee code (if any) 5 Exemption from FATCA reporting code (if any) _____ (Applies to accounts maintained outside the U.S.)	
5 Address (number, street, and apt. or suite no.) See instructions. 1322 24th Street	Requester's name and address (optional)
6 City, state, and ZIP code Kenner, Louisiana 70062	
7 List account number(s) here (optional)	

Part I Taxpayer Identification Number (TIN)

Enter your TIN in the appropriate box. The TIN provided must match the name given on line 1 to avoid backup withholding. For individuals, this is generally your social security number (SSN). However, for a resident alien, sole proprietor, or disregarded entity, see the instructions for Part I, later. For other entities, it is your employer identification number (EIN). If you do not have a number, see *How to get a TIN*, later.

Note: If the account is in more than one name, see the instructions for line 1. Also see *What Name and Number To Give the Requester* for guidelines on whose number to enter.

Social security number									
			-				-		
or									
Employer identification number									
8	5	-	1	0	4	6	8	6	9

Part II Certification

Under penalties of perjury, I certify that:

- The number shown on this form is my correct taxpayer identification number (or I am waiting for a number to be issued to me); and
- I am not subject to backup withholding because: (a) I am exempt from backup withholding, or (b) I have not been notified by the Internal Revenue Service (IRS) that I am subject to backup withholding as a result of a failure to report all interest or dividends, or (c) the IRS has notified me that I am no longer subject to backup withholding; and
- I am a U.S. citizen or other U.S. person (defined below); and
- The FATCA code(s) entered on this form (if any) indicating that I am exempt from FATCA reporting is correct.

Certification instructions. You must cross out item 2 above if you have been notified by the IRS that you are currently subject to backup withholding because you have failed to report all interest and dividends on your tax return. For real estate transactions, item 2 does not apply. For mortgage interest paid, acquisition or abandonment of secured property, cancellation of debt, contributions to an individual retirement arrangement (IRA), and generally, payments other than interest and dividends, you are not required to sign the certification, but you must provide your correct TIN. See the instructions for Part II, later.

Sign Here	Signature of U.S. person ► 	Date ► 4/24/2025
-----------	--	-------------------------

General Instructions

Section references are to the Internal Revenue Code unless otherwise noted.

Future developments. For the latest information about developments related to Form W-9 and its instructions, such as legislation enacted after they were published, go to www.irs.gov/FormW9.

Purpose of Form

An individual or entity (Form W-9 requester) who is required to file an information return with the IRS must obtain your correct taxpayer identification number (TIN) which may be your social security number (SSN), individual taxpayer identification number (ITIN), adoption taxpayer identification number (ATIN), or employer identification number (EIN), to report on an information return the amount paid to you, or other amount reportable on an information return. Examples of information returns include, but are not limited to, the following.

- Form 1099-INT (Interest earned or paid)

- Form 1099-DIV (dividends, including those from stocks or mutual funds)
- Form 1099-MISC (various types of income, prizes, awards, or gross proceeds)
- Form 1099-B (stock or mutual fund sales and certain other transactions by brokers)
- Form 1099-S (proceeds from real estate transactions)
- Form 1099-K (merchant card and third party network transactions)
- Form 1098 (home mortgage interest), 1098-E (student loan interest), 1098-T (tuition)
- Form 1099-C (canceled debt)
- Form 1099-A (acquisition or abandonment of secured property)

Use Form W-9 only if you are a U.S. person (including a resident alien), to provide your correct TIN.

If you do not return Form W-9 to the requester with a TIN, you might be subject to backup withholding. See What is backup withholding, later.



**Designation of Construction Contractor
as Agent of a Governmental Entity
Sales Tax Exemption Certificate**

Jefferson Parish Recreation Department - Eastbank Main Office Generator Project

_____, an agency of the United States government, or an agency, board, commission, or instrumentality of the State of Louisiana or its political subdivisions, including parishes, municipalities and school boards, does hereby designate the following contractor as its agent for the purpose of making sales tax exempt purchases on behalf of the governmental body:

Name of Contractor Craig's Electrical and Generator Service		
Address 1322 24th Street		
City Kenner	State LA	ZIP 70062

This designation of agency shall be effective for purchases of component construction materials, taxable services and leases and rentals of tangible personal property for the following named construction project:

Construction Project Jefferson Parish Recreation Department - Eastbank Main Office Generator	Contract Number Project No: 23015, Bid No. 50-001473
--	--

This designation and acceptance of agency is effective for the period

Beginning Date (mm/dd/yyyy) 04/24/2025	End Date (mm/dd/yyyy) 04/24/2026
--	--

Purchases for the named project during this period by the designated contractor shall be considered as the legal equivalent of purchases directly by the governmental body. Any materials purchased by this agent shall immediately, upon the vendor's delivery to the agent, become the property of this government entity. This government entity, as principal, assumes direct liability to the vendor for the payment of any property, services, leases, or rentals made by this designated agent. This agreement does not void or supersede the obligations of any party created under any construction contract related to this project, including specifically any contractual obligation of the construction contractor to submit payment to the vendors of materials or services for the project.

This contractor-agent is not authorized to delegate this purchasing agency to others; separate designations of agency by this governmental entity are required for each contractor or sub-contractor who is to purchase on behalf of this governmental entity. The undersigned hereby certify that this designation is the entirety of the agency designation agreement between them. In order for a purchase for an eligible governmental entity through a designated agent to be eligible for sales tax exemption, the designation of agency must be made, accepted, and disclosed to the vendor before or at the time of the purchase transaction.

Designation of Agency			Acceptance of Agency		
Signature of Authorized Designator		Date (mm/dd/yyyy)	Signature of Contractor or Subcontractor Authorized Acceptor		Date (mm/dd/yyyy)
Name of Authorized Designator			Name of Contractor's or Subcontractor's Acceptor		
Name of Governmental Entity			Name of Contractor		
Address			Address		
City	State	ZIP	City	State	ZIP

This designation of agency form, when properly executed by both the contractor and the governmental entity, shall serve as evidence of the sales tax exempt status that has been conferred onto the contractor. No other exemption certificate form is necessary to claim exemption from sales taxes. The agency agreement evidenced by this sales tax exemption certificate must be implemented at the time of contract execution with the governmental entity. The contract between the governmental entity and his agent must contain provisions to authenticate the conferment of agency.



CERTIFICATE OF LIABILITY INSURANCE

DATE (MM/DD/YYYY)

04/24/2025

THIS CERTIFICATE IS ISSUED AS A MATTER OF INFORMATION ONLY AND CONFERS NO RIGHTS UPON THE CERTIFICATE HOLDER. THIS CERTIFICATE DOES NOT AFFIRMATIVELY OR NEGATIVELY AMEND, EXTEND OR ALTER THE COVERAGE AFFORDED BY THE POLICIES BELOW. THIS CERTIFICATE OF INSURANCE DOES NOT CONSTITUTE A CONTRACT BETWEEN THE ISSUING INSURER(S), AUTHORIZED REPRESENTATIVE OR PRODUCER, AND THE CERTIFICATE HOLDER.

IMPORTANT: If the certificate holder is an ADDITIONAL INSURED, the policy(ies) must have ADDITIONAL INSURED provisions or be endorsed. If SUBROGATION IS WAIVED, subject to the terms and conditions of the policy, certain policies may require an endorsement. A statement on this certificate does not confer rights to the certificate holder in lieu of such endorsement(s).

PRODUCER	Bennett Simeon Insurance LLC 3100 Ridgelake Drive, Suite 204 Metairie, LA 70002 License #: 1078106	CONTACT NAME: Melissa Simeon PHONE (A/C, No, Ext): (504)603-3333 FAX (A/C, No): E-MAIL ADDRESS: melissa@simeonins.com
INSURED	Craig's Electrical & Generator Service LLC 1322 24th St Generator Service Llc Kenner, LA 70062-5263	INSURER(S) AFFORDING COVERAGE INSURER A: Western World Insurance Company NAIC # 13196 INSURER B: INSURER C: INSURER D: INSURER E: INSURER F:

COVERAGES

CERTIFICATE NUMBER: 00000061-0

REVISION NUMBER: 60

THIS IS TO CERTIFY THAT THE POLICIES OF INSURANCE LISTED BELOW HAVE BEEN ISSUED TO THE INSURED NAMED ABOVE FOR THE POLICY PERIOD INDICATED. NOTWITHSTANDING ANY REQUIREMENT, TERM OR CONDITION OF ANY CONTRACT OR OTHER DOCUMENT WITH RESPECT TO WHICH THIS CERTIFICATE MAY BE ISSUED OR MAY PERTAIN, THE INSURANCE AFFORDED BY THE POLICIES DESCRIBED HEREIN IS SUBJECT TO ALL THE TERMS, EXCLUSIONS AND CONDITIONS OF SUCH POLICIES. LIMITS SHOWN MAY HAVE BEEN REDUCED BY PAID CLAIMS.

INSR LTR	TYPE OF INSURANCE	ADDL INSD	SUBR WVD	POLICY NUMBER	POLICY EFF (MM/DD/YYYY)	POLICY EXP (MM/DD/YYYY)	LIMITS
A	<input checked="" type="checkbox"/> COMMERCIAL GENERAL LIABILITY <input type="checkbox"/> CLAIMS-MADE <input checked="" type="checkbox"/> OCCUR GEN'L AGGREGATE LIMIT APPLIES PER: <input checked="" type="checkbox"/> POLICY <input type="checkbox"/> PRO-JECT <input type="checkbox"/> LOC OTHER:			NPP6075672	11/20/2024	11/20/2025	EACH OCCURRENCE \$ 1,000,000 DAMAGE TO RENTED PREMISES (Ea occurrence) \$ 100,000 MED EXP (Any one person) \$ 5,000 PERSONAL & ADV INJURY \$ 1,000,000 GENERAL AGGREGATE \$ 2,000,000 PRODUCTS - COMP/OP AGG \$ 2,000,000
	AUTOMOBILE LIABILITY <input type="checkbox"/> ANY AUTO <input type="checkbox"/> OWNED AUTOS ONLY <input type="checkbox"/> SCHEDULED AUTOS <input type="checkbox"/> HIRED AUTOS ONLY <input type="checkbox"/> NON-OWNED AUTOS ONLY						COMBINED SINGLE LIMIT (Ea accident) \$ BODILY INJURY (Per person) \$ BODILY INJURY (Per accident) \$ PROPERTY DAMAGE (Per accident) \$
	UMBRELLA LIAB <input type="checkbox"/> OCCUR EXCESS LIAB <input type="checkbox"/> CLAIMS-MADE DED <input type="checkbox"/> RETENTION \$						EACH OCCURRENCE \$ AGGREGATE \$
	WORKERS COMPENSATION AND EMPLOYERS' LIABILITY ANY PROPRIETOR/PARTNER/EXECUTIVE OFFICER/MEMBER EXCLUDED? (Mandatory in NH) If yes, describe under DESCRIPTION OF OPERATIONS below Y/N <input type="checkbox"/> N/A						PER STATUTE <input type="checkbox"/> OTH-ER <input type="checkbox"/> E.L. EACH ACCIDENT \$ E.L. DISEASE - EA EMPLOYEE \$ E.L. DISEASE - POLICY LIMIT \$

DESCRIPTION OF OPERATIONS / LOCATIONS / VEHICLES (ACORD 101, Additional Remarks Schedule, may be attached if more space is required)

CERTIFICATE HOLDER

CANCELLATION

Jefferson Parish Recreation Department
Eastbank Main Office Generator Project
200 Derbigny Street, Suite 400
Gretna, LA 70053

SHOULD ANY OF THE ABOVE DESCRIBED POLICIES BE CANCELLED BEFORE THE EXPIRATION DATE THEREOF, NOTICE WILL BE DELIVERED IN ACCORDANCE WITH THE POLICY PROVISIONS.

AUTHORIZED REPRESENTATIVE

(MBS)

© 1988-2015 ACORD CORPORATION. All rights reserved.



CRAIELE-01

BELMA1

CERTIFICATE OF LIABILITY INSURANCE

DATE (MM/DD/YYYY)

4/24/2025

THIS CERTIFICATE IS ISSUED AS A MATTER OF INFORMATION ONLY AND CONFERS NO RIGHTS UPON THE CERTIFICATE HOLDER. THIS CERTIFICATE DOES NOT AFFIRMATIVELY OR NEGATIVELY AMEND, EXTEND OR ALTER THE COVERAGE AFFORDED BY THE POLICIES BELOW. THIS CERTIFICATE OF INSURANCE DOES NOT CONSTITUTE A CONTRACT BETWEEN THE ISSUING INSURER(S), AUTHORIZED REPRESENTATIVE OR PRODUCER, AND THE CERTIFICATE HOLDER.

IMPORTANT: If the certificate holder is an ADDITIONAL INSURED, the policy(ies) must have ADDITIONAL INSURED provisions or be endorsed. If SUBROGATION IS WAIVED, subject to the terms and conditions of the policy, certain policies may require an endorsement. A statement on this certificate does not confer rights to the certificate holder in lieu of such endorsement(s).

PRODUCER License # 0C41366 E-COMP, A Division of Granite Insurance Brokers 360 Lindbergh Avenue Livermore, CA 94551	CONTACT NAME: Jonny O'Donnell PHONE (A/C, No, Ext): FAX (A/C, No): E-MAIL ADDRESS: jodonnell@goecomp.com														
INSURED Craig's Electrical and Generator Service LLC 1322 24th Street Kenner, LA 70065	<table border="1"><thead><tr><th>INSURER(S) AFFORDING COVERAGE</th><th>NAIC #</th></tr></thead><tbody><tr><td>INSURER A: Employers Assurance Company</td><td>25402</td></tr><tr><td>INSURER B:</td><td></td></tr><tr><td>INSURER C:</td><td></td></tr><tr><td>INSURER D:</td><td></td></tr><tr><td>INSURER E:</td><td></td></tr><tr><td>INSURER F:</td><td></td></tr></tbody></table>	INSURER(S) AFFORDING COVERAGE	NAIC #	INSURER A: Employers Assurance Company	25402	INSURER B:		INSURER C:		INSURER D:		INSURER E:		INSURER F:	
INSURER(S) AFFORDING COVERAGE	NAIC #														
INSURER A: Employers Assurance Company	25402														
INSURER B:															
INSURER C:															
INSURER D:															
INSURER E:															
INSURER F:															

COVERAGES

CERTIFICATE NUMBER:

REVISION NUMBER:

THIS IS TO CERTIFY THAT THE POLICIES OF INSURANCE LISTED BELOW HAVE BEEN ISSUED TO THE INSURED NAMED ABOVE FOR THE POLICY PERIOD INDICATED. NOTWITHSTANDING ANY REQUIREMENT, TERM OR CONDITION OF ANY CONTRACT OR OTHER DOCUMENT WITH RESPECT TO WHICH THIS CERTIFICATE MAY BE ISSUED OR MAY PERTAIN, THE INSURANCE AFFORDED BY THE POLICIES DESCRIBED HEREIN IS SUBJECT TO ALL THE TERMS, EXCLUSIONS AND CONDITIONS OF SUCH POLICIES. LIMITS SHOWN MAY HAVE BEEN REDUCED BY PAID CLAIMS.

INSR LTR	TYPE OF INSURANCE	ADDL INSD	SUBR WVD	POLICY NUMBER	POLICY EFF (MM/DD/YYYY)	POLICY EXP (MM/DD/YYYY)	LIMITS
	COMMERCIAL GENERAL LIABILITY <input type="checkbox"/> CLAIMS-MADE <input type="checkbox"/> OCCUR GEN'L AGGREGATE LIMIT APPLIES PER: <input type="checkbox"/> POLICY <input type="checkbox"/> PRO-JECT <input type="checkbox"/> LOC OTHER:						EACH OCCURRENCE \$ DAMAGE TO RENTED PREMISES (Ea occurrence) \$ MED EXP (Any one person) \$ PERSONAL & ADV INJURY \$ GENERAL AGGREGATE \$ PRODUCTS - COMP/OP AGG \$ \$
	AUTOMOBILE LIABILITY <input type="checkbox"/> ANY AUTO OWNED AUTOS ONLY <input type="checkbox"/> HIRED AUTOS ONLY <input type="checkbox"/> SCHEDULED AUTOS <input type="checkbox"/> NON-OWNED AUTOS ONLY						COMBINED SINGLE LIMIT (Ea accident) \$ BODILY INJURY (Per person) \$ BODILY INJURY (Per accident) \$ PROPERTY DAMAGE (Per accident) \$ \$
	UMBRELLA LIAB <input type="checkbox"/> OCCUR EXCESS LIAB <input type="checkbox"/> CLAIMS-MADE DED <input type="checkbox"/> RETENTION \$						EACH OCCURRENCE \$ AGGREGATE \$ \$
A	WORKERS COMPENSATION AND EMPLOYERS' LIABILITY ANY PROPRIETOR/PARTNER/EXECUTIVE OFFICER/MEMBER EXCLUDED? (Mandatory in NH) If yes, describe under DESCRIPTION OF OPERATIONS below	Y/N Y	N/A	X EIG579786100	11/20/2024	11/20/2025	X PER STATUTE <input type="checkbox"/> OTH-ER <input type="checkbox"/> E.L. EACH ACCIDENT \$ 1,000,000 E.L. DISEASE - EA EMPLOYEE \$ 1,000,000 E.L. DISEASE - POLICY LIMIT \$ 1,000,000

DESCRIPTION OF OPERATIONS / LOCATIONS / VEHICLES (ACORD 101, Additional Remarks Schedule, may be attached if more space is required)
All operations usual and incidental to those of the named insured's business.

Waiver of subrogation applies in favor of The Parish of Jefferson, its Districts, Departments, Agencies and Employees under the direction of the Parish President and the Parish Council, and any other entities who may require waivers by specific contract; as per Business Coverage Form WC 00 03 13 - Waiver Of Our Right To Recover From Others Endorsement.

200 Derbigny Street, Suite 400
Project No: 23015, Bid No. 50-00147321

CERTIFICATE HOLDER

CANCELLATION

Jefferson Parish Recreation Department Eastbank Main Office Generator Project 200 Derbigny Street, Suite 400 Gretna, LA 70053	SHOULD ANY OF THE ABOVE DESCRIBED POLICIES BE CANCELLED BEFORE THE EXPIRATION DATE THEREOF, NOTICE WILL BE DELIVERED IN ACCORDANCE WITH THE POLICY PROVISIONS. AUTHORIZED REPRESENTATIVE
--	---



CERTIFICATE OF LIABILITY INSURANCE

DATE (MM/DD/YYYY)
04/24/2025

THIS CERTIFICATE IS ISSUED AS A MATTER OF INFORMATION ONLY AND CONFERS NO RIGHTS UPON THE CERTIFICATE HOLDER. THIS CERTIFICATE DOES NOT AFFIRMATIVELY OR NEGATIVELY AMEND, EXTEND OR ALTER THE COVERAGE AFFORDED BY THE POLICIES BELOW. THIS CERTIFICATE OF INSURANCE DOES NOT CONSTITUTE A CONTRACT BETWEEN THE ISSUING INSURER(S), AUTHORIZED REPRESENTATIVE OR PRODUCER, AND THE CERTIFICATE HOLDER.

IMPORTANT: If the certificate holder is an ADDITIONAL INSURED, the policy(ies) must have ADDITIONAL INSURED provisions or be endorsed. If SUBROGATION IS WAIVED, subject to the terms and conditions of the policy, certain policies may require an endorsement. A statement on this certificate does not confer rights to the certificate holder in lieu of such endorsement(s).

PRODUCER Nora Vaden Holmes 117 Metairie Lawn Drive Metairie, LA 70001	CONTACT NAME: Nora Vaden Holmes PHONE (A/C, No, Ext): 504-831-0002 E-MAIL ADDRESS: nora.v.holmes.jo9b@statefarm.com	FAX (A/C, No):
	INSURER(S) AFFORDING COVERAGE INSURER A: State Farm Mutual Automobile Insurance Company INSURER B: INSURER C: INSURER D: INSURER E: INSURER F:	

COVERAGES **CERTIFICATE NUMBER:** **REVISION NUMBER:**

THIS IS TO CERTIFY THAT THE POLICIES OF INSURANCE LISTED BELOW HAVE BEEN ISSUED TO THE INSURED NAMED ABOVE FOR THE POLICY PERIOD INDICATED. NOTWITHSTANDING ANY REQUIREMENT, TERM OR CONDITION OF ANY CONTRACT OR OTHER DOCUMENT WITH RESPECT TO WHICH THIS CERTIFICATE MAY BE ISSUED OR MAY PERTAIN, THE INSURANCE AFFORDED BY THE POLICIES DESCRIBED HEREIN IS SUBJECT TO ALL THE TERMS, EXCLUSIONS AND CONDITIONS OF SUCH POLICIES. LIMITS SHOWN MAY HAVE BEEN REDUCED BY PAID CLAIMS.

INSR LTR	TYPE OF INSURANCE	ADD INSD	SUB WVD	POLICY NUMBER	POLICY EFF (MM/DD/YYYY)	POLICY EXP (MM/DD/YYYY)	LIMITS
	COMMERCIAL GENERAL LIABILITY <input type="checkbox"/> CLAIMS-MADE <input type="checkbox"/> OCCUR GEN'L AGGREGATE LIMIT APPLIES PER: <input type="checkbox"/> POLICY <input type="checkbox"/> PRO-JECT <input type="checkbox"/> LOC OTHER:						EACH OCCURRENCE DAMAGE TO RENTED PREMISES (Ea occurrence) MED EXP (Any one person) PERSONAL & ADV INJURY GENERAL AGGREGATE PRODUCTS - COMP/OP AGG \$ \$ \$ \$ \$ \$
A	AUTOMOBILE LIABILITY <input type="checkbox"/> ANY AUTO <input type="checkbox"/> OWNED AUTOS ONLY <input type="checkbox"/> HIRED AUTOS ONLY <input checked="" type="checkbox"/> SCHEDULED AUTOS <input type="checkbox"/> NON-OWNED AUTOS ONLY	N	N	639 0182-A07-18A	01/07/2025	07/07/2025	COMBINED SINGLE LIMIT (Ea accident) BODILY INJURY (Per person) BODILY INJURY (Per accident) PROPERTY DAMAGE (Per accident) \$ \$ 1,000,000 \$ 1,000,000 \$ 1,000,000 \$
	UMBRELLA LIAB EXCESS LIAB <input type="checkbox"/> OCCUR <input type="checkbox"/> CLAIMS-MADE DED <input type="checkbox"/> RETENTION \$						EACH OCCURRENCE AGGREGATE \$ \$ \$
	WORKERS COMPENSATION AND EMPLOYERS' LIABILITY ANY PROPRIETOR/PARTNER/EXECUTIVE OFFICER/MEMBER EXCLUDED? <input type="checkbox"/> Y <input checked="" type="checkbox"/> N (Mandatory in NH) If yes, describe under DESCRIPTION OF OPERATIONS below		N/A				PER STATUTE <input type="checkbox"/> OTH-ER <input type="checkbox"/> E.L. EACH ACCIDENT E.L. DISEASE - EA EMPLOYEE E.L. DISEASE - POLICY LIMIT \$ \$ \$

DESCRIPTION OF OPERATIONS / LOCATIONS / VEHICLES (ACORD 101, Additional Remarks Schedule, may be attached if more space is required)

CERTIFICATE HOLDER

CANCELLATION

JEFFERSON PARISH RECREATION DEPARTMENT
EASTBANK MAIN OFFICE GENERATOR PROJECT
200 DERBIGNY STREET SUITE 400
METAIRIE, LA 70001

SHOULD ANY OF THE ABOVE DESCRIBED POLICIES BE CANCELLED BEFORE THE EXPIRATION DATE THEREOF, NOTICE WILL BE DELIVERED IN ACCORDANCE WITH THE POLICY PROVISIONS.

AUTHORIZED REPRESENTATIVE

Nellie Peranio

© 1988-2015 ACORD CORPORATION. All rights reserved.



CENTRALBIDDING
FROM CENTRAL AUCTION HOUSE

**5000147321-Labor, Equipment and Materials needed to Supply and Install
a Generator for the Jefferson Parish Department of Recreation. Project #
23015**

Jefferson Parish Government

Project documents obtained from www.CentralBidding.com

13-Mar-2025 10:50:58 AM

SPECIFICATIONS

**JEFFERSON PARISH RECREATION DEPARTMENT
EAST BANK RECREATION OFFICE GENERATOR**

6921 SAINTS DR.
METAIRIE, LA 70003

PROJECT NO. 23015
BID NO. 50-00147321

ELLIS ENGINEERING, LLC
525 BREWSTER RD.
MADISONVILLE, LA 70447
PHONE (504) 415-7670

 3-10-25

**THE ATTACHED PLANS AND SPECIFICATIONS HAVE BEEN PREPARED UNDER MY CLOSE
PERSONAL SUPERVISION AND MEET ALL PARISH, CITY, AND STATE REQUIREMENTS TO
THE BEST OF MY KNOWLEDGE AND BELIEF**

**JAMES W. ELLIS, II, P.E.
LOUISIANA LICENSE NO. 31603**

December 23, 2024

TABLE OF CONTENTS

<u>SECTION</u>	<u>NAME</u>	<u>PAGES</u>
00001	Table of contents	1
00010	Advertisement	2
Div. 00	CONTRACT REQUIREMENTS	
	Public Works Bid Instructions	12
	Louisiana Public Work Bid Form	2
	Bid Bond	1
	Form of Performance Bond	2
	Form of Labor and Materials Payment Bond	2
	Public Works Bid Affidavit	5
	Corporate Resolution	1
	Sales Tax Exemption	1
	General Conditions	111
Div. 16	ELECTRICAL	
16010	Basic Electrical Requirements	6
16100	Basic Electrical Materials and Methods	8
16400	Panelboards	5
16800	Generator	12
16850	Automatic Transfer Switch	13

ADVERTISEMENT FOR BIDS

BID NO. 50-00147321

Sealed Bids will be received electronically through our E-Procurement site at www.jeffparishbids.net until 2:00 p.m., **April 24, 2025** and shall, at the below listed time and place, be publicly opened and read aloud. At no charge, bidders may submit via Jefferson Parish's electronic procurement page by visiting www.jeffparishbids.net to register for this **free** site.

Bids will be accepted and received through Central Bidding until 2 p.m. The public bid opening will be held at the West Bank Purchasing Department at 200 Derbigny Street, Suite 4400, Gretna, LA 70053 beginning at 2:30 p.m. on each bid opening date for the following project:

**Labor, Equipment and Materials needed to Install a Generator
for the Jefferson Parish Department of Recreation.
Project # 23015**

Purchases for this project shall be exempt from state sales and use tax according to La. R.S. 47:301(8)(c)(i). The successful bidder shall be granted the tax-exempt status of Jefferson Parish via Form R-1020, Designation of Construction Contractor as Agent of a Governmental Entity Sales Tax Exemption Certificate. Form R-1020 is distributed by the Louisiana Department of Revenue.

All bids must be in accordance with the contract documents on file with the Jefferson Parish Purchasing Department, Suite 4400, Jefferson Parish General Government Building, at 200 Derbigny Street, Gretna, Louisiana. **Late bids will not be accepted.**

Each Bid must be accompanied by an electronic bid surety bond in the amount equal to five percent (5%) of the total amount bid, and payable without condition to the owner. Vendors must submit an electronic bid bond through the respective online clearinghouse bond management system(s) as indicated in the electronic bid solicitation on Central Auction House and place the electronic bid bond number as indicated on the electronic envelope. No scanned paper copies of any bid bond will be accepted as part of the electronic bid submission.

The drawings and specifications are on file and open for inspection in the Jefferson Parish Purchasing Department, Suite 4400, Jefferson Parish General Government Building, at 200 Derbigny Street, Gretna, Louisiana. **A complete set of Contract Documents may be secured from Ellis Engineering, LLC, 525 Brewster Rd. Madisonville, LA 70447, Phone: 504 415-7670 by licensed contractors upon receipt of \$300.00 per manual set and/or \$50.00 per electronic set.** Deposit on the first set of documents furnished bona fide prime bidders shall be fully refunded upon return of documents in good condition no later than ten (10) days after receipts of bids.

The successful bidder will be required to furnish a performance bond and a payment bond guaranteeing faithful performance of the contract. of the contract. Companies providing the bonds shall comply with the requirements of LA-R.S. 38:2218 and R.S. 38:2219 as applicable.

The Jefferson Parish Council reserves the right to reject all bids and to reject bids for just cause, pursuant to the law. Jefferson Parish and its partners as the recipients of federal funds are fully committed to awarding a contract(s) to firm(s) that will provide high quality services and that are dedicated to diversity and to containing costs. Thus, Jefferson Parish strongly encourages the involvement of minority and/or woman-owned business enterprises (DBE's, including MBE's, WBE's and SBE's) to stimulate participation in procurement and assistance programs.

All prospective bidders are invited to attend the non-mandatory pre-bid conference which will be held at 10:00 on March 27, 2025 at Eastbank recreation located at 6921 Saints Drive, Metairie, La 70003. However, failure to attend the pre-bid conference shall not relieve the bidder of responsibility for information discussed at the conference. Furthermore, failure to attend the pre-bid conference and inspection does not relieve the successful bidder from the necessity of furnishing materials or performing any work that may be required to complete the work in accordance with the specification with no additional cost to the owner.

Renny Simno
Director
Purchasing Department

Misty A. Camardelle
Assistant Director
Purchasing Department

ADV: The New Orleans Advocate: March 12, 19, & 26, 2025

For additional information, please visit the Purchasing Webpage at <https://www.jeffparish.gov/464/Purchasing> or you may call 504-364-2678.

PUBLIC WORKS BID INSTRUCTIONS

A. LOUISIANA CONTRACTOR'S LICENSE FOR THIS PROJECT

Must be in the following category:

Electrical

Each bidder shall comply with all rules and regulations of the Louisiana State Licensing Board for Contractors in accordance with existing state laws, and shall comply with the Licensing Requirements of Jefferson Parish Ordinance No. 13574, as amended a copy of which may be obtained from the Office of the Parish Clerk, Suite 6700, Jefferson Parish General Government Building, 200 Derbigny Street, Gretna, Louisiana 70053.

B. PROBABLE CONSTRUCTION RANGES AND PRICES

Range of the Probable Construction Cost for Base Bid:	<u>\$0K - \$250K</u>
Range of the Probable Construction Cost for Alternate No. 1:	<u>N/A</u>
Range of the Probable Construction Cost for Alternate No. 2:	<u>N/A</u>
Range of the Probable Construction Cost for Alternate No. 3:	<u>N/A</u>
Range of the Previous Contract Cap (Public Work Maintenance Contract):	<u>N/A</u>

The estimated cost range is for informational purposes only and may be subject to change. The bid prices received from bidders will be evaluated based on the actual estimate value, which will be read aloud at the time of bid opening, for award determination.

The purpose and intention of this invitation to bid is to afford all suppliers/contractors an equal opportunity to bid on construction, maintenance, repair, operating, services, supplies and/or equipment listed in this bid proposal. Jefferson Parish will accept one bid only from each vendor. Items bid on must meet or exceed specifications. Where brand names, make, manufacturer or stock numbers are specified, it is for the purpose of establishing certain minimum standards of quality. Bidders may submit for products of equal quality, style, type and character, provided brand names and stock numbers are specified. Complete product data may be required prior to award.

The price quoted for the work shall be stated in figures. In the event there is a difference in unit prices and totals, the unit prices shall prevail. In the event there is a difference in unit prices, written unit prices shall prevail over numerical unit prices.

The quantities listed on the bid form are prepared for comparison of bids and may be approximate. Payment to the contractor will be made in accordance with measurement and payment requirements for bid items and other requirements of the project specifications. Bid item quantities may be increased, decreased, or omitted as provided in the specifications.

Jefferson Parish requires all products to be new (current), and all work must be performed according to standard practices for the project. Unless otherwise specified, no after market parts will be accepted. Unless otherwise specified, all workmanship and materials must have at least a one (1) year guaranty, in writing, from the date of delivery/acceptance of the project.

C. METHODS OF BID SUBMISSION

All bids shall be submitted electronically through Jefferson Parish's eProcurement System online at no charge via Jefferson Parish's electronic procurement page by visiting www.jeffparishbids.net. Registration and use of this site are free to Jefferson Parish vendors. Additional instructions are included in the text box highlighting electronic procurement.

Only bids properly signed (see more below) will be accepted. NO LATE BIDS WILL BE ACCEPTED. The name of the bidder must be legibly shown. If the bidder is an individual, their name and address should be shown. If the bidder is an entity, the name of the person given the requisite authority to submit the bid on behalf of the entity shall be shown and the address of the entity's place of business should be shown.

Evidence of agency, corporate, limited liability or partnership authority of the person submitting and signing the bid is required for submission of bid. A copy of a corporate resolution or other signature authorization shall be required for submission of the bid. Failure to include a copy of the appropriate signature authorization will result in the rejection of the bid unless bidder has complied with LSA-R.S. 38:2212(B)(5). Photostatic or font signatures shall result in the bid being rejected. However, an electronic signature as defined in LSA-R.S. 9:2602(8) is acceptable. Signature must be a secured digital signature. A sample corporate resolution and sample certification of sole proprietorship can be downloaded from the Jefferson Parish Purchasing Department's website [Document Library | Jefferson Parish, LA \(jeffparish.gov\)](http://www.jeffparish.gov), or you may provide your own document.

D. TIMELINES

1. Prior to the closing time for receipt of scheduled bids

A bid may be withdrawn at any time prior to the scheduled closing time for receipt of bids, provided a request in writing, executed by the bidder or his duly authorized representative, is filed with the Parish prior to that time. When such a request is received, the bid will be returned to the bidder unopened. However, no bid can be modified, corrected or withdrawn after the time set for closing such bid, except as provided by LSA-R.S. 38:2214(C) & (D).

The Parish, its engineers, architects or anyone distributing plans and specifications for Parish public work projects, equal to or over the contract limit as defined in LA-R.S. 38:2212, shall furnish all prime bidders who request bid documents and who are properly licensed by the Louisiana State Licensing Board for Contractors with at least one set of complete bid documents. A deposit or fee may be charged on the documents as authorized by LA-R.S. 38:2212.

Addenda may be issued, as authorized by LA-R.S. 38:2212 (O). All formal Addenda require written acknowledgment on the bid form by the bidder. Failure to acknowledge an Addendum on the bid form shall cause the bid to be rejected. Jefferson Parish reserves the right to award the bid to the next lowest responsive and responsible bidder in this event.

Prior to submitting a bid each bidder shall visit the site of the proposed work and fully acquaint himself with all surface and subsurface conditions as they may exist so that he may fully understand the facilities, difficulties, and restrictions attending the execution of the work under this Contract. Bidders shall also thoroughly examine and be familiar with Drawings, Specifications, and Contract Documents. The failure or omission of any bidder to receive or examine any form, instrument, drawing, or document or to visit the site and acquaint himself with conditions there existing, shall in no way relieve any bidder from any obligation with respect to

his bid and the responsibility in the premises rests with him. Submission of a bid shall be considered prima facie evidence that the bidder has made such examination and is satisfied as to the conditions to be encountered in performing the work and as to requirements of the plans, project specifications, Resolution No. 141125, as amended, and contract forms.

Any pre-bid test and boring data in connection with subsurface conditions which have been completed by the Parish or its engineers and furnished to the bidder shall not be considered as fully representative of subsurface conditions existing throughout the area tested nor shall they in any way be binding upon the Parish, it being understood that said data is furnished the bidder for his convenience only and the bidder shall be solely responsible for conducting his own boring explorations he deems necessary in preparing his bid. Any prospective bidder wishing to conduct boring explorations on Parish property must obtain written permission from Jefferson Parish prior to such explorations.

No claims shall be made against the Parish for additional compensation due to unforeseen subsurface conditions arising during progress of the work and which might be in variance with the Parish's pre-bid boring data.

2. Post-closing time for receipt of scheduled bids

Except as where provided by law, bidder agrees that this bid shall be legally binding and may not be withdrawn for a period of forty-five (45) calendar days after the scheduled closing time for receiving bids. In the event the Parish issues the Letter of Award (copy of adopted resolution awarding bid by Jefferson Parish Council) during this period, the bid accepted shall continue to remain binding pending execution of the Contract.

Bidder agrees to execute the ensuing Contract and will deliver applicable Bonds to secure the faithful performance thereof.

The Parish of Jefferson reserves the right to cancel this contract for convenience by issuing a thirty (30) day written notice to contractor.

E. BID REVIEW AND AWARD

1. Rejection of Bids

- a. Jefferson Parish may reject any and all bids for just cause in accordance with LA R.S. 38:2214(B). Just cause, for the purpose of the construction of public works, is defined, but is not limited to, the following circumstances:
 - (1) The public entity's unavailability of funds sufficient for the construction of the proposed public work.
 - (2) The failure of any bidder to submit a bid within an established threshold of the preconstruction estimates for that public work, as part of the bid specifications.
 - (3) A substantial change by the public entity prior to the award in the scope or design of the proposed public work.
 - (4) A determination by the public entity not to build the proposed public work within twelve months of the date for the public opening and reading of bids.
 - (5) The disqualification by the public entity of all bidders.

- b. Additionally, bids may be considered irregular and be rejected for any of the following, but is not limited to the following circumstances:
- (1) If the bid form is on a form other than that furnished by the Parish or if the form is altered or any part thereof is detached.
 - (2) If affidavits included in bid form and/or required by law are not returned with the bid or are not properly executed and notarized.
 - (3) If there are unauthorized additions, conditional or alternate bids or irregularities which alter the general terms and conditions, the plans or specifications, or make the bid incomplete, indefinite, or ambiguous as to its meaning.
 - (4) If the bidder adds provisions reserving the right to accept or reject the award or to enter into the contract pursuant to the award.
 - (5) If an owner or a principal officer of the bidding firm is an owner or a principal officer of a firm which has been declared by the Parish to be ineligible to bid.
 - (6) If the proposed bid security does not meet the requirements of Section J.
 - (7) If more than one proposal for the same work, services, materials or supplies is received from an individual, partner, firm, corporation, joint venture, other legal entity, or combination thereof under the same or a different name.
 - (8) The bid is not properly signed or the authority of the signature person submitting the bid is deemed insufficient or unacceptable.
 - (9) If the bidder does not possess the proper license(s) required as noted in the specifications.
 - (10) Any other reasons for rejection set forth by State or Parish laws, Ordinances or Resolutions.
- c. In awarding contracts for materials and supplies, Jefferson Parish shall reject the lowest bid if received from a bidder domiciled in a Communist country, or if the materials or supplies are manufactured in a Communist country, including but not limited to China, North Korea and Vietnam, and to award the contract to the next lowest bidder. This Section shall not apply to any country having established trade relations agreements or approvals from the government of the United States. (LSA-R.S. 38:2212.3)

2. Disqualification of Bids

- a. The causes for disqualification from consideration for award of a contract with Jefferson Parish are as follows (Jefferson Parish Code of Ordinances, Section 2-912):
- (1) Conviction for commission of a criminal offense as an incident to obtaining or attempting to obtain a public or private contract or subcontract, or in the performance of such contract or subcontract;
 - (2) Conviction under state or federal statutes of embezzlement, theft, forgery, bribery, falsification or destruction of records, receiving stolen property, or any other offense indicating a lack of business integrity or business honesty which currently, seriously, and directly affects responsibility as a Parish contractor;
 - (3) Conviction under state or federal antitrust statutes arising out of the submission of bids or proposals;
 - (4) Violation of contract provisions, as set forth below, of a character which is regarded by the Purchasing Director or his designee for Jefferson Parish to be serious as to justify disqualification:
 - i. Deliberate failure without good cause to perform in accordance with the specifications or within the time limit provided in the contract; or

- ii. A recent record of failure to perform or of unsatisfactory performance in accordance with the terms of one or more contracts; provided that failure to perform or unsatisfactory performance caused by acts beyond the control of the contractor shall not be considered to be a basis for disqualification; or
 - iii. Failure to timely pay, without cause, a subcontractor for work performed under a construction contract as required under Section 2-976 in Chapter 2, Article VII, of the Jefferson Parish Code of Ordinances, provided disqualification on such basis shall not exceed a period of one (1) year from the deadline to pay the subcontractor.
 - (5) Any other cause the Purchasing Director determines to be so serious and compelling as to affect responsibility as a Parish contractor, including debarment by another governmental entity for any cause;
 - (6) Violation of the State Code of Ethics or the ethical standards set forth in the Jefferson Parish Code of Ordinances;
 - (7) Failure to secure and/or maintain necessary licenses and/or permits;
 - (8) Failure to comply with the Jefferson Parish Code of Ordinances and/or the Jefferson Parish Comprehensive Zoning Ordinance; or failure to comply with or meet bid specifications and/or failure to be a responsible bidder.
 - (9) A bid which is not responsive to, or does not meet bid specifications, will be rejected as being non-responsive, but that bidder will not be disqualified from future Parish bids, nor will that bidder be given a hearing pursuant to procedure listed below.
- b. The procedures for disqualification from consideration for award of a contract with Jefferson Parish are set forth in Sec. 2- 912 (b).

3. Award of Contract

The award of the contract, if it be awarded, will be by the Parish to the lowest responsive and responsible bidder whose proposal shall have complied with all the bid requirements. The successful bidder will be notified via the e-Procurement site that his bid has been accepted. No contract shall be executed with any contractor until their certificates of insurance, performance bonds, labor and materials payment bonds, or any other bonds required are made satisfactory to the Parish.

Jefferson Parish reserves the right to award contracts or place orders on a lump sum or individual item basis, or such combination as shall, in its judgment, be in the best interest of Jefferson Parish. Every contract or order shall be awarded to the lowest responsible bidder, taking into consideration the conformity with the specifications, and the delivery and/or completion date.

Preference will be given to bidders requesting a preference in their bid in accordance with LSA-R.S. 38:2251-2261 for materials, supplies, and provisions, produced, manufactured or grown in Louisiana, quality being equal to articles offered by competitors outside the State of Louisiana, unless federal funding is directly spent by Jefferson Parish on this project.

The successful bidder shall execute the contract with the Parish in the form of the contract set forth in Resolution No. 141125 Standard General Conditions of the Construction Contract. One copy of the executed contract with all documents forming a part thereof shall be filed at the expense of the contractor, with the Recorder of Mortgages in Jefferson Parish.

PROTESTS: Only those vendors that submit bids in response to this solicitation may protest any element of the procurement, in writing to the Director of the Purchasing Department. Written protest must be received within 48 hours of the release of the bid tabulation by the Purchasing Department. After consultation, the Parish Attorney's Office will then respond to protests in

writing. (For more information, please see Chapter 2, Article VII, Division 2, Sec. 2-913 of the Jefferson Parish Code of Ordinances.)

Upon full execution of the contract and receiving a written notice to proceed, the bidder agrees that all work shall be completed as follows:

The work shall be substantially complete within 270 calendar days of the written notice to proceed and completed and shall be ready for final acceptance no more than 30 calendar days after substantial completion.

F. SALES TAX EXEMPTION

For this project, the contractor shall not pay any state or local sales or use taxes on materials and equipment which are affixed and made part of the immovable property of the project or which is permanently incorporated in the project (hereinafter referred to as "applicable materials and equipment"). All purchases of applicable materials or equipment shall be made by the contractor on behalf of and as the agent of Jefferson Parish (Parish), a political subdivision of the State of Louisiana. No state and local sales and use taxes are owed on applicable materials and equipment under the provisions of Act 1029 of the 1991 Regular Session – Louisiana Revised Statute 47:301(8)(c). Parish will furnish to contractor a certificate form which certifies that Parish is not required to pay such state or local sales and use taxes, and contractor shall furnish a copy of such certificate to all vendors or suppliers of the applicable materials and equipment, and report to Parish the amount of taxes not incurred.

G. LIQUIDATED DAMAGES

In accordance with Resolution No. 141125, as amended, Bidder agrees to pay, as liquidated damages, the sum of \$ 250.00 for: (1) each consecutive calendar day after the agreed date of substantial completion that the work remains substantially incomplete, and (2) each consecutive calendar day after the 30th day following the actual date of substantial completion that the work has not been finally completed.

In addition to, but not in lieu of the per diem liquidated damages, Parish shall also be entitled to recover from the contractor or the contractor's surety additional liquidated damages as detailed in Resolution No. 141125, as amended. These additional liquidated damages may include, but are not limited to the following, in the amounts and for each of the items identified in the Supplementary Conditions:

- | | | |
|-----|---|------------------------|
| (1) | Extended Architectural and/or Engineering Fees | \$ <u>200.00</u> /hour |
| (2) | Extended Resident Project Representative Fee | \$ <u>N/A</u> /hour |
| (3) | Extended Construction Management Fees | \$ <u>200.00</u> /day |
| (4) | Extended Parish's Overhead and Personnel Expenses | \$ <u>100.00</u> /hour |
| (5) | Parish's Other Costs Directly Related to the Delay in Completion Beyond the Contract Times. | |

Whenever contractor's work requires inspections in excess of the budgeted amount for inspection, the contractor shall reimburse the Parish for the additional costs incurred by the Parish attributable to inspection of the contracted project in excess of the budgeted amount for inspections.

The reasonable budget for such inspections is \$ 400.00. Resident Project Representative overtime rates shall be calculated at 1.2 times the hourly rate. The cost of inspection in excess of this budgeted amount shall be assessed against Contractor's progress payments, all in accordance with Louisiana Public Bid Law.

H. ETHICAL STANDARDS AND COOPERATION WITH THE OFFICE OF THE INSPECTOR GENERAL, INCLUDING CONFLICTS OF INTEREST

Vendor agrees by bid submission to comply with all provisions of Louisiana Law as well as compliance with the Jefferson Parish Code of Ordinances, Louisiana Code of Ethics, as published on <http://ethics.la.gov> and applicable Jefferson Parish ethical standards and Jefferson Parish Terms and Conditions.

Inspector General: It shall be the duty of every Parish officer, employee, department, agency, special district, board, and commission; and the duty of every contractor, subcontractor, and licensee of the Parish, and the duty of every applicant for certification of eligibility for a Parish contract or program, to cooperate with the Inspector General in any investigation, audit, inspection, performance review, or hearing pursuant to JPCO 2-155.10(19). Every Parish contract and every bid, proposal, application or solicitation for a Parish contract, and every application for certification of eligibility for a Parish contract or program shall contain a statement that the corporation, partnership, or person understands and will abide by all provisions of JPCO 2-155.10. By submitting a bid, Bidder acknowledges this and will abide by all provisions of the referenced JPCO.

Conflicts of Interest: Jefferson Parish adheres to the Louisiana Code of Governmental Ethics, contained in Louisiana Revised Statutes Annotated, R.S. 42:1101, et seq. Vendor/Proposer by this submission warrants that there are no "conflicts of interest" related to this procurement that would violate applicable Louisiana Law. Violation of the Louisiana Code of Governmental Ethics may result in rescission of contract, permit or licenses, and the imposition of fines and/or penalties, without contractual liability to the public in accordance with applicable law.

I. REQUIRED AFFIDAVITS

For convenience, all legally mandated affidavits have been combined into one form, entitled **Public Works Bid Affidavit**. All bidders must submit with their bid submission, a completed, signed and properly notarized affidavit in its original format and without alteration in order to be compliant and for the bid to be considered responsive. A scanned copy of the completed, signed and properly notarized affidavit may be submitted with the bid; however, the successful bidder must submit the original affidavit in its original format and without material alteration prior to, or at contract execution. Failure to comply will result in the bid submission being rejected as non-responsive. The Parish reserves the right to award bid to the next lowest responsive and responsible bidder in this event.

The person submitting the bid, and whose authority to submit has been evidenced on the Corporate Resolution is the proper party to execute the **Public Works Bid Affidavit**.

J. BID REQUIREMENTS (BID DOCUMENTS, SPECIFICATIONS, BONDS, W-9 AND PAYMENT INFO)

Bidders must review the bid specifications and include any required documentation including but not limited to the LA Public Works Uniform Bid Form, Bid Security, Corporate Resolution or written evidence of signature authority, and the Public Works Affidavit. Pursuant to LA R.S. 38:2212(B)(3)(b), bidders shall also be responsible for providing any other documentation as required. Please note that the payment and performance bonds must be supplied by the successful bidder at contract signing.

No oral interpretation will be made to any bidder as to the meaning of the drawings, specifications, or contract documents. Every request for such interpretation shall be made in writing and addressed and forwarded to the Engineer, Architect or person distributing plans and specifications. No inquiry received within five (5) days prior to the day fixed for opening of the bids will be given consideration. Every interpretation made to the bidder shall be in the form of an addendum to the specifications and shall be issued as authorized by LA-R.S. 38:2212(O).

All such addenda shall become a part of the contract documents. Failure of any bidder to receive any such interpretation shall not relieve any bidder from any obligation under his bid as submitted without modification.

The specifications and plans are complementary of each other and all work called for or reasonably implied by either shall be performed as if called for by both. In case of conflict between the requirements of the specifications and plans, the specifications shall take precedence. Figured dimensions shall take precedence over scale dimensions, and larger scale details shall take precedence over smaller scale details in the general work drawings.

All vendors submitting bids shall register as a Jefferson Parish vendor, if not already registered. Registration forms may be downloaded from [Vendor Information | Jefferson Parish, LA \(jeffparish.gov\)](http://jeffparish.gov) and click on Vendor Information. Current W-9 forms with respective Tax Identification numbers and vendor applications may be submitted at any time; however, if your company is not registered and/or a current W-9 form is not on file, vendor registration is mandatory. Vendors may experience a delay in payment if your company is not a registered vendor with Jefferson Parish.

Bidders must comply with all provisions of this Notice, the Standard General Conditions of the Construction Contract and any special conditions and specifications contained herein, all of which are made part of this bid proposal. Resolution No. 141125, as amended, will be considered a part of the bid whether attached or not. A copy of these terms and resolutions may be obtained from the Office of the Parish Clerk, Suite 6700, Jefferson Parish General Government Building, 200 Derbigny Street, Gretna, Louisiana 70053. Bidders may also obtain a copy by visiting the Purchasing Department's webpage at [Document Library | Jefferson Parish, LA \(jeffparish.gov\)](http://jeffparish.gov) and clicking on online forms.

Bid Security: Bidders shall provide bid security in the form of an electronic bid bond in the amount of five percent (5%) of the total bid price (Base Bid and any Alternates) (as per R.S. 38:2218). The Bid Security shall remain valid until the contract is executed or until final disposition is made of the bids submitted. Such security will become the property of the Parish in the event the successful bidder fails or refuses to execute the contract or fails to produce performance and payment bonds upon contract signing. Bids shall remain binding for at least forty-five (45) days after the date set for the Bid Opening. In the event the Parish issues the Letter of Award during this period, the bid accepted shall continue to remain binding until the execution of contract. Jefferson Parish and the lowest responsible bidder, by mutual written consent, may agree to extend the deadline for award by one or more extensions of thirty (30) calendar days.

When submitting online, bidders must submit an electronic bid bond through the respective online clearinghouse bond management system(s) as indicated in the electronic bid solicitation on Central Auction House. No scanned paper copies of any bid bond will be accepted as part of the electronic bid submission.

Performance Bond: A performance bond is required in 100% of the contract amount and is due at the signing of the formal contract, unless another percentage is required in the bid specifications. In the event of a conflict between these instructions and the bid specifications, the bid specifications shall control.

Payment Bond: A payment bond is required in 100% of the contract amount and is due at the signing of the formal contract, unless another percentage is required in the bid specifications. In the event of a conflict between these instructions and the bid specifications, the bid specifications shall control.

To the extent permitted by law, the bond requirements as set forth herein are waived insofar as Community Development Housing Rehabilitation Construction Contracts are concerned for single family, owner-occupied dwellings. The Parish Attorney's Office will omit the requirements in connection with Community Development Housing Rehabilitation Construction Contracts for single family, owner-occupied dwellings.

K. INSURANCE REQUIREMENTS

All required insurance under this bid shall conform to Jefferson Parish Resolution No. 141125, as applicable. Contractors may not commence any work under any ensuing contract unless and until all required insurance and associated evidentiary requirements thereto have been met, along with any additional specifications contained in the **Invitation to Bid**. Except as where otherwise precluded by law, the Parish Attorney or her designee, with the concurrence of the Director of Risk Management or her designee, may agree on a case-by-case basis, to deviate from Jefferson Parish's standard insurance requirements, as provided in this Section. **Vendors requesting deviation therefrom shall submit such requests in writing, along with compelling substantiation, to the Purchasing Department prior to the bid's due date.** Any changes to the insurance requirements will be reflected in the bid specifications and addenda. Prior to contract execution and at all times thereafter during the term of such contract, contractors must provide and continuously maintain all coverages as required by the foregoing Resolutions, and the contract documents. Failure to do so shall be grounds for suspension, discontinuation or termination of the contract.

For bidding purposes, bidders must submit with bid submission a current (valid) insurance certificate evidencing the required coverages. **Failure to comply will cause the bid to be rejected.** The current insurance certificate will be used for proof of insurance at time of evaluation. Thereafter, and prior to contract execution, the low bidder will be required to provide final insurance certificates to the Parish which shall name **the Parish of Jefferson, its Districts Departments and Agencies under the direction of the Parish President and the Parish Council** as additional insureds regarding negligence by the contractor for the Commercial General Liability and the Comprehensive Automobile Liability policies. Additionally, said certificates should reflect the name of the Parish Department receiving goods and services and reference the respective Jefferson Parish bid number.

JEFFERSON PARISH REQUIRED STANDARD INSURANCE

☒ WORKER'S COMPENSATION INSURANCE

As required by Worker's Compensation Law of the State of the Contractor's headquarters. Employer's Liability is included, with minimum limits of \$500,000 per occurrence, except it shall be \$1,000,000 per occurrence when Work is to be over water and involves maritime exposures to cover all employees not covered under the State Worker's Compensation Act.

With a Waiver of Subrogation in favor of The Parish of Jefferson, its Districts, Departments, Agencies and Employees under the direction of the Parish President and the Parish Council, and any other entities who may require waivers by specific contract.

Note: If your company is not required by law to carry workmen's compensation insurance, i.e. sole employee of the company, then bidders must request a workmen's compensation insurance declaration affidavit prior to the bid opening date. This insurance declaration affidavit must be fully completed, signed, properly notarized and submitted with the bid. A scanned copy may be submitted with the bid; however, the successful bidder must submit the original affidavit in its original format and without material alteration upon contract execution. Failure to comply will result in the bid submission being rejected as non-responsive. The Parish reserves the right to award bid to the next lowest responsive and responsible bidder in this event.

☒ COMMERCIAL GENERAL LIABILITY

Limits of not less than the following: \$1,000,000.00 Combined Single Limit Per Occurrence; 2 million General Aggregate for bodily injury and property damage.

With a Waiver of Transfer of Rights of Recovery Against Others to Us in favor of The Parish of Jefferson, its Districts, Departments, Agencies and Employees under the direction of the Parish President and the Parish Council.

☒ BUSINESS AUTOMOBILE LIABILITY

Limits of not less than the following: Bodily injury liability \$1,000,000.00 each person; \$1,000,000.00 each occurrence. Property Damage Liability \$1,000,000.00 each occurrence. Liability coverage to be provided for Any Auto or for ALL Owned Autos and Hired and Non-owned Autos.

With a Waiver of Transfer of Rights of Recovery Against Others to Us in favor of The Parish of Jefferson, its Districts, Departments, Agencies and Employees under the direction of the Parish President and the Parish Council.

Note: This category may be omitted if bidders do not/will not utilize vehicles for the project AS DETERMINED BY Risk Management and Parish Attorney's Office after properly requesting a deviation as discussed above. Bidder must request a deviation prior to bid opening and may be given an automobile insurance declaration affidavit to execute. This insurance declaration affidavit must be fully completed, signed, properly notarized and submitted with the bid. A scanned copy of the completed, signed and properly notarized affidavit may be submitted with the bid; however, the successful bidder must submit the original affidavit in its original

format and without material alteration upon contract execution. Failure to comply will result in the bid submission being rejected as non-responsive. The Parish reserves the right to award bid to the next lowest responsive and responsible bidder in this event.

DEDUCTIBLES - The Parish Attorney with concurrence of the Director of Risk Management have waived the deductible section of the Terms and Conditions for all Invitations to Bid, until further notice.

UMBRELLA LIABILITY COVERAGE - An umbrella policy or excess may be used to meet minimum requirements. Certificate of Insurance must state which coverage the Umbrella sits over.

FOR CONSTRUCTION AND RENOVATION PROJECTS:

The following are required if selected below. Such insurance is due upon contract execution.



OWNER'S PROTECTIVE LIABILITY

To be for the same limits of liability for bodily injury and property damage liability established for commercial general liability.



BUILDER'S RISK INSURANCE

The contractor shall maintain Builder's Risk Insurance at his own expense to insure both the owner (Parish of Jefferson) and contractor as their interest may appear.

L. INDEMNIFICATION

Bidder acknowledges that bidder recovered the cost of any required insurance in the contract price as required by LA R.S. 9:2780.1(l) and that bidder recovered any such cost for the purposes of insuring an obligation to indemnify Jefferson Parish, defend Jefferson Parish, or hold Jefferson Parish harmless and that bidder's indemnity liability is limited to the amount of the proceeds that are payable under the insurance policy or policies that bidder has obtained.

M. FAMILIARITY WITH LAWS AND ORDINANCES

Bidders shall familiarize themselves with and shall comply with all applicable Federal and State Laws, Parish/Municipal Ordinances, Resolutions, and the rules and regulations of all authorities having jurisdiction over construction of the project, which may directly or indirectly affect the work or its prosecution.

These laws and/or ordinances will be deemed to be included in the contract, the same as though herein written in full.

In case of conflict between the requirements of these specifications and any State and/or Federal Regulations or Laws, the State and/or Federal Regulations or Laws shall take precedence in all cases in which State and/or Federal Funding of the contract, in whole or in part, depends upon compliance with said State and/or Federal Regulations or Laws.

N. MISCELLANEOUS

The successful bidder may be required to furnish a statement of the origin, composition, and manufacture of materials to be used in construction of the work together with samples, which samples may be subjected to testing to determine their quality and fitness for the work, as specified.

Bidders are not to exclude from participation in, deny the benefits of, or subject to discrimination under any program or activity, any person in the United States on the grounds of race, color, national origin, sex or religion except that any exemption from such prohibition against discrimination on the basis of religion as provided in the Civil Rights Acts of 1964, or Title VI and VII of the Act of April 11, 1968 shall also apply, as amended; nor discriminate on the basis of age under the Age Discrimination Act of 1975, as amended; nor with respect to an otherwise qualified handicapped individual as provided in Section 504 of the Rehabilitation Act of 1973, as amended. This assurance includes compliance with the administrative requirements of the Revenue Sharing final handicapped discrimination provisions contained in Section 51.55 (c), (d), (e), and (k) (5) of the Regulations.

Non-negotiable contract terms include but are not limited to taxes, assignment of contract, audit of records, EEOC and ADA compliance, record retention, content of contract/order of precedence, contract changes, force majeure, governing law, including ethics statements, claims or controversies, and termination based on contingency of appropriation of funds, as applicable.

LOUISIANA UNIFORM PUBLIC WORK BID FORM

TO: Jefferson Parish Purchasing
200 Derbigny Street, Suite 4400
Gretna, LA 70053

(Owner to provide name and address of owner)

BID FOR: Jefferson Parish Recreation Department
Eastbank Main Office Generator Project
Project No: 23015
Bid No. 50-00147321

(Owner to provide name of project and other identifying information)

The undersigned bidder hereby declares and represents that she/he: a) has carefully examined and understands the Bidding Documents, b) has not received, relied on, or based his bid on any verbal instructions contrary to the Bidding Documents or any addenda, c) has personally inspected and is familiar with the project site, and hereby proposes to provide all labor, materials, tools, appliances and facilities as required to perform, in a workmanlike manner, all work and services for the construction and completion of the referenced project, all in strict accordance with the Bidding Documents prepared by: Ellis Engineering, LLC and dated: December 23, 2024

(Owner to provide name of entity preparing bidding documents.)

Bidders must acknowledge all addenda. The Bidder acknowledges receipt of the following **ADDENDA:** (Enter the number the Designer has assigned to each of the addenda that the Bidder is acknowledging) _____

TOTAL BASE BID: For all work required by the Bidding Documents (including any and all unit prices designated "Base Bid" * but not alternates) the sum of:

_____ Dollars (\$ _____)

ALTERNATES: For any and all work required by the Bidding Documents for Alternates including any and all unit prices designated as alternates in the unit price description.

Alternate No. 1 *(Owner to provide description of alternate and state whether add or deduct)* for the lump sum of:

N/A _____ Dollars (\$ _____)

Alternate No. 2 *(Owner to provide description of alternate and state whether add or deduct)* for the lump sum of:

N/A _____ Dollars (\$ _____)

Alternate No. 3 *(Owner to provide description of alternate and state whether add or deduct)* for the lump sum of:

N/A _____ Dollars (\$ _____)

NAME OF BIDDER: _____

ADDRESS OF BIDDER: _____

LOUISIANA CONTRACTOR'S LICENSE NUMBER: _____

NAME OF AUTHORIZED SIGNATORY OF BIDDER: _____

TITLE OF AUTHORIZED SIGNATORY OF BIDDER: _____

SIGNATURE OF AUTHORIZED SIGNATORY OF BIDDER **: _____

DATE: _____

THE FOLLOWING ITEMS ARE TO BE INCLUDED WITH THE SUBMISSION OF THIS LOUISIANA UNIFORM PUBLIC WORK BID FORM:

* The Unit Price Form shall be used if the contract includes unit prices. Otherwise it is not required and need not be included with the form. The number of unit prices that may be included is not limited and additional sheets may be included if needed.


** **A CORPORATE RESOLUTION OR WRITTEN EVIDENCE** of the authority of the person signing the bid for the public work as prescribed by LA R.S. 38:2212(B)(5).

BID SECURITY in the form of a bid bond, certified check or cashier's check as prescribed by LA R.S. 38:2218(A) attached to and made a part of this bid.

Bid Bond

An Electronic Bid Bond must be submitted with this bid, through one of the respective clearing houses at <https://www.centralbidding.com/bid-bonds/>. To access the bonding companies on Central Bidding, hover over the “Central Bidding” link at the top of the page and select the “Bid Bonds” link.

The electronic bid bond number is to be placed in the required section listed on the standard envelope. Scanned copies of bid bonds will not be accepted with your submission.

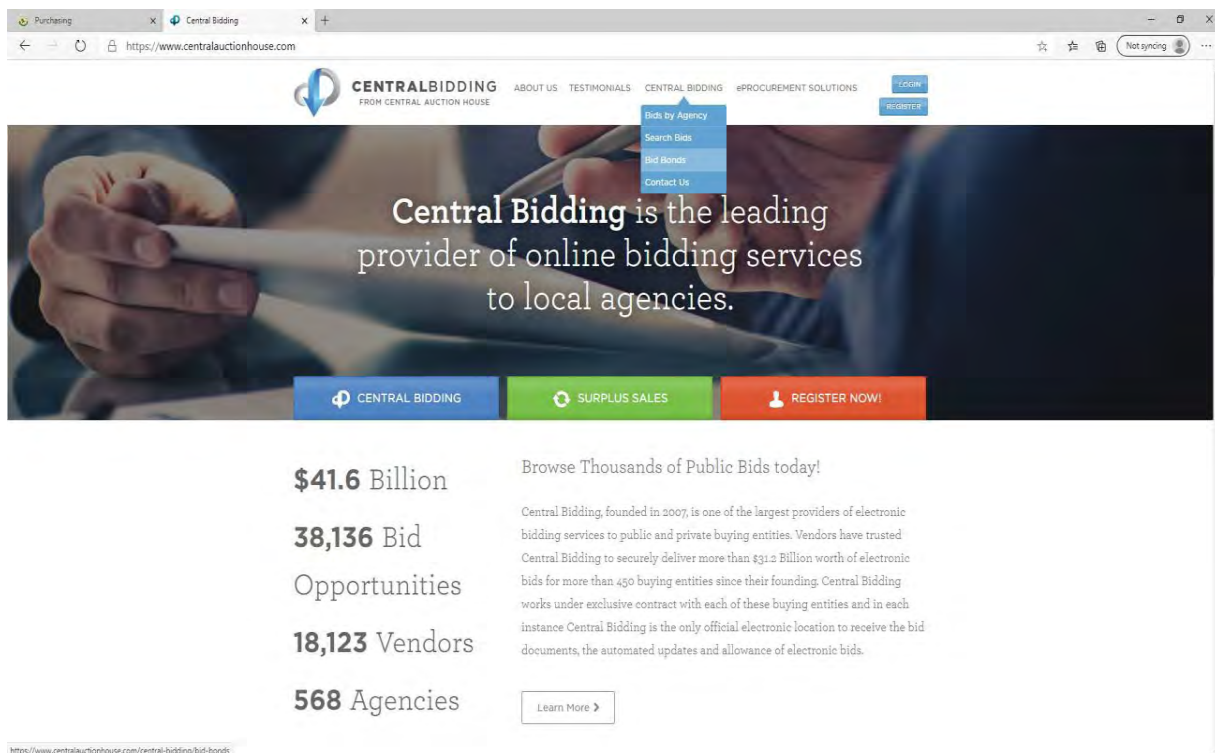

The screenshot shows the Central Bidding website interface. The browser address bar displays <https://www.centralauctionhouse.com>. The website header includes the Central Bidding logo and navigation links: ABOUT US, TESTIMONIALS, CENTRAL BIDDING, and #PROCUREMENT SOLUTIONS. A dropdown menu is open under the CENTRAL BIDDING link, showing options: Bids by Agency, Search Bids, Bid Bonds, and Contact Us. The main banner features the text: "Central Bidding is the leading provider of online bidding services to local agencies." Below the banner are three buttons: CENTRAL BIDDING, SURPLUS SALES, and REGISTER NOW!. The page content includes statistics: \$41.6 Billion, 38,136 Bid Opportunities, 18,123 Vendors, and 568 Agencies. A text block states: "Browse Thousands of Public Bids today!" and "Central Bidding, founded in 2007, is one of the largest providers of electronic bidding services to public and private buying entities. Vendors have trusted Central Bidding to securely deliver more than \$31.2 Billion worth of electronic bids for more than 450 buying entities since their founding. Central Bidding works under exclusive contract with each of these buying entities and in each instance Central Bidding is the only official electronic location to receive the bid documents, the automated updates and allowance of electronic bids." A "Learn More" button is located below this text. The footer shows the URL: <https://www.centralauctionhouse.com/central-bidding/bid-bonds>.

\$41.6 Billion

38,136 Bid Opportunities

18,123 Vendors

568 Agencies

Browse Thousands of Public Bids today!

Central Bidding, founded in 2007, is one of the largest providers of electronic bidding services to public and private buying entities. Vendors have trusted Central Bidding to securely deliver more than \$31.2 Billion worth of electronic bids for more than 450 buying entities since their founding. Central Bidding works under exclusive contract with each of these buying entities and in each instance Central Bidding is the only official electronic location to receive the bid documents, the automated updates and allowance of electronic bids.

[Learn More](#)

<https://www.centralauctionhouse.com/central-bidding/bid-bonds>

FORM OF PERFORMANCE BOND

KNOW ALL MEN BY THESE PRESENTS:

That we, _____, a _____,
(Name of Contractor)
hereinafter called "Principal", and _____, State
(Surety)
of _____, hereinafter called the "Surety", are held and firmly bound unto
_____, of _____,
(Owner) (City and State)
hereinafter called "Owner", in the penal sum of _____
Dollars (\$) in lawful money of the United States, for the payment of which sum
well and truly to be made, we bind ourselves, our heirs, executors, administrators, and
successors, jointly and severally, firmly by these presents.

THE CONDITION OF THIS OBLIGATION is such that Whereas, the Principal entered
into a certain contract with the Owner, dated the _____ day of _____,
20__, a copy of which is hereto attached and made a part hereof for the construction of:

EASTBANK OFFICE GENERATOR
6921 SAINTS DR, METAIRIE, LA 70003

NOW, THEREFORE, if the Principal shall well, truly and faithfully perform its duties, all
the undertakings, covenants, terms, conditions, and agreements of said contract during the
original term thereof, and any extensions thereof which may be granted by the Owner, with or
without notice to the Surety, and if he shall satisfy all claims and demands incurred under such
contract, and shall fully indemnify and save harmless the Owner from all costs and damages
which it may suffer by reason of failure to do so, and shall reimburse and repay the Owner all

FORM OF PERFORMANCE BOND (continued)

outlay and expense which the Owner may incur in making good any default in connection with the construction of such work, and all insurance premiums on said work, whether by sub-contractor or otherwise, then this obligation shall be void; otherwise to remain in full force and effect.

PROVIDED, FURTHER, that the said Surety, for value received, hereby stipulates and agrees that no change, extension of time, alteration or addition to the terms of the contract or to the work to be performed thereunder or the specifications accompanying the same shall in any wise affect its obligation on this bond, and it does hereby waive notice of any such change, extension of time, alteration or addition to the terms of the contract or to the work or to the specifications.

PROVIDED, FURTHER, that no final settlement between the Owner and the Contractor shall abridge the right of any beneficiary hereunder, whose claim may be unsatisfied.

IN WITNESS WHEREOF, this instrument is executed in _____ counterparts, each one of which shall be deemed an original, this the _____ day of _____, 20__.

WITNESSES:

_____ _____ _____	_____ (Principal) _____ Title: _____ _____ (Surety) By: _____ (Attorney-in-fact) _____ (Address)
---------------------------------	---

NOTE: Date of Bond must not be prior to date of Contract. If Contractor is Partnership, all partners should execute bond.

FORM OF LABOR AND MATERIALS PAYMENT BOND

KNOW ALL MEN BY THESE PRESENT: that

(Name of Contractor)

(Address of Contractor)

a _____ hereinafter called Principal,

and _____
(Name of Surety)

(Address of Surety)

hereinafter called Surety, all held and firmly bound unto the Parish of Jefferson hereinafter called Owner, in the penal sum of _____ Dollar (\$)) in lawful money of the United States, for the payment of which sum well and truly be made, we bind ourselves, successors, and assigns, jointly and severally, firmly by these presents.

THE CONDITION OF THIS OBLIGATION is such that whereas, the Principal entered into a certain contract with the Owner, dated the _____ day of _____, 20__, a copy of which is hereto attached and made a part hereof for the construction of:

EASTBANK OFFICE GENERATOR
6921 SAINTS DR, METAIRIE, LA 70003

NOW, THEREFORE, if the Principal shall promptly make payment to all persons, firms, subcontractors, and corporations furnishing materials for or performing labor in the prosecution of the work provided for in such contract, and any authorized extension or modification thereof, including all amounts due for materials, lubricants, oil, gasoline, coal and coke, repairs on machinery, equipment and tools, consumed or used in connection with the construction of such work, and all insurance premiums on said work, and for all labor, performed in such work whether by subcontractor or otherwise, then this obligation shall be void; otherwise to remain in full force and effect.

FORM OF LABOR AND MATERIALS PAYMENT BOND (Continued)

PROVIDED, FURTHER, that the said Surety, for the value received, hereby stipulates and agrees that no change, extension of time, alteration or addition to the terms of the contract or to the work to be performed thereunder or to the specifications accompanying the same shall in anywise affect its obligation on this bond, and it does hereby waive notice of any such change, extension of time, alteration or addition to the terms of the contract or to the specifications.

PROVIDED, FURTHER, that no final settlement between Owner and the Contractor shall abridge the right of any beneficiary hereunder, whose claim may be unsatisfied.

IN WITNESS WHEREOF, this instrument is executed in _____ counterparts, each of which shall be deemed an original, this _____ day of _____, 20__.

ATTEST:

(SEAL)

Witness as to Principal

Address

ATTEST:

(SEAL)

Address

Principal

BY: _____

ADDRESS: _____

Surety

BY: _____

ADDRESS: _____

NOTE: DATE OF BOND must not be prior to date of Contract:

1. Correct Name of Contractor
2. A Corporation, A Partnership, or an Individual
3. Correct Name of Surety

Public Works Bid Affidavit Instructions

- **Affidavit is supplied as a courtesy to Affiants, but it is the responsibility of the affiant to insure the affidavit they submit to Jefferson Parish complies, in both form and content, with federal, state and parish laws.**
- **Affidavit must be signed by an authorized representative of the entity or the affidavit will not be accepted.**
- **Affidavit must be notarized or the affidavit will not be accepted.**
- **Notary must sign name, print name, and include bar/notary number, or the affidavit will not be accepted.**
- **Affiant MUST select either A or B when required or the affidavit will not be accepted.**
- **Affiants who select choice A must include an attachment or the affidavit will not be accepted.**
- **If both choice A and B are selected, the affidavit will not be accepted.**
- **Affidavit marked N/A will not be accepted.**
- **It is the responsibility of the Affiant to submit a new affidavit if any additional campaign contributions are made after the affidavit is executed but prior to the time the council acts on the matter.**

Instruction sheet may be omitted when submitting the affidavit

Public Works Bid

AFFIDAVIT

STATE OF _____

PARISH/COUNTY OF _____

BEFORE ME, the undersigned authority, personally came and appeared: _____
_____, (Affiant) who after being by me duly sworn, deposed and said that
he/she is the fully authorized _____ of _____ (Entity),
the party who submitted a bid in response to Bid Number _____, to the Parish of
Jefferson.

Affiant further said:

Campaign Contribution Disclosures

(Choose A or B, if option A is indicated please include the required attachment):

Choice A _____ Attached hereto is a list of all campaign contributions, including the date and amount of each contribution, made to current or former elected officials of the Parish of Jefferson by Entity, Affiant, and/or officers, directors and owners, including employees, owning 25% or more of the Entity during the two-year period immediately preceding the date of this affidavit or the current term of the elected official, whichever is greater. Further, Entity, Affiant, and/or Entity Owners have not made any contributions to or in support of current or former members of the Jefferson Parish Council or the Jefferson Parish President through or in the name of another person or legal entity, either directly or indirectly.

Choice B _____ there are **NO** campaign contributions made which would require disclosure under Choice A of this section.

Affiant further said:

Debt Disclosures

(Choose A or B, if option A is indicated please include the required attachment):

Choice A _____ Attached hereto is a list of all debts owed by the affiant to any elected or appointed official of the Parish of Jefferson, and any and all debts owed by any elected or appointed official of the parish to the Affiant.

Choice B _____ There are **NO** debts which would require disclosure under Choice A of this section.

Affiant further said:

That Affiant has employed no person, corporation, firm, association, or other organization, either directly or indirectly, to secure the public contract under which he received payment, other than persons regularly employed by the Affiant whose services in connection with the construction, alteration or demolition of the public building or project or in securing the public contract were in the regular course of their duties for Affiant; and

That no part of the contract price received by Affiant was paid or will be paid to any person, corporation, firm, association, or other organization for soliciting the contract, other than the payment of their normal compensation to persons regularly employed by the Affiant whose services in connection with the construction, alteration or demolition of the public building or project were in the regular course of their duties for Affiant.

Affiant further said:

Affiant personally has not been convicted of, nor has he/she entered into a plea of guilty or nolo contendere to any of the crimes or equivalent federal crimes listed below. No individual partner, incorporator, director, manager, officer, organizer, or member, who has a minimum of a ten percent ownership in the Bidding Entity, has been convicted of, or has entered a plea of guilty or nolo contendere to any of the crimes or equivalent federal crimes listed below. A conviction of or plea of guilty or nolo contendere to the following state crimes or equivalent federal crimes shall permanently bar any person or the bidding entity from bidding on public projects:

- (a) Public bribery (R.S. 14:118)
- (b) Corrupt influencing (R.S. 14:120)
- (c) Extortion (R.S. 14:66)
- (d) Money laundering (R.S. 14:230)

A conviction of or plea of guilty or nolo contendere to the following state crimes or equivalent federal crimes shall bar any person or the bidding entity from bidding on public projects for a period of five years from the date of conviction or from the date of the entrance of the plea of guilty or nolo contendere:

- (a) Theft (R.S. 14:67)
- (b) Identity Theft (R.S. 14:67, 16)
- (c) Theft of a business record (R.S. 14:67.20)
- (d) False accounting (R.S. 14:70)
- (e) Issuing worthless checks (R.S. 14:71)
- (f) Bank fraud (R.S. 14:71.1)
- (g) Forgery (R.S. 14:72)
- (h) Contractors; misapplication of payments (R.S. 14:202)
- (i) Malfeasance in office (R.S. 14:134)

The five-year prohibition provided for in this section shall apply only if the crime was committed during the solicitation or execution of a contract or bid awarded pursuant to these provisions. If evidence is submitted substantiating that a false attestation has been made and the project must be readvertised or the contract cancelled, the awarded entity making the false attestation shall be responsible to the public entity for the costs of rebidding, additional costs due to increased costs of bids and any and all delay costs due to the rebid or cancellation of this project.

[The remainder of this page is intentionally left blank.]

Affiant further said:

- (1) Entity is registered and participates in a status verification system to verify that all employees in the State of Louisiana are legal citizens of the United States or are legal aliens.
- (2) Entity shall continue, during the term of the contract, to utilize a status verification system to verify the legal status of all new employees in the State of Louisiana.
- (3) Entity shall require all subcontractors to submit to the Entity a sworn affidavit verifying compliance with statements (1) and (2).

Signature of Affiant

Printed Name of Affiant

SWORN AND SUBSCRIBED TO BEFORE ME

ON THE _____ DAY OF _____, 20____.

Notary Public

Printed Name of Notary

Notary/Bar Roll Number

My commission expires _____.

CORPORATE RESOLUTION

EXCERPT FROM MINUTES OF MEETING OF THE BOARD OF DIRECTORS OF

INCORPORATED.

AT THE MEETING OF DIRECTORS OF _____
INCORPORATED, DULY NOTICED AND HELD ON _____,
A QUORUM BEING THERE PRESENT, ON MOTION DULY MADE AND SECONDED. IT
WAS:

RESOLVED THAT _____, BE AND IS HEREBY
APPOINTED, CONSTITUTED AND DESIGNATED AS AGENT AND ATTORNEY-IN-
FACT OF THE CORPORATION WITH FULL POWER AND AUTHORITY TO ACT ON
BEHALF OF THIS CORPORATION IN ALL NEGOTIATIONS, BIDDING, CONCERNS
AND TRANSACTIONS WITH THE PARISH OF JEFFERSON OR ANY OF ITS AGENCIES,
DEPARTMENTS, EMPLOYEES OR AGENTS, INCLUDING BUT NOT LIMITED TO, THE
EXECUTION OF ALL BIDS, PAPERS, DOCUMENTS, AFFIDAVITS, BONDS, SURETIES,
CONTRACTS AND ACTS AND TO RECEIVE ALL PURCHASE ORDERS AND NOTICES
ISSUED PURSUANT TO THE PROVISIONS OF ANY SUCH BID OR CONTRACT, THIS
CORPORATION HEREBY RATIFYING, APPROVING, CONFIRMING, AND ACCEPTING
EACH AND EVERY SUCH ACT PERFORMED BY SAID AGENT AND ATTORNEY-IN-
FACT.

I HEREBY CERTIFY THE FOREGOING TO BE
A TRUE AND CORRECT COPY OF AN
EXCERPT OF THE MINUTES OF THE ABOVE
DATED MEETING OF THE BOARD OF
DIRECTORS OF SAID CORPORATION, AND
THE SAME HAS NOT BEEN REVOKED OR
RESCINDED.

SECRETARY-TREASURER

DATE



**Designation of Construction Contractor
as Agent of a Governmental Entity
Sales Tax Exemption Certificate**

_____, an agency of the United States government, or an agency, board, commission, or instrumentality of the State of Louisiana or its political subdivisions, including parishes, municipalities and school boards, does hereby designate the following contractor as its agent for the purpose of making sales tax exempt purchases on behalf of the governmental body:

Name of Contractor		
Address		
City	State	ZIP

This designation of agency shall be effective for purchases of component construction materials, taxable services and leases and rentals of tangible personal property for the following named construction project:

Construction Project	Contract Number
----------------------	-----------------

This designation and acceptance of agency is effective for the period

Beginning Date (mm/dd/yyyy)	End Date (mm/dd/yyyy)
-----------------------------	-----------------------

Purchases for the named project during this period by the designated contractor shall be considered as the legal equivalent of purchases directly by the governmental body. Any materials purchased by this agent shall immediately, upon the vendor’s delivery to the agent, become the property of this government entity. This government entity, as principal, assumes direct liability to the vendor for the payment of any property, services, leases, or rentals made by this designated agent. This agreement does not void or supersede the obligations of any party created under any construction contract related to this project, including specifically any contractual obligation of the construction contractor to submit payment to the vendors of materials or services for the project.

This contractor-agent is not authorized to delegate this purchasing agency to others; separate designations of agency by this governmental entity are required for each contractor or sub-contractor who is to purchase on behalf of this governmental entity. The undersigned hereby certify that this designation is the entirety of the agency designation agreement between them. In order for a purchase for an eligible governmental entity through a designated agent to be eligible for sales tax exemption, the designation of agency must be made, accepted, and disclosed to the vendor before or at the time of the purchase transaction.

Designation of Agency			Acceptance of Agency		
Signature of Authorized Designator		Date (mm/dd/yyyy)	Signature of Contractor or Subcontractor Authorized Acceptor		Date (mm/dd/yyyy)
Name of Authorized Designator			Name of Contractor's or Subcontractor's Acceptor		
Name of Governmental Entity			Name of Contractor		
Address			Address		
City	State	ZIP	City	State	ZIP

This designation of agency form, when properly executed by both the contractor and the governmental entity, shall serve as evidence of the sales tax exempt status that has been conferred onto the contractor. No other exemption certificate form is necessary to claim exemption from sales taxes. The agency agreement evidenced by this sales tax exemption certificate must be implemented at the time of contract execution with the governmental entity. The contract between the governmental entity and his agent must contain provisions to authenticate the conferment of agency.

This document has important legal consequences; consultation with an attorney is encouraged with respect to its use or modification. This document should be adapted to the particular circumstances of the contemplated Project and the controlling Laws and Regulations.

RESOLUTION 141125
STANDARD GENERAL CONDITIONS
OF THE CONSTRUCTION CONTRACT

Prepared By



Endorsed By



Copyright© 2018

National Society of Professional Engineers
1420 King Street, Alexandria, VA 22314-2794
(703) 684-2882
www.nspe.org

American Council of Engineering Companies
1015 15th Street N.W., Washington, DC 20005
(202) 347-7474
www.acec.org

American Society of Civil Engineers
1801 Alexander Bell Drive, Reston, VA 20191-4400
(800) 548-2723
www.asce.org

The copyright for this EJCDC document is owned jointly by the three sponsoring organizations listed above. The National Society of Professional Engineers is the Copyright Administrator for the EJCDC documents; please direct all inquiries regarding EJCDC copyrights to NSPE.

NOTE: EJCDC publications may be purchased at www.ejcdc.org, or from any of the sponsoring organizations above.

STANDARD GENERAL CONDITIONS OF THE CONSTRUCTION CONTRACT

TABLE OF CONTENTS

	Page
Article 1—Definitions and Terminology.....	1
1.01 Defined Terms.....	1
1.02 Terminology	6
Article 2—Preliminary Matters	8
2.01 Delivery of Performance and Payment Bonds; Evidence of Insurance; Recordation of Contract Documents	8
2.02 Copies of Documents	8
2.03 Before Starting Construction	9
2.04 Preconstruction Conference; Designation of Authorized Representatives	9
2.05 Acceptance of Schedules	9
2.06 Electronic Transmittals.....	10
Article 3—Contract Documents: Intent, Requirements, Reuse.....	10
3.01 Intent.....	10
3.02 Reference Standards.....	11
3.03 Reporting and Resolving Discrepancies	12
3.04 Requirements of the Contract Documents	12
3.05 Reuse of Documents	13
Article 4—Commencement and Progress of the Work	13
4.01 Commencement of Contract Times; Notice to Proceed	13
4.02 Starting the Work.....	14
4.03 Reference Points	14
4.04 Progress Schedule	14
4.05 Delays in Contractor’s Progress	14
Article 5—Site; Subsurface and Physical Conditions; Hazardous Environmental Conditions	16
5.01 Availability of Lands	16
5.02 Use of Site and Other Areas	16
5.03 Subsurface and Physical Conditions.....	17
5.04 Differing Subsurface or Physical Conditions	18

5.05	Underground Facilities	20
5.06	Hazardous Environmental Conditions at Site	22
Article 6—Bonds and Insurance.....		24
6.01	Performance, Payment, and Other Bonds	24
6.02	Insurance—General Provisions	25
6.03	Contractor’s Insurance	27
6.04	Builder’s Risk and Other Property Insurance	31
6.05	Property Losses; Subrogation	32
6.06	Receipt and Application of Property Insurance Proceeds	33
Article 7—Contractor’s Responsibilities		34
7.01	Contractor’s Means and Methods of Construction	34
7.02	Supervision and Superintendence	34
7.03	Labor; Working Hours	34
7.04	Services, Materials, and Equipment.....	35
7.05	“Or Equals”	35
7.06	Substitutes	36
7.07	Concerning Subcontractors and Suppliers	38
7.08	Patent Fees and Royalties	39
7.09	Permits	40
7.10	Taxes	40
7.11	Laws and Regulations.....	40
7.12	Record Documents.....	41
7.13	Safety and Protection.....	41
7.14	Hazard Communication Programs	42
7.15	Emergencies.....	43
7.16	Submittals	43
7.17	Contractor’s General Warranty and Guarantee	45
7.18	Indemnification	46
7.19	Delegation of Professional Design Services	47
Article 8—Other Work at the Site.....		48
8.01	Other Work	48
8.02	Coordination	49
8.03	Legal Relationships.....	49

Article 9—Owner’s Responsibilities	50
9.01 Communications to Contractor.....	50
9.02 Replacement of Engineer	50
9.03 Furnish Data	50
9.04 Pay When Due.....	50
9.05 Lands and Easements; Reports, Tests, and Drawings	50
9.06 Insurance.....	51
9.06 Change Orders	51
9.07 Inspections, Tests, and Approvals.....	51
9.08 Limitations on Owner’s Responsibilities	51
9.09 Undisclosed Hazardous Environmental Condition.....	51
9.11 Evidence of Financial Arrangements.....	51
9.10 NEW: Safety Programs	51
Article 10—Engineer’s Status During Construction	51
10.01 Owner’s Representative.....	51
10.02 Visits to Site.....	52
10.03 Resident Project Representative.....	52
10.04 Engineer’s Authority	52
10.05 Determinations for Unit Price Work	52
10.06 Decisions on Requirements of Contract Documents and Acceptability of Work	53
10.07 Limitations on Engineer’s Authority and Responsibilities	53
10.08 Compliance with Safety Program.....	53
Article 11—Changes to the Contract	53
11.01 Amending and Supplementing the Contract	53
11.02 Change Orders	54
11.03 Work Change Directives.....	54
11.04 Field Orders.....	55
11.05 Owner-Authorized Changes in the Work	55
11.06 Unauthorized Changes in the Work.....	55
11.07 Change of Contract Price	55
11.08 Change of Contract Times.....	57
11.09 Change Proposals.....	57
11.10 Notification to Surety.....	58

Article 12—Claims.....	58
12.01 Claims.....	58
Article 13—Cost of the Work; Allowances; Unit Price Work	60
13.01 Cost of the Work	60
13.02 Allowances	64
13.03 Unit Price Work.....	64
Article 14—Tests and Inspections; Correction, Removal, or Acceptance of Defective Work	66
14.01 Access to Work.....	66
14.02 Tests, Inspections, and Approvals.....	66
14.03 Defective Work	67
14.04 Acceptance of Defective Work.....	67
14.05 Uncovering Work	67
14.06 Owner May Stop the Work	68
14.07 Owner May Correct Defective Work.....	68
Article 15—Payments to Contractor; Set-Offs; Completion; Correction Period	69
15.01 Progress Payments.....	69
15.02 Contractor’s Warranty of Title	73
15.03 Substantial Completion.....	73
15.04 Partial Use or Occupancy	74
15.05 Final Inspection	75
15.06 Final Payment.....	75
15.07 Waiver of Claims	77
15.08 Correction Period.....	77
Article 16—Suspension of Work and Termination	78
16.01 Owner May Suspend Work	78
16.02 Owner May Terminate for Cause.....	78
16.03 Owner May Terminate for Convenience.....	80
16.04 Contractor May Stop Work or Terminate	80
Article 17—INTENTIONALLY OMITTED	80
Article 18—Miscellaneous	80
18.01 Giving Notice	80
18.02 Computation of Times.....	81
18.03 Cumulative Remedies	81

18.04	Limitation of Damages	81
18.05	No Waiver	81
18.06	Survival of Obligations	81
18.07	Controlling Law	82
18.08	Assignment of Contract.....	82
18.09	Successors and Assigns	82
18.10	Headings.....	82
	Supplementary Conditions of the Construction Contract.....	83
	EXHIBIT A - Duties, Responsibilities and Limitations of Authority of Resident Project Representative.....	92
	Form of Agreement.....	96

STANDARD GENERAL CONDITIONS OF THE CONSTRUCTION CONTRACT

ARTICLE 1—DEFINITIONS AND TERMINOLOGY

1.01 *Defined Terms*

- A. Wherever used in the Bidding Requirements or Contract Documents, a term printed with initial capital letters, including the term's singular and plural forms, will have the meaning indicated in the definitions below. In addition to terms specifically defined, terms with initial capital letters in the Contract Documents include references to identified articles and paragraphs, and the titles of other documents or forms.
1. *Addenda*—Written or graphic instruments issued prior to the opening of Bids which clarify, correct, or change the Bidding Requirements or the proposed Contract Documents.
 2. *Agreement*—The written instrument, executed by Owner and Contractor, that sets forth the Contract Price and Contract Times, identifies the parties and the Engineer, and designates the specific items that are Contract Documents.
 3. *Application for Payment*—The document prepared by Contractor, in a form acceptable to Engineer, to request progress or final payments, and which is to be accompanied by such supporting documentation as is required by the Contract Documents.
 4. *Bid*—The offer of a Bidder submitted on the prescribed form setting forth the prices for the Work to be performed.
 5. *Bidder*—An individual or entity that submits a Bid to Owner.
 6. *Bidding Documents*—The Bidding Requirements, the proposed Contract Documents, and all Addenda.
 7. *Bidding Requirements*—The Advertisement or invitation to bid, Instructions to Bidders, Bid Bond or other Bid security, if any, the Bid Form, and the Bid with any attachments.
 8. Bonds---Performance and payment bonds and other instruments of security.
 9. *Change Order*—A document which is signed by Contractor and Owner and authorizes an addition, deletion, or revision in the Work or an adjustment in the Contract Price or the Contract Times, or other revision to the Contract, issued on or after the Effective Date of the Contract.
 10. *Change Proposal*—A written request by Contractor, duly submitted in compliance with the procedural requirements set forth herein, seeking an adjustment in Contract Price or Contract Times; contesting an initial decision by Engineer concerning the requirements of the Contract Documents or the acceptability of Work under the Contract Documents; challenging a set-off against payments due; or seeking other relief with respect to the terms of the Contract.

11. *Claim*

- a. A demand or assertion by Owner directly to Contractor, duly submitted in compliance with the procedural requirements set forth herein, seeking an adjustment of Contract Price or Contract Times; contesting an initial decision by Engineer concerning the requirements of the Contract Documents or the acceptability of Work under the Contract Documents; contesting Engineer's decision regarding a Change Proposal; seeking resolution of a contractual issue that Engineer has declined to address; or seeking other relief with respect to the terms of the Contract.
- b. A demand or assertion by Contractor directly to Owner, duly submitted in compliance with the procedural requirements set forth herein, contesting Engineer's decision regarding a Change Proposal, or seeking resolution of a contractual issue that Engineer has declined to address.
- c. A demand or assertion by Owner or Contractor, duly submitted in compliance with the procedural requirements set forth herein, made pursuant to Paragraph 12.01.A.4, concerning disputes arising after Engineer has issued a recommendation of final payment.
- d. A demand for money or services by a third party is not a Claim.

12. *Constituent of Concern*—Asbestos (any material that contains more than one percent asbestos and is friable or is releasing asbestos fibers into the air above current action levels established by the United States Occupational Safety and Health Administration), petroleum (including crude oil or any fraction thereof which is liquid at standard conditions of temperature and pressure [60 degrees Fahrenheit and 14.7 pounds per square inch absolute], such as oil, petroleum, fuel oil, oil sludge, oil refuse, gasoline, kerosene, and oil mixed with other non-Hazardous Waste and crude oils), radioactive materials (source, special nuclear, or byproduct material as defined by the Atomic Energy Act of 1954 [42 USC Section 2011 et seq.] as amended from time to time), polychlorinated biphenyls (PCBs), lead-based paint (as defined by the HUD/EPA standard), hazardous waste (as defined in Section 1004 of the Solid Waste Disposal Act (42 USC Section 6903) as amended from time to time), and any substance, product, waste, or other material of any nature whatsoever that is or becomes listed, regulated, or addressed pursuant to Laws and Regulations regulating, relating to, or imposing liability or standards of conduct concerning, any hazardous, toxic, or dangerous waste, substance, or material.

13. *Contract*—The entire and integrated written contract between Owner and Contractor concerning the Work.

14. *Contract Documents*—Those items so designated in the Agreement, and which together comprise the Contract.

15. *Contract Price*—The money that Owner has agreed to pay Contractor for completion of the Work in accordance with the Contract Documents.

16. *Contract Times*—The number of days or the dates by which Contractor shall: (a) achieve Milestones, if any; (b) achieve Substantial Completion; and (c) complete the Work.

17. *Contractor*—The individual or entity with which Owner has contracted for performance of the Work.

18. *Cost of the Work*—See Paragraph 13.01 for definition.

19. *Drawings*—The part of the Contract that graphically shows the scope, extent, and character of the Work to be performed by Contractor.
20. *Effective Date of the Contract*—The date, indicated in the Agreement, on which the Contract becomes effective.
21. *Electronic Document*—Any Project-related correspondence, attachments to correspondence, data, documents, drawings, information, or graphics, including but not limited to Shop Drawings and other Submittals, that are in an electronic or digital format.
22. *Electronic Means*—Electronic mail (email), upload/download from a secure Project website, or other communications methods that allow: (a) the transmission or communication of Electronic Documents; (b) the documentation of transmissions, including sending and receipt; (c) printing of the transmitted Electronic Document by the recipient; (d) the storage and archiving of the Electronic Document by sender and recipient; and (e) the use by recipient of the Electronic Document for purposes permitted by this Contract. Electronic Means does not include the use of text messaging, or of Facebook, Twitter, Instagram, or similar social media services for transmission of Electronic Documents.
23. *Engineer*—The individual or entity named as such in the Agreement.
24. *Field Order*—A written order issued by Engineer which requires minor changes in the Work but does not change the Contract Price or the Contract Times.
25. *Force Account*—Payment for directed construction work based on the cost of labor, equipment, materials furnished, overhead, and profit.
26. *Hazardous Environmental Condition*—The presence at the Site of Constituents of Concern in such quantities or circumstances that may present a danger to persons or property exposed thereto.
- a. The presence at the Site of materials that are necessary for the execution of the Work, or that are to be incorporated into the Work, and that are controlled and contained pursuant to industry practices, Laws and Regulations, and the requirements of the Contract, is not a Hazardous Environmental Condition.
 - b. The presence of Constituents of Concern that are to be removed or remediated as part of the Work is not a Hazardous Environmental Condition.
 - c. The presence of Constituents of Concern as part of the routine, anticipated, and obvious working conditions at the Site, is not a Hazardous Environmental Condition.
27. *Laws and Regulations; Laws or Regulations*—Any and all applicable laws, statutes, rules, regulations, ordinances, codes, and binding decrees, resolutions, and orders of any and all governmental bodies, agencies, authorities, and courts having jurisdiction.
28. *Liens*—Charges, security interests, or encumbrances upon Contract-related funds, real property, or personal property.
29. *Milestone*—A principal event in the performance of the Work that the Contract requires Contractor to achieve by an intermediate completion date, or by a time prior to Substantial Completion of all the Work.

30. *Notice of Award*— ~~The written notice by Owner to a Bidder of Owner's acceptance of the Bid.~~ The written notice by Owner to the apparent successful bidder stating that upon timely compliance by the apparent successful bidder with the conditions precedent listed therein, Owner will sign and deliver the Agreement to the successful bidder. However, the Notice of Award shall not be construed as an agreement, meeting of the minds, contract, or any other legal obligation between the Owner and Contractor. Until the Contractor receives a Notice to Proceed from the Owner, the Contractor has no right or remedy against the Owner.
31. *Notice to Proceed*—A written notice by Owner to Contractor fixing the date on which the Contract Times will commence to run and on which Contractor shall start to perform the Work.
32. *Owner*—The individual or entity with which Contractor has contracted regarding the Work, and which has agreed to pay Contractor for the performance of the Work, pursuant to the terms of the Contract.
33. *Partial Utilization*--Use by Owner of a substantially completed part of the Work for the purpose for which it is intended (or a related purpose) prior to Substantial Completion of all the Work.
34. *Progress Schedule*—A schedule, prepared and maintained by Contractor, describing the sequence and duration of the activities comprising Contractor's plan to accomplish the Work within the Contract Times.
35. *Project*—The total undertaking to be accomplished for Owner by engineers, contractors, and others, including planning, study, design, construction, testing, commissioning, and start-up, and of which the Work to be performed under the Contract Documents is a part.
36. *Resident Project Representative*—The authorized representative of Engineer assigned to assist Engineer at the Site. As used herein, the term Resident Project Representative (RPR) includes any assistants or field staff of Resident Project Representative.
37. *Samples*—Physical examples of materials, equipment, or workmanship that are representative of some portion of the Work and that establish the standards by which such portion of the Work will be judged.
38. *Schedule of Submittals*—A schedule, prepared and maintained by Contractor, of required submittals and the time requirements for Engineer's review of the submittals.
39. *Schedule of Values*—A schedule, prepared and maintained by Contractor, allocating portions of the Contract Price to various portions of the Work and used as the basis for reviewing Contractor's Applications for Payment.
40. *Shop Drawings*—All drawings, diagrams, illustrations, schedules, and other data or information that are specifically prepared or assembled by or for Contractor and submitted by Contractor to illustrate some portion of the Work. Shop Drawings, whether approved or not, are not Drawings and are not Contract Documents.
41. *Site*—Lands or areas indicated in the Contract Documents as being furnished by Owner upon which the Work is to be performed, including rights-of-way and easements, and such other lands or areas furnished by Owner which are designated for the use of Contractor.

42. *Specifications*—The part of the Contract that consists of written requirements for materials, equipment, systems, standards, and workmanship as applied to the Work, and certain administrative requirements and procedural matters applicable to the Work.
43. *Subcontractor*—An individual or entity having a direct contract with Contractor or with any other Subcontractor for the performance of a part of the Work.
44. *Submittal*—A written or graphic document, prepared by or for Contractor, which the Contract Documents require Contractor to submit to Engineer, or that is indicated as a Submittal in the Schedule of Submittals accepted by Engineer. Submittals may include Shop Drawings and Samples; schedules; product data; Owner-delegated designs; sustainable design information; information on special procedures; testing plans; results of tests and evaluations, source quality-control testing and inspections, and field or Site quality-control testing and inspections; warranties and certifications; Suppliers' instructions and reports; records of delivery of spare parts and tools; operations and maintenance data; Project photographic documentation; record documents; and other such documents required by the Contract Documents. Submittals, whether or not approved or accepted by Engineer, are not Contract Documents. Change Proposals, Change Orders, Claims, notices, Applications for Payment, and requests for interpretation or clarification are not Submittals.
45. *Substantial Completion*— The time at which the Work (or a specified part thereof) has progressed to the point where, in the opinion of Engineer, as evidenced by Engineer's issued and signed final Certificate of Substantial Completion as provided in Paragraph 15.03.C and confirmed by Owner pursuant to a resolution adopted by the Jefferson Parish Council as provided in Paragraph 15.03.G, the Work (or a specified part thereof) is sufficiently complete, in accordance with the Contract Documents, so that the Work (or a specified part thereof) can be utilized for the purposes for which it is intended. The terms "substantially complete" and "substantially completed" as applied to all or part of the Work refer to Substantial Completion of such Work.
46. *Successful Bidder*—The Bidder to which the Owner makes an award of contract.
47. *Supplementary Conditions*—The part of the Contract that amends or supplements these General Conditions.
48. *Supplier*—A manufacturer, fabricator, supplier, distributor, or vendor having a direct contract with Contractor or with any Subcontractor to furnish materials or equipment to be incorporated in the Work by Contractor or a Subcontractor.
49. *Technical Data*
- a. Those items expressly identified as Technical Data in the Supplementary Conditions, with respect to either (1) existing subsurface conditions at or adjacent to the Site, or existing physical conditions at or adjacent to the Site including existing surface or subsurface structures (except Underground Facilities) or (2) Hazardous Environmental Conditions at the Site.
 - b. If no such express identifications of Technical Data have been made with respect to conditions at the Site, then Technical Data is defined, with respect to conditions at the Site under Paragraphs 5.03, 5.04, and 5.06, as the data contained in boring logs, recorded measurements of subsurface water levels, assessments of the condition of subsurface facilities, laboratory test results, and other factual, objective information

regarding conditions at the Site that are set forth in any geotechnical, environmental, or other Site or facilities conditions report prepared for the Project and made available to Contractor.

- c. Information and data regarding the presence or location of Underground Facilities are not intended to be categorized, identified, or defined as Technical Data, and instead Underground Facilities are shown or indicated on the Drawings.

50. *Underground Facilities*—All active or not-in-service underground lines, pipelines, conduits, ducts, encasements, cables, wires, manholes, vaults, tanks, tunnels, or other such facilities or systems at the Site, including but not limited to those facilities or systems that produce, transmit, distribute, or convey telephone or other communications, cable television, fiber optic transmissions, power, electricity, light, heat, gases, oil, crude oil products, liquid petroleum products, water, steam, waste, wastewater, storm water, other liquids or chemicals, or traffic or other control systems. An abandoned facility or system is not an Underground Facility.

51. *Unit Price Work*—Work to be paid for on the basis of unit prices.

52. *Work*—The entire construction or the various separately identifiable parts thereof required to be provided under the Contract Documents. Work includes and is the result of performing or providing all labor, services, and documentation necessary to produce such construction; furnishing, installing, and incorporating all materials and equipment into such construction; and may include related services such as testing, start-up, and commissioning, all as required by the Contract Documents.

53. *Work Change Directive*—A written directive to Contractor issued on or after the Effective Date of the Contract, signed by Owner and recommended by Engineer, ordering an addition, deletion, or revision in the Work, or responding to differing or unforeseen subsurface or physical conditions under which the Work is to be performed or to emergencies. A Work Change Directive will not change the Contract Price or the Contract Times but is evidence that the parties expect that the change ordered or documented by a Work Change Directive will be incorporated in a subsequently issued Change Order following negotiations by the parties as to its effect, if any, on the Contract Price or Contract Times. Contractor shall not be entitled to any change in the Contract Price or the Contract Times related to a Work Change Directive unless and until a valid Change Order is approved by the Jefferson Parish Council.

1.02 Terminology

- A. The words and terms discussed in Paragraphs 1.02.B, C, D, and E are not defined terms that require initial capital letters, but, when used in the Bidding Requirements or Contract Documents, have the indicated meaning.
- B. *Intent of Certain Terms or Adjectives*: The Contract Documents include the terms “as allowed,” “as approved,” “as ordered,” “as directed” or terms of like effect or import to authorize an exercise of professional judgment by Engineer. In addition, the adjectives “reasonable,” “suitable,” “acceptable,” “proper,” “satisfactory,” or adjectives of like effect or import are used to describe an action or determination of Engineer as to the Work. It is intended that such exercise of professional judgment, action, or determination will be solely to evaluate, in general, the Work for compliance with the information in the Contract Documents and with the design concept of the Project as a functioning whole as shown or indicated in the Contract

Documents (unless there is a specific statement indicating otherwise). The use of any such term or adjective is not intended to and shall not be effective to assign to Engineer any duty or authority to supervise or direct the performance of the Work, or any duty or authority to undertake responsibility contrary to the provisions of Article 10 or any other provision of the Contract Documents.

- C. *Day*: The word “day” means a calendar day of 24 hours measured from midnight to the next midnight.
- D. *Defective*: The word “defective,” when modifying the word “Work,” refers to Work that is unsatisfactory, faulty, or deficient in that it:
 - 1. does not conform to the Contract Documents;
 - 2. does not meet the requirements of any applicable inspection, reference standard, test, or approval referred to in the Contract Documents; or
 - 3. has been damaged prior to Engineer’s recommendation of final payment (unless responsibility for the protection thereof has been assumed by Owner at Substantial Completion in accordance with Paragraph 15.03 or Paragraph 15.04).
- E. *Furnish, Install, Perform, Provide*
 - 1. The word “furnish,” when used in connection with services, materials, or equipment, means to supply and deliver said services, materials, or equipment to the Site (or some other specified location) ready for use or installation and in usable or operable condition.
 - 2. The word “install,” when used in connection with services, materials, or equipment, means to put into use or place in final position said services, materials, or equipment complete and ready for intended use.
 - 3. The words “perform” or “provide,” when used in connection with services, materials, or equipment, means to furnish and install said services, materials, or equipment complete and ready for intended use.
 - 4. If the Contract Documents establish an obligation of Contractor with respect to specific services, materials, or equipment, but do not expressly use any of the four words “furnish,” “install,” “perform,” or “provide,” then Contractor shall furnish and install said services, materials, or equipment complete and ready for intended use.
- F. *Contract Price or Contract Times*: References to a change in “Contract Price or Contract Times” or “Contract Times or Contract Price” or similar, indicate that such change applies to (1) Contract Price, (2) Contract Times, or (3) both Contract Price and Contract Times, as warranted, even if the term “or both” is not expressed.
- G. Unless stated otherwise in the Contract Documents, words or phrases that have a well-known technical or construction industry or trade meaning are used in the Contract Documents in accordance with such recognized meaning.

ARTICLE 2—PRELIMINARY MATTERS

2.01 *Delivery of Performance and Payment Bonds; Evidence of Insurance; Recordation of Contract Documents*

- A. *Performance and Payment Bonds*: When Contractor delivers the signed counterparts of the Agreement to Owner, Contractor shall also deliver to Owner the performance bond and payment bond (if the Contract requires Contractor to furnish such bonds).
- B. *Evidence of Contractor's Insurance*: When Contractor delivers the signed counterparts of the Agreement to Owner, Contractor shall also deliver to Owner, with copies to each additional insured (as identified in the Contract), the certificates, endorsements, and other evidence of insurance required to be provided by Contractor in accordance with Article 6, except to the extent the Supplementary Conditions expressly establish other dates for delivery of specific insurance policies.
- ~~C. *Evidence of Owner's Insurance*: After receipt of the signed counterparts of the Agreement and all required bonds and insurance documentation, Owner shall promptly deliver to Contractor, with copies to each additional insured (as identified in the Contract), the certificates and other evidence of insurance required to be provided by Owner under Article 6.~~
- C. Contractor shall not start any Work at the Site unless and until Contractor has in place and in full force and effect all of the insurance and Bonds which the Contractor is required to obtain by the Agreement, the Contract, or the Supplementary Conditions. Any delay in obtaining confirmation of the existence of the insurance, Bonds, and other security required by this Contract and compliance with the terms of the Contract therefor shall be counted as workdays if the start of Work is delayed beyond the time set forth in paragraphs 4.01 and 4.02. The Contract shall not be in force or binding on Owner until satisfactory Bonds and insurance have been provided in accordance with the Contract Documents.
- D. In accordance with the Instructions to Bidders, one complete copy of the executed Contract Documents, including Specifications and Drawings, shall be filed with the Clerk of Court and Ex-Officio Recorder of Mortgages for Jefferson Parish promptly, but in any event before starting any Work, at Contractor's expense, which expense may be deducted from any application for payment if not paid for directly by Contractor.

2.02 *Copies of Documents*

- A. Owner shall furnish to Contractor one ~~four~~ printed copy ~~copies~~ of the Contract (including one fully signed counterpart of the Agreement), and one copy in electronic portable document format (PDF). Additional printed copies will be furnished upon request at the cost of reproduction.
- ~~B. Owner shall maintain and safeguard at least one original printed record version of the Contract, including Drawings and Specifications signed and sealed by Engineer and other design professionals. Owner shall make such original printed record version of the Contract available to Contractor for review. Owner may delegate the responsibilities under this provision to Engineer.~~

2.03 *Before Starting Construction*

- A. *Preliminary Schedules:* Within 10 days after the Effective Date of the Contract (or as otherwise required by the Contract Documents), Contractor shall submit to Engineer for timely review:
1. a preliminary Progress Schedule indicating the times (numbers of days or dates) for starting and completing the various stages of the Work, including any Milestones specified in the Contract;
 2. a preliminary Schedule of Submittals; and
 3. a preliminary Schedule of Values for all of the Work which includes quantities and prices of items which when added together equal the Contract Price and subdivides the Work into component parts in sufficient detail to serve as the basis for progress payments during performance of the Work. Such prices will include an appropriate amount of overhead and profit applicable to each item of Work.
 4. The construction schedule shall be in a detailed precedence-style critical path method (CPM) or prima vera type format satisfactory to the Owner and the Engineer, and shall also: (1) provide a graphic representation of all activities and events that will occur during the performance of the Work; (2) identify each phase of construction and occupancy; and (3) set forth dates that are critical in insuring the timely and orderly completion of the Work in accordance with the requirements of the Contract Documents (hereinafter referred to as Milestone Dates). Upon review and acceptance by the Owner and the Engineer of the Milestone Dates, the construction schedule shall be deemed part of the Contract Documents and attached to the agreement as Exhibit. If not accepted, the construction schedule shall be promptly revised by the Contractor in accordance with the recommendations of the Owner and the Engineer and resubmitted for acceptance.

2.04 *Preconstruction Conference; Designation of Authorized Representatives*

- A. Before any Work at the Site is started, a conference attended by Owner, Contractor, Engineer, and others as appropriate will be held to establish a working understanding among the parties as to the Work, and to discuss the schedules referred to in Paragraph 2.03.A, procedures for handling Shop Drawings, Samples, and other Submittals, processing Applications for Payment, electronic or digital transmittals, and maintaining required records.
- B. At this conference Owner and Contractor each shall designate, in writing, a specific individual to act as its authorized representative with respect to the services and responsibilities under the Contract. Such individuals shall have the authority to transmit and receive information, render decisions relative to the Contract, and otherwise act on behalf of each respective party.

2.05 *Acceptance of Schedules*

- A. At least 10 days before submission of the first Application for Payment a conference, attended by Contractor, Engineer, and others as appropriate, will be held to review the schedules submitted in accordance with Paragraph 2.03.A. No progress payment will be made to Contractor until acceptable schedules are submitted to Engineer.
1. The Progress Schedule will be acceptable to Engineer if it provides an orderly progression of the Work to completion within the Contract Times. Such acceptance will not impose on Engineer responsibility for the Progress Schedule, for sequencing, scheduling, or

progress of the Work, nor interfere with or relieve Contractor from Contractor's full responsibility therefor.

2. Contractor's Schedule of Submittals will be acceptable to Engineer if it provides a workable arrangement for reviewing and processing the required submittals.
3. Contractor's Schedule of Values will be acceptable to Engineer as to form and substance if it provides a reasonable allocation of the Contract Price to the component parts of the Work.
4. If a schedule is not acceptable, Contractor will have an additional 10 days to revise and resubmit the schedule.

2.06 *Electronic Transmittals*

- A. Except as otherwise stated elsewhere in the Contract, the Owner, Engineer, and Contractor may send, and shall accept, Electronic Documents transmitted by Electronic Means.
- B. If the Contract does not establish protocols for Electronic Means, then Owner, Engineer, and Contractor shall jointly develop such protocols.
- C. Subject to any governing protocols for Electronic Means, when transmitting Electronic Documents by Electronic Means, the transmitting party makes no representations as to long-term compatibility, usability, or readability of the Electronic Documents resulting from the recipient's use of software application packages, operating systems, or computer hardware differing from those used in the drafting or transmittal of the Electronic Documents.

ARTICLE 3—CONTRACT DOCUMENTS: INTENT, REQUIREMENTS, REUSE

3.01 *Intent*

- A. The Contract Documents are complementary; what is required by one Contract Document is as binding as if required by all.
- B. It is the intent of the Contract Documents to describe a functionally complete Project (or part thereof) to be constructed in accordance with the Contract Documents. In case of discrepancy, the following order of precedence will apply:

1. Special Provisions Section as included in the Specifications

2. Drawings

3. Supplementary Conditions

4. Standard Specifications of Jefferson Parish as either included or referenced in the Specifications

5. Standard Plans of Jefferson Parish as either included or referenced in the Specifications

Calculated dimensions will govern over scaled dimensions.

Contractor shall take no advantage of any error or omission in the Contract Documents. If Contractor discovers such an error or omission, Contractor shall immediately notify Engineer. Engineer will then make such corrections and interpretations as deemed necessary to fulfil the intent of the Contract Documents.

- C. Unless otherwise stated in the Contract Documents, if there is a discrepancy between the electronic versions of the Contract Documents (including any printed copies derived from such electronic versions) and the printed record version, the printed record version will govern.
- D. The Contract supersedes prior negotiations, representations, and agreements, whether written or oral.
- E. Engineer will issue clarifications and interpretations of the Contract Documents as provided herein.
- F. Any provision or part of the Contract Documents held to be void or unenforceable under any Law or Regulation will be deemed stricken, and all remaining provisions will continue to be valid and binding upon Owner and Contractor, which agree that the Contract Documents will be reformed to replace such stricken provision or part thereof with a valid and enforceable provision that comes as close as possible to expressing the intention of the stricken provision.
- G. Nothing in the Contract Documents creates:
 - 1. any contractual relationship between Owner or Engineer and any Subcontractor, Supplier, or other individual or entity performing or furnishing any of the Work, for the benefit of such Subcontractor, Supplier, or other individual or entity; or
 - 2. any obligation on the part of Owner or Engineer to pay or to see to the payment of any money due any such Subcontractor, Supplier, or other individual or entity, except as may otherwise be required by Laws and Regulations.
- H. Owner makes no warranties, express or implied, with respect to the fitness of the Drawings or Specifications prepared by the Engineer or any other person, and Contractor waives any claims against Owner arising out of any implied or express warranties of the fitness of the Drawings or Specifications for their intended purpose.

3.02 *Reference Standards*

A. *Standards Specifications, Codes, Laws, and Regulations*

- 1. Reference in the Contract Documents to standard specifications, manuals, reference standards, or codes of any technical society, organization, or association, or to Laws or Regulations, whether such reference be specific or by implication, means the standard specification, manual, reference standard, code, or Laws or Regulations in effect at the time of opening of Bids (or on the Effective Date of the Contract if there were no Bids), except as may be otherwise specifically stated in the Contract Documents.
- 2. No provision of any such standard, specification, manual, reference standard, or code, and no instruction of a Supplier, will be effective to change the duties or responsibilities of Owner, Contractor, or Engineer from those set forth in the part of the Contract Documents prepared by or for Engineer. No such provision or instruction shall be effective to assign to Owner or Engineer any duty or authority to supervise or direct the performance of the Work, or any duty or authority to undertake responsibility inconsistent with the provisions of the part of the Contract Documents prepared by or for Engineer.

3.03 *Reporting and Resolving Discrepancies*

A. *Reporting Discrepancies*

1. *Contractor's Verification of Figures and Field Measurements:* Before undertaking each part of the Work, Contractor shall carefully study the Contract Documents, and check and verify pertinent figures and dimensions therein, particularly with respect to applicable field measurements. Contractor shall promptly report in writing to Engineer any conflict, error, ambiguity, or discrepancy that Contractor discovers, or has actual knowledge of, and shall not proceed with any Work affected thereby until the conflict, error, ambiguity, or discrepancy is resolved by a clarification or interpretation by Engineer, or by an amendment or supplement to the Contract issued pursuant to Paragraph 11.01.

The grades, elevations, dimensions, locations, and field measurements or any drawings or specifications issued by the Engineer, or the Work installed by other contractors, are not guaranteed by the Engineer or the Owner. Any errors due to the Contractor's failure to verify all such grades, elevations, locations, dimensions, or field measurements shall be promptly rectified by Contractor without any additional costs to Owner or extensions of Contract Times.

2. *Contractor's Review of Contract Documents:* If, before or during the performance of the Work, Contractor discovers any conflict, error, ambiguity, or discrepancy within the Contract Documents, or between the Contract Documents and (a) any applicable Law or Regulation, (b) actual field conditions, (c) any standard specification, manual, reference standard, or code, or (d) any instruction of any Supplier, then Contractor shall promptly report it to Engineer in writing. Contractor shall not proceed with the Work affected thereby (except in an emergency as required by Paragraph 7.15) until the conflict, error, ambiguity, or discrepancy is resolved, by a clarification or interpretation by Engineer, or by an amendment or supplement to the Contract issued pursuant to Paragraph 11.01.
3. Contractor shall not be liable to Owner or Engineer for failure to report any conflict, error, ambiguity, or discrepancy in the Contract Documents unless Contractor had actual knowledge thereof, or reasonably should have known thereof.

B. *Resolving Discrepancies*

1. Except as may be otherwise specifically stated in the Contract Documents, the provisions of the part of the Contract Documents prepared by or for Engineer take precedence in resolving any conflict, error, ambiguity, or discrepancy between such provisions of the Contract Documents and:
 - a. the provisions of any standard specification, manual, reference standard, or code, or the instruction of any Supplier (whether or not specifically incorporated by reference as a Contract Document); or
 - b. the provisions of any Laws or Regulations applicable to the performance of the Work (unless such an interpretation of the provisions of the Contract Documents would result in violation of such Law or Regulation).

3.04 *Requirements of the Contract Documents*

- A. During the performance of the Work and until final payment, Contractor and Owner shall submit to the Engineer in writing all matters in question concerning the requirements of the Contract Documents (sometimes referred to as requests for information or interpretation—

RFIs), or relating to the acceptability of the Work under the Contract Documents, as soon as possible after such matters arise. Engineer will be the initial interpreter of the requirements of the Contract Documents, and judge of the acceptability of the Work.

- B. Engineer will, with reasonable promptness, render a written clarification, interpretation, or decision on the issue submitted, or initiate an amendment or supplement to the Contract Documents. Engineer's written clarification, interpretation, or decision will be final and binding on Contractor, unless it appeals by submitting a Change Proposal, and on Owner, unless it appeals by filing a Claim.
- C. If a submitted matter in question concerns terms and conditions of the Contract Documents that do not involve (1) the performance or acceptability of the Work under the Contract Documents, (2) the design (as set forth in the Drawings, Specifications, or otherwise), or (3) other engineering or technical matters, then Engineer will promptly notify Owner and Contractor in writing that Engineer is unable to provide a decision or interpretation. If Owner and Contractor are unable to agree on resolution of such a matter in question, either party may pursue resolution as provided in Article 12.

3.05 *Reuse of Documents*

- A. Contractor and its Subcontractors and Suppliers shall not:
 - 1. have or acquire any title to or ownership rights in any of the Drawings, Specifications, or other documents (or copies of any thereof) prepared by or bearing the seal of Engineer or its consultants, including electronic media versions, or reuse any such Drawings, Specifications, other documents, or copies thereof on extensions of the Project or any other project without written consent of Owner and Engineer and specific written verification or adaptation by Engineer; or
 - 2. have or acquire any title or ownership rights in any other Contract Documents, reuse any such Contract Documents for any purpose without Owner's express written consent, or violate any copyrights pertaining to such Contract Documents.
- B. The prohibitions of this Paragraph 3.05 will survive final payment, or termination of the Contract. Nothing herein precludes Contractor from retaining copies of the Contract Documents for record purposes.

ARTICLE 4—COMMENCEMENT AND PROGRESS OF THE WORK

4.01 *Commencement of Contract Times; Notice to Proceed*

- A. ~~The Contract Times will commence to run on the 30th day after the Effective Date of the Contract or, if a Notice to Proceed is given, on the day indicated in the Notice to Proceed. A Notice to Proceed may be given at any time within 30 days after the Effective Date of the Contract. In no event will the Contract Times commence to run later than the 60th day after the day of Bid opening or the 30th day after the Effective Date of the Contract, whichever date is earlier.~~

The Contract Times will commence to run on the day indicated in the Notice to Proceed. The Owner shall issue a Notice to Proceed in accordance with La. R.S. 38:2215. In no event will Owner have any obligations or duties to Contractor under the Agreement until the Notice to Proceed is given to Contractor. In no event will the Contract Times commence to run later

than one hundred eighty days after the contract execution or the thirtieth day after the Effective Date of Agreement, whichever date is later, unless the parties otherwise agree.

4.02 *Starting the Work*

- A. Contractor shall start to perform the Work within 10 days from the date when the Contract Times commence to run. No Work may be done at the Site prior to such date.

4.03 *Reference Points*

- A. ~~Owner~~ Engineer shall provide engineering surveys to establish reference points for construction which in Engineer's judgment are necessary to enable Contractor to proceed with the Work. Contractor shall be responsible for laying out the Work, shall protect and preserve the established reference points and property monuments, and shall make no changes or relocations without the prior written approval of Owner. Contractor shall report to Engineer whenever any reference point or property monument is lost or destroyed or requires relocation because of necessary changes in grades or locations, and shall be responsible for the accurate replacement or relocation of such reference points or property monuments by professionally qualified personnel.

4.04 *Progress Schedule*

- A. Contractor shall adhere to the Progress Schedule established in accordance with Paragraph 2.05 as it may be adjusted from time to time as provided below.
 - 1. Contractor shall submit to Engineer for acceptance (to the extent indicated in Paragraph 2.05) proposed adjustments in the Progress Schedule that will not result in changing the Contract Times.
 - 2. Proposed adjustments in the Progress Schedule that will change the Contract Times must be submitted in accordance with the requirements of Article 11.
- B. Contractor shall carry on the Work and adhere to the Progress Schedule during all disputes or disagreements with Owner. No Work will be delayed or postponed pending resolution of any disputes or disagreements, or during any appeal process, except as permitted by Paragraph 16.04, or as Owner and Contractor may otherwise agree in writing.

4.05 *Delays in Contractor's Progress*

- A. If Owner, Engineer, or anyone for whom Owner is responsible, delays, disrupts, or interferes with the performance or progress of the Work, then Contractor shall be entitled to an equitable adjustment in Contract Price or Contract Times.
- B. Contractor shall not be entitled to an adjustment in Contract Price or Contract Times for delay, disruption, or interference caused by or within the control of Contractor. Delay, disruption, and interference attributable to and within the control of a Subcontractor or Supplier shall be deemed to be within the control of Contractor.
- C. If Contractor's performance or progress is delayed, disrupted, or interfered with by unanticipated causes not the fault of and beyond the control of Owner, Contractor, and those for which they are responsible, then Contractor shall be entitled to an equitable adjustment in Contract Times. Such an adjustment will be Contractor's sole and exclusive remedy for the delays, disruption, and interference described in this paragraph. Causes of delay, disruption,

or interference that may give rise to an adjustment in Contract Times under this paragraph include but are not limited to the following:

1. Severe and unavoidable natural catastrophes such as fires, floods, epidemics, and earthquakes;
 2. Abnormal weather conditions;
 3. Acts or failures to act of third-party utility owners or other third-party entities (other than those third-party utility owners or other third-party entities performing other work at or adjacent to the Site as arranged by or under contract with Owner, as contemplated in Article 8); and
 4. Acts of war or terrorism.
- D. Contractor's entitlement to an adjustment of Contract Times or Contract Price is limited as follows:
1. Contractor's entitlement to an adjustment of the Contract Times is conditioned on the delay, disruption, or interference adversely affecting an activity on the critical path to completion of the Work, as of the time of the delay, disruption, or interference.
 2. Contractor shall not be entitled to an adjustment in Contract Price for any delay, disruption, or interference if such delay is concurrent with a delay, disruption, or interference caused by or within the control of Contractor. Such a concurrent delay by Contractor shall not preclude an adjustment of Contract Times to which Contractor is otherwise entitled.
 3. Adjustments of Contract Times or Contract Price are subject to the provisions of Article 11.
- E. Each Contractor request or Change Proposal seeking an increase in Contract Times or Contract Price must be supplemented by supporting data that sets forth in detail the following:
1. The circumstances that form the basis for the requested adjustment;
 2. The date upon which each cause of delay, disruption, or interference began to affect the progress of the Work;
 3. The date upon which each cause of delay, disruption, or interference ceased to affect the progress of the Work;
 4. The number of days' increase in Contract Times claimed as a consequence of each such cause of delay, disruption, or interference; and
 5. The impact on Contract Price, in accordance with the provisions of Paragraph 11.07.

Contractor shall also furnish such additional supporting documentation as Owner or Engineer may require including, where appropriate, a revised progress schedule indicating all the activities affected by the delay, disruption, or interference, and an explanation of the effect of the delay, disruption, or interference on the critical path to completion of the Work.

- F. Delays, disruption, and interference to the performance or progress of the Work resulting from the existence of a differing subsurface or physical condition, an Underground Facility that was not shown or indicated by the Contract Documents, or not shown or indicated with

reasonable accuracy, and those resulting from Hazardous Environmental Conditions, are governed by Article 5, together with the provisions of Paragraphs 4.05.D and 4.05.E.

- G. Paragraph 8.03 addresses delays, disruption, and interference to the performance or progress of the Work resulting from the performance of certain other work at or adjacent to the Site.

ARTICLE 5—SITE; SUBSURFACE AND PHYSICAL CONDITIONS; HAZARDOUS ENVIRONMENTAL CONDITIONS

5.01 *Availability of Lands*

- A. Owner shall furnish the Site. Owner shall notify Contractor in writing of any encumbrances or restrictions not of general application but specifically related to use of the Site with which Contractor must comply in performing the Work.
- B. Upon reasonable written request, Owner shall furnish Contractor with a current statement of record legal title and legal description of the lands upon which permanent improvements are to be made and Owner's interest therein as necessary for giving notice of or filing a mechanic's or construction lien against such lands in accordance with applicable Laws and Regulations.
- C. Contractor shall provide for all additional lands and access thereto that may be required for temporary construction facilities or storage of materials and equipment.

5.02 *Use of Site and Other Areas*

A. *Limitation on Use of Site and Other Areas*

- 1. Contractor shall confine construction equipment, temporary construction facilities, the storage of materials and equipment, and the operations of workers to the Site, adjacent areas that Contractor has arranged to use through construction easements or otherwise, and other adjacent areas permitted by Laws and Regulations, and shall not unreasonably encumber the Site and such other adjacent areas with construction equipment or other materials or equipment. Contractor shall assume full responsibility for (a) damage to the Site; (b) damage to any such other adjacent areas used for Contractor's operations; (c) damage to any other adjacent land or areas, or to improvements, structures, utilities, or similar facilities located at such adjacent lands or areas; and (d) for injuries and losses sustained by the owners or occupants of any such land or areas; provided that such damage or injuries result from the performance of the Work or from other actions or conduct of the Contractor or those for which Contractor is responsible.
- 2. If a damage or injury claim is made by the owner or occupant of any such land or area because of the performance of the Work, or because of other actions or conduct of the Contractor or those for which Contractor is responsible, Contractor shall (a) take immediate corrective or remedial action as required by Paragraph 7.13, or otherwise; (b) promptly attempt to settle the claim as to all parties through negotiations with such owner or occupant, or otherwise resolve the claim by a arbitration or other dispute resolution proceeding, or in a court of competent jurisdiction; and (c) to the fullest extent permitted by Laws and Regulations, indemnify and hold harmless Owner and Engineer, and the officers, directors, members, partners, employees, agents, consultants and subcontractors of each and any of them, from and against any such claim, and against all costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals and all court or arbitration or other

dispute resolution costs) arising out of or relating to any claim or action, legal or equitable, brought by any such owner or occupant against Owner, Engineer, or any other party indemnified hereunder to the extent caused directly or indirectly, in whole or in part by, or based upon, Contractor's performance of the Work, or because of other actions or conduct of the Contractor or those for which Contractor is responsible.

- B. *Removal of Debris During Performance of the Work:* During the progress of the Work the Contractor shall keep the Site and other adjacent areas free from accumulations of waste materials, rubbish, and other debris. Removal and disposal of such waste materials, rubbish, and other debris will conform to applicable Laws and Regulations.
- C. *Cleaning:* Prior to Substantial Completion of the Work Contractor shall clean the Site and the Work and make it ready for utilization by Owner. At the completion of the Work Contractor shall remove from the Site and adjacent areas all tools, appliances, construction equipment and machinery, and surplus materials and shall restore to original condition all property not designated for alteration by the Contract Documents.
- D. *Loading of Structures:* Contractor shall not load nor permit any part of any structure to be loaded in any manner that will endanger the structure, nor shall Contractor subject any part of the Work or adjacent structures or land to stresses or pressures that will endanger them.

5.03 *Subsurface and Physical Conditions*

- A. *Reports and Drawings:* The Supplementary Conditions identify:
 - 1. Those reports of explorations and tests of subsurface conditions at or adjacent to the Site that contain Technical Data;
 - 2. Those drawings of existing physical conditions at or adjacent to the Site, including those drawings depicting existing surface or subsurface structures at or adjacent to the Site (except Underground Facilities), that contain Technical Data; and
 - 3. Technical Data contained in such reports and drawings.
- B. *Underground Facilities:* Underground Facilities are shown or indicated on the Drawings, pursuant to Paragraph 5.05, and not in the drawings referred to in Paragraph 5.03.A. Information and data regarding the presence or location of Underground Facilities are not intended to be categorized, identified, or defined as Technical Data.
- C. *Reliance by Contractor on Technical Data:* Contractor may rely upon the accuracy of the Technical Data expressly identified in the Supplementary Conditions with respect to such reports and drawings, but such reports and drawings are not Contract Documents. If no such express identification has been made, then Contractor may rely upon the accuracy of the Technical Data as defined in Paragraph 1.01.A.46.b.
- D. *Limitations of Other Data and Documents:* Except for such reliance on Technical Data, Contractor may not rely upon or make any claim against Owner or Engineer, or any of their officers, directors, members, partners, employees, agents, consultants, or subcontractors, with respect to:
 - 1. the completeness of such reports and drawings for Contractor's purposes, including, but not limited to, any aspects of the means, methods, techniques, sequences, and procedures of construction to be employed by Contractor, and safety precautions and programs incident thereto;

2. other data, interpretations, opinions, and information contained in such reports or shown or indicated in such drawings;
 3. the contents of other Site-related documents made available to Contractor, such as record drawings from other projects at or adjacent to the Site, or Owner's archival documents concerning the Site; or
 4. any Contractor interpretation of or conclusion drawn from any Technical Data or any such other data, interpretations, opinions, or information.
- E. The Contractor and each Subcontractor shall evaluate and satisfy themselves as to the Site conditions and limitations under which the Work is to be performed, including, without limitation, (1) the location, condition, layout, and nature of the Project Site and surrounding areas; (2) generally prevailing climactic conditions; (3) anticipated labor, supply, and costs; (4) availability and cost of materials, tools, and equipment; and (5) other similar issues. The Owner assumes no responsibility or liability for the physical condition or safety of the Project Site or any improvements located on the Project Site. Except as set forth in Article 4, the Contractor shall be solely responsible for providing a safe place for the performance of the Work. The Owner shall not be required to make adjustments in either the Contract Price or Contract Times arising from a failure by the Contractor or any Subcontractor to comply with the requirements of this paragraph.

5.04 *Differing Subsurface or Physical Conditions*

- A. *Notice by Contractor:* If Contractor ~~believes~~ discovers or should have discovered that any subsurface or physical condition that is uncovered or revealed at the Site or adjacent to the Site:
1. is of such a nature as to establish that any Technical Data on which Contractor is entitled to rely as provided in Paragraph 5.03 is materially inaccurate;
 2. is of such a nature as to require a change in the Drawings or Specifications;
 3. differs materially from that shown or indicated in the Contract Documents; or
 4. is of an unusual nature, and differs materially from conditions ordinarily encountered and generally recognized as inherent in work of the character provided for in the Contract Documents;
- then Contractor shall, ~~promptly after becoming aware thereof~~ immediately and in any event within 48 hours after the time the Contractor discovers and before further disturbing the subsurface or physical conditions or performing any Work in connection therewith (except in an emergency as required by Paragraph 7.15), notify Owner and Engineer in writing about such condition. Contractor shall not further disturb such condition or perform any Work in connection therewith (except with respect to an emergency) until receipt of a written statement permitting Contractor to do so.
- B. *Engineer's Review:* After receipt of written notice as required by the preceding paragraph, Engineer will promptly review the subsurface or physical condition in question; determine whether it is necessary for Owner to obtain additional exploration or tests with respect to the condition; conclude whether the condition falls within any one or more of the differing site condition categories in Paragraph 5.04.A; obtain any pertinent cost or schedule information from Contractor; prepare recommendations to Owner regarding the Contractor's resumption of Work in connection with the subsurface or physical condition in question and the need for

any change in the Drawings or Specifications; and advise Owner in writing of Engineer's findings, conclusions, and recommendations.

- C. *Owner's Statement to Contractor Regarding Site Condition:* After receipt of Engineer's written findings, conclusions, and recommendations, Owner shall issue a written statement to Contractor (with a copy to Engineer) regarding the subsurface or physical condition in question, addressing the resumption of Work in connection with such condition, indicating whether any change in the Drawings or Specifications will be made, and adopting or rejecting Engineer's written findings, conclusions, and recommendations, in whole or in part.
- D. *Early Resumption of Work:* If at any time Engineer determines that Work in connection with the subsurface or physical condition in question may resume prior to completion of Engineer's review or Owner's issuance of its statement to Contractor, because the condition in question has been adequately documented, and analyzed on a preliminary basis, then the Engineer may at its discretion instruct Contractor to resume such Work.
- E. *Possible Price and Times Adjustments*
 - 1. Contractor shall be entitled to an equitable adjustment in Contract Price or Contract Times, to the extent that the existence of a differing subsurface or physical condition, or any related delay, disruption, or interference, causes an increase or decrease in Contractor's cost of, or time required for, performance of the Work; subject, however, to the following:
 - a. Such condition must fall within any one or more of the categories described in Paragraph 5.04.A;
 - b. With respect to Work that is paid for on a unit price basis, any adjustment in Contract Price will be subject to the provisions of Paragraph 13.03; and,
 - c. Contractor's entitlement to an adjustment of the Contract Times is subject to the provisions of Paragraphs 4.05.D and 4.05.E.
 - 2. Contractor shall not be entitled to any adjustment in the Contract Price or Contract Times with respect to a subsurface or physical condition if:
 - a. Contractor knew of the existence of such condition at the time Contractor made a commitment to Owner with respect to Contract Price and Contract Times by the submission of a Bid or becoming bound under a negotiated contract, or otherwise;
 - b. The existence of such condition reasonably could have been discovered or revealed as a result of any examination, investigation, exploration, test, or study of the Site and contiguous areas expressly required by the Bidding Requirements or Contract Documents to be conducted by or for Contractor prior to Contractor's making such commitment; or
 - c. Contractor failed to give the written notice required by Paragraph 5.04.A.
 - 3. If Owner and Contractor agree regarding Contractor's entitlement to and the amount or extent of any adjustment in the Contract Price or Contract Times, then any such adjustment will be set forth in a Change Order.
 - 4. Contractor may submit a Change Proposal regarding its entitlement to or the amount or extent of any adjustment in the Contract Price or Contract Times, no later than 30 days

after Owner's issuance of the Owner's written statement to Contractor regarding the subsurface or physical condition in question.

- F. *Underground Facilities; Hazardous Environmental Conditions*: Paragraph 5.05 governs rights and responsibilities regarding the presence or location of Underground Facilities. Paragraph 5.06 governs rights and responsibilities regarding Hazardous Environmental Conditions. The provisions of Paragraphs 5.03 and 5.04 are not applicable to the presence or location of Underground Facilities, or to Hazardous Environmental Conditions.

5.05 *Underground Facilities*

- A. *Contractor's Responsibilities*: Unless it is otherwise expressly provided in the Supplementary Conditions, the cost of all of the following are included in the Contract Price, and Contractor shall have full responsibility for:
1. reviewing and checking all information and data regarding existing Underground Facilities at the Site;
 2. complying with applicable state and local utility damage prevention Laws and Regulations;
 3. verifying the actual location of those Underground Facilities shown or indicated in the Contract Documents as being within the area affected by the Work, by exposing such Underground Facilities during the course of construction;
 4. coordination of the Work with the owners (including Owner) of such Underground Facilities, during construction; and
 5. the safety and protection of all existing Underground Facilities at the Site, and repairing any damage thereto resulting from the Work.
- B. *Notice by Contractor*: If Contractor believes that an Underground Facility that is uncovered or revealed at the Site was not shown or indicated on the Drawings, or was not shown or indicated on the Drawings with reasonable accuracy, then Contractor shall, ~~promptly after becoming aware thereof~~ immediately and in any event within 24 hours after Contractor discovers and before further disturbing conditions affected thereby or performing any Work in connection therewith (except in an emergency as required by Paragraph 7.15), notify Owner and Engineer in writing regarding such Underground Facility.
- C. *Engineer's Review*: Engineer will:
1. promptly review the Underground Facility and conclude whether such Underground Facility was not shown or indicated on the Drawings, or was not shown or indicated with reasonable accuracy;
 2. identify and communicate with the owner of the Underground Facility; prepare recommendations to Owner (and if necessary issue any preliminary instructions to Contractor) regarding the Contractor's resumption of Work in connection with the Underground Facility in question;
 3. obtain any pertinent cost or schedule information from Contractor; determine the extent, if any, to which a change is required in the Drawings or Specifications to reflect and document the consequences of the existence or location of the Underground Facility; and
 4. advise Owner in writing of Engineer's findings, conclusions, and recommendations.

During such time, Contractor shall be responsible for the safety and protection of such Underground Facility.

- D. *Owner's Statement to Contractor Regarding Underground Facility:* After receipt of Engineer's written findings, conclusions, and recommendations, Owner shall issue a written statement to Contractor (with a copy to Engineer) regarding the Underground Facility in question addressing the resumption of Work in connection with such Underground Facility, indicating whether any change in the Drawings or Specifications will be made, and adopting or rejecting Engineer's written findings, conclusions, and recommendations in whole or in part.
- E. *Early Resumption of Work:* If at any time Engineer determines that Work in connection with the Underground Facility may resume prior to completion of Engineer's review or Owner's issuance of its statement to Contractor, because the Underground Facility in question and conditions affected by its presence have been adequately documented, and analyzed on a preliminary basis, then the Engineer may at its discretion instruct Contractor to resume such Work.
- F. *Possible Price and Times Adjustments*
 - 1. Contractor shall be entitled to an equitable adjustment in the Contract Price or Contract Times, to the extent that any existing Underground Facility at the Site that was not shown or indicated on the Drawings, or was not shown or indicated with reasonable accuracy, or any related delay, disruption, or interference, causes an increase or decrease in Contractor's cost of, or time required for, performance of the Work; subject, however, to the following:
 - a. With respect to Work that is paid for on a unit price basis, any adjustment in Contract Price will be subject to the provisions of Paragraph 13.03;
 - b. Contractor's entitlement to an adjustment of the Contract Times is subject to the provisions of Paragraphs 4.05.D and 4.05.E; and
 - c. Contractor gave the notice required in Paragraph 5.05.B.
 - 2. If Owner and Contractor agree regarding Contractor's entitlement to and the amount or extent of any adjustment in the Contract Price or Contract Times, then any such adjustment will be set forth in a Change Order.
 - 3. Contractor may submit a Change Proposal regarding its entitlement to or the amount or extent of any adjustment in the Contract Price or Contract Times, no later than 30 days after Owner's issuance of the Owner's written statement to Contractor regarding the Underground Facility in question.
 - 4. The information and data shown or indicated on the Drawings with respect to existing Underground Facilities at the Site is based on information and data (a) furnished by the owners of such Underground Facilities, or by others, (b) obtained from available records, or (c) gathered in an investigation conducted in accordance with the current edition of ASCE 38, Standard Guideline for the Collection and Depiction of Existing Subsurface Utility Data, by the American Society of Civil Engineers. If such information or data is incorrect or incomplete, Contractor's remedies are limited to those set forth in this Paragraph 5.05.F.

5.06 *Hazardous Environmental Conditions at Site*

- A. *Reports and Drawings:* The Supplementary Conditions identify:
1. those reports known to Owner relating to Hazardous Environmental Conditions that have been identified at or adjacent to the Site;
 2. drawings known to Owner relating to Hazardous Environmental Conditions that have been identified at or adjacent to the Site; and
 3. Technical Data contained in such reports and drawings.
- B. *Reliance by Contractor on Technical Data Authorized:* Contractor may rely upon the accuracy of the Technical Data expressly identified in the Supplementary Conditions with respect to such reports and drawings, but such reports and drawings are not Contract Documents. If no such express identification has been made, then Contractor may rely on the accuracy of the Technical Data as defined in Paragraph 1.01.A.46.b. Except for such reliance on Technical Data, Contractor may not rely upon or make any claim against Owner or Engineer, or any of their officers, directors, members, partners, employees, agents, consultants, or subcontractors, with respect to:
1. the completeness of such reports and drawings for Contractor's purposes, including, but not limited to, any aspects of the means, methods, techniques, sequences and procedures of construction to be employed by Contractor, and safety precautions and programs incident thereto;
 2. other data, interpretations, opinions, and information contained in such reports or shown or indicated in such drawings; or
 3. any Contractor interpretation of or conclusion drawn from any Technical Data or any such other data, interpretations, opinions or information.
- C. ~~Contractor shall not be responsible for removing or remediating any Hazardous Environmental Condition encountered, uncovered, or revealed at the Site unless such removal or remediation is expressly identified in the Contract Documents to be within the scope of the Work. Contractor must take all precautions to discover and locate any Hazardous Environmental Condition at the Site that may present a substantial danger to persons or property exposed thereto in connection with the Work at the Site.~~
- D. Contractor shall be responsible for controlling, containing, and duly removing all Constituents of Concern brought to the Site by Contractor, Subcontractors, Suppliers, or anyone else for whom Contractor is responsible, and for any associated costs; and for the costs of removing and remediating any Hazardous Environmental Condition created by the presence of any such Constituents of Concern.
- E. If Contractor encounters, uncovers, or reveals a Hazardous Environmental Condition whose removal or remediation is not expressly identified in the Contract Documents as being within the scope of the Work, or if Contractor or anyone for whom Contractor is responsible creates a Hazardous Environmental Condition, then Contractor shall ~~immediately~~ within 24 hours: (1) secure or otherwise isolate such condition; (2) stop all Work in connection with such condition and in any area affected thereby (except in an emergency as required by Paragraph 7.15); and (3) notify Owner and Engineer (and promptly thereafter confirm such notice in writing). Owner shall promptly consult with Engineer concerning the necessity for Owner to retain a qualified expert to evaluate such condition or take corrective action, if any. Promptly after

consulting with Engineer, Owner shall take such actions as are necessary to permit Owner to timely obtain required permits and provide Contractor the written notice required by Paragraph 5.06.F. If Contractor or anyone for whom Contractor is responsible created the Hazardous Environmental Condition in question, then Owner may remove and remediate the Hazardous Environmental Condition, and impose a set-off against payments to account for the associated costs.

- F. Contractor shall not resume Work in connection with such Hazardous Environmental Condition or in any affected area until after Owner has obtained any required permits related thereto, and delivered written notice to Contractor either (1) specifying that such condition and any affected area is or has been rendered safe for the resumption of Work, or (2) specifying any special conditions under which such Work may be resumed safely.
- G. If Owner and Contractor cannot agree as to entitlement to or on the amount or extent, if any, of any adjustment in Contract Price or Contract Times, as a result of such Work stoppage, such special conditions under which Work is agreed to be resumed by Contractor, or any costs or expenses incurred in response to the Hazardous Environmental Condition, then within 30 days of Owner's written notice regarding the resumption of Work, Contractor may submit a Change Proposal, or Owner may impose a set-off. Entitlement to any such adjustment is subject to the provisions of Paragraphs 4.05.D, 4.05.E, 11.07, and 11.08.
- H. If, after receipt of such written notice, Contractor does not agree to resume such Work based on a reasonable belief it is unsafe, or does not agree to resume such Work under such special conditions, then Owner may order the portion of the Work that is in the area affected by such condition to be deleted from the Work, following the contractual change procedures in Article 11. Owner may have such deleted portion of the Work performed by Owner's own forces or others in accordance with Article 8.
- ~~I. To the fullest extent permitted by Laws and Regulations, Owner shall indemnify and hold harmless Contractor, Subcontractors, and Engineer, and the officers, directors, members, partners, employees, agents, consultants, and subcontractors of each and any of them, from and against all claims, costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals, and all court, arbitration, or other dispute resolution costs) arising out of or relating to a Hazardous Environmental Condition, provided that such Hazardous Environmental Condition (1) was not shown or indicated in the Drawings, Specifications, or other Contract Documents, identified as Technical Data entitled to limited reliance pursuant to Paragraph 5.06.B, or identified in the Contract Documents to be included within the scope of the Work, and (2) was not created by Contractor or by anyone for whom Contractor is responsible. Nothing in this Paragraph 5.06.I obligates Owner to indemnify any individual or entity from and against the consequences of that individual's or entity's own negligence.~~
- ↓ I. To the fullest extent permitted by Laws and Regulations, Contractor shall indemnify and hold harmless Owner and Engineer, and the officers, directors, members, partners, employees, agents, consultants, and subcontractors of each and any of them, from and against all claims, costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals and all court or arbitration or other dispute resolution costs) arising out of or relating to the failure to control, contain, or remove a Constituent of Concern brought to the Site by Contractor or by anyone for whom Contractor is responsible, or to a Hazardous Environmental Condition created by Contractor or by anyone

for whom Contractor is responsible. Nothing in this Paragraph 5.06.J obligates Contractor to indemnify any individual or entity from and against the consequences of that individual's or entity's own negligence.

✕ J. The provisions of Paragraphs 5.03, 5.04, and 5.05 do not apply to the presence of Constituents of Concern or to a Hazardous Environmental Condition uncovered or revealed at the Site.

ARTICLE 6—BONDS AND INSURANCE

6.01 *Performance, Payment, and Other Bonds*

- A. Contractor shall furnish a performance bond and a payment bond, each in an amount at least equal to the Contract Price as security for the faithful performance and payment of Contractor's obligations under the Contract. These bonds must remain in effect until one year after the date when final payment becomes due or until completion of the correction period specified in Paragraph 15.08, whichever is later, except as provided otherwise by Laws or Regulations, the terms of a prescribed bond form, the Supplementary Conditions, or other provisions of the Contract.
- B. Contractor shall also furnish such other bonds (if any) as are required by the Supplementary Conditions or other provisions of the Contract.
- C. All bonds must be in the form included in the Bidding Documents or otherwise specified by Owner prior to execution of the Contract, except as provided otherwise by Laws or Regulations, and must be issued and signed by a surety ~~named in "Companies Holding Certificates of Authority as Acceptable Sureties on Federal Bonds and as Acceptable Reinsuring Companies" as published in Department Circular 570 (as amended and supplemented) by the Bureau of the Fiscal Service, U.S. Department of the Treasury meeting the requirements set forth in La. R.S. 38:2218 and 2219 and any other requirements and qualifications set forth in the Supplementary Conditions.~~ A bond signed by an agent or attorney-in-fact must be accompanied by a certified copy of that individual's authority to bind the surety. The evidence of authority must show that it is effective on the date the agent or attorney-in-fact signed the accompanying bond.
- D. Contractor shall obtain the required bonds from surety companies that are duly licensed or authorized, in the state or jurisdiction in which the Project is located, to issue bonds in the required amounts.
- E. If the surety on a bond furnished by Contractor is declared bankrupt or becomes insolvent, or the surety ceases to meet the requirements above, then Contractor shall promptly notify Owner and Engineer in writing and shall, within 20 days after the event giving rise to such notification, provide another bond and surety, both of which must comply with the bond and surety requirements above.
- F. If Contractor has failed to obtain a required bond, Owner may exclude the Contractor from the Site and exercise Owner's termination rights under Article 16.
- G. Upon request to Owner from any Subcontractor, Supplier, or other person or entity claiming to have furnished labor, services, materials, or equipment used in the performance of the Work, Owner shall provide a copy of the payment bond to such person or entity.

H. Upon request to Contractor from any Subcontractor, Supplier, or other person or entity claiming to have furnished labor, services, materials, or equipment used in the performance of the Work, Contractor shall provide a copy of the payment bond to such person or entity.

I. Performance Bond: Any surety bond written for a Jefferson Parish Public Works project shall be written by a surety or insurance company currently on the U.S. Department of Treasury Financial Management Service list of approved bonding companies which is published annually in the Federal Register, or by a Louisiana domiciled insurance company with at least an A rating in the latest printing of the A.M. Best's Key Rating Guide to write individual bonds up to ten percent of policyholder's surplus as shown in the A.M. Best's Key Rating Guide or by a surety company that complies with the requirements of La. R.S. 38:2219.

No surety will be accepted from a bondsman which does not have a permanent agent or representative in the State upon whom notices referred to in the General Conditions may be served. Service of said notice on said agent or representative in the State shall be equal to service of notice on the president of the surety, or such other officer as may be concerned. Should the Contractor's surety, even though approved and accepted by the Owner, subsequently remove its agency or representative from the State or terminates its residency or license in this State or become insolvent, bankrupt, or otherwise fail, the Contractor shall immediately furnish a new bond from another company approved by the Owner, at no additional cost to the Owner. The new bond shall be executed upon the same terms and conditions as the original bond.

J. Alternative Security: The Owner may in its discretion accept alternative security pursuant to the requirements set forth in the Louisiana public contract law (La. R.S. 38:2181 et.seq.).

K. Scope of the Bond and Obligation of the Surety: The Contractor's surety shall obligate itself to all the terms and covenants of the Contract Documents covering the Work to be performed hereunder. The Owner reserves the right to order extra work or make changes by altering, adding to, or deducting from the Work under the conditions and in the manner hereinbefore described without notice to the Contractor's surety and without in any manner affecting the liability of bondsman or releasing it from any of its obligations hereunder.

The Bond shall also secure for the Owner the faithful performance of the Contract in strict accordance with the plans and specifications and Contract Documents. It shall protect the Owner against all lien laws of the State and shall provide for payment of reasonable attorney's fees for enforcement of the Contract and institution of concursus proceedings, if such proceedings become necessary. Likewise, it shall provide that if the Engineer is put to labor or expense by enforcement of the Contract and institution of concursus proceedings or through delinquency or insolvency of the Contract they shall be equitably paid for such extra expense and services involved.

The surety of the Contractor shall be and does hereby declare and acknowledge itself by acceptance to be bound to the Owner as guarantor jointly and in solido with the Contractor for fulfillment of the foregoing terms including, but not limited to, any provisions for actual or liquidated damages.

6.02 Insurance—General Provisions

A. ~~Owner and~~ Contractor shall obtain and maintain insurance as required in this article, Article 7.18, and in the Supplementary Conditions. Pursuant to La. R.S. 9:2780.1, the cost of such insurance shall be included in the Contract Price.

- B. All insurance required by the Contract to be purchased and maintained by ~~Owner and Contractor~~ shall be obtained from insurance companies that are duly licensed or authorized in the ~~state or jurisdiction in which the Project is located~~ State of Louisiana to issue insurance policies for the required limits and coverages. Unless a different standard is indicated in the Supplementary Conditions, all companies that provide insurance policies required under this Contract shall have an A.M. Best rating of A-VI or better. This requirement will be waived for workers' compensation coverage only for those contractors whose workers' compensation coverage is placed with companies who participate in the State of Louisiana Workers' Compensation Assigned Risk Pool or the Louisiana Worker's Compensation Corporation.
- C. Alternative forms of insurance coverage, including but not limited to self-insurance and "Occupational Accident and Excess Employer's Indemnity Policies," are not sufficient to meet the insurance requirements of this Contract, unless expressly allowed in the Supplementary Conditions.
- D. Contractor shall deliver to Owner, with copies to each additional insured identified herein or in the Contract, certificates of insurance and endorsements establishing that Contractor has obtained and is maintaining the policies and coverages required by the Contract. Contractor shall deliver these documents when returning the signed copies of the agreement to Owner. Each such certificate shall include the Project name, the Project number, proposal number, and Owner's address as identified in the Agreement. Upon request by Owner or any other insured, Contractor shall also furnish other evidence of such required insurance, including but not limited to copies of policies, documentation of applicable self-insured retentions (if allowed) and deductibles, full disclosure of all relevant exclusions, and evidence of insurance required to be purchased and maintained by Subcontractors or Suppliers. In any documentation furnished under this provision, Contractor, Subcontractors, and Suppliers may block out (redact) (1) any confidential premium or pricing information and (2) any wording specific to a project or jurisdiction other than those applicable to this Contract.
- ~~E. Owner shall deliver to Contractor, with copies to each additional insured identified in the Contract, certificates of insurance and endorsements establishing that Owner has obtained and is maintaining the policies and coverages required of Owner by the Contract (if any). Upon request by Contractor or any other insured, Owner shall also provide other evidence of such required insurance (if any), including but not limited to copies of policies, documentation of applicable self-insured retentions (if allowed) and deductibles, and full disclosure of all relevant exclusions. In any documentation furnished under this provision, Owner may block out (redact) (1) any confidential premium or pricing information and (2) any wording specific to a project or jurisdiction other than those relevant to this Contract.~~
- ~~F~~ E. Failure of Owner to demand such certificates or other evidence of the other party's full compliance with these insurance requirements, or failure of Owner to identify a deficiency in compliance from the evidence provided, will not be construed as a waiver of the other party's obligation to obtain and maintain such insurance.
- ~~G~~ F. In addition to the liability insurance required to be provided by Contractor, the Owner, at Owner's option, may purchase and maintain Owner's own liability insurance. Owner's liability policies, if any, operate separately and independently from policies required to be provided by Contractor, and Contractor cannot rely upon Owner's liability policies for any of Contractor's obligations to the Owner, Engineer, or third parties.

~~H~~ G. Contractor shall require:

1. Subcontractors to purchase and maintain worker's compensation, commercial general liability, and other insurance that is appropriate for their participation in the Project, and to name as additional insureds Owner ~~and Engineer~~ (and any other individuals or entities identified in the Supplementary Conditions as additional insureds on Contractor's liability policies) on each Subcontractor's commercial general liability insurance policy; and
2. Suppliers to purchase and maintain insurance that is appropriate for their participation in the Project.

~~I~~ H. If ~~either party Contractor~~ does not purchase or maintain the insurance required of such party ~~by by Owner in accordance with the Contract, such party Contractor shall notify the other party Owner~~ in writing of such failure to purchase prior to the start of the Work, or of such failure to maintain prior to any change in the required coverage.

~~J~~ I. If Contractor has failed to obtain and maintain required insurance, Contractor's entitlement to enter or remain at the Site will end immediately, and Owner may impose an appropriate set-off against payment for any associated costs (including but not limited to the cost of purchasing necessary insurance coverage), and exercise Owner's termination rights under Article 16.

~~K~~ J. Without prejudice to any other right or remedy, if ~~a party Contractor~~ has failed to obtain required insurance, ~~the other party Owner~~ may elect (but is in no way obligated) to obtain equivalent insurance to protect ~~such other party's~~ Owner's interests at the expense of ~~the party Contractor~~ who was required to provide such coverage, and the Contract Price will be adjusted accordingly.

~~L~~ K. Owner does not represent that insurance coverage and limits established in this Contract necessarily will be adequate to protect Contractor or Contractor's interests. Contractor is responsible for determining whether such coverage and limits are adequate to protect its interests, and for obtaining and maintaining any additional insurance that Contractor deems necessary.

~~M~~ L. The insurance and insurance limits required herein will not be deemed as a limitation on Contractor's liability, or that of its Subcontractors or Suppliers, under the indemnities granted to Owner and other individuals and entities in the Contract or otherwise.

~~N~~ M. All the policies of insurance required to be purchased and maintained under this Contract will contain a provision or endorsement that the coverage afforded will not be canceled, or renewal refused, until at least 10 days prior written notice has been given to the purchasing policyholder. Within three days of receipt of any such written notice, the purchasing policyholder shall provide a copy of the notice to each other insured and Engineer.

6.03 *Contractor's Insurance*

- A. *Required Insurance:* Contractor shall purchase and maintain Worker's Compensation, Commercial General Liability, and other insurance pursuant to the specific requirements of the Supplementary Conditions.
- B. *General Provisions:* The policies of insurance required by this Paragraph 6.03 as supplemented must:
 1. include at least the specific coverages required;

2. be written for not less than the limits provided herein or in the Supplementary Conditions, or those required by Laws or Regulations, whichever is greater;
 3. remain in effect at least until the Work is complete (as set forth in Paragraph 15.06.D), and longer if expressly required elsewhere in this Contract, and at all times thereafter when Contractor may be correcting, removing, or replacing defective Work as a warranty or correction obligation, or otherwise, or returning to the Site to conduct other tasks arising from the Contract;
 4. apply with respect to the performance of the Work, whether such performance is by Contractor, any Subcontractor or Supplier, or by anyone directly or indirectly employed by any of them to perform any of the Work, or by anyone for whose acts any of them may be liable; and
 5. include all necessary endorsements to support the stated requirements.
- C. *Additional Insureds*: The Contractor's commercial general liability, automobile liability, employer's liability, umbrella or excess, pollution liability, and unmanned aerial vehicle liability policies, if required by this Contract, must:
1. include and list as additional insureds Owner ~~and Engineer~~ and any individuals or entities identified as additional insureds in the Supplementary Conditions;
 2. include coverage for the respective officers, directors, members, partners, employees, and consultants of all such additional insureds;
 3. afford primary coverage to these additional insureds for all claims covered thereby (including as applicable those arising from both ongoing and completed operations);
 4. not seek contribution from insurance maintained by the additional insured;
 5. as to commercial general liability insurance, apply to additional insureds with respect to liability caused in whole or in part by Contractor's acts or omissions, or the acts and omissions of those working on Contractor's behalf, in the performance of Contractor's operations; and
 6. with respect to workers' compensation only, include a Waiver of Subrogation in favor of the Owner and any principals for whom the Owner is working, including any co-lessors of such principals; and, with respect to all of the foregoing, be subject to the approval of the Owner.
- D. The limits of liability for the insurance required by paragraph 6.03 of the General Conditions shall provide the following coverage for not less than the following amounts or greater where required by Laws and Regulations, and any Jefferson Parish resolutions:
1. Workers' Compensation, etc. under the General Conditions:
The CONTRACTOR shall take out and maintain during the life of this contract, Worker's Compensation Insurance for all his employees in any way engaged in this project. As required by Louisiana State Statute exception: employer's liability shall be \$1,000,000 per occurrence when work is to be over water and involves maritime exposures, otherwise this limit shall be no less than \$500,000 per occurrence.

2. CONTRACTOR's Comprehensive General Liability Insurance under the General Conditions which shall also include completed operations and product liability coverage:

The CONTRACTOR shall take out and maintain during the life of this contract Comprehensive General Liability Insurance with a combined Single Limit per occurrence for bodily injury and property damage. This insurance shall include coverage for bodily injury and property damage, and indicate on the certificate of insurance the following:

1. Premises - operations;
2. Broad form contractual liability;
3. Products and completed operations;
4. Use of contractors and sub-contractors;
5. Personal Injury;
6. Broad form property damage;
7. Explosion, collapse and underground [XCU] coverage.

NOTE: On the certificate of insurance, under the description of operations, the following wording is required: The aggregate loss limit applies to each project or a copy of ISO Form CG 25 03 [ed. 11-85 or latest form] shall be submitted.

COMBINED SINGLE LIMITS [CSL] -AMOUNT OF INSURANCE REQUIRED

CONTRACTS UP TO \$1,000,000:

General contracts - each occurrence/ minimum limits \$500,000.00,

New construction/renovations - each occurrence/minimum limits \$500,000.00***
[depending on building value],

CONTRACTS OVER \$1,000,000:

General contracts - each occurrence/ minimum limits \$1,000,000.00,

New construction/renovations - each occurrence/minimum limits \$1,000,000.00***
[depending on building value].

*** WHILE THE MINIMUM COMBINED SINGLE LIMITS OF \$500,000 IS REQUIRED FOR ALL RENOVATION, THE VALUE OF THE BUILDING SHALL BE MULTIPLIED BY 10% AND THE INSURANCE REQUIREMENTS WILL BE INCREASED AT \$1,000,000 INTERVALS AND ROUNDED TO THE NEAREST MILLION.

EXAMPLE: RENOVATIONS ON A THIRTY-THREE MILLION DOLLAR BUILDING WOULD REQUIRE THREE MILLION DOLLARS, [\$3,000,000] MINIMUM COMBINED SINGLE LIMITS OF COVERAGE

The CONTRACTOR shall take out and maintain a policy of Umbrella Liability Coverage in excess of the primary insurance afforded above and including all operations of the CONTRACTOR, with minimum limits of \$1,000,000.00.

3. The CONTRACTOR shall take out and maintain during the life of this contract Business Automobile Liability Insurance with a Combined Single Limit of \$1,000,000 per Occurrence for bodily injury and property damage, unless otherwise indicated. This insurance shall include for bodily injury and property damage the following coverage:

- 1) Any automobiles;
- 2) Owned automobiles;
- 3) Hired automobiles;
- 4) Non-owned automobiles.

4. OWNER's Protective Liability.

The CONTRACTOR shall take out and maintain a policy of OWNER's Protective Liability for the same limits of liability for bodily injury and property damage liability and conditions as provided hereinabove under "Comprehensive General Liability Insurance".

The cost of this coverage is at the CONTRACTOR's expense.

5. Builder's Risk Insurance

The CONTRACTOR shall take out and maintain Builder's Risk Insurance at his expense, to insure both the OWNER and CONTRACTOR as their interest may appear. These policies must cover for such amount of the work as is determined by the ENGINEER and/or Architect and shall be the all-risk type of coverage. Although the insurance takes account of payments during the course of the construction from the OWNER to the CONTRACTOR, it is understood that the work shall be at the risk of the CONTRACTOR until finally accepted by the OWNER as a whole pursuant to the provisions of the General Conditions. Except as otherwise provided by law, the Parish Attorney's Office with the concurrence of the Director of Risk Management is authorized to omit in whole or part the insurance requirements of this section in connection with such contracts.

6. Miscellaneous

(a) If at any time any of the said policies shall be or becomes unsatisfactory to the OWNER as to form or substance; or if a company issuing any such policy shall be or become unsatisfactory to the OWNER, the CONTRACTOR/Subcontractors shall promptly obtain a new policy, submit the same to the OWNER for approval and submit a certificate thereof as provided above.

Upon failure of a CONTRACTOR/Subcontractor to furnish to deliver and maintain such insurance as above provide this Contract, at the election of the OWNER, may be forthwith declared suspended, discontinued or terminated. Failure of the CONTRACTOR/Subcontractor to take out and/or to maintain insurance shall not relieve the CONTRACTOR/Subcontractor from any liability under the contract, nor shall the insurance requirements be construed to conflict with the obligation of the CONTRACTOR/Subcontractor concerning indemnification.

(b) **WAIVER.** Except as otherwise provided by law, the coverage requirements of this section may be waived in whole or part on contracts under \$100,000.00 and the Chairman of the Council is authorized to use his discretion in regard to insurance requirements for such contracts. Except as otherwise provided by law, the Parish Attorney's Office with the concurrence of the Director of Risk Management is authorized to omit in whole or part the insurance requirements of this section in connection with such contracts.

E. The policies of insurance so required by paragraph 6.03 to be purchased and maintained by CONTRACTOR shall indicate the project number, proposal number, and OWNER's address as identified in the Agreement and shall also include the following clauses:

1. The CONTRACTOR/Sub-contractor insurers will have no right of recovery or subrogation against the OWNER, it being the intention of the parties that the insurance policy so affected shall protect both parties and be the primary coverage for any and all losses covered by the below described insurance.

2. The OWNER shall be named as additional insured as regards to negligence by the CONTRACTOR [ISO Forms CG 20 10 (Form B) or latest applicable ISO form], or equivalent.

3. The insurance companies issuing the policy or policies shall have no recourse against the OWNER for payment of any premiums or for assessments under any form of policy.

4. Any and all deductibles in the insurance policies shall be assumed by and be for the amount of \$10,000.00 unless increased as set forth in section 5.04 C6(a) and at the sole risk of the CONTRACTOR/Sub-contractor.

5. Any and all communications regarding the insurance shall include the Project name, Project number, proposal number, and OWNER's address, as identified in the Agreement.

6.04 *Builder's Risk and Other Property Insurance*

A. *Builder's Risk:* Unless otherwise provided in the Supplementary Conditions, Contractor shall is not required to purchase and maintain builder's risk insurance upon the Work on a completed value basis, in the amount of the Work's full insurable replacement cost (subject to such deductible amounts as may be provided in the Supplementary Conditions or required by Laws and Regulations). The specific requirements applicable to the builder's risk insurance are set forth in the Supplementary Conditions.

Except as otherwise provided by law, the Parish Attorney's Office with the concurrence of the Director of Risk Management is authorized to omit in whole or part the insurance requirements of this section in connection with such contracts.

B. *Property Insurance for Facilities of Owner Where Work Will Occur:* ~~Owner is responsible for obtaining and maintaining property insurance covering each existing structure, building, or facility in which any part of the Work will occur, or to which any part of the Work will attach or be adjoined. Such property insurance will be written on a special perils (all-risk) form, on a replacement cost basis, providing coverage consistent with that required for the builder's risk insurance, and will be maintained until the Work is complete, as set forth in Paragraph 15.06.D.~~

Owner shall not be responsible for purchasing and maintaining any property insurance specified in this paragraph 6.04 to protect the interests of Contractor, Subcontractors, or others in the Work to the extent of any deductible amounts that are identified herein or in the Supplementary Conditions. The risk of loss within such identified deductible amount will be borne by Contractor, Subcontractors, or others suffering any such loss, and if any of them wishes property insurance coverage within the limits of such amounts, each may purchase and maintain it at the purchaser's own expense.

~~C. *Property Insurance for Substantially Complete Facilities:* Promptly after Substantial Completion, and before actual occupancy or use of the substantially completed Work, Owner will obtain property insurance for such substantially completed Work, and maintain such property insurance at least until the Work is complete, as set forth in Paragraph 15.06.D. Such property insurance will be written on a special perils (all-risk) form, on a replacement cost basis, and provide coverage consistent with that required for the builder's risk insurance. The builder's risk insurance may terminate upon written confirmation of Owner's procurement of such property insurance.~~

~~D. *Partial Occupancy or Use by Owner:* If Owner will occupy or use a portion or portions of the Work prior to Substantial Completion of all the Work, as provided in Paragraph 15.04, then Owner (directly, if it is the purchaser of the builder's risk policy, or through Contractor) will provide advance notice of such occupancy or use to the builder's risk insurer, and obtain an endorsement consenting to the continuation of coverage prior to commencing such partial occupancy or use.~~

~~E. *D. Insurance of Other Property; Additional Insurance:* If the express insurance provisions of the Contract do not require or address the insurance of a property item or interest, then the entity or individual owning such property item will be responsible for insuring it. If Contractor elects to obtain other special insurance to be included in or supplement the builder's risk or property insurance policies provided under this Paragraph 6.04, it may do so at Contractor's expense.~~

6.05 *Property Losses; Subrogation*

A. The builder's risk insurance policy purchased and maintained in accordance with Paragraph 6.04 (or an installation floater policy if authorized by the Supplementary Conditions), will contain provisions to the effect that in the event of payment of any loss or damage the insurer will have no rights of recovery against any insureds thereunder, or against Engineer or its consultants, or their officers, directors, members, partners, employees, agents, consultants, or subcontractors.

~~1. Owner and Contractor waive all rights against each other and the respective officers, directors, members, partners, employees, agents, consultants, and subcontractors of each and any of them, for all losses and damages caused by, arising out of, or resulting from any of the perils, risks, or causes of loss covered by such policies and any other property insurance applicable to the Work; and, in addition, waive all such rights against Engineer, its consultants, all individuals or entities identified in the Supplementary Conditions as builder's risk or installation floater insureds, and the officers, directors, members, partners, employees, agents, consultants, and subcontractors of each and any of them, under such policies for losses and damages so caused.~~

- ~~2. None of the above waivers extends to the rights that any party making such waiver may have to the proceeds of insurance held by Owner or Contractor as trustee or fiduciary, or otherwise payable under any policy so issued.~~
- B. Any property insurance policy maintained by Owner covering any loss, damage, or consequential loss to Owner's existing structures, buildings, or facilities in which any part of the Work will occur, or to which any part of the Work will attach or adjoin; to adjacent structures, buildings, or facilities of Owner; or to part or all of the completed or substantially completed Work, during partial occupancy or use pursuant to Paragraph 15.04, after Substantial Completion pursuant to Paragraph 15.03, or after final payment pursuant to Paragraph 15.06, will contain provisions to the effect that in the event of payment of any loss or damage the insurer will have no rights of recovery against any insureds thereunder, or against Contractor, Subcontractors, or Engineer, or the officers, directors, members, partners, employees, agents, consultants, or subcontractors of each and any of them, and that the insured is allowed to waive the insurer's rights of subrogation in a written contract executed prior to the loss, damage, or consequential loss.
- ~~1. Owner waives all rights against Contractor, Subcontractors, and Engineer, and the officers, directors, members, partners, employees, agents, consultants and subcontractors of each and any of them, for all losses and damages caused by, arising out of, or resulting from fire or any of the perils, risks, or causes of loss covered by such policies.~~
- ~~C. The waivers in this Paragraph 6.05 include the waiver of rights due to business interruption, loss of use, or other consequential loss extending beyond direct physical loss or damage to Owner's property or the Work caused by, arising out of, or resulting from fire or other insured peril, risk, or cause of loss.~~
- ~~D~~ C. Contractor shall be responsible for assuring that each Subcontract contains provisions whereby the Subcontractor waives all rights against Owner, Contractor, all individuals or entities identified in the Supplementary Conditions as insureds, the Engineer and its consultants, and the officers, directors, members, partners, employees, agents, consultants, and subcontractors of each and any of them, for all losses and damages caused by, arising out of, relating to, or resulting from fire or other peril, risk, or cause of loss covered by builder's risk insurance, installation floater, and any other property insurance applicable to the Work.

6.06 *Receipt and Application of Property Insurance Proceeds*

- A. Any insured loss under the builder's risk and other policies of property insurance required by Paragraph 6.04 will be adjusted and settled with the named insured that purchased the policy. Such named insured shall act as fiduciary for the other insureds, and give notice to such other insureds that adjustment and settlement of a claim is in progress. Any other insured may state its position regarding a claim for insured loss in writing within 15 days after notice of such claim.
- B. Proceeds for such insured losses may be made payable by the insurer either jointly to multiple insureds, or to the named insured that purchased the policy in its own right and as fiduciary for other insureds, subject to the requirements of any applicable mortgage clause. A named insured receiving insurance proceeds under the builder's risk and other policies of insurance required by Paragraph 6.04 shall maintain such proceeds in a segregated account, and distribute such proceeds in accordance with such agreement as the parties in interest may

reach, or as otherwise required under the dispute resolution provisions of this Contract or applicable Laws and Regulations.

- C. If no other special agreement is reached, Contractor shall repair or replace the damaged Work, using allocated insurance proceeds.

ARTICLE 7—CONTRACTOR'S RESPONSIBILITIES

7.01 Contractor's Means and Methods of Construction

- A. Contractor shall be solely responsible for the means, methods, techniques, sequences, and procedures of construction.
- B. If the Contract Documents note, or Contractor determines, that professional engineering or other design services are needed to carry out Contractor's responsibilities for construction means, methods, techniques, sequences, and procedures, or for Site safety, then Contractor shall cause such services to be provided by a properly licensed design professional, at Contractor's expense. Such services are not Owner-delegated professional design services under this Contract, and neither Owner nor Engineer has any responsibility with respect to (1) Contractor's determination of the need for such services, (2) the qualifications or licensing of the design professionals retained or employed by Contractor, (3) the performance of such services, or (4) any errors, omissions, or defects in such services.

7.02 Supervision and Superintendence

- A. Contractor shall supervise, inspect, and direct the Work competently and efficiently, devoting such attention thereto and applying such skills and expertise as may be necessary to perform the Work in accordance with the Contract Documents.
- B. At all times during the progress of the Work, Contractor shall assign a competent resident superintendent who will not be replaced without written notice to Owner and Engineer except under extraordinary circumstances.

For purposes of giving or receiving notice, directives, Change Orders, or any other information from Engineer or Owner to Contractor, the Contractor shall designate one person as Project Manager to receive such notice directives, Change Orders, or other information. If the person so identified by Contractor is not present on the job Site during normal working hours for any consecutive 48 hour period, the Contractor shall in writing, addressed to Engineer and Owner identify the individual who is acting as Project Manager. Contractor may designate the resident superintendent as the Project Manager.

7.03 Labor; Working Hours

- A. Contractor shall provide competent, suitably qualified personnel to survey and lay out the Work and perform construction as required by the Contract Documents. Contractor shall maintain good discipline and order at the Site.
- B. Contractor shall be fully responsible to Owner and Engineer for all acts and omissions of Contractor's employees; of Suppliers and Subcontractors, and their employees; and of any other individuals or entities performing or furnishing any of the Work, just as Contractor is responsible for Contractor's own acts and omissions.

- C. Except as otherwise required for the safety or protection of persons or the Work or property at the Site or adjacent thereto, and except as otherwise stated in the Contract Documents, all Work at the Site will be performed during regular working hours, Monday through Friday. Contractor will not permit overtime work or perform Work on a Saturday, Sunday, or any legal holiday. Contractor may perform Work outside regular working hours or on Saturdays, Sundays, or legal holidays only with Owner's written consent, which will not be unreasonably withheld. For purposes of the foregoing sentence and this Contract "regular working hours" shall mean between 7:00 a.m. and 6:00 p.m. Emergency work may be performed without prior permission. Contractor shall establish a normal work schedule which does not exceed 40 hours per week. Overtime shall be scheduled only after Contractor obtains written permission from Owner.

7.04 *Services, Materials, and Equipment*

- A. Unless otherwise specified in the Contract Documents, Contractor shall provide and assume full responsibility for all services, materials, equipment, labor, transportation, construction equipment and machinery, tools, appliances, fuel, power, light, heat, telephone, water, sanitary facilities, temporary facilities, and all other facilities and incidentals necessary for the performance, testing, start up, and completion of the Work, whether or not such items are specifically called for in the Contract Documents.
- B. All materials and equipment incorporated into the Work must be new and of good quality, except as otherwise provided in the Contract Documents. All special warranties and guarantees required by the Specifications will expressly run to the benefit of Owner. If required by Engineer, Contractor shall furnish satisfactory evidence (including reports of required tests) as to the source, kind, and quality of materials and equipment.
- C. All materials and equipment must be stored, applied, installed, connected, erected, protected, used, cleaned, and conditioned in accordance with instructions of the applicable Supplier, except as otherwise may be provided in the Contract Documents.
- D. The Contractor agrees to assign to the Owner at the time of final completion of the Work any and all manufacturer's warranties relating to equipment, machinery, materials and labor used and incorporated in the Work and Contractor further agrees to perform the Work in such a manner to preserve any and all manufacturer's warranties.

7.05 *"Or Equals"*

- A. *Contractor's Request; Governing Criteria:* Whenever an item of equipment or material is specified or described in the Contract Documents by using the names of one or more proprietary items or specific Suppliers, the Contract Price has been based upon Contractor furnishing such item as specified. The specification or description of such an item is intended to establish the type, function, appearance, and quality required. Unless the specification or description contains or is followed by words reading that no like, equivalent, or "or equal" item is permitted, Contractor may request that Engineer authorize the use of other items of equipment or material, or items from other proposed Suppliers, under the circumstances described below.
1. If Engineer in its sole discretion determines that an item of equipment or material proposed by Contractor is functionally equal to that named and sufficiently similar so that no change in related Work will be required, Engineer will deem it an "or equal" item. For

the purposes of this paragraph, a proposed item of equipment or material will be considered functionally equal to an item so named if:

- a. in the exercise of reasonable judgment Engineer determines that the proposed item:
 - 1) is at least equal in materials of construction, quality, durability, appearance, strength, and design characteristics;
 - 2) will reliably perform at least equally well the function and achieve the results imposed by the design concept of the completed Project as a functioning whole;
 - 3) has a proven record of performance and availability of responsive service; and
 - 4) is not objectionable to Owner.
 - b. Contractor certifies that, if the proposed item is approved and incorporated into the Work:
 - 1) there will be no increase in cost to the Owner or increase in Contract Times; and
 - 2) the item will conform substantially to the detailed requirements of the item named in the Contract Documents.
- B. *Contractor's Expense*: Contractor shall provide all data in support of any proposed "or equal" item at Contractor's expense.
- C. *Engineer's Evaluation and Determination*: Engineer will be allowed a reasonable time to evaluate each "or-equal" request. Engineer may require Contractor to furnish additional data about the proposed "or-equal" item. Engineer will be the sole judge of acceptability. No "or-equal" item will be ordered, furnished, installed, or utilized until Engineer's review is complete and Engineer determines that the proposed item is an "or-equal," which will be evidenced by an approved Shop Drawing or other written communication. Engineer will advise Contractor in writing of any negative determination.
- D. *Effect of Engineer's Determination*: Neither approval nor denial of an "or-equal" request will result in any change in Contract Price. The Engineer's denial of an "or-equal" request will be final and binding, and may not be reversed through an appeal under any provision of the Contract.
- E. *Treatment as a Substitution Request*: If Engineer determines that an item of equipment or material proposed by Contractor does not qualify as an "or-equal" item, Contractor may request that Engineer consider the item a proposed substitute pursuant to Paragraph 7.06.

7.06 Substitutes

- A. *Contractor's Request; Governing Criteria*: Unless the specification or description of an item of equipment or material required to be furnished under the Contract Documents contains or is followed by words reading that no substitution is permitted, Contractor may request that Engineer authorize the use of other items of equipment or material under the circumstances described below. To the extent possible such requests must be made before commencement of related construction at the Site.
1. Contractor shall submit sufficient information as provided below to allow Engineer to determine if the item of material or equipment proposed is functionally equivalent to that named and an acceptable substitute therefor. Engineer will not accept requests for

review of proposed substitute items of equipment or material from anyone other than Contractor.

2. The requirements for review by Engineer will be as set forth in Paragraph 7.06.B, as supplemented by the Specifications, and as Engineer may decide is appropriate under the circumstances.
3. Contractor shall make written application to Engineer for review of a proposed substitute item of equipment or material that Contractor seeks to furnish or use. The application:
 - a. will certify that the proposed substitute item will:
 - 1) perform adequately the functions and achieve the results called for by the general design;
 - 2) be similar in substance to the item specified; and
 - 3) be suited to the same use as the item specified.
 - b. will state:
 - 1) the extent, if any, to which the use of the proposed substitute item will necessitate a change in Contract Times;
 - 2) whether use of the proposed substitute item in the Work will require a change in any of the Contract Documents (or in the provisions of any other direct contract with Owner for other work on the Project) to adapt the design to the proposed substitute item; and
 - 3) whether incorporation or use of the proposed substitute item in connection with the Work is subject to payment of any license fee or royalty.
 - c. will identify:
 - 1) all variations of the proposed substitute item from the item specified; and
 - 2) available engineering, sales, maintenance, repair, and replacement services.
 - d. will contain an itemized estimate of all costs or credits that will result directly or indirectly from use of such substitute item, including but not limited to changes in Contract Price, shared savings, costs of redesign, and claims of other contractors affected by any resulting change.
- B. *Engineer's Evaluation and Determination:* Engineer will be allowed a reasonable time to evaluate each substitute request, and to obtain comments and direction from Owner. Engineer may require Contractor to furnish additional data about the proposed substitute item. Engineer will be the sole judge of acceptability. No substitute will be ordered, furnished, installed, or utilized until Engineer's review is complete and Engineer determines that the proposed item is an acceptable substitute. Engineer's determination will be evidenced by a Field Order or a proposed Change Order accounting for the substitution itself and all related impacts, including changes in Contract Price or Contract Times. Engineer will advise Contractor in writing of any negative determination.
- C. *Special Guarantee:* Owner may require Contractor to furnish at Contractor's expense a special performance guarantee or other surety with respect to any substitute.

- D. *Reimbursement of Engineer's Cost:* Engineer will record Engineer's costs in evaluating a substitute proposed or submitted by Contractor. Whether or not Engineer approves a substitute so proposed or submitted by Contractor, Contractor shall reimburse Owner for the reasonable charges of Engineer for evaluating each such proposed substitute. Contractor shall also reimburse Owner for the reasonable charges of Engineer for making changes in the Contract Documents (or in the provisions of any other direct contract with Owner) resulting from the acceptance of each proposed substitute.
- E. *Contractor's Expense:* Contractor shall provide all data in support of any proposed substitute at Contractor's expense.
- F. *Effect of Engineer's Determination:* If Engineer approves the substitution request, Contractor shall execute the proposed Change Order and proceed with the substitution. The Engineer's denial of a substitution request will be final and binding, and may not be reversed through an appeal under any provision of the Contract. Contractor may challenge the scope of reimbursement costs imposed under Paragraph 7.06.D, by timely submittal of a Change Proposal.

7.07 *Concerning Subcontractors and Suppliers*

- A. Contractor may retain Subcontractors and Suppliers for the performance of parts of the Work. Such Subcontractors and Suppliers must be acceptable to Owner. The Contractor's retention of a Subcontractor or Supplier for the performance of parts of the Work will not relieve Contractor's obligation to Owner to perform and complete the Work in accordance with the Contract Documents.
- B. Contractor shall retain specific Subcontractors and Suppliers for the performance of designated parts of the Work if required by the Contract to do so.
- C. Subsequent to the submittal of Contractor's Bid or final negotiation of the terms of the Contract, Owner may not require Contractor to retain any Subcontractor or Supplier to furnish or perform any of the Work against which Contractor has reasonable objection.
- D. Prior to entry into any binding subcontract or purchase order, Contractor shall submit to Owner the identity of the proposed Subcontractor or Supplier (unless Owner has already deemed such proposed Subcontractor or Supplier acceptable during the bidding process or otherwise). ~~Such proposed Subcontractor or Supplier shall be deemed acceptable to Owner unless Owner raises a substantive, reasonable objection within 5 days.~~
- E. Owner may require the replacement of any Subcontractor or Supplier. Owner also may require Contractor to retain specific replacements; provided, however, that Owner may not require a replacement to which Contractor has a reasonable objection. If Contractor has submitted the identity of certain Subcontractors or Suppliers for acceptance by Owner, and Owner has accepted it ~~(either in writing or by failing to make written objection thereto)~~, then Owner may subsequently revoke the acceptance of any such Subcontractor or Supplier so identified solely on the basis of substantive, reasonable objection after due investigation. Contractor shall submit an acceptable replacement for the rejected Subcontractor or Supplier.
- F. If Owner requires the replacement of any Subcontractor or Supplier retained by Contractor to perform any part of the Work, then Contractor shall be entitled to an adjustment in Contract Price or Contract Times, with respect to the replacement; and Contractor shall

initiate a Change Proposal for such adjustment within 30 days of Owner's requirement of replacement.

- G. No acceptance by Owner of any such Subcontractor or Supplier, whether initially or as a replacement, will constitute a waiver of the right of Owner to the completion of the Work in accordance with the Contract Documents.
- H. At the request of Owner, on a monthly basis, Contractor shall submit to Engineer a complete list of all Subcontractors and Suppliers having a direct contract with Contractor, and of all other Subcontractors and Suppliers known to Contractor at the time of submittal.

Contractor shall be fully responsible to Owner for all acts and omissions of the Subcontractors, Suppliers, and other individuals or entities performing or furnishing any of the Work just as Contractor is responsible for Contractor's own acts and omissions. Nothing in the Contract Documents shall create for the benefit of any such Subcontractor, Supplier, or other individual or entity any contractual relationship between Owner and any such Subcontractor, Supplier or other individual or entity, nor shall it create any obligation on the part of Owner to pay or to see to the payment of any moneys due any such Subcontractor, Supplier, or other individual or entity except as may otherwise be required by Laws and Regulations.

- I. Contractor shall be solely responsible for scheduling and coordinating the work of Subcontractors and Suppliers.
- J. The divisions and sections of the Specifications and the identifications of any Drawings do not control Contractor in dividing the Work among Subcontractors or Suppliers, or in delineating the Work to be performed by any specific trade.
- K. All Work performed for Contractor by a Subcontractor or Supplier must be pursuant to an appropriate contractual agreement that specifically binds the Subcontractor or Supplier to the applicable terms and conditions of the Contract for the benefit of Owner and Engineer.
- L. Owner may furnish to any Subcontractor or Supplier, to the extent practicable, information about amounts paid to Contractor for Work performed for Contractor by the Subcontractor or Supplier.
- M. Contractor shall restrict all Subcontractors and Suppliers from communicating with Engineer or Owner, except through Contractor or in case of an emergency, or as otherwise expressly allowed in this Contract.

7.08 *Patent Fees and Royalties*

- A. Contractor shall pay all license fees and royalties and assume all costs incident to the use in the performance of the Work or the incorporation in the Work of any invention, design, process, product, or device which is the subject of patent rights or copyrights held by others. If an invention, design, process, product, or device is specified in the Contract Documents for use in the performance of the Work and if, to the actual knowledge of Owner or Engineer, its use is subject to patent rights or copyrights calling for the payment of any license fee or royalty to others, the existence of such rights will be disclosed in the Contract Documents.
- ~~B. To the fullest extent permitted by Laws and Regulations, Owner shall indemnify and hold harmless Contractor, and its officers, directors, members, partners, employees, agents, consultants, and subcontractors, from and against all claims, costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals, and all court or arbitration or other dispute resolution costs) arising out of or~~

~~relating to any infringement of patent rights or copyrights incident to the use in the performance of the Work or resulting from the incorporation in the Work of any invention, design, process, product, or device specified in the Contract Documents, but not identified as being subject to payment of any license fee or royalty to others required by patent rights or copyrights.~~

- € B. To the fullest extent permitted by Laws and Regulations, Contractor shall indemnify and hold harmless Owner and Engineer, and the officers, directors, members, partners, employees, agents, consultants and subcontractors of each and any of them, from and against all claims, costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals and all court or arbitration or other dispute resolution costs) arising out of or relating to any infringement of patent rights or copyrights incident to the use in the performance of the Work or resulting from the incorporation in the Work of any invention, design, process, product, or device not specified in the Contract Documents.

7.09 *Permits*

- A. Unless otherwise provided in the Contract Documents, Contractor shall obtain and pay for all construction permits, licenses, and certificates of occupancy. Owner shall assist Contractor, when necessary, in obtaining such permits and licenses. Contractor shall pay all governmental charges and inspection fees necessary for the prosecution of the Work which are applicable at the time of the submission of Contractor's Bid (or when Contractor became bound under a negotiated contract). Owner shall pay all charges of utility owners for connections for providing permanent service to the Work.

7.10 *Taxes*

- A. Contractor shall pay all sales, consumer, use, and other similar taxes required to be paid by Contractor in accordance with the Laws and Regulations of the place of the Project which are applicable during the performance of the Work. Parish may designate Contractor as its agent for the purpose of making sales tax exempt purchases on behalf of Jefferson Parish; such project shall be designated sales tax exempt in a Resolution adopted by the Jefferson Parish Council.
- B. Owner is exempt from payment of sales and compensating use taxes of the State of Louisiana and of cities and counties thereof on all materials to be incorporated into the Work when a Project is designated as tax exempt by the Jefferson Parish Council.
1. Owner will furnish the required certificates of tax exemption to Contractor for use in the purchase of supplies and materials to be incorporated into the Work.
2. Owner's exemption does not apply to construction tools, machinery, equipment, or other property purchased by or leased by Contractor, or to supplies or materials not incorporated into the Work.

7.11 *Laws and Regulations*

- A. Contractor shall give all notices required by and shall comply with all Laws and Regulations applicable to the performance of the Work. Neither Owner nor Engineer shall be responsible for monitoring Contractor's compliance with any Laws or Regulations.
- B. If Contractor performs any Work or takes any other action knowing or having reason to know that it is contrary to Laws or Regulations, Contractor shall bear all resulting costs and losses,

and shall indemnify and hold harmless Owner and Engineer, and the officers, directors, members, partners, employees, agents, consultants, and subcontractors of each and any of them, from and against all claims, costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals and all court or arbitration or other dispute resolution costs) arising out of or relating to such Work or other action. It is not Contractor's responsibility to make certain that the Work described in the Contract Documents is in accordance with Laws and Regulations, but this does not relieve Contractor of its obligations under Paragraph 3.03.

- C. Owner or Contractor may give written notice to the other party of any changes after the submission of Contractor's Bid (or after the date when Contractor became bound under a negotiated contract) in Laws or Regulations having an effect on the cost or time of performance of the Work, including but not limited to changes in Laws or Regulations having an effect on procuring permits and on sales, use, value-added, consumption, and other similar taxes. If Owner and Contractor are unable to agree on entitlement to or on the amount or extent, if any, of any adjustment in Contract Price or Contract Times resulting from such changes, then within 30 days of such written notice Contractor may submit a Change Proposal, or Owner may initiate a Claim.
- D. Pursuant to La. R.S. 38:2196, with respect to public contracts involving the state or a political subdivision of the state, when the Work is to be done in this state (Louisiana), or the services are to be provided or the materials are to be supplied in this state, provisions in such agreements requiring disputes arising thereunder to be resolved in a forum outside of this state or requiring their interpretation to be governed by the laws of another jurisdiction are inequitable and against the public policy of this state.

7.12 *Record Documents*

- A. Contractor shall maintain in a safe place at the Site one printed record copy of all Drawings, Specifications, Addenda, Change Orders, Work Change Directives, Field Orders, written interpretations and clarifications, and approved Shop Drawings. Contractor shall keep such record documents in good order and annotate them to show changes made during construction. These record documents, together with all approved Samples, will be available to Engineer for reference. Upon completion of the Work, Contractor shall deliver these record documents to Engineer.

7.13 *Safety and Protection*

- A. Contractor shall be solely responsible for initiating, maintaining, and supervising all safety precautions and programs in connection with the Work. Such responsibility does not relieve Subcontractors of their responsibility for the safety of persons or property in the performance of their work, nor for compliance with applicable safety Laws and Regulations.
- B. Contractor shall designate a qualified and experienced safety representative whose duties and responsibilities are the prevention of Work-related accidents and the maintenance and supervision of safety precautions and programs.
- C. Contractor shall take all necessary precautions for the safety of, and shall provide the necessary protection to prevent damage, injury, or loss to:
 - 1. all persons on the Site or who may be affected by the Work;

2. all the Work and materials and equipment to be incorporated therein, whether in storage on or off the Site; and
 3. other property at the Site or adjacent thereto, including trees, shrubs, lawns, walks, pavements, roadways, structures, other work in progress, utilities, and Underground Facilities not designated for removal, relocation, or replacement in the course of construction.
- D. All damage, injury, or loss to any property referred to in Paragraph 7.13.C.2 or 7.13.C.3 caused, directly or indirectly, in whole or in part, by Contractor, any Subcontractor, Supplier, or any other individual or entity directly or indirectly employed by any of them to perform any of the Work, or anyone for whose acts any of them may be liable, shall be remedied by Contractor at its expense (except damage or loss attributable to the fault of Drawings or Specifications or to the acts or omissions of Owner or Engineer or anyone employed by any of them, or anyone for whose acts any of them may be liable, and not attributable, directly or indirectly, in whole or in part, to the fault or negligence of Contractor or any Subcontractor, Supplier, or other individual or entity directly or indirectly employed by any of them).
 - E. Contractor shall comply with all applicable Laws and Regulations relating to the safety of persons or property, or to the protection of persons or property from damage, injury, or loss; and shall erect and maintain all necessary safeguards for such safety and protection.
 - F. Contractor shall notify Owner; the owners of adjacent property; the owners of Underground Facilities and other utilities (if the identity of such owners is known to Contractor); and other contractors and utility owners performing work at or adjacent to the Site, in writing, when Contractor knows that prosecution of the Work may affect them, and shall cooperate with them in the protection, removal, relocation, and replacement of their property or work in progress.
 - G. Contractor shall comply with the applicable requirements of Owner's safety programs, if any. ~~Any Owner's safety programs that are applicable to the Work are identified or included in the Supplementary Conditions or Specifications.~~
 - H. Contractor shall inform Owner and Engineer of the specific requirements of Contractor's safety program with which Owner's and Engineer's employees and representatives must comply while at the Site.
 - I. Contractor's duties and responsibilities for safety and protection will continue until all the Work is completed, Engineer has issued a written notice to Owner and Contractor in accordance with Paragraph 15.06.C that the Work is acceptable, and Contractor has left the Site (except as otherwise expressly provided in connection with Substantial Completion).
 - J. Contractor's duties and responsibilities for safety and protection will resume whenever Contractor or any Subcontractor or Supplier returns to the Site to fulfill warranty or correction obligations, or to conduct other tasks arising from the Contract Documents.

7.14 *Hazard Communication Programs*

- A. Contractor shall be responsible for coordinating any exchange of safety data sheets (formerly known as material safety data sheets) or other hazard communication information required to be made available to or exchanged between or among employers at the Site in accordance with Laws or Regulations.

7.15 *Emergencies*

- A. In emergencies affecting the safety or protection of persons or the Work or property at the Site or adjacent thereto, Contractor is obligated to act to prevent damage, injury, or loss. Contractor shall give Engineer ~~prompt written~~ notice immediately but in no event more than 24 hours after the alleged emergency if Contractor believes that any significant changes in the Work or variations from the Contract Documents have been caused by an emergency, or are required as a result of Contractor's response to an emergency. If Engineer determines that a change in the Contract Documents is required because of an emergency or Contractor's response, a Work Change Directive or Change Order will be issued.

7.16 *Submittals*

A. *Shop Drawing and Sample Requirements*

- 1. Before submitting a Shop Drawing or Sample, Contractor shall:
 - a. review and coordinate the Shop Drawing or Sample with other Shop Drawings and Samples and with the requirements of the Work and the Contract Documents;
 - b. determine and verify:
 - 1) all field measurements, quantities, dimensions, specified performance and design criteria, installation requirements, materials, catalog numbers, and similar information with respect to the Submittal;
 - 2) the suitability of all materials and equipment offered with respect to the indicated application, fabrication, shipping, handling, storage, assembly, and installation pertaining to the performance of the Work; and
 - 3) all information relative to Contractor's responsibilities for means, methods, techniques, sequences, and procedures of construction, and safety precautions and programs incident thereto;
 - c. confirm that the Submittal is complete with respect to all related data included in the Submittal.
- 2. Each Shop Drawing or Sample must bear a stamp or specific written certification that Contractor has satisfied Contractor's obligations under the Contract Documents with respect to Contractor's review of that Submittal, and that Contractor approves the Submittal.
- 3. With each Shop Drawing or Sample, Contractor shall give Engineer specific written notice of any variations that the Submittal may have from the requirements of the Contract Documents. This notice must be set forth in a written communication separate from the Submittal; and, in addition, in the case of a Shop Drawing by a specific notation made on the Shop Drawing itself.

- B. *Submittal Procedures for Shop Drawings and Samples:* Contractor shall label and submit Shop Drawings and Samples to Engineer for review and approval in accordance with the accepted Schedule of Submittals.

1. *Shop Drawings*

- a. Contractor shall submit the number of copies required in the Specifications.

- b. Data shown on the Shop Drawings must be complete with respect to quantities, dimensions, specified performance and design criteria, materials, and similar data to show Engineer the services, materials, and equipment Contractor proposes to provide, and to enable Engineer to review the information for the limited purposes required by Paragraph 7.16.C.

2. *Samples*

- a. Contractor shall submit the number of Samples required in the Specifications.
 - b. Contractor shall clearly identify each Sample as to material, Supplier, pertinent data such as catalog numbers, the use for which intended and other data as Engineer may require to enable Engineer to review the Submittal for the limited purposes required by Paragraph 7.16.C.
3. Where a Shop Drawing or Sample is required by the Contract Documents or the Schedule of Submittals, any related Work performed prior to Engineer's review and approval of the pertinent submittal will be at the sole expense and responsibility of Contractor.

C. *Engineer's Review of Shop Drawings and Samples*

- 1. Engineer will provide timely review of Shop Drawings and Samples in accordance with the accepted Schedule of Submittals. Engineer's review and approval will be only to determine if the items covered by the Submittals will, after installation or incorporation in the Work, comply with the requirements of the Contract Documents, and be compatible with the design concept of the completed Project as a functioning whole as indicated by the Contract Documents.
- 2. Engineer's review and approval will not extend to means, methods, techniques, sequences, or procedures of construction, or to safety precautions or programs incident thereto.
- 3. Engineer's review and approval of a separate item as such will not indicate approval of the assembly in which the item functions.
- 4. Engineer's review and approval of a Shop Drawing or Sample will not relieve Contractor from responsibility for any variation from the requirements of the Contract Documents unless Contractor has complied with the requirements of Paragraph 7.16.A.3 and Engineer has given written approval of each such variation by specific written notation thereof incorporated in or accompanying the Shop Drawing or Sample. Engineer will document any such approved variation from the requirements of the Contract Documents in a Field Order or other appropriate Contract modification.
- 5. Engineer's review and approval of a Shop Drawing or Sample will not relieve Contractor from responsibility for complying with the requirements of Paragraphs 7.16.A and B.
- 6. Engineer's review and approval of a Shop Drawing or Sample, or of a variation from the requirements of the Contract Documents, will not, under any circumstances, change the Contract Times or Contract Price, unless such changes are included in a Change Order.
- 7. Neither Engineer's receipt, review, acceptance, or approval of a Shop Drawing or Sample will result in such item becoming a Contract Document.

8. Contractor shall perform the Work in compliance with the requirements and commitments set forth in approved Shop Drawings and Samples, subject to the provisions of Paragraph 7.16.C.4.

D. *Resubmittal Procedures for Shop Drawings and Samples*

1. Contractor shall make corrections required by Engineer and shall return the required number of corrected copies of Shop Drawings and submit, as required, new Samples for review and approval. Contractor shall direct specific attention in writing to revisions other than the corrections called for by Engineer on previous Submittals.
2. Contractor shall furnish required Shop Drawing and Sample submittals with sufficient information and accuracy to obtain required approval of an item with no more than two resubmittals. Engineer will record Engineer's time for reviewing a third or subsequent resubmittal of a Shop Drawing or Sample, and Contractor shall be responsible for Engineer's charges to Owner for such time. Owner may impose a set-off against payments due Contractor to secure reimbursement for such charges.
3. If Contractor requests a change of a previously approved Shop Drawing or Sample, Contractor shall be responsible for Engineer's charges to Owner for its review time, and Owner may impose a set-off against payments due Contractor to secure reimbursement for such charges, unless the need for such change is beyond the control of Contractor.

E. *Submittals Other than Shop Drawings, Samples, and Owner-Delegated Designs*

1. The following provisions apply to all Submittals other than Shop Drawings, Samples, and Owner-delegated designs:
 - a. Contractor shall submit all such Submittals to the Engineer in accordance with the Schedule of Submittals and pursuant to the applicable terms of the Contract Documents.
 - b. Engineer will provide timely review of all such Submittals in accordance with the Schedule of Submittals and return such Submittals with a notation of either Accepted or Not Accepted. Any such Submittal that is not returned within the time established in the Schedule of Submittals will be deemed accepted.
 - c. Engineer's review will be only to determine if the Submittal is acceptable under the requirements of the Contract Documents as to general form and content of the Submittal.
 - d. If any such Submittal is not accepted, Contractor shall confer with Engineer regarding the reason for the non-acceptance, and resubmit an acceptable document.
2. Procedures for the submittal and acceptance of the Progress Schedule, the Schedule of Submittals, and the Schedule of Values are set forth in Paragraphs 2.03, 2.04, and 2.05.

- F. *Owner-delegated Designs:*** Submittals pursuant to Owner-delegated designs are governed by the provisions of Paragraph 7.19.

7.17 *Contractor's General Warranty and Guarantee*

- A. Contractor warrants and guarantees to Owner that all Work will be in accordance with the Contract Documents and will not be defective. Engineer is entitled to rely on Contractor's warranty and guarantee.

- B. Owner's rights under this warranty and guarantee are in addition to, and are not limited by, Owner's rights under the correction period provisions of Paragraph 15.08. The time in which Owner may enforce its warranty and guarantee rights under this Paragraph 7.17 is limited only by applicable Laws and Regulations restricting actions to enforce such rights; provided, however, that after the end of the correction period under Paragraph 15.08:
1. Owner shall give Contractor written notice of any defective Work within 60 days of the discovery that such Work is defective; and
 2. Such notice will be deemed the start of an event giving rise to a Claim under Paragraph 12.01.B, such that any related Claim must be brought within 30 days of the notice.
- C. Contractor's warranty and guarantee hereunder excludes defects or damage caused by:
1. abuse, or improper modification, maintenance, or operation, by persons other than Contractor, Subcontractors, Suppliers, or any other individual or entity for whom Contractor is responsible; or
 2. normal wear and tear under normal usage.
- D. Contractor's obligation to perform and complete the Work in accordance with the Contract Documents is absolute. None of the following will constitute an acceptance of Work that is not in accordance with the Contract Documents, a release of Contractor's obligation to perform the Work in accordance with the Contract Documents, or a release of Owner's warranty and guarantee rights under this Paragraph 7.17:
1. Observations by Engineer;
 2. Recommendation by Engineer or payment by Owner of any progress or final payment;
 3. The issuance of a certificate of Substantial Completion by Engineer or any payment related thereto by Owner;
 4. Use or occupancy of the Work or any part thereof by Owner;
 5. Any review and approval of a Shop Drawing or Sample submittal;
 6. The issuance of a notice of acceptability by Engineer;
 7. The end of the correction period established in Paragraph 15.08;
 8. Any inspection, test, or approval by others; or
 9. Any correction of defective Work by Owner.
- E. If the Contract requires the Contractor to accept the assignment of a contract entered into by Owner, then the specific warranties, guarantees, and correction obligations contained in the assigned contract will govern with respect to Contractor's performance obligations to Owner for the Work described in the assigned contract.

7.18 *Indemnification*

- A. To the fullest extent permitted by Laws and Regulations, and in addition to any other obligations of Contractor under the Contract or otherwise, Contractor shall indemnify, defend, and hold harmless Owner and Engineer, and the officers, directors, members, partners, employees, agents, consultants and subcontractors of each and any of them (collectively the "Indemnitees"), from any and all losses, damages, costs, and judgments

EJCDC® C-700, Standard General Conditions of the Construction Contract.

Copyright© 2018 National Society of Professional Engineers, American Council of Engineering Companies,
and American Society of Civil Engineers. All rights reserved.

(including, but not limited to, all reasonable fees and charges of engineers, architects, attorneys, and other professionals, and all court or arbitration or other dispute resolution costs, and all reasonable fees and charges incurred in establishing the right to indemnity pursuant to the provisions in this section) arising from third-party claims or actions relating to or resulting from the performance or furnishing of the Work, provided that any such claim, action, loss, cost, judgment or damage is attributable to bodily injury, sickness, disease, or death, or to damage to or destruction of tangible property (other than the Work itself), including the loss of use resulting therefrom, but only to the extent caused by any negligent or intentional act or omission of Contractor, any Subcontractor, any Supplier, or any individual or entity directly or indirectly employed by any of them to perform any of the Work, or anyone for whose acts any of them may be liable.

Pursuant to La. R.S. 9:2780.1 and Article 6.02 of the General Conditions, Contractor acknowledges that Contractor is required to obtain insurance for the purpose of insuring its obligation to indemnify, defend, and hold harmless the Indemnitees as described above, and Contractor acknowledges that Contractor has recovered the cost of such insurance in the Contract Price.

B. In any and all claims against Owner or Engineer, or any of their officers, directors, members, partners, employees, agents, consultants, or subcontractors, by any employee (or the survivor or personal representative of such employee) of Contractor, any Subcontractor, any Supplier, or any individual or entity directly or indirectly employed by any of them to perform any of the Work, or anyone for whose acts any of them may be liable, the indemnification obligation under Paragraph 7.18.A will not be limited in any way by any limitation on the amount or type of damages, compensation, or benefits payable by or for Contractor or any such Subcontractor, Supplier, or other individual or entity under workers' compensation acts, disability benefit acts, or other employee benefit acts.

7.19 *Delegation of Professional Design Services*

- A. Owner may require Contractor to provide professional design services for a portion of the Work by express delegation in the Contract Documents. Such delegation will specify the performance and design criteria that such services must satisfy, and the Submittals that Contractor must furnish to Engineer with respect to the Owner-delegated design.
- B. Contractor shall cause such Owner-delegated professional design services to be provided pursuant to the professional standard of care by a properly licensed design professional, whose signature and seal must appear on all drawings, calculations, specifications, certifications, and Submittals prepared by such design professional. Such design professional must issue all certifications of design required by Laws and Regulations.
- C. If a Shop Drawing or other Submittal related to the Owner-delegated design is prepared by Contractor, a Subcontractor, or others for submittal to Engineer, then such Shop Drawing or other Submittal must bear the written approval of Contractor's design professional when submitted by Contractor to Engineer.
- D. Owner and Engineer shall be entitled to rely upon the adequacy, accuracy, and completeness of the services, certifications, and approvals performed or provided by the design professionals retained or employed by Contractor under an Owner-delegated design, subject to the professional standard of care and the performance and design criteria stated in the Contract Documents.

- E. Pursuant to this Paragraph 7.19, Engineer's review, approval, and other determinations regarding design drawings, calculations, specifications, certifications, and other Submittals furnished by Contractor pursuant to an Owner-delegated design will be only for the following limited purposes:
 - 1. Checking for conformance with the requirements of this Paragraph 7.19;
 - 2. Confirming that Contractor (through its design professionals) has used the performance and design criteria specified in the Contract Documents; and
 - 3. Establishing that the design furnished by Contractor is consistent with the design concept expressed in the Contract Documents.
- F. Contractor shall not be responsible for the adequacy of performance or design criteria specified by Owner or Engineer.
- G. Contractor is not required to provide professional services in violation of applicable Laws and Regulations.

ARTICLE 8—OTHER WORK AT THE SITE

8.01 *Other Work*

- A. In addition to and apart from the Work under the Contract Documents, the Owner may perform other work at or adjacent to the Site. Such other work may be performed by Owner's employees, or through contracts between the Owner and third parties. Owner may also arrange to have third-party utility owners perform work on their utilities and facilities at or adjacent to the Site.
- B. If Owner performs other work at or adjacent to the Site with Owner's employees, or through contracts for such other work, then Owner shall give Contractor written notice thereof prior to starting any such other work. If Owner has advance information regarding the start of any third-party utility work that Owner has arranged to take place at or adjacent to the Site, Owner shall provide such information to Contractor.
- C. Contractor shall afford proper and safe access to the Site to each contractor that performs such other work, each utility owner performing other work, and Owner, if Owner is performing other work with Owner's employees, and provide a reasonable opportunity for the introduction and storage of materials and equipment and the execution of such other work.
- D. Contractor shall do all cutting, fitting, and patching of the Work that may be required to properly connect or otherwise make its several parts come together and properly integrate with such other work. Contractor shall not endanger any work of others by cutting, excavating, or otherwise altering such work; provided, however, that Contractor may cut or alter others' work with the written consent of Engineer and the others whose work will be affected.
- E. If the proper execution or results of any part of Contractor's Work depends upon work performed by others, Contractor shall inspect such other work and promptly report to Engineer in writing any delays, defects, or deficiencies in such other work that render it unavailable or unsuitable for the proper execution and results of Contractor's Work. Contractor's failure to so report will constitute an acceptance of such other work as fit and

proper for integration with Contractor's Work except for latent defects and deficiencies in such other work.

- F. The provisions of this article are not applicable to work that is performed by third-party utilities or other third-party entities without a contract with Owner, or that is performed without having been arranged by Owner. If such work occurs, then any related delay, disruption, or interference incurred by Contractor is governed by the provisions of Paragraph 4.05.C.3.

8.02 *Coordination*

- A. If Owner intends to contract with others for the performance of other work at or adjacent to the Site, to perform other work at or adjacent to the Site with Owner's employees, or to arrange to have utility owners perform work at or adjacent to the Site, the following will be set forth in the Supplementary Conditions or provided to Contractor prior to the start of any such other work:
 - 1. The identity of the individual or entity that will have authority and responsibility for coordination of the activities among the various contractors;
 - 2. An itemization of the specific matters to be covered by such authority and responsibility; and
 - 3. The extent of such authority and responsibilities.
- B. Unless otherwise provided in the Supplementary Conditions, Owner shall have sole authority and responsibility for such coordination.

8.03 *Legal Relationships*

- A. If, in the course of performing other work for Owner at or adjacent to the Site, the Owner's employees, any other contractor working for Owner, or any utility owner that Owner has arranged to perform work, causes damage to the Work or to the property of Contractor or its Subcontractors, or delays, disrupts, interferes with, or increases the scope or cost of the performance of the Work, through actions or inaction, then Contractor shall be entitled to an equitable adjustment in the Contract Price or the Contract Times. Contractor must submit any Change Proposal seeking an equitable adjustment in the Contract Price or the Contract Times under this paragraph within 30 days of the damaging, delaying, disrupting, or interfering event. The entitlement to, and extent of, any such equitable adjustment will take into account information (if any) regarding such other work that was provided to Contractor in the Contract Documents prior to the submittal of the Bid or the final negotiation of the terms of the Contract, and any remedies available to Contractor under Laws or Regulations concerning utility action or inaction. When applicable, any such equitable adjustment in Contract Price will be conditioned on Contractor assigning to Owner all Contractor's rights against such other contractor or utility owner with respect to the damage, delay, disruption, or interference that is the subject of the adjustment. Contractor's entitlement to an adjustment of the Contract Times or Contract Price is subject to the provisions of Paragraphs 4.05.D and 4.05.E.
- B. Contractor shall take reasonable and customary measures to avoid damaging, delaying, disrupting, or interfering with the work of Owner, any other contractor, or any utility owner performing other work at or adjacent to the Site.
 - 1. If Contractor fails to take such measures and as a result damages, delays, disrupts, or interferes with the work of any such other contractor or utility owner, then Owner may

impose a set-off against payments due Contractor, and assign to such other contractor or utility owner the Owner's contractual rights against Contractor with respect to the breach of the obligations set forth in this Paragraph 8.03.B.

2. When Owner is performing other work at or adjacent to the Site with Owner's employees, Contractor shall be liable to Owner for damage to such other work, and for the reasonable direct delay, disruption, and interference costs incurred by Owner as a result of Contractor's failure to take reasonable and customary measures with respect to Owner's other work. In response to such damage, delay, disruption, or interference, Owner may impose a set-off against payments due Contractor.
- C. If Contractor damages, delays, disrupts, or interferes with the work of any other contractor, or any utility owner performing other work at or adjacent to the Site, through Contractor's failure to take reasonable and customary measures to avoid such impacts, or if any claim arising out of Contractor's actions, inactions, or negligence in performance of the Work at or adjacent to the Site is made by any such other contractor or utility owner against Contractor or Owner, ~~or Engineer~~, then Contractor shall (1) promptly attempt to settle the claim as to all parties through negotiations with such other contractor or utility owner, or otherwise resolve the claim by ~~arbitration or other~~ a dispute resolution proceeding or at law, and (2) indemnify and hold harmless Owner and Engineer, ~~and the officers, directors, members, partners, employees, agents, consultants and subcontractors of each and any of them~~ from and against any such claims, and against all costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals and all court or arbitration or other dispute resolution costs) arising out of or relating to such damage, delay, disruption, or interference.

ARTICLE 9—OWNER'S RESPONSIBILITIES

9.01 *Communications to Contractor*

- A. Except as otherwise provided in these General Conditions, Owner shall issue all communications to Contractor through Engineer.

9.02 *Replacement of Engineer*

- A. Owner may at its discretion appoint an engineer to replace Engineer ~~provided Contractor makes no reasonable objection to the replacement engineer~~. The replacement engineer's status under the Contract Documents will be that of the former Engineer.

9.03 *Furnish Data*

- A. Owner shall promptly furnish the data required of Owner under the Contract Documents.

9.04 *Pay When Due*

- A. Owner shall make payments to Contractor when they are due as provided in the Agreement.

9.05 *Lands and Easements; Reports, Tests, and Drawings*

- A. Owner's duties with respect to providing lands and easements are set forth in Paragraph 5.01.
- B. Owner's duties with respect to providing engineering surveys to establish reference points are set forth in Paragraph 4.03.

- C. Article 5 refers to Owner's identifying and making available to Contractor copies of reports of explorations and tests of conditions at the Site, and drawings of physical conditions relating to existing surface or subsurface structures at the Site.

~~9.06 Insurance~~

- ~~A. Owner's responsibilities, if any, with respect to purchasing and maintaining liability and property insurance are set forth in Article 6.~~

9.06 *Change Orders*

- A. Owner's responsibilities with respect to Change Orders are set forth in Article 11.

9.07 *Inspections, Tests, and Approvals*

- A. Owner's responsibility with respect to certain inspections, tests, and approvals is set forth in Paragraph 14.02.B.

9.08 *Limitations on Owner's Responsibilities*

- A. The Owner shall not supervise, direct, or have control or authority over, nor be responsible for, Contractor's means, methods, techniques, sequences, or procedures of construction, or the safety precautions and programs incident thereto, or for any failure of Contractor to comply with Laws and Regulations applicable to the performance of the Work. Owner will not be responsible for Contractor's failure to perform the Work in accordance with the Contract Documents.

9.09 *Undisclosed Hazardous Environmental Condition*

- A. Owner's responsibility in respect to an undisclosed Hazardous Environmental Condition is set forth in Paragraph 5.06.

~~9.11 Evidence of Financial Arrangements~~

- ~~A. Upon request of Contractor, Owner shall furnish Contractor reasonable evidence that financial arrangements have been made to satisfy Owner's obligations under the Contract (including obligations under proposed changes in the Work).~~

9.10 *NEW: Safety Programs*

- A. NEW: While at the Site, Owner's employees and representatives shall comply with the specific applicable requirements of Contractor's safety programs of which Owner has been informed.

ARTICLE 10—ENGINEER'S STATUS DURING CONSTRUCTION

10.01 *Owner's Representative*

- A. Engineer will be Owner's representative during the construction period. The duties and responsibilities and the limitations of authority of Engineer as Owner's representative during construction are set forth in the Contract.
- B. Engineer shall identify a specific individual to serve as liaison between Owner and Contractor and between Engineer and Contractor. Engineer will notify Owner and Contractor of the name of an acting replacement as Engineer representative whenever the person so designated is not available. Whenever the Contractor or Owner requires information, direction, or assistance, the Contractor or Owner shall notify the individual designated by Engineer.

10.02 *Visits to Site*

- A. Engineer will make visits to the Site at intervals appropriate to the various stages of construction as Engineer deems necessary in order to observe, as an experienced and qualified design professional, the progress that has been made and the quality of the various aspects of Contractor's executed Work. Based on information obtained during such visits and observations, Engineer, for the benefit of Owner, will determine, in general, if the Work is proceeding in accordance with the Contract Documents. Engineer will not be required to make exhaustive or continuous inspections on the Site to check the quality or quantity of the Work. Engineer's efforts will be directed toward providing for Owner a greater degree of confidence that the completed Work will conform generally to the Contract Documents. On the basis of such visits and observations, Engineer will keep Owner informed of the progress of the Work and will endeavor to guard Owner against defective Work.
- B. Engineer's visits and observations are subject to all the limitations on Engineer's authority and responsibility set forth in Paragraph 10.07. Particularly, but without limitation, during or as a result of Engineer's visits or observations of Contractor's Work, Engineer will not supervise, direct, control, or have authority over or be responsible for Contractor's means, methods, techniques, sequences, or procedures of construction, or the safety precautions and programs incident thereto, or for any failure of Contractor to comply with Laws and Regulations applicable to the performance of the Work.

10.03 *Resident Project Representative*

- A. If Owner and Engineer have agreed that Engineer will furnish a Resident Project Representative to represent Engineer at the Site and assist Engineer in observing the progress and quality of the Work, then the authority and responsibilities of any such Resident Project Representative will be as provided in the Supplementary Conditions, and limitations on the responsibilities thereof will be as provided in the Supplementary Conditions and in Paragraph 10.07.
- B. If Owner designates an individual or entity who is not Engineer's consultant, agent, or employee to represent Owner at the Site, then the responsibilities and authority of such individual or entity will be as provided in the Supplementary Conditions.

10.04 *Engineer's Authority*

- A. Engineer has the authority to reject Work in accordance with Article 14.
- B. Engineer's authority as to Submittals is set forth in Paragraph 7.16.
- C. Engineer's authority as to design drawings, calculations, specifications, certifications and other Submittals from Contractor in response to Owner's delegation (if any) to Contractor of professional design services, is set forth in Paragraph 7.19.
- D. Engineer's authority as to changes in the Work is set forth in Article 11.
- E. Engineer's authority as to Applications for Payment is set forth in Article 15.

10.05 *Determinations for Unit Price Work*

- A. Engineer will determine the actual quantities and classifications of Unit Price Work performed by Contractor as set forth in Paragraph 13.03.

10.06 *Decisions on Requirements of Contract Documents and Acceptability of Work*

- A. Engineer will render decisions regarding the requirements of the Contract Documents, and judge the acceptability of the Work, pursuant to the specific procedures set forth herein for initial interpretations, Change Proposals, and acceptance of the Work. In rendering such decisions and judgments, Engineer will not show partiality to Owner or Contractor, and will not be liable to Owner, Contractor, or others in connection with any proceedings, interpretations, decisions, or judgments conducted or rendered in good faith.

10.07 *Limitations on Engineer's Authority and Responsibilities*

- A. Neither Engineer's authority or responsibility under this Article 10 or under any other provision of the Contract, nor any decision made by Engineer in good faith either to exercise or not exercise such authority or responsibility or the undertaking, exercise, or performance of any authority or responsibility by Engineer, will create, impose, or give rise to any duty in contract, tort, or otherwise owed by Engineer to Contractor, any Subcontractor, any Supplier, any other individual or entity, or to any surety for or employee or agent of any of them.
- B. Engineer will not supervise, direct, control, or have authority over or be responsible for Contractor's means, methods, techniques, sequences, or procedures of construction, or the safety precautions and programs incident thereto, or for any failure of Contractor to comply with Laws and Regulations applicable to the performance of the Work. Engineer will not be responsible for Contractor's failure to perform the Work in accordance with the Contract Documents.
- C. Engineer will not be responsible for the acts or omissions of Contractor or of any Subcontractor, any Supplier, or of any other individual or entity performing any of the Work.
- D. Engineer's review of the final Application for Payment and accompanying documentation, and all maintenance and operating instructions, schedules, guarantees, bonds, certificates of inspection, tests and approvals, and other documentation required to be delivered by Contractor under Paragraph 15.06.A, will only be to determine generally that their content complies with the requirements of, and in the case of certificates of inspections, tests, and approvals, that the results certified indicate compliance with the Contract Documents.
- E. The limitations upon authority and responsibility set forth in this Paragraph 10.07 also apply to the Resident Project Representative, if any.
- F. The duties, responsibilities, and limitations of authority of the Resident Project Representative are as further defined in the Supplementary Conditions and Exhibit A, which is attached thereto and incorporated therein by reference.

10.08 *Compliance with Safety Program*

- A. While at the Site, Engineer's employees and representatives will comply with the specific applicable requirements of Owner's and Contractor's safety programs of which Engineer has been informed.

ARTICLE 11—CHANGES TO THE CONTRACT

11.01 *Amending and Supplementing the Contract*

- A. The Contract may be amended or supplemented by a Change Order, a Work Change Directive, or a Field Order.

- B. If an amendment or supplement to the Contract includes a change in the Contract Price or the Contract Times, such amendment or supplement must be set forth in a Change Order.
- C. All changes to the Contract that involve (1) the performance or acceptability of the Work, (2) the design (as set forth in the Drawings, Specifications, or otherwise), or (3) other engineering or technical matters, must be supported by Engineer's recommendation. Owner and Contractor may amend other terms and conditions of the Contract without the recommendation of the Engineer.

11.02 *Change Orders*

- A. Owner and Contractor shall execute appropriate Change Orders covering:
 - 1. Changes in Contract Price or Contract Times which are agreed to by the parties, including any undisputed sum or amount of time for Work actually performed in accordance with a Work Change Directive;
 - 2. Changes in Contract Price resulting from an Owner set-off, unless Contractor has duly contested such set-off;
 - 3. Changes in the Work which are: (a) ordered by Owner pursuant to Paragraph 11.05, (b) required because of Owner's acceptance of defective Work under Paragraph 14.04 or Owner's correction of defective Work under Paragraph 14.07, or (c) agreed to by the parties, subject to the need for Engineer's recommendation if the change in the Work involves the design (as set forth in the Drawings, Specifications, or otherwise) or other engineering or technical matters; and
 - 4. Changes that embody the substance of any final and binding results under: Paragraph 11.03.B, resolving the impact of a Work Change Directive; Paragraph 11.09, concerning Change Proposals; Article 12, Claims; Paragraph 13.02.D, final adjustments resulting from allowances; Paragraph 13.03.D, final adjustments relating to determination of quantities for Unit Price Work; and similar provisions.
- ~~B. If Owner or Contractor refuses to execute a Change Order that is required to be executed under the terms of Paragraph 11.02.A, it will be deemed to be of full force and effect, as if fully executed.~~

11.03 *Work Change Directives*

- A. A Work Change Directive will not change the Contract Price or the Contract Times but is evidence that the parties expect that the modification ordered or documented by a Work Change Directive will be incorporated in a subsequently issued Change Order, following negotiations by the parties as to the Work Change Directive's effect, if any, on the Contract Price and Contract Times; or, if negotiations are unsuccessful, by a determination under the terms of the Contract Documents governing adjustments, expressly including Paragraph 11.07 regarding change of Contract Price.
- B. If Owner has issued a Work Change Directive and:
 - 1. Contractor believes that an adjustment in Contract Times or Contract Price is necessary, then Contractor shall submit any Change Proposal seeking such an adjustment no later than 30 days after the completion of the Work set out in the Work Change Directive.

2. Owner believes that an adjustment in Contract Times or Contract Price is necessary, then Owner shall submit any Claim seeking such an adjustment no later than 60 days after issuance of the Work Change Directive.

11.04 *Field Orders*

- A. Engineer may authorize minor changes in the Work if the changes do not involve an adjustment in the Contract Price or the Contract Times and are compatible with the design concept of the completed Project as a functioning whole as indicated by the Contract Documents. Such changes will be accomplished by a Field Order and will be binding on Owner and also on Contractor, which shall perform the Work involved promptly.
- B. If Contractor believes that a Field Order justifies an adjustment in the Contract Price or Contract Times, then before proceeding with the Work at issue, Contractor shall submit a Change Proposal as provided herein.

11.05 *Owner-Authorized Changes in the Work*

- A. Without invalidating the Contract and without notice to any surety, Owner may, at any time or from time to time, order additions, deletions, or revisions in the Work. Changes involving the design (as set forth in the Drawings, Specifications, or otherwise) or other engineering or technical matters will be supported by Engineer's recommendation.
- B. Such changes in the Work may be accomplished by a Change Order, if Owner and Contractor have agreed as to the effect, if any, of the changes on Contract Times or Contract Price; or by a Work Change Directive. Upon receipt of any such document, Contractor shall promptly proceed with the Work involved; or, in the case of a deletion in the Work, promptly cease construction activities with respect to such deleted Work. Added or revised Work must be performed under the applicable conditions of the Contract Documents.
- C. Nothing in this Paragraph 11.05 obligates Contractor to undertake work that Contractor reasonably concludes cannot be performed in a manner consistent with Contractor's safety obligations under the Contract Documents or Laws and Regulations.

11.06 *Unauthorized Changes in the Work*

- A. Contractor shall not be entitled to an increase in the Contract Price or an extension of the Contract Times with respect to any work performed that is not required by the Contract Documents, as amended, modified, or supplemented, except in the case of an emergency as provided in Paragraph 7.15 or in the case of uncovering Work as provided in Paragraph 14.05.C.2.

11.07 *Change of Contract Price*

- A. The Contract Price may only be changed by a Change Order. Any Change Proposal for an adjustment in the Contract Price must comply with the provisions of Paragraph 11.09. Any Claim for an adjustment of Contract Price must comply with the provisions of Article 12. No course of conduct or dealings between the parties, no express or implied acceptance of alterations or additions to the Work, and no claim that the OWNER has been unjustly enriched by any alterations or additions to the Work shall be the basis of any claim for an increase in any amount due under the Contract Documents
- B. An adjustment in the Contract Price will be determined as follows:

1. Where the Work involved is covered by unit prices contained in the Contract Documents, then by application of such unit prices to the quantities of the items involved (subject to the provisions of Paragraph 13.03);
 2. Where the Work involved is not covered by unit prices contained in the Contract Documents, then by a mutually agreed lump sum (which may include an allowance for overhead and profit not necessarily in accordance with Paragraph 11.07.C.2); or
 3. Where the Work involved is not covered by unit prices contained in the Contract Documents and the parties do not reach mutual agreement to a lump sum, then on ~~the a~~ a “Force Account” basis, ~~of comprised by~~ the Cost of the Work (determined as provided in Paragraph 13.01) plus a Contractor’s fee for overhead and profit (determined as provided in Paragraph 11.07.C).
- C. *Contractor’s Fee:* When applicable, the Contractor’s fee for overhead and profit will be determined as follows:
1. A mutually acceptable fixed fee.; or
 2. If a fixed fee is not agreed upon, then a fee based on the following percentages of the various portions of the Cost of the Work:
 - a. For costs incurred under Paragraphs 13.01.B.1 and 13.01.B.2, the Contractor’s fee will be 15 percent;
 - b. For costs incurred under Paragraph 13.01.B.3, the Contractor’s fee will be 5 percent;
 - c. Where one or more tiers of subcontracts are on the basis of Cost of the Work plus a fee and no fixed fee is agreed upon, the intent of Paragraphs 11.07.C.2.a and 11.07.C.2.b is that the Contractor’s fee will be based on: (1) a fee of 15 percent of the costs incurred under Paragraphs 13.01.B.1 and 13.01.B.2 by the Subcontractor that actually performs the Work, at whatever tier, and (2) with respect to Contractor itself and to any Subcontractors of a tier higher than that of the Subcontractor that actually performs the Work, a fee of 5 percent of the amount (fee plus underlying costs incurred) attributable to the next lower tier Subcontractor; provided, however, that for any such subcontracted Work the maximum total fee to be paid by Owner will be no greater than 27 percent of the costs incurred by the Subcontractor that actually performs the Work;
 - d. No fee will be payable on the basis of costs itemized under Paragraphs 13.01.B.4, 13.01.B.5, and 13.01.C;
 - e. The amount of credit to be allowed by Contractor to Owner for any change which results in a net decrease in Cost of the Work will be the amount of the actual net decrease in Cost of the Work and a deduction of an additional amount equal to 5 percent of such actual net decrease in Cost of the Work; and
 - f. When both additions and credits are involved in any one change or Change Proposal, the adjustment in Contractor’s fee will be computed by determining the sum of the costs in each of the cost categories in Paragraph 13.01.B (specifically, payroll costs, Paragraph 13.01.B.1; incorporated materials and equipment costs, Paragraph 13.01.B.2; Subcontract costs, Paragraph 13.01.B.3; special consultants costs, Paragraph 13.01.B.4; and other costs, Paragraph 13.01.B.5) and applying to

each such cost category sum the appropriate fee from Paragraphs 11.07.C.2.a through 11.07.C.2.e, inclusive.

11.08 *Change of Contract Times*

- A. The Contract Times may only be changed by a Change Order. Any Change Proposal for an adjustment in the Contract Times must comply with the provisions of Paragraph 11.09. Any Claim for an adjustment in the Contract Times must comply with the provisions of Article 12. No course of conduct or dealings between the parties, no express or implied acceptance of alterations or additions to the Work, and no claim that the Owner has been unjustly enriched by any alterations or additions to the Work shall be the basis of any claim for a change in any time period provided for in the Contract Documents.
- B. Delay, disruption, and interference in the Work, and any related changes in Contract Times, are addressed in and governed by Paragraph 4.05.
- C. All time limits stated in the Contract Documents are of the essence of the Agreement. The Contractor acknowledges and understands that failure by the Contractor will cause significant damage to the Owner both in direct damages as well as delay damages, including but not limited to the damages specified in the Agreement as actual damages and as liquidated damages.

11.09 *Change Proposals*

- A. *Purpose and Content:* Contractor shall submit a Change Proposal to Engineer to request an adjustment in the Contract Times or Contract Price; contest an initial decision by Engineer concerning the requirements of the Contract Documents or relating to the acceptability of the Work under the Contract Documents; challenge a set-off against payment due; or seek other relief under the Contract. The Change Proposal will specify any proposed change in Contract Times or Contract Price, or other proposed relief, and explain the reason for the proposed change, with citations to any governing or applicable provisions of the Contract Documents. Each Change Proposal will address only one issue, or a set of closely related issues.
- B. *Change Proposal Procedures*
 - 1. *Submittal:* Contractor shall submit each Change Proposal to Engineer within 30 days after the start of the event giving rise thereto, or after such initial decision.
 - 2. *Supporting Data:* The Contractor shall submit supporting data, including the proposed change in Contract Price or Contract Time (if any), to the Engineer and Owner within 15 days after the submittal of the Change Proposal.
 - a. Change Proposals based on or related to delay, interruption, or interference must comply with the provisions of Paragraphs 4.05.D and 4.05.E.
 - b. Change proposals related to a change of Contract Price must include full and detailed accounts of materials incorporated into the Work and labor and equipment used for the subject Work.

The supporting data must be accompanied by a written statement that the supporting data are accurate and complete, and that any requested time or price adjustment is the entire adjustment to which Contractor believes it is entitled as a result of said event.

3. *Engineer's Initial Review:* Engineer will advise Owner regarding the Change Proposal, and consider any comments or response from Owner regarding the Change Proposal. If in its discretion Engineer concludes that additional supporting data is needed before conducting a full review and making a decision regarding the Change Proposal, then Engineer may request that Contractor submit such additional supporting data by a date specified by Engineer, prior to Engineer beginning its full review of the Change Proposal.
 4. *Engineer's Full Review and Action on the Change Proposal:* Upon receipt of Contractor's supporting data (including any additional data requested by Engineer), Engineer will conduct a full review of each Change Proposal and, within 30 days after such receipt of the Contractor's supporting data, either approve the Change Proposal in whole, deny it in whole, or approve it in part and deny it in part. Such actions must be in writing, with a copy provided to Owner and Contractor. If Engineer does not take action on the Change Proposal within 30 days, then either Owner or Contractor may at any time thereafter submit a letter to the other party indicating that as a result of Engineer's inaction the Change Proposal is deemed denied, thereby commencing the time for appeal of the denial under Article 12.
 5. *Binding Decision:* Engineer's decision is final and binding upon Owner and Contractor, unless Owner or Contractor appeals the decision by filing a Claim under Article 12.
- C. *Resolution of Certain Change Proposals:* If the Change Proposal does not involve the design (as set forth in the Drawings, Specifications, or otherwise), the acceptability of the Work, or other engineering or technical matters, then Engineer will notify the parties in writing that the Engineer is unable to resolve the Change Proposal. For purposes of further resolution of such a Change Proposal, such notice will be deemed a denial, and Contractor may choose to seek resolution under the terms of Article 12.
- D. *Post-Completion:* Contractor shall not submit any Change Proposals after Engineer issues a written recommendation of final payment pursuant to Paragraph 15.06.B.

11.10 *Notification to Surety*

- A. If the provisions of any bond require notice to be given to a surety of any change affecting the general scope of the Work or the provisions of the Contract Documents (including, but not limited to, Contract Price or Contract Times), the giving of any such notice will be Contractor's responsibility. The amount of each applicable bond will be adjusted to reflect the effect of any such change.

ARTICLE 12—CLAIMS

12.01 *Claims*

- A. *Claims Process:* The following disputes between Owner and Contractor are subject to the Claims process set forth in this article:
1. Appeals by Owner or Contractor of Engineer's decisions regarding Change Proposals;
 2. Owner demands for adjustments in the Contract Price or Contract Times, or other relief under the Contract Documents;

3. Disputes that Engineer has been unable to address because they do not involve the design (as set forth in the Drawings, Specifications, or otherwise), the acceptability of the Work, or other engineering or technical matters; and
 4. Subject to the waiver provisions of Paragraph 15.07, any dispute arising after Engineer has issued a written recommendation of final payment pursuant to Paragraph 15.06.B.
- B. *Submittal of Claim:* The party submitting a Claim shall deliver it directly to the other party to the Contract promptly (but in no event later than 30 days) after the start of the event giving rise thereto; in the case of appeals regarding Change Proposals within 30 days of the decision under appeal. The party submitting the Claim shall also furnish a copy to the Engineer, for its information only. The responsibility to substantiate a Claim rests with the party making the Claim. In the case of a Claim by Contractor seeking an increase in the Contract Times or Contract Price, Contractor shall certify that the Claim is made in good faith, that the supporting data are accurate and complete, and that to the best of Contractor's knowledge and belief the amount of time or money requested accurately reflects the full amount to which Contractor is entitled.
- C. *Review and Resolution:* The party receiving a Claim shall review it thoroughly, giving full consideration to its merits. The two parties shall seek to resolve the Claim through the exchange of information and direct negotiations. The parties may extend the time for resolving the Claim by mutual agreement. All actions taken on a Claim will be stated in writing and submitted to the other party, with a copy to Engineer.
- D. *Mediation*
1. At any time after initiation of a Claim, Owner and Contractor may mutually agree to mediation of the underlying dispute. The agreement to mediate will stay the Claim submittal and response process.
 2. If Owner and Contractor agree to mediation, then after 60 days from such agreement, either Owner or Contractor may unilaterally terminate the mediation process, and the Claim submittal and decision process will resume as of the date of the termination. If the mediation proceeds but is unsuccessful in resolving the dispute, the Claim submittal and decision process will resume as of the date of the conclusion of the mediation, as determined by the mediator.
 3. Owner and Contractor shall each pay one-half of the mediator's fees and costs.
- E. *Partial Approval:* If the party receiving a Claim approves the Claim in part and denies it in part, such action will be final and binding ~~unless within 30 days of such action the other party invokes the procedure set forth in Article 17 for final resolution of disputes.~~
- F. *Denial of Claim:* If efforts to resolve a Claim are not successful, the party receiving the Claim may deny it by giving written notice of denial to the other party. If the receiving party does not take action on the Claim within 90 days, then either Owner or Contractor may at any time thereafter submit a letter to the other party indicating that as a result of the inaction, the Claim is deemed denied, thereby commencing the time for appeal of the denial. ~~A denial of the Claim will be final and binding unless within 30 days of the denial the other party invokes the procedure set forth in Article 17 for the final resolution of disputes.~~
- G. *Final and Binding Results:* If the parties reach a mutual agreement regarding a Claim, whether through approval of the Claim, direct negotiations, mediation, or otherwise; or if a Claim is

approved in part and denied in part, or denied in full, and such actions become final and binding; then the results of the agreement or action on the Claim will be incorporated in a Change Order or other written document to the extent they affect the Contract, including the Work, the Contract Times, or the Contract Price.

ARTICLE 13—COST OF THE WORK; ALLOWANCES; UNIT PRICE WORK

13.01 *Cost of the Work*

- A. *Purposes for Determination of Cost of the Work:* The term Cost of the Work means the sum of all costs necessary for the proper performance of the Work at issue, as further defined below. The provisions of this Paragraph 13.01 are used for two distinct purposes:
1. To determine Cost of the Work when Cost of the Work is a component of the Contract Price, under cost-plus-fee, time-and-materials, or other cost-based terms; or
 2. When needed to determine the value of a Change Order, Change Proposal, Claim, set-off, or other adjustment in Contract Price. When the value of any such adjustment is determined on the basis of Cost of the Work, Contractor is entitled only to those additional or incremental costs required because of the change in the Work or because of the event giving rise to the adjustment.
- B. *Costs Included:* Except as otherwise may be agreed to in writing by Owner, costs included in the Cost of the Work will be in amounts no higher than those commonly incurred in the locality of the Project, will not include any of the costs itemized in Paragraph 13.01.C, and will include only the following items:
1. ~~Payroll costs for employees in the direct employ of Contractor in the performance of the Work under schedules of job classifications agreed upon by Owner and Contractor in advance of the subject Work. Such employees include, without limitation, superintendents, foremen, safety managers, safety representatives, and other personnel employed full time on the Work. Payroll costs for employees not employed full time on the Work will be apportioned on the basis of their time spent on the Work. Payroll costs include, but are not limited to, salaries and wages plus the cost of fringe benefits, which include social security contributions, unemployment, excise, and payroll taxes, workers' compensation, health and retirement benefits, sick leave, and vacation and holiday pay applicable thereto. The expenses of performing Work outside of regular working hours, on Saturday, Sunday, or legal holidays, will be included in the above to the extent authorized by Owner.~~

For labor and working foremen in direct charge of operations, the Contractor shall receive the wage rates agreed on in writing before beginning work for each hour that said labor and foremen are engaged in such work. Jobsite and home office supervisory personnel shall not be included as direct labor. The Contractor shall receive the actual costs paid to, or in behalf of, workers for subsistence and travel allowances, health and welfare benefits, pension fund benefits or other benefits when such amounts are required by collective bargaining agreement or other employment contract applicable to the classes of labor employed on the Work, but limited to a maximum daily rate for subsistence and travel allowances. This maximum shall be agreed upon prior to the Contractor incurring such charges.

2. ~~Cost of all materials and equipment furnished and incorporated in the Work, including costs of transportation and storage thereof, and Suppliers' field services required in connection therewith. All cash discounts accrue to Contractor unless Owner deposits funds with Contractor with which to make payments, in which case the cash discounts will accrue to Owner. All trade discounts, rebates, and refunds and returns from sale of surplus materials and equipment will accrue to Owner, and Contractor shall make provisions so that they may be obtained.~~

For materials accepted by the Engineer and used, the Contractor shall receive the actual cost of such materials delivered to the Work, including transportation charges and sales taxes if applicable.

3. ~~Payments made by Contractor to Subcontractors for Work performed by Subcontractors. If required by Owner, Contractor shall obtain competitive bids from subcontractors acceptable to Owner and Contractor and shall deliver such bids to Owner, which will then determine, with the advice of Engineer, which bids, if any, will be acceptable. If any subcontract provides that the Subcontractor is to be paid on the basis of Cost of the Work plus a fee, the Subcontractor's Cost of the Work and fee will be determined in the same manner as Contractor's Cost of the Work and fee as provided in this Paragraph 13.01.~~

For Change Order work performed by an approved Subcontractor, the Subcontractor shall receive the Subcontractor's actual and reasonable allowable direct cost of such Work plus a 15 percent mark-up for the Subcontractor's indirect jobsite and home office overhead expenses and profit. In addition, the Contractor will be paid a 10 percent mark-up on the Subcontractor's total direct and indirect costs, and profit for general supervision and sequencing of the Change Order work.

4. Costs of special consultants (including but not limited to engineers, architects, testing laboratories, surveyors, attorneys, and accountants) employed or retained for services specifically related to the Work, but only to the extent approved in writing by Owner.
5. Other costs consisting of the following:
 - a. The proportion of necessary transportation, travel, and subsistence expenses of Contractor's employees incurred in discharge of duties connected with the Work.
 - b. Cost, including transportation and maintenance, of all materials, supplies, equipment, machinery, appliances, office, and temporary facilities at the Site, which are consumed in the performance of the Work, and cost, less market value, of such items used but not consumed which remain the property of Contractor.
 - 1) In establishing included costs for materials such as scaffolding, plating, or sheeting, consideration will be given to the actual or the estimated life of the material for use on other projects; or rental rates may be established on the basis of purchase or salvage value of such items, whichever is less. Contractor will not be eligible for compensation for such items in an amount that exceeds the purchase cost of such item.
 - c. *Construction Equipment Rental*
 - 1) ~~Rentals of all construction equipment and machinery, and the parts thereof, in accordance with rental agreements approved by Owner as to price (including any surcharge or special rates applicable to overtime use of the construction~~

~~equipment or machinery), and the costs of transportation, loading, unloading, assembly, dismantling, and removal thereof. All such costs will be in accordance with the terms of said rental agreements. The rental of any such equipment, machinery, or parts must cease when the use thereof is no longer necessary for the Work.~~

- ~~2) Costs for equipment and machinery owned by Contractor or a Contractor related entity will be paid at a rate shown for such equipment in the equipment rental rate book specified in the Supplementary Conditions. An hourly rate will be computed by dividing the monthly rates by 176. These computed rates will include all operating costs.~~
- ~~3) With respect to Work that is the result of a Change Order, Change Proposal, Claim, set off, or other adjustment in Contract Price ("changed Work"), included costs will be based on the time the equipment or machinery is in use on the changed Work and the costs of transportation, loading, unloading, assembly, dismantling, and removal when directly attributable to the changed Work. The cost of any such equipment or machinery, or parts thereof, must cease to accrue when the use thereof is no longer necessary for the changed Work.~~

For authorized machinery or special equipment, the Contractor shall receive the rental rates agreed on in writing before such work is begun. For equipment rented from independent outside sources, the Contractor will be reimbursed the reasonable actual cost as shown on paid rental invoices. For company owned equipment, the Contractor will be reimbursed his internal cost recovery equipment charge rate consistent with his original bid cost estimates. If the Contractor chooses to use a rental rate guide book instead of his internal cost recovery rates to establish rental rates for company owned equipment, costs for equipment and will be paid at a rate shown for such equipment in the equipment rental rate book specified in the Supplementary Conditions. In addition, no 15 percent mark-up on equipment direct cost for jobsite and home office overhead expenses and profit will be allowed if the Contractor chooses to use rental rate guide book prices instead of his internal cost recovery rates.

- d. Sales, consumer, use, and other similar taxes related to the Work, and for which Contractor is liable, as imposed by Laws and Regulations.
- e. Deposits lost for causes other than negligence of Contractor, any Subcontractor, or anyone directly or indirectly employed by any of them or for whose acts any of them may be liable, and royalty payments and fees for permits and licenses.
- f. Losses and damages (and related expenses) caused by damage to the Work, not compensated by insurance or otherwise, sustained by Contractor in connection with the performance of the Work ~~(except losses and damages within the deductible amounts of builder's risk or other property insurance established in accordance with Paragraph 6.04)~~, provided such losses and damages have resulted from causes other than the negligence of Contractor, any Subcontractor, or anyone directly or indirectly employed by any of them or for whose acts any of them may be liable. Such losses include settlements made with the written consent and approval of Owner. No such losses, damages, and expenses will be included in the Cost of the Work for the purpose of determining Contractor's fee.

- g. The cost of utilities, fuel, and sanitary facilities at the Site.
- h. Minor expenses such as communication service at the Site, express and courier services, and similar petty cash items in connection with the Work.
- i. ~~The costs of premiums for all bonds and insurance that Contractor is required by the Contract Documents to purchase and maintain.~~

For property damage, liability and workmen's compensation insurance premiums, unemployment insurance contributions, social security taxes, and bond costs on Force Account work, the Contractor shall receive the actual cost thereof. The Contractor shall furnish satisfactory evidence of the rates paid for such bond, insurance and tax.

C. *Costs Excluded:* The term Cost of the Work does not include any of the following items:

1. Payroll costs and other compensation of Contractor's officers, executives, principals, general managers, engineers, architects, estimators, attorneys, auditors, accountants, purchasing and contracting agents, expeditors, timekeepers, clerks, and other personnel employed by Contractor, whether at the Site or in Contractor's principal or branch office for general administration of the Work and not specifically included in the agreed upon schedule of job classifications referred to in Paragraph 13.01.B.1 or specifically covered by Paragraph 13.01.B.4. The payroll costs and other compensation excluded here are to be considered administrative costs covered by the Contractor's fee.
2. The cost of purchasing, renting, or furnishing small tools and hand tools.
3. Expenses of Contractor's principal and branch offices other than Contractor's office at the Site.
4. Any part of Contractor's capital expenses, including interest on Contractor's capital employed for the Work and charges against Contractor for delinquent payments.
5. Costs due to the negligence of Contractor, any Subcontractor, or anyone directly or indirectly employed by any of them or for whose acts any of them may be liable, including but not limited to, the correction of defective Work, disposal of materials or equipment wrongly supplied, and making good any damage to property.
6. Expenses incurred in preparing and advancing Claims.
7. Other overhead or general expense costs of any kind and the costs of any item not specifically and expressly included in Paragraph 13.01.B.

D. *Contractor's Fee*

- ~~1. When the Work as a whole is performed on the basis of cost-plus-a-fee, then:~~
 - ~~a. Contractor's fee for the Work set forth in the Contract Documents as of the Effective Date of the Contract will be determined as set forth in the Agreement.~~
 - ~~b. for any Work covered by a Change Order, Change Proposal, Claim, set-off, or other adjustment in Contract Price on the basis of Cost of the Work, Contractor's fee will be determined as follows:~~
 - ~~1) When the fee for the Work as a whole is a percentage of the Cost of the Work, the fee will automatically adjust as the Cost of the Work changes.~~

~~2) When the fee for the Work as a whole is a fixed fee, the fee for any additions or deletions will be determined in accordance with Paragraph 11.07.C.2.~~

~~2~~ 1. When the Work as a whole is performed on the basis of a stipulated sum, or any other basis other than cost-plus-a-fee, then Contractor's fee for any Work covered by a Change Order, Change Proposal, Claim, set-off, or other adjustment in Contract Price on the basis of Cost of the Work will be determined in accordance with Paragraph 11.07.C.2.

E. *Documentation and Audit:* Whenever the Cost of the Work for any purpose is to be determined pursuant to this Article 13, Contractor and pertinent Subcontractors will establish and maintain records of the costs in accordance with generally accepted accounting practices. Subject to prior written notice, Owner will be afforded reasonable access, during normal business hours, to all Contractor's accounts, records, books, correspondence, instructions, drawings, receipts, vouchers, memoranda, and similar data relating to the Cost of the Work and Contractor's fee. Contractor shall preserve all such documents for a period of three years after the final payment by Owner. Pertinent Subcontractors will afford such access to Owner, and preserve such documents, to the same extent required of Contractor.

13.02 Allowances

A. It is understood that Contractor has included in the Contract Price all allowances so named in the Contract Documents and shall cause the Work so covered to be performed for such sums and by such persons or entities as may be acceptable to Owner and Engineer.

B. *Cash Allowances:* Contractor agrees that:

1. the cash allowances include the cost to Contractor (less any applicable trade discounts) of materials and equipment required by the allowances to be delivered at the Site, and all applicable taxes; and
2. Contractor's costs for unloading and handling on the Site, labor, installation, overhead, profit, and other expenses contemplated for the cash allowances have been included in the Contract Price and not in the allowances, and no demand for additional payment for any of the foregoing will be valid.

C. *Owner's Contingency Allowance:* Contractor agrees that an Owner's contingency allowance, if any, is for the sole use of Owner to cover unanticipated costs.

D. Prior to final payment, an appropriate Change Order will be issued as recommended by Engineer to reflect actual amounts due Contractor for Work covered by allowances, and the Contract Price will be correspondingly adjusted.

13.03 Unit Price Work

A. Where the Contract Documents provide that all or part of the Work is to be Unit Price Work, initially the Contract Price will be deemed to include for all Unit Price Work an amount equal to the sum of the unit price for each separately identified item of Unit Price Work times the estimated quantity of each item as indicated in the Agreement.

B. The estimated quantities of items of Unit Price Work are not guaranteed and are solely for the purpose of comparison of Bids and determining an initial Contract Price. Payments to Contractor for Unit Price Work will be based on actual quantities.

C. Each unit price will be deemed to include an amount considered by Contractor to be adequate to cover Contractor's overhead and profit for each separately identified item.

D. Engineer will determine the actual quantities and classifications of Unit Price Work performed by Contractor. Engineer will review with Contractor the Engineer's preliminary determinations on such matters before rendering a written decision thereon (by recommendation of an Application for Payment or otherwise). Engineer's written decision thereon will be final and binding (except as modified by Engineer to reflect changed factual conditions or more accurate data) upon Owner and Contractor, and the final adjustment of Contract Price will be set forth in a Change Order, subject to the provisions of the following paragraph.

E. *Adjustments in Unit Price*

- ~~1. Contractor or Owner shall be entitled to an adjustment in the unit price with respect to an item of Unit Price Work if:~~
 - ~~a. the quantity of the item of Unit Price Work performed by Contractor differs materially and significantly from the estimated quantity of such item indicated in the Agreement; and~~
 - ~~b. Contractor's unit costs to perform the item of Unit Price Work have changed materially and significantly as a result of the quantity change.~~
- ~~2. The adjustment in unit price will account for and be coordinated with any related changes in quantities of other items of Work, and in Contractor's costs to perform such other Work, such that the resulting overall change in Contract Price is equitable to Owner and Contractor.~~
- ~~3. Adjusted unit prices will apply to all units of that item.~~
1. Pursuant to La. R.S. 38:2212, where certain unit prices are contained in the initial Contract, no deviations shall be allowed in computing negotiated Change Order costs, thus adjustments in unit price are not permitted. To the extent the statute is found to be non-applicable, then the provisions set forth in paragraph 13.03(E)(2) will apply when the stated conditions exist.
2. The unit price of an item of Unit Price Work shall be subject to reevaluation and adjustment under the following conditions:
 - a. if the total cost of a particular item of Unit Price Work amounts to ten (10) percent or more of the Contract Price and the variation in the quantity twenty-five (25) percent from the estimated quantity of such item indicated in the Agreement; and
 - b. if there is no corresponding adjustment with respect to any other item of Work; and
 - c. if Contractor believes that Contractor has incurred additional expense as a result thereof; or if Owner believes that the quantity variation entitles Owner to an adjustment in the unit price, either Owner or Contractor may make a claim for an adjustment in the Contract Price in accordance with Article 12 if the parties are unable to agree as to the effect of any such variations in the quantity of Unit Price Work performed.

ARTICLE 14—TESTS AND INSPECTIONS; CORRECTION, REMOVAL, OR ACCEPTANCE OF DEFECTIVE WORK

14.01 *Access to Work*

- A. Owner, Engineer, their consultants and other representatives and personnel of Owner, independent testing laboratories, and authorities having jurisdiction have access to the Site and the Work at reasonable times for their observation, inspection, and testing. Contractor shall provide them proper and safe conditions for such access and advise them of Contractor's safety procedures and programs so that they may comply with such procedures and programs as applicable.

14.02 *Tests, Inspections, and Approvals*

- A. Contractor shall give Engineer timely notice of readiness of the Work (or specific parts thereof) for all required inspections and tests, and shall cooperate with inspection and testing personnel to facilitate required inspections and tests.
- B. Owner shall retain and pay for the services of an independent inspector, testing laboratory, or other qualified individual or entity to perform all inspections and tests expressly required by the Contract Documents to be furnished and paid for by Owner, except that costs incurred in connection with tests or inspections of covered Work will be governed by the provisions of Paragraph 14.05.
- C. If Laws or Regulations of any public body having jurisdiction require any Work (or part thereof) specifically to be inspected, tested, or approved by an employee or other representative of such public body, Contractor shall assume full responsibility for arranging and obtaining such inspections, tests, or approvals, pay all costs in connection therewith, and furnish Engineer the required certificates of inspection or approval.
- D. Contractor shall be responsible for arranging, obtaining, and paying for all inspections and tests required:
 - 1. by the Contract Documents, unless the Contract Documents expressly allocate responsibility for a specific inspection or test to Owner;
 - 2. to attain Owner's and Engineer's acceptance of materials or equipment to be incorporated in the Work;
 - 3. by manufacturers of equipment furnished under the Contract Documents;
 - 4. for testing, adjusting, and balancing of mechanical, electrical, and other equipment to be incorporated into the Work; and
 - 5. for acceptance of materials, mix designs, or equipment submitted for approval prior to Contractor's purchase thereof for incorporation in the Work.

Such inspections and tests will be performed by independent inspectors, testing laboratories, or other qualified individuals or entities acceptable to Owner ~~and Engineer.~~

- E. If the Contract Documents require the Work (or part thereof) to be approved by Owner, Engineer, or another designated individual or entity, then Contractor shall assume full responsibility for arranging and obtaining such approvals.
- F. If any Work (or the work of others) that is to be inspected, tested, or approved is covered by Contractor without written concurrence of Engineer, Contractor shall, if requested by

Engineer, uncover such Work for observation. Such uncovering will be at Contractor's expense unless Contractor had given Engineer timely notice of Contractor's intention to cover the same and Engineer had not acted with reasonable promptness in response to such notice.

14.03 *Defective Work*

- A. *Contractor's Obligation*: It is Contractor's obligation to assure that the Work is not defective.
- B. *Engineer's Authority*: Engineer has the authority to determine whether Work is defective, and to reject defective Work.
- C. *Notice of Defects*: Prompt written notice of all defective Work of which Owner or Engineer has actual knowledge will be given to Contractor.
- D. *Correction, or Removal and Replacement*: Promptly after receipt of written notice of defective Work, Contractor shall correct all such defective Work, whether or not fabricated, installed, or completed, or, if Engineer has rejected the defective Work, remove it from the Project and replace it with Work that is not defective.
- E. *Preservation of Warranties*: When correcting defective Work, Contractor shall take no action that would void or otherwise impair Owner's special warranty and guarantee, if any, on said Work.
- F. *Costs and Damages*: In addition to its correction, removal, and replacement obligations with respect to defective Work, Contractor shall pay all claims, costs, losses, and damages arising out of or relating to defective Work, including but not limited to the cost of the inspection, testing, correction, removal, replacement, or reconstruction of such defective Work, fines levied against Owner by governmental authorities because the Work is defective, and the costs of repair or replacement of work of others resulting from defective Work. Prior to final payment, if Owner and Contractor are unable to agree as to the measure of such claims, costs, losses, and damages resulting from defective Work, then Owner may impose a reasonable set-off against payments due under Article 15.

14.04 *Acceptance of Defective Work*

- A. If, instead of requiring correction or removal and replacement of defective Work, Owner prefers to accept it, Owner may do so (subject, if such acceptance occurs prior to final payment, to Engineer's confirmation that such acceptance is in general accord with the design intent and applicable engineering principles, and will not endanger public safety). Contractor shall pay all claims, costs, losses, and damages attributable to Owner's evaluation of and determination to accept such defective Work (such costs to be approved by Engineer as to reasonableness), and for the diminished value of the Work to the extent not otherwise paid by Contractor. If any such acceptance occurs prior to final payment, the necessary revisions in the Contract Documents with respect to the Work will be incorporated in a Change Order. If the parties are unable to agree as to the decrease in the Contract Price, reflecting the diminished value of Work so accepted, then Owner may impose a reasonable set-off against payments due under Article 15. If the acceptance of defective Work occurs after final payment, Contractor shall pay an appropriate amount to Owner.

14.05 *Uncovering Work*

- A. Engineer has the authority to require additional inspection or testing of the Work, whether or not the Work is fabricated, installed, or completed.

- B. If any Work is covered contrary to the written request of Engineer, then Contractor shall, if requested by Engineer, uncover such Work for Engineer's observation, and then replace the covering, all at Contractor's expense.
- C. If Engineer considers it necessary or advisable that covered Work be observed by Engineer or inspected or tested by others, then Contractor, at Engineer's request, shall uncover, expose, or otherwise make available for observation, inspection, or testing as Engineer may require, that portion of the Work in question, and provide all necessary labor, material, and equipment.
 - 1. If it is found that the uncovered Work is defective, Contractor shall be responsible for all claims, costs, losses, and damages arising out of or relating to such uncovering, exposure, observation, inspection, and testing, and of satisfactory replacement or reconstruction (including but not limited to all costs of repair or replacement of work of others); and pending Contractor's full discharge of this responsibility the Owner shall be entitled to impose a reasonable set-off against payments due under Article 15.
 - 2. If the uncovered Work is not found to be defective, Contractor shall be allowed an increase in the Contract Price or an extension of the Contract Times, directly attributable to such uncovering, exposure, observation, inspection, testing, replacement, and reconstruction unless Contractor fails to provide written notice as required by paragraph 14.02F. If the parties are unable to agree as to the amount or extent thereof, then Contractor may submit a Change Proposal within 30 days of the determination that the Work is not defective.

14.06 *Owner May Stop the Work*

- A. If the Work is defective, or Contractor fails to supply sufficient skilled workers or suitable materials or equipment, or fails to perform the Work in such a way that the completed Work will conform to the Contract Documents, then Owner may order Contractor to stop the Work, or any portion thereof, until the cause for such order has been eliminated; however, this right of Owner to stop the Work will not give rise to any duty on the part of Owner to exercise this right for the benefit of Contractor, any Subcontractor, any Supplier, any other individual or entity, or any surety for, or employee or agent of any of them.

14.07 *Owner May Correct Defective Work*

- A. If Contractor fails within a reasonable time after written notice from Engineer to correct defective Work, or to remove and replace defective Work as required by Engineer, then Owner may, after 7 days' written notice to Contractor, correct or remedy any such deficiency.
- B. In exercising the rights and remedies under this Paragraph 14.07, Owner shall proceed expeditiously. In connection with such corrective or remedial action, Owner may exclude Contractor from all or part of the Site, take possession of all or part of the Work and suspend Contractor's services related thereto, and incorporate in the Work all materials and equipment stored at the Site or for which Owner has paid Contractor but which are stored elsewhere. Contractor shall allow Owner, Owner's representatives, agents and employees, Owner's other contractors, and Engineer and Engineer's consultants access to the Site to enable Owner to exercise the rights and remedies under this paragraph.
- C. All claims, costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals) incurred or sustained by Owner in exercising the rights and remedies under this Paragraph 14.07 will be charged against

Contractor as set-offs against payments due under Article 15. Such claims, costs, losses and damages will include but not be limited to all costs of repair, or replacement of work of others destroyed or damaged by correction, removal, or replacement of Contractor's defective Work.

- D. Contractor shall not be allowed an extension of the Contract Times because of any delay in the performance of the Work attributable to the exercise by Owner of Owner's rights and remedies under this Paragraph 14.07.

ARTICLE 15—PAYMENTS TO CONTRACTOR; SET-OFFS; COMPLETION; CORRECTION PERIOD

15.01 *Progress Payments*

- A. *Basis for Progress Payments:* The Schedule of Values established as provided in Article 2 will serve as the basis for progress payments and will be incorporated into a form of Application for Payment acceptable to Engineer. Progress payments for Unit Price Work will be based on the number of units completed during the pay period, as determined under the provisions of Paragraph 13.03. Progress payments for cost-based Work will be based on Cost of the Work completed by Contractor during the pay period.

B. *Applications for Payments*

1. At least 20 days before the date established in the Agreement for each progress payment (but not more often than once a month), Contractor shall submit to Engineer for review an Application for Payment filled out and signed by Contractor covering the Work completed as of the date of the Application and accompanied by such supporting documentation as is required by the Contract Documents.
2. If payment is requested on the basis of materials and equipment not incorporated in the Work but delivered and suitably stored at the Site or at another location agreed to in writing, the Application for Payment must also be accompanied by: (a) a bill of sale, invoice, copies of subcontract or purchase order payments, or other documentation establishing full payment by Contractor for the materials and equipment; (b) at Owner's request, documentation warranting that Owner has received the materials and equipment free and clear of all Liens; and (c) evidence that the materials and equipment are covered by appropriate property insurance, a warehouse bond, or other arrangements to protect Owner's interest therein, all of which must be satisfactory to Owner.
3. Beginning with the second Application for Payment, each Application must include an affidavit of Contractor stating that all previous progress payments received by Contractor have been applied to discharge Contractor's legitimate obligations associated with prior Applications for Payment.
4. The amount of retainage with respect to progress payments will be as stipulated in the Agreement.
5. Contractor shall also comply with the following specific requirements:
 - a. The aggregate cost of materials stored offsite shall not at any time, without written approval of Owner, exceed the amount identified in the Supplementary Conditions.

- b. Title to such materials shall be vested in Owner, as evidenced by documentation satisfactory in form and substance to Owner, including, without limitation, recorded financing statements, UCC filings, and UCC searches.
- c. With each application for payment, the Contractor shall submit to Owner a written list identifying each location where materials are stored off the Project Site and the value of materials at each location. Contractor shall procure insurance satisfactory to Owner for materials stored off the Project Site in an amount not less than the total value thereof.
- d. The consent of any Surety shall be obtained to the extent required prior to payment for any materials stored off the Project Site.
- e. Representatives of Owner shall have the right to make inspections of the storage areas at any time.
- f. Such materials shall be (1) protected from diversion, destruction, theft and damage to the satisfaction of Owner; (2) specifically marked for use on the Project; and (3) segregated from other materials at the storage facility.

C. Review of Applications

- 1. Engineer will, within 10 days after receipt of each Application for Payment, including each resubmittal, either indicate in writing a recommendation of payment and present the Application to Owner, or return the Application to Contractor indicating in writing Engineer's reasons for refusing to recommend payment. In the latter case, Contractor may make the necessary corrections and resubmit the Application.
- 2. Engineer's recommendation of any payment requested in an Application for Payment will constitute a representation by Engineer to Owner, based on Engineer's observations of the executed Work as an experienced and qualified design professional, and on Engineer's review of the Application for Payment and the accompanying data and schedules, that to the best of Engineer's knowledge, information and belief:
 - a. the Work has progressed to the point indicated;
 - b. the quality of the Work is generally in accordance with the Contract Documents (subject to an evaluation of the Work as a functioning whole prior to or upon Substantial Completion, the results of any subsequent tests called for in the Contract Documents, a final determination of quantities and classifications for Unit Price Work under Paragraph 13.03, and any other qualifications stated in the recommendation); and
 - c. the conditions precedent to Contractor's being entitled to such payment appear to have been fulfilled in so far as it is Engineer's responsibility to observe the Work.
- 3. By recommending any such payment Engineer will not thereby be deemed to have represented that:
 - a. inspections made to check the quality or the quantity of the Work as it has been performed have been exhaustive, extended to every aspect of the Work in progress, or involved detailed inspections of the Work beyond the responsibilities specifically assigned to Engineer in the Contract; or

- b. there may not be other matters or issues between the parties that might entitle Contractor to be paid additionally by Owner or entitle Owner to withhold payment to Contractor.
- 4. Neither Engineer's review of Contractor's Work for the purposes of recommending payments nor Engineer's recommendation of any payment, including final payment, will impose responsibility on Engineer:
 - a. to supervise, direct, or control the Work;
 - b. for the means, methods, techniques, sequences, or procedures of construction, or the safety precautions and programs incident thereto;
 - c. for Contractor's failure to comply with Laws and Regulations applicable to Contractor's performance of the Work;
 - d. to make any examination to ascertain how or for what purposes Contractor has used the money paid by Owner; or
 - e. to determine that title to any of the Work, materials, or equipment has passed to Owner free and clear of any Liens.
- 5. Engineer may refuse to recommend the whole or any part of any payment if, in Engineer's opinion, it would be incorrect to make the representations to Owner stated in Paragraph 15.01.C.2.
- 6. Engineer will recommend reductions in payment (set-offs) necessary in Engineer's opinion to protect Owner from loss because:
 - a. the Work is defective, requiring correction or replacement;
 - b. the Contract Price has been reduced by Change Orders;
 - c. Owner has been required to correct defective Work in accordance with Paragraph 14.07, or has accepted defective Work pursuant to Paragraph 14.04;
 - d. Owner has been required to remove or remediate a Hazardous Environmental Condition for which Contractor is responsible;
 - e. Engineer has actual knowledge of the occurrence of any of the events that would constitute a default by Contractor and therefore justify termination for cause under the Contract Documents;
 - f. Engineer has knowledge that Contractor has failed to pay Subcontractors or Suppliers or for labor;
 - g. Contractor has failed to make submittals in accordance with the accepted schedules or otherwise failed to comply with paragraph 2.07; or
 - h. Contractor owes or may owe Owner liquidated damages, actual damages, or both, in accordance with the provisions in the Agreement regarding delay in completion of the Work within the Contract Times.

D. Payment Becomes Due

- 1. ~~Ten~~ Thirty (30) days after presentation of the Application for Payment to Owner with Engineer's recommendation, the amount recommended (subject to any Owner set-offs) will become due, and when due will be paid by Owner to Contractor.

E. *Reductions in Payment by Owner*

1. In addition to any reductions in payment (set-offs) recommended by Engineer, Owner is entitled to impose a set-off against payment based on any of the following:
 - a. Claims have been made against Owner based on Contractor's conduct in the performance or furnishing of the Work, or Owner has incurred costs, losses, or damages resulting from Contractor's conduct in the performance or furnishing of the Work, including but not limited to claims, costs, losses, or damages from workplace injuries, adjacent property damage, non-compliance with Laws and Regulations, and patent infringement;
 - b. Contractor has failed to take reasonable and customary measures to avoid damage, delay, disruption, and interference with other work at or adjacent to the Site;
 - c. Contractor has failed to provide and maintain required bonds or insurance;
 - d. Owner has been required to remove or remediate a Hazardous Environmental Condition for which Contractor is responsible;
 - e. Owner has incurred extra charges or engineering costs related to submittal reviews, evaluations of proposed substitutes, tests and inspections, or return visits to manufacturing or assembly facilities;
 - f. The Work is defective, requiring correction or replacement;
 - g. Owner has been required to correct defective Work in accordance with Paragraph 14.07, or has accepted defective Work pursuant to Paragraph 14.04;
 - h. The Contract Price has been reduced by Change Orders;
 - i. An event has occurred that would constitute a default by Contractor and therefore justify a termination for cause;
 - j. Liquidated or other damages have accrued as a result of Contractor's failure to achieve Milestones, Substantial Completion, or final completion of the Work;
 - k. Liens have been filed in connection with the Work, except where Contractor has delivered a specific bond satisfactory to Owner to secure the satisfaction and discharge of such Liens;
 - l. Other items entitle Owner to a set-off against the amount recommended;
 - m. Owner has actual knowledge of the occurrence of any of the events enumerated in paragraphs 15.01.C.6.f through 15.01.C.6.h or 16.02.A; or
 - n. Punch lists generated during a construction project shall include the cost estimates for the particular items of work the design professional has developed based on the mobilization, labor, materials and equipment costs of correcting each punch list item. The Owner shall withhold from payment the value of the punch list as per La. R.S. 38:2248 B.
2. If Owner imposes any set-off against payment, whether based on its own knowledge or on the written recommendations of Engineer, Owner will give Contractor immediate written notice (with a copy to Engineer) stating the reasons for such action and the specific amount of the reduction, and promptly pay Contractor any amount remaining

after deduction of the amount so withheld. Owner shall promptly pay Contractor the amount so withheld, or any adjustment thereto agreed to by Owner and Contractor, if Contractor remedies the reasons for such action. The reduction imposed will be binding on Contractor unless it duly submits a Change Proposal contesting the reduction.

3. Upon a subsequent determination that Owner's refusal of payment was not justified, the amount wrongfully withheld will be treated as an amount due as determined by Paragraph 15.01.D.1 and subject to interest as provided in the Agreement.

15.02 *Contractor's Warranty of Title*

- A. Contractor warrants and guarantees that title to all Work, materials, and equipment furnished under the Contract will pass to Owner free and clear of (1) all Liens and other title defects, and (2) all patent, licensing, copyright, or royalty obligations, no later than 7 days after the time of payment by Owner.

15.03 *Substantial Completion*

- A. When Contractor considers the entire Work ready for its intended use Contractor shall notify Owner and Engineer in writing that the entire Work is substantially complete and request that Engineer issue a certificate of Substantial Completion. Contractor shall at the same time submit to Owner and Engineer an initial draft of punch list items to be completed or corrected before final payment.
- B. Promptly after Contractor's notification, Owner, Contractor, and Engineer shall make an inspection of the Work to determine the status of completion. If Engineer does not consider the Work substantially complete, Engineer will notify Contractor in writing giving the reasons therefor.
- C. If Engineer considers the Work substantially complete, Engineer will deliver to Owner a preliminary certificate of Substantial Completion which will fix the date of Substantial Completion. Engineer shall attach to the certificate a punch list of items to be completed or corrected before final payment, along with cost estimates as required by law. Owner shall have 7 days after receipt of the preliminary certificate during which to make written objection to Engineer as to any provisions of the certificate or attached punch list. If, after considering the objections to the provisions of the preliminary certificate, Engineer concludes that the Work is not substantially complete, Engineer will, within 14 days after submission of the preliminary certificate to Owner, notify Contractor in writing that the Work is not substantially complete, stating the reasons therefor. If Owner does not object to the provisions of the certificate, or if despite consideration of Owner's objections Engineer concludes that the Work is substantially complete, then Engineer will, within said 14 days, execute and deliver to Owner and Contractor a final certificate of Substantial Completion (with a revised punch list of items, including cost estimates, to be completed or corrected) reflecting such changes from the preliminary certificate as Engineer believes justified after consideration of any objections from Owner.
- D. At the time of receipt of the preliminary certificate of Substantial Completion, Owner and Contractor will confer regarding Owner's use or occupancy of the Work following Substantial Completion, review the builder's risk insurance policy with respect to the end of the builder's risk coverage, and confirm the transition to coverage of the Work under a permanent property insurance policy held by Owner. Unless Owner and Contractor agree otherwise in writing, Owner shall bear responsibility for security, operation, protection of the Work,

property insurance, maintenance, heat, and utilities upon Owner's use or occupancy of the Work.

- E. After Substantial Completion the Contractor shall promptly begin work on the punch list of items to be completed or corrected prior to final payment. In appropriate cases Contractor may submit monthly Applications for Payment for completed punch list items, following the progress payment procedures set forth above.
- F. Owner shall have the right to exclude Contractor from the Site after the date of Substantial Completion subject to allowing Contractor reasonable access to remove its property and complete or correct items on the punch list.
- G. Upon issuance of the final Certificate of Substantial Completion as set forth in Paragraph 15.03.C, Owner, through its governing authority, shall adopt a resolution accepting the work as substantially complete and directing Contractor to record such acceptance with the Clerk of Court and Ex-Officio Recorder of Mortgages as provided in La R.S. 38:2241.1(C). Contractor may also apply at the appropriate time for payment of retainage following the procedure for progress payments. In accordance with the Public Contract Law, Owner shall withhold from any payment made, an amount equal to the value established by Engineer of the cost of the incomplete items contained on the punch list of items to be completed or corrected that was prepared by Engineer in accordance with Paragraph 15.03.C, and an amount to cover the cost of any known claims of materialmen, laborers, suppliers or subcontractors, and any other amounts which Owner is permitted to deduct by law or pursuant to any provisions of the Contract Documents.

15.04 *Partial Use or Occupancy*

- A. Prior to Substantial Completion of all the Work, Owner may use or occupy any substantially completed part of the Work which has specifically been identified in the Contract Documents, or which Owner, Engineer, and Contractor agree constitutes a separately functioning and usable part of the Work that can be used by Owner for its intended purpose without significant interference with Contractor's performance of the remainder of the Work, subject to the following conditions:
 - 1. At any time, Owner may request in writing that Contractor permit Owner to use or occupy any such part of the Work that Owner believes to be substantially complete. If and when Contractor agrees that such part of the Work is substantially complete, Contractor, Owner, and Engineer will follow the procedures of Paragraph 15.03.A through 15.03.E for that part of the Work.
 - 2. At any time, Contractor may notify Owner and Engineer in writing that Contractor considers any such part of the Work substantially complete and request Engineer to issue a certificate of Substantial Completion for that part of the Work.
 - 3. Within a reasonable time after either such request, Owner, Contractor, and Engineer shall make an inspection of that part of the Work to determine its status of completion. If Engineer does not consider that part of the Work to be substantially complete, Engineer will notify Owner and Contractor in writing giving the reasons therefor. If Engineer considers that part of the Work to be substantially complete, the provisions of Paragraph 15.03 will apply with respect to certification of Substantial Completion of that part of the Work and the division of responsibility in respect thereof and access thereto.

4. No use or occupancy or separate operation of part of the Work may occur prior to compliance with the requirements of Paragraph 6.04 regarding builder's risk or other property insurance.
5. Owner may at any time request Contractor in writing to permit Owner to take over operation of any such part of the Work although it is not substantially complete. A copy of such request will be sent to Engineer and within a reasonable time thereafter Owner, Contractor and Engineer shall make an inspection of that part of the Work to determine its status of completion and will prepare a list of the items remaining to be completed or corrected thereon before final payment. If Contractor does not object in writing to Owner and Engineer that such part of the Work is not ready for separate operation by Owner, Engineer will finalize the list of items to be completed or corrected and will deliver such lists to Owner and Contractor together with a written recommendation as to the division of responsibilities pending final payment between Owner and Contractor with respect to security, operation, safety, maintenance, utilities, insurance, warranties and guarantees for that part of the Work which will become binding upon Owner and Contractor at the time when Owner takes over such operation (unless they shall have otherwise agreed in writing and so informed Engineer). During such operation and prior to Substantial Completion of such part of the Work, Owner shall allow Contractor reasonable access to complete or correct items on said list and to complete other related Work.

15.05 *Final Inspection*

- A. Upon written notice from Contractor that the entire Work or an agreed portion thereof is complete, Engineer will promptly make a final inspection with Owner and Contractor and will notify Contractor in writing of all particulars in which this inspection reveals that the Work, or agreed portion thereof, is incomplete or defective. Contractor shall immediately take such measures as are necessary to complete such Work or remedy such deficiencies.

15.06 *Final Payment*

A. *Application for Payment*

1. After Contractor has, in the opinion of Engineer, satisfactorily completed all corrections identified during the final inspection and has delivered, in accordance with the Contract Documents, all maintenance and operating instructions, schedules, guarantees, bonds, certificates or other evidence of insurance, certificates of inspection, annotated record documents (as provided in Paragraph 7.12), and other documents, Contractor may make application for final payment.
2. The final Application for Payment must be accompanied (except as previously delivered) by:
 - a. all documentation called for in the Contract Documents;
 - b. consent of the surety, if any, to final payment;
 - c. satisfactory evidence that all title issues have been resolved such that title to all Work, materials, and equipment has passed to Owner free and clear of any Liens or other title defects, or will so pass upon final payment.
 - d. a list of all duly pending Change Proposals and Claims; and

- e. complete and legally effective releases or waivers (satisfactory to Owner) of all Lien rights arising out of the Work, and of Liens filed in connection with the Work.
- ~~3. In lieu of the releases or waivers of Liens specified in Paragraph 15.06.A.2 and as approved by Owner, Contractor may furnish receipts or releases in full and an affidavit of Contractor that: (a) the releases and receipts include all labor, services, material, and equipment for which a Lien could be filed; and (b) all payrolls, material and equipment bills, and other indebtedness connected with the Work for which Owner might in any way be responsible, or which might in any way result in liens or other burdens on Owner's property, have been paid or otherwise satisfied. If any Subcontractor or Supplier fails to furnish such a release or receipt in full, Contractor may furnish a bond or other collateral satisfactory to Owner to indemnify Owner against any Lien, or Owner at its option may issue joint checks payable to Contractor and specified Subcontractors and Suppliers.~~
- B. *Engineer's Review of Final Application and Recommendation of Payment:* If, on the basis of Engineer's observation of the Work during construction and final inspection, and Engineer's review of the final Application for Payment and accompanying documentation as required by the Contract Documents, Engineer is satisfied that the Work has been completed and Contractor's other obligations under the Contract have been fulfilled, Engineer will, within 10 days after receipt of the final Application for Payment, indicate in writing Engineer's recommendation of final payment and present the final Application for Payment to Owner for payment. Such recommendation will account for any set-offs against payment that are necessary in Engineer's opinion to protect Owner from loss for the reasons stated above with respect to progress payments. Otherwise, Engineer will return the Application for Payment to Contractor, indicating in writing the reasons for refusing to recommend final payment, in which case Contractor shall make the necessary corrections and resubmit the Application for Payment.
- C. *Notice of Acceptability:* In support of its recommendation of payment of the final Application for Payment, Engineer will also give written notice to Owner and Contractor that the Work is acceptable, subject to stated limitations in the notice and to the provisions of Paragraph 15.07.
- D. *Completion of Work:* The Work is complete (subject to surviving obligations) when it is ready for final payment as established by the Engineer's written recommendation of final payment and issuance of notice of the acceptability of the Work.
- E. *Final Payment Becomes Due:* ~~Upon receipt from Engineer of the final Application for Payment and accompanying documentation, Owner shall set off against the amount recommended by Engineer for final payment any further sum to which Owner is entitled, including but not limited to set-offs for liquidated damages and set-offs allowed under the provisions of this Contract with respect to progress payments. Owner shall pay the resulting balance due to Contractor within 30 days of Owner's receipt of the final Application for Payment from Engineer.~~
1. After the presentation to Owner of the Application for Payment and accompanying documentation, the amount recommended by Engineer will become due and, when due, will be paid by Owner to Contractor in accordance with the Louisiana Public Contract Statute.

2. Following acceptance of the Work by Owner, Contractor shall file the acceptance with the Clerk of Court and Ex-Officio Recorder of Mortgages.

3. Release and payment of Retainage, or balance due, will become due and will be paid by Owner to Contractor thirty days after receipt of Application for Retainage Payment (which must include a clear lien and privilege certificate secured from the Clerk of Court and Ex-Officio Recorder of Mortgages dated no less than forty-five (45) days after the filing of the acceptance and other documentation as required by the Contract Documents), and recommendation of payment by Engineer.

15.07 *Waiver of Claims*

- A. By making final payment, Owner waives its claim or right to liquidated damages or other damages for late completion by Contractor, except as set forth in an outstanding Claim, appeal under the provisions of Article 17, set-off, or express reservation of rights by Owner. Owner reserves all other claims or rights after final payment.
- B. The acceptance of final payment by Contractor will constitute a waiver by Contractor of all claims and rights against Owner other than those pending matters that have been duly submitted as a Claim, or appealed under the provisions of Article 17.

15.08 *Correction Period*

- A. The parties agree that: (a) any and all defects discovered in the Work within one year ~~the first three (3) years~~ after the issuance of the certificate of substantial completion are not due to the fault, negligence, and/or lack of maintenance by Owner; (b) any and all such defects in the Work are presumed to be due to the fault, negligence and/or unworkmanlike performance by Contractor; and (c) Contractor shall bear the burden of proof that any such defects are due to the fault, negligence, breach of the standard of care, and/or unworkmanlike performance by any person(s) or entity(ies) other than Contractor. If within one year ~~three (3) years~~ after the date of Substantial Completion (or such longer period of time as may be prescribed by the Supplementary Conditions or the terms of any applicable special guarantee required by the Contract Documents), Owner gives Contractor written notice that any Work has been found to be defective, or that Contractor's repair of any damages to the Site or adjacent areas has been found to be defective, then after receipt of such notice of defect Contractor shall promptly, without cost to Owner and in accordance with Owner's written instructions:
 - 1. correct the defective repairs to the Site or such adjacent areas;
 - 2. correct such defective Work;
 - 3. remove the defective Work from the Project and replace it with Work that is not defective, if the defective Work has been rejected by Owner, and
 - 4. satisfactorily correct or repair or remove and replace any damage to other Work, to the work of others, or to other land or areas resulting from the corrective measures.
- B. Owner shall give any such notice of defect within 60 days of the discovery that such Work or repairs is defective. If such notice is given within such 60 days but after the end of the correction period, the notice will be deemed a notice of defective Work under Paragraph 7.17.B.

- C. If, after receipt of a notice of defect within 60 days and within the correction period, Contractor does not promptly comply with the terms of Owner's written instructions, or in an emergency where delay would cause serious risk of loss or damage, Owner may have the defective Work corrected or repaired or may have the rejected Work removed and replaced. Contractor shall pay all costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals and all court or other dispute resolution costs) arising out of or relating to such correction or repair or such removal and replacement (including but not limited to all costs of repair or replacement of work of others). Contractor's failure to pay such costs, losses, and damages within 10 days of invoice from Owner will be deemed the start of an event giving rise to a Claim under Paragraph 12.01.B, such that any related Claim must be brought within 30 days of the failure to pay.
- D. In special circumstances where a particular item of equipment is placed in continuous service for the benefit of Owner before Substantial Completion of all the Work, the correction period for that item may start to run from an earlier date if so provided in the Specifications.
- E. Where defective Work (and damage to other Work resulting therefrom) has been corrected or removed and replaced under this paragraph, the correction period hereunder with respect to such Work will be extended for an additional period of one year after such correction or removal and replacement has been satisfactorily completed.
- F. Contractor's obligations under this paragraph are in addition to all other obligations and warranties. The provisions of this paragraph are not to be construed as a substitute for, or a waiver of, the provisions of any applicable statute of limitation or repose.

ARTICLE 16—SUSPENSION OF WORK AND TERMINATION

16.01 *Owner May Suspend Work*

- A. At any time and without cause, Owner may suspend the Work or any portion thereof for a period of not more than 90 consecutive days by written notice to Contractor and Engineer. Such notice will fix the date on which Work will be resumed. Contractor shall resume the Work on the date so fixed. Contractor shall be entitled to an adjustment in the Contract Price or an extension of the Contract Times directly attributable to any such suspension. Any Change Proposal seeking such adjustments must be submitted no later than 30 days after the date fixed for resumption of Work.

16.02 *Owner May Terminate for Cause*

- A. The occurrence of any one or more of the following events will constitute a default by Contractor and justify termination for cause:
 - 1. Contractor's persistent failure to perform the Work in accordance with the Contract Documents (including, but not limited to, failure to supply sufficient skilled workers or suitable materials or equipment, or failure to adhere to the Progress Schedule);
 - 2. Failure of Contractor to perform or otherwise to comply with a material term of the Contract Documents;
 - 3. Contractor's disregard of Laws or Regulations of any public body having jurisdiction; or
 - 4. Contractor's repeated disregard of the authority of Owner or Engineer.

- B. If one or more of the events identified in Paragraph 16.02.A occurs, then after giving Contractor (and any surety) 10 days' written notice that Owner is considering a declaration that Contractor is in default and termination of the Contract, Owner may proceed to:
1. declare Contractor to be in default, and give Contractor (and any surety) written notice that the Contract is terminated; and
 2. enforce the rights available to Owner under any applicable performance bond.
- C. Subject to the terms and operation of any applicable performance bond, if Owner has terminated the Contract for cause, Owner may exclude Contractor from the Site, take possession of the Work, incorporate in the Work all materials and equipment stored at the Site or for which Owner has paid Contractor but which are stored elsewhere, and complete the Work as Owner may deem expedient.
- D. Owner may not proceed with termination of the Contract under Paragraph 16.02.B if Contractor within 7 days of receipt of notice of intent to terminate begins to correct its failure to perform and proceeds diligently to cure such failure.
- E. If Owner proceeds as provided in Paragraph 16.02.B, Contractor shall not be entitled to receive any further payment until the Work is completed. If the unpaid balance of the Contract Price exceeds the cost to complete the Work, including all related claims, costs, losses, and damages (including but not limited to all fees and charges of engineers, architects, attorneys, and other professionals) sustained by Owner, such excess will be paid to Contractor. If the cost to complete the Work including such related claims, costs, losses, and damages exceeds such unpaid balance, Contractor shall pay the difference to Owner. Such claims, costs, losses, and damages incurred by Owner will be reviewed by Engineer as to their reasonableness and, when so approved by Engineer, incorporated in a Change Order. When exercising any rights or remedies under this paragraph, Owner shall not be required to obtain the lowest price for the Work performed.
- F. Where Contractor's services have been so terminated by Owner, the termination will not affect any rights or remedies of Owner against Contractor then existing or which may thereafter accrue, or any rights or remedies of Owner against Contractor or any surety under any payment bond or performance bond. Any retention or payment of money due Contractor by Owner will not release Contractor from liability.
- G. If and to the extent that Contractor has provided a performance bond under the provisions of Paragraph 6.01.A, the provisions of that bond will govern over any inconsistent provisions of Paragraphs 16.02.B and 16.02.D.
- H. The costs incurred by Owner due to Contractor's default, including attorney's fees, or for completing the Work under the Contract, will be deducted from any monies due or which may become due the Contractor. When this expense exceeds the sum which would have been payable under the Contract, the Contractor and surety shall be liable and shall pay Owner the amount of such excess.

16.03 *Owner May Terminate for Convenience*

- A. Upon 7 days' written notice to Contractor and Engineer, Owner may, without cause and without prejudice to any other right or remedy of Owner, terminate the Contract. In such case, Contractor shall be paid for (without duplication of any items):
 - 1. completed and acceptable Work executed in accordance with the Contract Documents prior to the effective date of termination, including fair and reasonable sums for overhead and profit on such Work;
 - 2. expenses sustained prior to the effective date of termination in performing services and furnishing labor, materials, or equipment as required by the Contract Documents in connection with uncompleted Work, plus fair and reasonable sums for overhead and profit on such expenses; and
 - 3. other reasonable expenses directly attributable to termination, including costs incurred to prepare a termination for convenience cost proposal.
- B. Contractor shall not be paid for any loss of anticipated profits or revenue, post-termination overhead costs, or other economic loss arising out of or resulting from such termination.

16.04 *Contractor May Stop Work or Terminate*

- A. If, through no act or fault of Contractor, (1) the Work is suspended for more than 90 consecutive days by Owner or under an order of court or other public authority, or (2) Engineer fails to act on any Application for Payment within 30 days after it is submitted, or (3) Owner fails for 30 days to pay Contractor any sum finally determined to be due, then Contractor may, upon 7 days' written notice to Owner and Engineer, and provided Owner or Engineer do not remedy such suspension or failure within that time, terminate the contract and recover from Owner payment on the same terms as provided in Paragraph 16.03.
- B. In lieu of terminating the Contract and without prejudice to any other right or remedy, if Engineer has failed to act on an Application for Payment within 30 days after it is submitted, or Owner has failed for 30 days to pay Contractor any sum finally determined to be due, Contractor may, 7 days after written notice to Owner and Engineer, stop the Work until payment is made of all such amounts due Contractor, including interest thereon. The provisions of this paragraph are not intended to preclude Contractor from submitting a Change Proposal for an adjustment in Contract Price or Contract Times or otherwise for expenses or damage directly attributable to Contractor's stopping the Work as permitted by this paragraph.

ARTICLE 17—INTENTIONALLY OMITTED

ARTICLE 18—MISCELLANEOUS

18.01 *Giving Notice*

- A. Whenever any provision of the Contract requires the giving of written notice to Owner, Engineer, or Contractor, it will be deemed to have been validly given only if delivered:
 - 1. in person, by a commercial courier service or otherwise, to the recipient's place of business;
 - 2. by registered or certified mail, postage prepaid, to the recipient's place of business; or

3. by e-mail to the recipient, with the words "Formal Notice" or similar in the e-mail's subject line.

18.02 *Computation of Times*

- A. When any period of time is referred to in the Contract by days, ~~it will be computed to exclude the first and include the last day of such period. If the last day of any such period falls on a Saturday or Sunday or on a day made a legal holiday by the law of the applicable jurisdiction, such day will be omitted from the computation~~ the date of the act, event, or default after which the period begins to run is not included. The last day of the period is to be included, unless it is a Saturday, Sunday, or legal holiday, in which event the period runs until the end of the next day which is not a legal holiday.

18.03 *Cumulative Remedies*

- A. The duties and obligations imposed by these General Conditions and the rights and remedies available hereunder to the parties hereto and, in particular but without limitation, the warranties, guarantees, and obligations imposed upon Contractor hereunder and all of the rights and remedies available to Owner and Engineer thereunder are in addition to, and are not to be construed in any way as a limitation of, any rights and remedies available to any or all of them which are otherwise imposed or available by Laws or Regulations, by special warranty or guarantee, or by other provisions of the Contract. The provisions of this paragraph will be as effective as if repeated specifically in the Contract Documents in connection with each particular duty, obligation, right, and remedy to which they apply.

18.04 *Limitation of Damages*

- A. With respect to any and all Change Proposals, Claims, disputes subject to final resolution, and other matters at issue, neither Owner nor Engineer, nor any of their officers, directors, members, partners, employees, agents, consultants, or subcontractors, shall be liable to Contractor for any claims, costs, losses, or damages sustained by Contractor on or in connection with any other project or anticipated project.

18.05 *No Waiver*

- A. A party's non-enforcement of any provision will not constitute a waiver of that provision, nor will it affect the enforceability of that provision or of the remainder of this Contract.

18.06 *Survival of Obligations*

- A. All representations, indemnifications, warranties, and guarantees made in, required by, or given in accordance with the Contract, as well as all continuing obligations indicated in the Contract, will survive final payment, completion, and acceptance of the Work or termination of the Contract or of the services of Contractor.
- B. Nothing herein, in the Agreement, or any of the other Contract Documents shall be construed as a waiver, modification, or alteration of the CONTRACTOR's or its surety's obligations under La. R.S. 38:2189. Nothing in this paragraph or any other provision in the General Conditions or other Contract Documents concerning any specific time periods shall establish a period of limitation with respect to any other obligation which CONTRACTOR has under the Contract Documents. The establishment of time periods relates only to the specific obligations of CONTRACTOR to correct the Work, and has no relationship to the time within which CONTRACTOR's obligations under the Contract Documents may be sought to be enforced, nor

to the time within which the proceedings may be commenced to establish CONTRACTOR's liability with respect to CONTRACTOR's obligations other than specifically to correct the Work.

18.07 *Controlling Law*

- A. This Contract is to be governed by ~~the law of the state in which the Project is located~~ Louisiana law.

18.08 *Assignment of Contract*

- A. Unless expressly agreed to elsewhere in the Contract, no assignment by a party to this Contract of any rights under or interests in the Contract will be binding on the other party without the written consent of the party sought to be bound; and, specifically but without limitation, money that may become due and money that is due may not be assigned without such consent (except to the extent that the effect of this restriction may be limited by law), and unless specifically stated to the contrary in any written consent to an assignment, no assignment will release or discharge the assignor from any duty or responsibility under the Contract.

18.09 *Successors and Assigns*

- A. Owner and Contractor each binds itself, its successors, assigns, and legal representatives to the other party hereto, its successors, assigns, and legal representatives in respect to all covenants, agreements, and obligations contained in the Contract Documents.

18.10 *Headings*

- A. Article and paragraph headings are inserted for convenience only and do not constitute parts of these General Conditions.

SUPPLEMENTARY CONDITIONS OF THE CONSTRUCTION CONTRACT

These Supplementary Conditions amend or supplement EJCDC® C-700, Standard General Conditions of the Construction Contract (2018), as edited for Jefferson Parish. The General Conditions remain in full force and effect except as amended.

The terms used in these Supplementary Conditions have the meanings stated in the General Conditions. Additional terms used in these Supplementary Conditions have the meanings stated below, which are applicable to both the singular and plural thereof.

SC-4.05 Amend Paragraph 4.05.C by adding the following subparagraphs:

5. *Weather-Related Delays*

- a. The Contractor acknowledges and agrees that weather conditions shall not be an automatic cause for time extension. The Contract Times specified in the Bidding Documents and Contract Documents include an allowance as stated in those documents for inclement weather. In order to document and claim days lost to inclement weather conditions, the Contractor shall, on a semi-monthly basis, submit a report to the Engineer, stating the time lost to inclement weather, within seven (7) days of the end of the report period. The Engineer will review the report for submittal to the Owner within seven days of receipt of the report and make recommendations for either acceptance or rejection of each claimed time period lost to inclement weather. The Owner will then instruct the Engineer to approve or reject the report. There shall be no additional compensation due the Contractor for inclement weather days allowed hereunder.
- b. The report for lost days due to inclement weather shall account for all days during the reporting period, including weekends and holidays. Claims for lost days on either weekends or holidays will not be considered unless the Contractor can show that the inclement weather affected work production on the following workday. The reporting periods shall be from the first day of the month through and including the last day of the month. Lost time accounting shall be in one-half day increments.
- c. Lost time shall be considered only if the weather occurrence is in excess of the normal weather patterns as established by the nearest office of the National Weather Service, U.S. Department of Commerce. When the Contract utilizes critical path method scheduling (C.P.M.), the Engineer will determine if the days lost due to weather conditions actually affected the critical path activities. If weather conditions did not affect the progress of the critical path activities, no time extension will be granted.

SC-5.03 Add the following new paragraphs immediately after Paragraph 5.03.E:

- F. Unless otherwise provided by Contractor in accordance with the Special Provisions section as included in the Specifications, the following table lists the reports of explorations and tests of subsurface conditions at or adjacent to the Site that contain Technical Data, and specifically identifies the Technical Data in the report upon which Contractor may rely: **[If there are no such reports, so indicate in the table.]**

Report Title	Date of Report	Technical Data
		[Identify Technical Data]

- G. Unless otherwise provided by Contractor in accordance with the Special Provisions section as included in the Specifications, the following table lists the drawings of existing physical conditions at or adjacent to the Site, including those drawings depicting existing surface or subsurface structures at or adjacent to the Site (except Underground Facilities), that contain Technical Data, and specifically identifies the Technical Data upon which Contractor may rely: **[If there are no such drawings, so indicate in the table.]**

Drawings Title	Date of Drawings	Technical Data
		[Identify Technical Data]

- H. Contractor may examine copies of reports and drawings identified in SC-5.03.F and SC-5.03.G that were not included with the Bidding Documents at **[location]** during regular business hours, or may request copies from Engineer. These reports and drawing are not part of the Contract Documents, but the Technical Data contained therein upon which Contractor is entitled to rely as identified and established above are incorporated therein by reference. Contractor is not entitled to rely upon other information and data utilized in the preparation of the Drawings and Specifications.

SC-5.06 Add the following new paragraphs immediately after Paragraph 5.06.A.3:

4. Unless otherwise provided by Contractor in accordance with the Special Provisions section as included in the Specifications, the following table lists the reports known to Owner relating to Hazardous Environmental Conditions at or adjacent to the Site, and the Technical Data (if any) upon which Contractor may rely: **[If there are no such reports, so indicate in the table]**

Report Title	Date of Report	Technical Data
		[Identify Technical Data]

5. Unless otherwise provided by Contractor in accordance with the Special Provisions section as included in the Specifications, the following table lists the drawings known to Owner relating to Hazardous Environmental Conditions at or adjacent to the Site, and Technical Data (if any) contained in such Drawings upon which Contractor may rely: [If there are no such drawings, so indicate in the table]

Drawings Title	Date of Drawings	Technical Data
		[Identify Technical Data]

SC-10.03 See Exhibit A.

SC-13.01 Supplement Paragraph 13.01.B.5.c.(2) by adding the following sentence:

The equipment rental rate book that governs the included costs for the rental of machinery and equipment owned by Contractor (or a related entity) under the Cost of the Work provisions of this Contract is the most current edition of the Equipment Rental Rate book.

SC-15.01.B.5

Pursuant to the reference in paragraph 15.01.B.5.a of the Standard General Conditions, the aggregate cost of materials stored offsite shall not at any time exceed **\$ 250,000.00**, without the written approval of the Owner.

SC-19. *Non-Work Days:* Non-work days shall be defined as days in which the Contractor worked less than four (4) hours due to inclement weather conditions.

SC-20 *Removal and Disposal of Structures and Obstructions*

A. *General*

The Contractor shall remove any existing structure or part of structure, fence, building, or other encumbrances or obstructions that interfere in any way with the new construction. Compensation for the removal of any structure not listed as a pay item in the Proposal and with a Contract Bid Price shall be included in the Contract unit prices bid for the pay items of the Work.

B. *Privately and Publicly Owned Materials*

If called for in the Special Conditions, all privately and publicly owned materials in structures removed shall be salvaged without damage and shall be piled neatly and in an acceptable manner upon the premises if it belongs to an abutting property owner, otherwise at accessible points along the improvements. Material in structures which is property of the Owner or property of any public body, private body, or individual which is fit for use elsewhere, shall remain property of the original owner. It shall be carefully

removed without damage, in sections, which may be readily transported, and shall be piled neatly in an accessible point by the Contractor. When materials of Owner, State, Municipality, or Parish are stored on or beyond the right of way, the Contractor will be held responsible for their care and preservation for a period of ten (10) days following the day the last or final portion of the materials stored at a particular location are placed thereon. When privately owned materials are stored beyond the right of way, the Contractor will be held responsible for their care and preservation for a period of ten (10) days (computed as set forth above); provided, however, that as of the day the ten (10) days responsibility period for care and preservation of the materials begins, the Contractor must furnish the Engineer with evidence satisfactory to the latter that the proper owner of the materials has been duly notified by the Contractor that the said owner must assume responsibility for his materials on the date following the Contractor's ten (10) day responsibility.

SC-21 Public Convenience and Safety

A. Care of Traffic

No road shall be closed by the Contractor to the public except by written permission of the Engineer and/or Architect, and except while so closed, the Contractor shall maintain traffic over, through, or around the work included in his Contract, with the maximum practical convenience, for the full twenty-four hours of each day of the Contract, whether or not work has ceased temporarily. The Contractor shall notify the Engineer at the earliest possible date after the Contract has been executed, and in any case before the starting of any construction that might in any way inconvenience or endanger traffic, so that the necessary arrangements may be determined.

B. General Public

The convenience of the general public and of residents along the Work shall be provided for in a reasonable adequate and satisfactory manner. Where existing roads are not available for use as detours, unless otherwise provided, all traffic shall be permitted to pass through the Work. In such cases the vehicles of the traveling public shall have precedence over Contractor's vehicles to the end that the traveling public's vehicles shall not be unduly delayed for the convenience of the Contractor. In order that all unnecessary delay to the traveling public may be avoided, where ordered by the Engineer, the Contractor shall provide and station competent flagmen whose sole duties shall consist of directing and controlling the movement of public traffic either through or around the Work.

C. Temporary Roads, Driveways, etc.

The Contractor shall provide and maintain, in a manner approved and deemed practicable by the Engineer, such temporary roads as may be necessary to provide convenient access to driveways, houses, buildings, or other property abutting the work. Where temporary bridges are necessary for traffic and pedestrians, these bridges shall be constructed at the expense of the Contractor as directed by the Engineer.

D. Arranging the Work

The Contractor shall arrange his work so that no undue or prolonged blocking of business establishments will occur.

E. Storage of Materials

Materials and equipment stored on the right of way or Project Site shall be so placed and the Work at all times shall be so conducted as to insure minimum danger and obstruction to the traveling public.

F. Control During Work

During grading operations where traffic is being permitted to pass through construction, the Contractor shall provide a smooth, even surface that will provide a satisfactory passageway for use of traffic. The roadbed shall be sprinkled with water if necessary to prevent a dust nuisance, provided the dust nuisance is a result of the Work.

G. Fire Protection

Fire hydrants shall be accessible at all times to the Fire Department. No material or other obstructions shall be placed closer to a fire hydrant than permitted by ordinances, rules, or regulations or within fifteen (15') feet of a fire hydrant, in the absence of such ordinances, rules, or regulations.

SC-22 Structures at Railroad Crossings

A. Notification

No Work of any character shall be commenced on railroad right of way until the Railroad Company has issued a permit to the Owner and has been duly notified by the Contractor in writing (with a copy forwarded to the Engineer) of the date he proposes to begin work, and until an authorized representative of the Railroad Company is present, unless the Railroad Company waives such requirement.

B. Inspection by Railroad Company

All Work performed by the Contractor within the right of way limits of the railroad shall be subject to the inspection and approval of the chief engineer of the Railroad Company, or his authorized representative and any precautions considered necessary by said chief engineer to safeguard the property, equipment, employees, and passengers of the Railroad Company shall be taken by the Contractor without extra compensation.

C. Cooperation with Railroad Company

The Contractor shall, without extra compensation, take such precautions and erect and maintain such telltale or warning devices as the Railroad Company considers necessary to safeguard the operation of its trains. The temporary vertical and horizontal clearances

specified by the chief engineer of the Railroad Company in approving these shall be maintained at all times. No steel, brick, pipe, or any other loose material shall be left on the ground in the immediate vicinity of the railway tracks.

D. Insurance

Before any Work is done within Railroad right of way, the Contractor shall provide and pay all costs of any special insurance requirements of the Railroad.

SC-23 Protection and Restoration of Property and Landscape

A. Contractor's Responsibility

The Contractor shall not enter upon private property for any purpose without first obtaining permission from the owners and lessees. The Contractor shall use every precaution necessary for the preservation of all public and private property, monuments, highway signs, telephone lines, other utilities, etc., along and adjacent to the Work; shall use every precaution necessary to prevent damage to pipes, conduits, and other underground structures; and shall protect carefully from disturbance or damage all land monuments and property marks until an authorized agent has witnessed or otherwise referenced their location and shall not remove them until directed. The street and highway signs and markers that are to be affected by the Work shall be carefully removed when the Work begins and stored in a manner to keep them clean and dry. The Contractor must obtain all necessary information in regard to existing utilities, and shall give notice in writing to the owners or the proper authorities in charge of streets, gas, water, pipes, electric, sewers, and other underground structures, including conduits, railways, poles and pole lines, manholes, catch basins, fixtures, appurtenances, and all other property that may be affected by the Contractor's operations, at least forty-eight (48) hours before his operations will affect such property. The Contractor shall not hinder or interfere with any person in the protection of such work or with the operation of utilities, at any time. When property or the operation of railways, telephone lines, telegraph lines, or other public utilities are endangered, the Contractor shall, at his own expense, maintain flagmen or watchmen and any other necessary precautions to avoid interruption of service or damage to life or property, and he shall promptly repair, restore, or make good any injury or damage caused by his negligent operations in an acceptable manner. The Contractor must also obtain all necessary information in regard to the installation of new cables, conduits, and transformers, and make proper provision and give proper notifications, so that these can be installed at the proper time without delay to the Contractor or unnecessary inconvenience to the Owner.

B. Undercutting Buildings

Where provided in Special Conditions, when the work involves the undercutting of any buildings along the Work, the Contractor must give property owners and lessees due and sufficient notice of the undercutting and the Contractor shall adequately support such buildings. The Contractor and his Surety shall hold the Owner and their representatives harmless from any damages resulting from undercutting any such buildings.

C. Trees, Shrubs, Plants, or Grass

The Contractor shall not remove, injure, cut, or destroy trees, shrubs, plants, or grass that are to remain in the streets or those which are privately owned, without proper authority. Unless otherwise provided in the Special Provisions or the Proposal, the Contractor shall replace and replant all plants, shrubs, and grass and restore the grounds back to its original good condition to the satisfaction of the Owner and property owner. The Contractor shall assume the responsibility of replanting and guarantees that plants, shrubs, and grass will be watered, fertilized, and cultivated until they are in a growing condition. No direct payment will be made for removing and replanting of trees, shrubs, plants, or grass unless such items are set forth in the Proposal.

D. Reparation

When or where any direct damage or injury is done to public or private property by or on account of any negligent act, omission, neglect, or otherwise of the Contractor, he shall make good such damage or injury in an acceptable manner. In case of failure on the part of the Contractor to restore such property or make good such damage, the Owner may upon forty-eight (48) hours' notice proceed to repair, rebuild, or otherwise restore such property as may be deemed necessary, and the cost thereof will be deducted from any monies due or which may become due under the Contract. The Contractor shall indemnify and save harmless the Owner, or the Design Professional acting in behalf of the Owner, from all suits and actions that may be brought against it by reason of any injury, or alleged injury, to the person or property of another resulting from negligence or carelessness in the execution of the Work, or on account of any negligent act or omission, or from improper methods or means of construction on the part of the Contractor, his representatives, or employees. The Contractor shall have the sole responsibility of determining the best and proper method or means of construction and the Owner, or the Design Professional acting on behalf of the Owner, shall not be held responsible for determining or suggesting a method or means of construction, except as expressly indicated in the Contract Documents

SC-24 Barricades, Danger, Warning, and Detour Signs

A. General

The Contractor shall, without extra compensation, provide, erect, paint, and maintain all necessary barricades. Also without extra compensation, the Contractor shall provide suitable and sufficient lights, torches, reflectors, or other danger signals and signs, provide a sufficient number of watchmen and flagmen, and take all necessary precautions for the protection of the Work and safety of the public.

B. Warning Signs, Painting, Illumination

The Contractor shall erect warning signs beyond the limits of the Project, sufficiently in advance of any place on the Project where operations interfere with the use of the road by traffic, including all intermediate points where the new Work crosses or coincides with the existing road. Barricades shall be kept well painted and suitable warning signs shall

be placed thereon. All barricades and obstructions shall be illuminated at night and all lights or devices for this purpose shall be kept burning from sunset to sunrise.

C. Hazards and Compensation

Whenever traffic is maintained through or over any part of the project, the CONTRACTOR shall clearly mark all traffic hazards. No direct payment will be made for barricades, signs, and illumination therefor, or for watchmen or flagmen.

SC-25 Affidavit Attesting That Public Contract Not Secured Through Employment or Payment of Solicitor (LSA R.S. 38:2224): The Contractor warrants that (1) he has not employed or retained any person, corporation, firm, association, company or other organization, either directly or indirectly, to secure this Contract, other than persons regularly employed by the Contractor and whose services were in the regular course of their duties for the Contractor and (2) that no part of the Contract Price received by Contractor was paid or will be paid to any person, corporation, firm, association, company or other organization, either directly or indirectly any fee, commission, percentage, brokerage fee, gifts, or any other consideration, contingent upon or resulting from the award or making of this Contract or to solicit or secure this Contract, other than the payment of their normal compensation to persons regularly employed by the Contractor whose services in connection with this Contract were in the regular course of their duties for Contractor. For breach or violation of this warranty, the Owner shall have the right to annul this Contract without liability.

SC-26 Historical or Archaeological Deposits: If, during the course of construction, evidence of deposits of historical or archaeological interest is found, Contractor shall cease operations affecting the find and shall notify Owner, who shall notify the State Historic Preservation Officer. No further disturbance of the deposits shall ensue until Contractor has been notified by Owner that he may proceed. Owner will issue a notice to proceed only after the state official has surveyed the find and made a determination to the Owner. Compensation to Contractor, if any, for lost time or changes in construction to avoid the find, shall be determined in accordance with changed conditions or Change Order provisions of the Contract Documents.

SC-27 Additional Liquidated Damages: Contractor shall owe the amounts set forth in ARTICLE VII of the Agreement for each of the following items:

- (1) Extended architectural and/or engineering fees;
- (2) Extended Resident Project Representative fees;
- (3) Extended construction management fees;
- (4) Extended Owner's overhead and personnel expenses; and
- (5) Owner's other costs directly related to the delay in completion beyond the Contract Times.

SC-28 Removal/Relocation of Trees on Public Property: The Director of the Jefferson Parish Parkways Department shall be contacted and advised of trees that are on public property prior to the removal/relocation of such trees by the Contractor. Furthermore, the Department of Parkways shall be given a reasonable period of time to respond and when necessary remove the trees.

SC-29 Road Closure: In the event that it becomes necessary to close any roadway or partially close any major road due to scheduled construction work being performed by Contractor the public must be notified and made aware of the closure in a timely manner. In order to utilize both the print and electronic media to disseminate this information to the public, the Jefferson Parish Public Information Office must receive pertinent information from the Contractors concerning the closure. Notice of a road closure or partial road closure of a major road must be sent to Jefferson Parish in care of its Public Information Officer, 1221 Elmwood Park Blvd., Suite 1002, Jefferson, Louisiana 70123. THAT NOTIFICATION MUST CONTAIN THE FOLLOWING INFORMATION AND MUST BE RECEIVED BY THE PUBLIC INFORMATION OFFICE AT LEAST 10 DAYS PRIOR TO THE SCHEDULED CLOSURE:

- (a) Name of the Contractor, engineer, etc., involved in the work/project who is responsible for the action.
- (b) A brief description of the project (Example: "...drain line installation," "...to remove and replace concrete slabs," etc.)
- (c) The date and time the action will take place and when re-opening is scheduled. (Example. "...will be closed from 6 a.m. on Friday, July 23, 1999 to 8 p.m. on Monday, July 26, 1999.")
- (d) The exact location of action. (Example: "...closed on David Drive from W. Napoleon Avenue to Veterans Memorial Boulevard," or "...the 900 block of David Drive")
- (e) Define the action that will be taken. (Example: eastbound, westbound, inside or outside lanes or both, etc.)
- (f) If the roadway will be closed completely to traffic and a detour will be in effect, a map illustrating the detour route must accompany the information.
- (g) Contact person for additional information.

EXHIBIT A

TO SUPPLEMENTARY CONDITIONS

OF THE CONSTRUCTION CONTRACT

Duties, Responsibilities and Limitations of Authority of Resident Project Representative

The Resident Project Representative (RPR) will be Engineer's representative at the Site. RPR's dealings in matters pertaining to the Work in general will be with Engineer and Contractor. RPR's dealings with Subcontractors will only be through or with the full knowledge or approval of Contractor. RPR shall generally communicate with Owner with the knowledge of and under the direction of Engineer. The RPR will:

1. *Conferences and Meetings:* Attend meetings with Contractor, such as preconstruction conferences, progress meetings, job conferences, and other Project-related meetings (but not including Contractor's safety meetings), and as appropriate prepare and circulate copies of minutes thereof.
2. *Safety Compliance:* Comply with Site safety programs, as they apply to RPR, and if required to do so by such safety programs, receive safety training specifically related to RPR's own personal safety while at the Site.
3. *Liaison*
 - a. Serve as Engineer's liaison with Contractor. Working principally through Contractor's authorized representative or designee, assist in providing information regarding the provisions and intent of the Contract Documents.
 - b. Assist Engineer in serving as Owner's liaison with Contractor when Contractor's operations affect Owner's on-Site operations.
 - c. Assist in obtaining from Owner additional details or information, when required for Contractor's proper execution of the Work.
4. *Review of Work; Defective Work*
 - a. Conduct on-Site observations of the Work to assist Engineer in determining, to the extent set forth in Paragraph 10.02, if the Work is in general proceeding in accordance with the Contract Documents.
 - b. Observe whether any Work in place appears to be defective.
 - c. Observe whether any Work in place should be uncovered for observation, or requires special testing, inspection or approval.

- d. Report to Engineer whenever RPR believes that any Work will not produce a completed Project that conforms generally to the Contract Documents or will prejudice the integrity of the design concept of the completed Project as a functioning whole as indicated in the Contract Documents, or has been damaged, or does not meet the requirements of any inspection, test or approval required to be made; and advise Engineer of Work that RPR believes should be corrected or rejected or should be uncovered for observation, or requires special testing, inspection or approval.
- 5. *Inspections and Tests*
 - a. Observe Contractor-arranged inspections required by Laws and Regulations, including but not limited to those performed by public or other agencies having jurisdiction over the Work.
 - b. Accompany visiting inspectors representing public or other agencies having jurisdiction over the Work.
- 6. Shop Drawings and Samples
 - a. Record date of receipt of Shop Drawings and Samples.
 - b. Receive Samples, which are furnished at the Site by Contractor, and notify Engineer of availability of Samples for examination.
 - c. Advise Engineer and Contractor of the commencement of any Work requiring a Shop Drawing or Sample if the submittal has not been approved by Engineer.
- 7. Interpretation of Contract Documents: Report to Engineer when clarifications and interpretations of the Contract Documents are needed and transmit to Contractor clarifications and interpretations as issued by Engineer.
- 8. Modifications: Consider and evaluate Contractor's suggestions for modifications in Drawings or Specifications and report with RPR's recommendations to Engineer. Transmit to Contractor in writing decisions as issued by Engineer.
- 9. Records
 - a. Maintain at the job Site orderly files for correspondence, reports of job conferences, Shop Drawings and Samples, reproductions of original Contract Documents including all Work Change Directives, Addenda, Change Orders, Field Orders, additional Drawings issued subsequent to the execution of the Contract, Engineer's clarifications and interpretations of the Contract Documents, progress

reports, Shop Drawing submittals received from and delivered to Contractor and other Project related documents.

- b. Prepare a daily report or keep a diary or log book, recording Contractors hours on the job site, weather conditions, data relative to questions of Work Change Directives, Change Orders or changed conditions, list of job Site visitors, daily activities, decisions, observations in general, and specific observations in more detail as in the case of observing test procedures; and send copies to Engineer.
- c. Record names, addresses and telephone numbers of all contractors, subcontractors and major suppliers of materials and equipment.

10. Reports

- a. Furnish to Engineer periodic reports as required of progress of the Work and of Contractor's compliance with the progress schedule and schedule of Shop Drawing and Sample submittals.
- b. Consult with Engineer in advance of scheduled major tests, inspections or start of important phases of the Work.
- c. Draft proposed Change Orders and Work Change Directives, obtaining backup material from Contractor and recommend to Engineer Change Orders, Work Change Directives, and Field Orders.
- d. Report immediately to Engineer and Owner the occurrence of any accident.

11. *Payment Requests:* Review Applications for Payment with Contractor.

12. Certificates, Maintenance and Operation Manuals: During the course of the Work, verify that certificates, maintenance and operation manuals and other data required to be assembled and furnished by Contractor are applicable to the items actually installed and in accordance with the Contract Documents, and have this material delivered to Engineer for review and forwarding to Owner prior to final payment for the Work.

13. *Completion*

- a. Participate in Engineer's visits regarding Substantial Completion.
- b. Assist in the preparation of a punch list of items to be completed or corrected.
- c. Participate in Engineer's visit to the Site in the company of Owner and Contractor regarding completion of the Work, and prepare a final punch list of items to be completed or corrected by Contractor.

- d. Observe whether items on the final punch list have been completed or corrected.
14. The RPR will not:
- a. Authorize any deviation from the Contract Documents or substitution of materials or equipment (including “or-equal” items).
 - b. Exceed limitations of Engineer’s authority as set forth in the Contract Documents.
 - c. Undertake any of the responsibilities of Contractor, Subcontractors, or Suppliers.
 - d. Advise on, issue directions relative to, or assume control over any aspect of the means, methods, techniques, sequences or procedures of construction.
 - e. Advise on, issue directions regarding, or assume control over security or safety practices, precautions, and programs in connection with the activities or operations of Owner or Contractor.
 - f. Participate in specialized field or laboratory tests or inspections conducted off-site by others except as specifically authorized by Engineer.
 - g. Authorize Owner to occupy the Project in whole or in part.

**FORM OF AGREEMENT
BETWEEN
THE PARISH OF JEFFERSON
AND
[INSERT NAME OF VENDOR]**

THIS AGREEMENT is made as of the date of full execution by the parties, as evidenced by the electronic signatures by and between the Parish of Jefferson, State of Louisiana, hereinafter called "OWNER", duly represented herein by _____, Chairman of Jefferson Parish Council, duly authorized to act by virtue of Resolution No. _____, adopted on the ____ day of _____, 20__, which is made a part hereof, and insert contractor's legal name, represented by contractor's representative's name, representative's title, hereinafter called "CONTRACTOR".

NOW THEREFORE, in consideration of the compensation to be paid to CONTRACTOR and of the mutual agreements herein contained, the parties hereby agree as follows:

SECTION 1. SCOPE OF WORK

A. OWNER, through the Chairman of the Jefferson Parish Council, _____, by virtue of Resolution No. _____, does hereby grant and confirm unto CONTRACTOR an Agreement to perform the Work under Project No. _____, Proposal No. 50-_____, for name of project, as per the General Conditions, any Supplementary Conditions, the Drawings, and Specifications on file in the Office of the Chief Buyer for the Parish of Jefferson for the bid amount of \$_____ in accordance with the CONTRACTOR's written bid proposal dated _____, which is made a part hereof by reference.

B. The CONTRACTOR, its successors and assigns shall perform all Work, including the assumption of all obligations, duties and responsibilities necessary to the successful completion of the Contract and the furnishing of all materials and equipment required to be incorporated in and to form a permanent part of the Work; tools, equipment, supplies, transportation, facilities, labor, superintendence and services required to perform the Work; and Bond, insurance and submittals; all as indicated or specified in the Contract Documents to be performed or furnished by CONTRACTOR for the Work included in and covered by OWNER's official award of this Contract to CONTRACTOR; such award being based on the acceptance by OWNER of CONTRACTOR's bid.

C. That OWNER shall pay to CONTRACTOR for performance of the Work embraced in this Contract, in accordance with the Contract Documents, and CONTRACTOR shall accept as full compensation therefor, the sum (subject to adjustment as provided in the Contract Documents) of _____ Dollars and __ Cents (\$_____)

for all Work covered by and included in the Contract award and designated in the foregoing Article I; payment thereof to be made in current funds in the manner provided in the Contract Documents.

D. Notwithstanding anything to the contrary in the foregoing, CONTRACTOR acknowledges and agrees that, pursuant to the applicable Laws and Regulations, this Agreement is subject to an annual appropriation dependency requirement to the effect that the renewal and/or continuation of this Agreement is contingent upon the appropriation of funds to fulfill the requirements of the Agreement. If the OWNER fails to appropriate sufficient monies to provide for payments under this Agreement, the Agreement shall terminate on the last day of the last fiscal year for which funds were appropriated. This ground for termination is in addition to any other grounds that are identified in the General Conditions or the Supplementary Conditions.

E. As provided in Paragraph 13.03.B of the General Conditions, estimated quantities are not guaranteed, and determinations of actual quantities and classification are to be made by ENGINEER as provided in Paragraph 10.05 of the General Conditions. Unit prices have been computed as provided in Paragraph 13.03.D of the General Conditions.

SECTION 2. OWNER'S REPRESENTATIVE

A. The Project has been designed by insert engineer, who is hereinafter called "ENGINEER" and who is to act as OWNER's representative, to assume all duties and responsibilities and to have the rights and authority assigned to ENGINEER in the Contract Documents in connection with completion of the Work in accordance with the Contract Documents.

B. All notices, letters, and other communications directed to OWNER shall be delivered, mailed (with proper postage), or emailed to the ENGINEER at the address in the Invitation to Bid, with a copy sent to:

insert Director of Department
Jefferson Parish Department of insert name of Department
insert address
Jefferson, Louisiana insert zip code

C. In addition, a copy of all correspondence directed to the ENGINEER shall be sent to the OWNER. The business address of CONTRACTOR given in this Agreement and CONTRACTOR's office in the vicinity of the Work are both hereby designated as the places to which all notices, letters, and other communications to CONTRACTOR will be mailed, emailed, or delivered. CONTRACTOR shall notify ENGINEER and OWNER of any change of address immediately.

SECTION 3. CONTRACT TERM

The Work will be substantially completed within ____ days after the date when the Contract Times commence to run as provided in Paragraph 4.01 of the General Conditions ("Substantial Completion"), and completed and ready for final acceptance in accordance with Paragraph 15.06.B. of the General Conditions within ____ days after the date when the Contract Times commence to run. This time allocation allows for ____ days of lost production due to inclement weather. The contract time shall commence on the date listed on the CONTRACTOR'S Notice To Proceed issued by OWNER.

SECTION 4. BONDS

A. LABOR AND MATERIALS PAYMENT BOND

CONTRACTOR hereby firmly and truly binds itself as principal with _____, as surety, unto the OWNER in the full and true sum of \$_____ for the payment whereof Contractor and Surety bind themselves, their heirs, executors, administrators, successors and assigns, jointly and severally, firmly by these presents, according to the terms and conditions of the labor and material payment bond(s).

B. PERFORMANCE BOND

CONTRACTOR hereby firmly and truly binds itself as principal with _____, as surety, unto the OWNER in the full and true sum of \$_____ for the payment whereof Contractor and Surety bind themselves, their heirs, executors, administrators, successors and assigns, jointly and severally, firmly by these presents, according to the terms and conditions of the performance payment bond(s).

SECTION 5. LIQUIDATED DAMAGES

A. OWNER and CONTRACTOR recognize and agree that time is of the essence of this Agreement and that the Work must be completed in every respect appropriate within the applicable time limits set forth in the Contract Documents, commencing from the date specified in the Contract Documents. OWNER and CONTRACTOR further understand and agree that it is difficult at this time to estimate the damage which the delay in completion of the Work would cause the OWNER and that, accordingly, if the CONTRACTOR shall neglect, fail, or refuse to complete the Work in accordance with the Contract Times specified in the Contract Documents, or any extension thereof granted by the OWNER in accordance with the applicable provisions of the Contract Documents then, in addition to the other stipulated damages provided for in Article VII below, the CONTRACTOR agrees, as a part of the consideration for the award of this Contract, that OWNER shall be entitled to receive the amount or amounts per day set forth in paragraph B below from CONTRACTOR, not as a penalty but as stipulated

("liquidated") damages for delay for such breach of contract, such amounts being specifically herein agreed upon in advance as the measure of damages to the OWNER on account of such delay in the completion of the Work.

B. The CONTRACTOR shall owe OWNER liquidated damages in the amount of _____ dollars (\$_____.00) for each and every calendar day after the time specified in Article V for Substantial Completion of the Work until the Work is determined to be substantially complete in accordance with the Contract Documents. After Substantial Completion, if the CONTRACTOR shall neglect, fail, or refuse to complete the Work within the time specified in Article V for final completion, or any proper extension thereof granted by the OWNER, CONTRACTOR shall owe OWNER liquidated damages in the amount of _____ dollars (\$_____.00) for each day after the time specified in Article V for final completion until the Work is determined to be finally completed in every respect in accordance with the Contract Documents.

C. The number of calendar days in default shall be calculated exclusive of the day on which the applicable completion time was specified and shall include each and every other calendar day up to and including the day that the CONTRACTOR has been determined to satisfy its obligation for the applicable degree of completion under the Contract Documents.

D. CONTRACTOR further agrees that the expiration of the Contract Time shall, ipso facto, constitute a putting in default where CONTRACTOR has failed to complete the Work in accordance with the applicable Contract Times, and OWNER need not formally place the CONTRACTOR in default, the CONTRACTOR hereby expressly waiving any and all notices of default.

E. CONTRACTOR agrees and consents that the liquidated damages may be deducted from progress payments payable to CONTRACTOR pursuant to the Contract Documents and that CONTRACTOR shall accept the Contract Price, reduced by the aggregate amount of the liquidated damages so deducted, in full satisfaction of all Work executed under the Contract Documents.

F. In addition to, and not in lieu of the liquidated damages provided above, OWNER shall also be entitled to recover from CONTRACTOR or CONTRACTOR's Surety additional liquidated damages arising out of the breach of contract for delay in completion of the Work in accordance with the Contract Times for the same amount of time calculated pursuant to ARTICLE VI above. These additional liquidated damages, the amounts of each of which are applicable to the Contract having been set forth in the Supplementary Conditions, may include, but are not limited to:

- (1) Extended architectural and/or engineering fees: \$_____/hour;
- (2) Extended Resident Project Representative fees: \$_____/hour;
- (3) Extended construction management fees: \$_____/day;
- (4) Extended OWNER'S overhead and personnel expenses: \$_____/hour; and

- (5) Owner's other costs directly related to the delay in completion beyond the Contract Times.

CONTRACTOR agrees and consents that the additional liquidated damages may be deducted from progress payments payable to CONTRACTOR pursuant to the Contract Documents and that CONTRACTOR shall accept the Contract Price, reduced by the aggregate amount of the additional liquidated damages so deducted, in full satisfaction of all Work executed under the Contract Documents.

SECTION 6. PAYMENTS

CONTRACTOR shall submit Applications for Payment in accordance with Article 15 of the General Conditions. Applications for Payment will be processed by ENGINEER as provided in the General Conditions.

OWNER shall make progress payments on account of the Contract Price on the basis of CONTRACTOR's Applications for Payment as recommended by ENGINEER, as provided below. All such payments will be measured by the schedule of values established pursuant to Paragraph 2.05 of the General Conditions (and in the case of Unit Price Work based on the number of units completed) or, in the event there is no schedule of values, as provided in the General Requirements.

Upon receipt of the Final Application for Payment, OWNER shall pay the remainder of the Contract Price as recommended by ENGINEER as provided in Paragraph 15.06.E.3. of the General Conditions and any relevant Supplementary Conditions.

Pursuant to LSA-R.S. 38:2248, OWNER shall retain the following percentages of each progress payment until payment is due under the terms and conditions governing retainage payment:

<u>CONTRACT AMOUNT</u>	<u>RETAINAGE</u>
\$0 - \$499,999.99	10%
\$500,000 or greater	5%

SECTION 7. CONTRACT DOCUMENTS

The Contract Documents, which comprise the agreement between OWNER and CONTRACTOR, concerning the Work, consist of the documents listed in the Table of Contents, if any, and the documents identified below:

1. General Conditions (pages 1 to 82 of 104, inclusive).
2. Supplementary Conditions (pages 83 to 91 of 104, inclusive).
3. Exhibits to this Agreement (pages 92 to 95 of 104, inclusive).
4. Form of Agreement (pages 96 to 104 of 104, inclusive).
5. Performance, Payment, and other Bonds, consisting of ____ pages.
6. Notice to Proceed. (Not attached)
7. Specifications bearing the title insert title of project and consisting of ____ pages.
8. Drawings consisting of a cover sheet and sheets numbered ____ through ____, inclusive with each sheet bearing the following general title: insert title of project.
9. Addenda numbers ____ to ____, inclusive.
10. CONTRACTOR's Bid (pages ____ to ____, inclusive).
11. Documentation submitted by CONTRACTOR prior to Notice of Award: (pages ____ to ____, inclusive).
12. The following which may be delivered or issued after the Effective Date of the Agreement and are not attached hereto: All Written Amendments and other documents amending, modifying or supplementing the Contract Documents pursuant to Article 11 of the General Conditions.

The documents listed above are attached to this Agreement (except as expressly noted otherwise above).

SECTION 8. CONTRACTOR'S REPRESENTATIONS

In order to induce OWNER to enter into this Agreement, the CONTRACTOR makes the following representations:

A. CONTRACTOR has visited the Site, has familiarized himself with and is satisfied as to the nature and extent of the Contract Documents, Work, locality, and as to all general, local and Site conditions and federal, state, and local Laws, and Regulations, which may affect cost, progress, performance or furnishing of the Work.

B. CONTRACTOR has examined and carefully studied the Contract Documents and the other related data identified in the Bidding Documents including Technical Data.

C. CONTRACTOR has carefully studied all (1) reports of explorations and tests of subsurface conditions at or contiguous to the Site and all drawings of physical conditions in or relating to existing surface or subsurface structures at or contiguous to the Site (except Underground Facilities) which have been identified in the Supplementary Conditions as provided in Paragraph 5.03.A. of the General Conditions and (2) reports and drawings of a Hazardous Environmental Condition, if any, at the Site which has been identified in the Supplementary Conditions as provided in Paragraph 5.03.A of the General Conditions. CONTRACTOR accepts the determination set forth in Paragraph SC-5.03 of the Supplementary Conditions of the extent of the Technical Data contained in such reports and drawings upon which CONTRACTOR is entitled to rely as provided in Paragraph 5.03 of the General Conditions. CONTRACTOR acknowledges that such reports and drawings are not Contract Documents and may not be complete for CONTRACTOR's purpose. CONTRACTOR acknowledges that OWNER and ENGINEER do not assume responsibility for the accuracy or completeness of information and data shown or indicated in the Contract Documents with respect to Underground Facilities at or contiguous to the Site. CONTRACTOR has obtained and carefully studied (or assumes responsibility for having done so) all such additional supplementary examinations, investigations, explorations, test, studies and data concerning conditions (surface, subsurface and Underground Facilities) at or contiguous to the Site or otherwise which may affect cost, progress, performance or furnishing of the Work or which relate to any aspect of the means, methods, techniques, sequences and procedures of construction to be employed by CONTRACTOR and safety precautions and programs incident thereto. CONTRACTOR does not consider that any additional examinations, investigations, explorations, tests, studies or data are necessary for the performance and furnishing of the Work at the Contract Price, within the Contract Times and in accordance with the other terms and conditions of the Contract Documents.

D. CONTRACTOR is aware of the general nature of work to be performed by OWNER and others at the Site that relates to the Work as indicated in the Contract Documents.

E. CONTRACTOR has correlated the information known to CONTRACTOR, information and observations obtained from visits to the Site, reports and drawings identified in the Contract Documents and all additional examinations, investigations, explorations, tests, studies and data with the Contract Documents.

F. CONTRACTOR has given ENGINEER written notice of all conflicts, errors, ambiguities or discrepancies that CONTRACTOR has discovered in the Contract Documents and the written resolution thereof by ENGINEER is acceptable to CONTRACTOR, and the Contract Documents are generally sufficient to indicate and convey an understanding of all terms and conditions for performance and furnishing of the Work.

SECTION 9. ASSIGNMENT

Neither the OWNER nor the CONTRACTOR shall assign, sell, transfer or otherwise convey any interest in this Agreement, including any monies due or to become due to the CONTRACTOR under the contract,

without the prior written consent of the other, nor without the consent of the surety, unless the surety has waived its right to notice of assignment. Unless specifically stated to the contrary in any written consent, no assignment, sale, transfer, or conveyance will act as a release or discharge of a party from any duty or responsibility under this Agreement or the General Conditions.

SECTION 10. INSPECTOR GENERAL

It shall be the duty of every parish officer, employee, department, agency, special district, board, and commission; and the duty of every contractor, subcontractor, and licensee of the parish, and the duty of every applicant for certification of eligibility for a parish contract or program, to cooperate with the inspector general in any investigation, audit, inspection, performance review, or hearing pursuant to JPCO 2-155.10(19).

By signing this document, every corporation, partnership, or person contracting with PARISH, whether by cooperative endeavor, intergovernmental agreement, bid, proposal, application or solicitation for a parish contract, and every application for certification of eligibility for a parish contract or program, attests that it understands and will abide by all provisions of JPCO 2-155.10.

SECTION 11. SEVERABILITY CLAUSE

Any provision or part of the Contract Documents held to be void or unenforceable under any Law or Regulation shall be deemed stricken, and all remaining provisions shall continue to be valid and binding upon OWNER and CONTRACTOR, who agree that the Contract Documents shall be reformed to replace such stricken provision or part thereof with a valid and enforceable provision that comes as close as possible to expressing the intention of the stricken provision.

SECTION 12. ENTIRE AGREEMENT

This Agreement shall be deemed to be a contract made under the laws of the State of Louisiana, and for all purposes shall be interpreted in its entirety in accordance with the laws of said State. The contractor hereby agrees and consents to the jurisdiction of the courts of the State of Louisiana over its person. The parties hereto agree that the sole and exclusive venue of any suit or proceeding brought pursuant to this contract shall be the 24th Judicial District Court for the Parish of Jefferson, State of Louisiana.

This Agreement and the attached documents represent the entire agreement between the OWNER and CONTRACTOR and supersede all prior negotiations, representations or agreements, either written or oral. This Agreement may be amended only by a written instrument signed by both the OWNER, through its Council Chairperson, and the CONTRACTOR.

This Agreement is fully executed on the latest date indicated below.

PARISH OF JEFFERSON

Date

By: _____

_____, Chairman
Jefferson Parish Council

INSERT CONTRACTOR'S NAME

Date

By: _____

insert representative name
insert title

License No. _____

Address for giving notices:

SECTION 16010 – BASIC ELECTRICAL REQUIREMENTS

PART 1 - GENERAL

RELATED DOCUMENTS

All drawings and general provisions of the contract, including General Conditions, Supplementary Conditions, and other Division 1 Specifications, apply to this section.

Separation of Specifications into Sections is for convenience only and is not intended to establish limits of work or liability. The following sections apply to this project:

- 16010 – Basic Electrical Requirements
- 16100 – Basic Electrical Materials and Methods
- 16400 – Panelboards
- 16800 – Generator
- 16850 – Automatic Transfer Switch

DESCRIPTION OF WORK

Furnish all labor, tools, materials, fixtures, equipment, accessories, transportation, etc., required for a complete electrical lighting and power systems, complete with necessary auxiliaries as indicated on the drawings and specifications.

Removal of existing electrical equipment not being reused. Owner has first right of refusal.

DRAWINGS AND SPECIFICATIONS

The drawings showing the layout of electrical work indicate the approximate location of transformers, switchboards, panelboards, disconnects, outlets, and conduit routing. The contractor shall refer to architectural, structural, and mechanical drawings as well as equipment manufacturer's shop drawings and rough-in drawings, and adjust work accordingly to provide a coordinated installation. All adjustments and minor deviations necessary shall be made without additional cost to the owner. It shall be the electrical contractor's responsibility to see that all equipment such as pull boxes, junction boxes, panelboards, and other apparatus, that may require maintenance from time to time, is made accessible. Any condition that may occur during construction which conflicts with accessibility to the proposed installation of the electrical equipment, shall be brought to the Architect's attention prior to the point at which a change in location would require additional cost and delays to construction

All electrical gear shall be mounted at or above the first floor slab or base flood elevation, whichever is higher, unless noted otherwise.

The drawings and specifications are complementary and what is shown and/or called for on one shall be furnished and installed the same as if shown and/or called for on the other.

Where the Contractor is not certain about the method of installation, he shall ask the Architect for further installation details. Lack of details, not requested, will not be an excuse for improper installation.

When a color or other condition for a product is specified to be determined by the architect, the submittal for that item shall be clearly marked with the available options. (Do not select a color or other condition in the submittal) The architect shall be specifically asked by the contractor to provide the required information, and that product shall not be manufactured prior to obtaining such information.

LAWS, CODES, AND PERMITS

The latest accepted edition of the National Electrical Code (NFPA 70), National Fire Alarm Code (NFPA 72), and all State, Parish, City, and local building codes shall be considered a part of these specifications, and pertinent articles will not be repeated herein. These codes establish the minimum acceptable criteria where more stringent requirements have not been defined in these specifications and/or drawings.

The Contractor shall apply for all permits and pay all fees incidental to completing the electrical work. This Contractor shall give notice to the proper authorities in ample time for the work to be inspected and approved as it progresses, and no work shall be concealed until inspected and approved by authorized inspectors. If the plans or these specifications in any way conflict with the Code, State or Local Rules, these latter are to be followed, without expense to the Owner, but the Architect shall be notified of this condition and approval secured before changes are made.

Comply with utility company standards. Coordinate all work for installation of metering, outages, and all aspects of the service with the utility company prior to roughin.

Upon completion and before acceptance of work, a certificate of approval from the appropriate regulatory agency shall be furnished to the Architect.

No work shall be concealed until approved by the local inspector. Local regulations shall be adhered to.

The contractor shall assure that he does not install electrical equipment including raceways in or through areas restricted by the international building code and local building codes including elevator shafts and stairs.

JOB SITE

Prior to submitting quotation for electrical work, Contractor shall visit and examine the job site with all authorities concerned in order to become familiar with all existing conditions

pertinent to the work to be performed thereon. No additional compensation will be allowed for failure to be so informed.

Where existing equipment including raceways and wiring is in conflict with work of this project, the contractor shall rework/reroute/relocate this equipment as necessary.

TEMPORARY POWER

The Contractor shall be responsible for providing temporary light and power to the construction site as necessary to meet all of the OSHA requirements for construction, and as required by the general contractor and various sub-contractors.

SERVICE INTERRUPTIONS

Services to the buildings shall be kept in operation at all times during construction. If a situation occurs that the service needs to be interrupted, the Contractor shall be responsible for contacting the proper authorities to schedule the outage at a time that is convenient to the occupants. It shall be understood that this outage may have to be scheduled after regular working hours or on the weekends. Allowances shall be added to the Contractors bid to cover the cost of any overtime work. This shall come at no additional cost to the Owner after the bid date.

WARRANTY

The contractor shall guarantee all labor and materials for a period of twelve (12) months from the date of final acceptance. All defective materials and work shall be replaced with new materials or equipment. This shall come at no additional cost to the Owner.

PART 2 – PRODUCTS

MATERIALS

Equipment and materials shall be new and shall be listed by Underwriters Laboratories for the purpose for which they are being used. All material of similar use shall be of the same manufacturer.

Substitutions to materials listed on the drawings and specifications can be made as long as they are approved as acceptable by the Architect. Requests for prior approval shall be submitted no later than seven working days prior to bidding. All requests for prior approval shall be in writing by providing a hard copy of the submittal data to the engineer's office.

All termination lugs shall be rated 75 degree C minimum and shall be compatible with the number and size of wires to be terminated.

SUBSTITUTIONS

Names of manufacturers or catalog numbers are mentioned herein in order to establish a standard as to design quality. Other products similar in design and of equal quality may be used if submitted to the architect and found acceptable by him. Refer to the general conditions for additional information.

Any substitution to items specified, that are not approved prior to bidding, shall be brought to the attention of the engineer as an alternative product prior to the official submittal of electrical products along with the specific reason for the proposed substitution. Refer to the general conditions for additional information.

When the contractor elects to use an acceptable alternate manufacturer's equipment, the contractor shall be responsible to coordinate the change with all trades affected and pay for any additional work required under this or any other division affected by the substitution.

SUBMITTALS

Within thirty days of the award of the contract, the Contractor shall be responsible for submitting six (6) copies of submittals containing catalog cuts and performance data for all material and equipment proposed for use. These submittals shall be reviewed by the Architect for general compliance to the contract documents. The Architect's review of these submittals in no way modifies the contract or relieves the Contractor from compliance with the contract unless a difference is clearly stated in the submission and specific acceptance is given by the Architect as a change to the contract.

Submittals shall be identified with the project name and the contractor's name and have the contractor's stamp showing that he has reviewed the submittal and found it to be in accordance with the plans and specifications. Submittals shall be bound.

Items of division 16 shall be submitted in one package.

Submittals that do not comply with the above may be returned, without review, for resubmission.

All shop drawings must be reviewed before the various factories start fabrication. The contractor shall allow a minimum of 30 days for this review.

Developing electronic or CAD files shall be the responsibility of the contractor. Electronic CAD drawings will not be provided to the contractor.

PART 3 – EXECUTION

INSTALLATION

Ask for details whenever uncertain about installation methods. Lack of details requested

shall not excuse proper installation and corrections shall be the responsibility of the contractor.

AS-BUILT DRAWINGS & OPERATING INSTRUCTIONS

The Contractor shall be responsible for providing As-Built drawings to the Architect at the completion of the project. The Contractor shall make a reproducible set of the original contract drawings, and in a neat and understandable manner, show any significant changes made during construction. Unless noted otherwise in the contract documents, the Contractor shall provide one additional copy of these drawings to the Architect. The Contractor shall pay for all reproduction costs. Final payment shall be withheld until these drawings are accepted by the Architect.

The Contractor shall furnish two bound sets of any operating instructions and maintenance manuals to the Architect upon completion of the project.

CUTTING AND PATCHING

The Contractor shall be responsible for all cutting and patching that is required to complete the installation of the electrical systems. All work shall be coordinated between trades with strict accordance with the requirements of the General Conditions. Structural members shall not be cut or modified without the approval of the architect.

The Contractor shall be responsible for covering, caulking, or otherwise to make weatherproof all openings left in the structure for electrical work. This includes openings around conduit penetrations.

EXCAVATING AND BACKFILLING

The Contractor shall be responsible for all excavating and backfilling required to complete the installation of the electrical systems. All excess material and debris shall be removed. All backfilling shall be with sand. Backfilling shall be thoroughly tamped and compacted.

It shall be the Contractor's responsibility to locate all underground utilities before trenching and excavating. Care shall be taken to avoid damage to the existing utilities. Any damage shall be repaired or replaced by the Contractor at no expense to the Owner.

PAINTING

No painting shall be required under DIVISION 16, except for factory-finished items. Any damaged surfaces of factory items shall be repaired by the Contractor to an acceptable level determined by the Architect.

EXISTING EQUIPMENT

The Contractor shall be responsible for the removal and reinstallation of any electrical equipment, such as light fixtures, that shall be reused. Any existing electrical equipment that

is removed and not reused shall be returned to the Owner. Any material that the Owner does not wish to keep shall be removed from the site by the Contractor.

When existing electrical items such as outlets are removed from service, care shall be taken to keep the integrity of the remaining electrical systems.

SERVICE EQUIPMENT MARKING

In addition to other marking requirements, all service equipment shall be marked with the available fault current and the date of calculation of the fault current. See other areas of these specifications for additional labeling requirements. Labels shall be engraved metal or laminated-plastic nameplate mounted with corrosion-resistant screws.

TESTING AND ADJUSTMENTS

Provide a complete fault current coordination study and an arc flash hazard study and tag all gear accordingly. Provide labeling on all switchgear and switch boards. Adjust all trip and parameter settings in accordance with the calculations.

END OF SECTION 16010

SECTION 16100 - BASIC ELECTRICAL MATERIALS AND METHODS

PART 1 - GENERAL

SUMMARY

This Section includes the following:

1. Raceways
2. Wires, cables, and connections
3. Wiring devices
4. Grounding
5. Safety Switches and fuses
6. Supporting devices for electrical components
7. Equipment for utility company's electricity metering

QUALITY ASSURANCE

Electrical Components, Devices, and Accessories shall be listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

Devices for Utility Company Electricity Metering shall comply with utility company published standards.

Comply with NFPA 70.

COORDINATION

Coordinate chases, slots, inserts, sleeves, and openings for electrical supports, raceways, and cable with general construction work.

Sequence, coordinate, and integrate installing electrical materials and equipment for efficient flow of the Work. Coordinate installing large equipment that requires positioning before closing in the building.

Coordinate electrical service connections to components furnished by utility companies.

Coordinate installation and connection of exterior underground and overhead utilities and services, including provision for service entrances and electricity-metering components.

Coordinate location of access panels and doors for electrical items that are concealed by finished surfaces.

Where electrical identification devices are applied to field-finished surfaces, coordinate installation of identification devices with completion of finished surface.

PART 2 - PRODUCTS

RACEWAYS

EMT: Electrical metallic tubing; ANSI C80.3, zinc-coated steel.

FMC: Flexible metal conduit; zinc-coated steel.

IMC: Intermediate metal conduit; ANSI C80.6, zinc-coated steel, with threaded fittings.

LFMC: Liquidtight flexible metal conduit; zinc-coated steel with sunlight-resistant and mineral-oil-resistant plastic jacket.

RMC: Rigid metal conduit; galvanized rigid steel; ANSI C80.1.

RNC: Rigid nonmetallic conduit; NEMA TC 2, Schedule 40 or 80 PVC, with NEMA TC3 fittings.

Raceway Fittings: Specifically designed for raceway type with which used.

WIRES, CABLES, AND CONNECTIONS

All conductors shall have 600V insulation type THHN/THWN

Conductors in outdoor underground raceways shall be type THWN

Conductors, No. 10 AWG and Smaller: Solid or stranded copper.

Conductors, Larger Than No. 10 AWG: Stranded copper.

No wire shall be smaller than #12 awg unless noted otherwise.

All conductors shall be copper.

Insulation: Thermoplastic, rated 600 V, 90 deg C minimum, Type THHN-THWN, or USE depending on application.

Wire Connectors and Splices: Units of size, ampacity rating, material, type, and class suitable for service indicated.

WIRING DEVICES

Wall Switches shall be 20A, 277V, AC type designed for quiet operation.

Duplex receptacles shall be 20A/2 pole, 3-wire, 125V, grounding type.

All devices shall be specification grade Hubbell, Leviton, or equal.

All device plates shall be brushed stainless steel with matching counter sunk screws unless noted otherwise. All boxes shall have a cover plate.

Consult with the Architect for color selections before ordering devices.

Use multigang plates where devices are grouped together.

Boxes and fittings shall comply with article 314 of the NEC. Particular attention shall be paid to the number of conductors allowed in an outlet box or junction box. Contractor shall make provisions to prevent overcrowding outlet and junction boxes regardless of the number of conductors shown on the plans at the outlets.

In locations where power, combination, and tele/data outlets are mounted together, care shall be taken to minimize the overall spacing along the wall. Consult with the Architect for specific details.

GROUNDING

The grounding system shall be in accordance with N.E.C. Article 250.

A grounding conductor shall be provided in all conduit.

SAFETY SWITCHES AND FUSES

Safety switches shall be of the quick-make, quick-break, heavy-duty, fusible or non-fusible type with cover interlock to prevent opening of the door when the switch is in the "ON" position. Use NEMA 3R enclosures outdoors and NEMA 1 enclosures indoors, unless otherwise noted.

Provide a complete set of dual-element, class RK-1 or class J fuses of ampere rating shown on the drawings. Furnish the owner with 20% spare fuses with at least one set for every rating.

All fuses shall have a minimum interrupting rating of 200,000 A.

SUPPORTING DEVICES

Material: Cold-formed steel, with corrosion-resistant coating.

Metal Items for Use Outdoors or in Damp Locations: Hot-dip galvanized steel.

Slotted-Steel Channel: Flange edges turned toward web, and 9/16-inch- diameter slotted holes at a maximum of 2 inches o.c., in webs. Strength rating to suit structural loading.

Slotted Channel Fittings and Accessories: Recommended by the manufacturer for use with the type and size of channel with which used.

Raceway and Cable Supports: Manufactured clevis hangers, riser clamps, straps, threaded C-clamps with retainers, ceiling trapeze hangers, wall brackets, and spring-steel clamps or click-type hangers.

Pipe Sleeves: ASTM A 53, Type E, Grade A, Schedule 40, galvanized steel, plain ends.

Cable Supports for Vertical Conduit: Factory-fabricated assembly consisting of threaded body and insulating wedging plug for non-armored electrical cables in riser conduits. Plugs have number and size of conductor gripping holes as required to suit individual risers. Body constructed of malleable-iron casting with hot-dip galvanized finish.

Expansion Anchors: Carbon-steel wedge or sleeve type.

Toggle Bolts: All-steel springhead type.

EQUIPMENT FOR UTILITY COMPANY'S ELECTRICITY METERING

Comply with requirements of electrical power utility company for current transformer cabinets, meter sockets, and modular meter centers.

PART 3 - EXECUTION

ELECTRICAL EQUIPMENT INSTALLATION

Headroom Maintenance: If mounting heights or other location criteria are not indicated, arrange and install components and equipment to provide maximum possible headroom.

Materials and Components: Install level, plumb, and parallel and perpendicular to other building systems and components, unless otherwise indicated.

Equipment: Install to facilitate service, maintenance, and repair or replacement of components. Connect for ease of disconnecting, with minimum interference with other installations.

Right of Way: Give to raceways and piping systems installed at a required slope.

RACEWAY APPLICATION

Outdoor Installations:

1. Exposed: RMC.
2. Concealed: RNC.
3. Underground, Single Run: RNC.

4. Underground, Grouped: RNC.
5. Connection to Vibrating Equipment: LFMC.
6. Boxes and Enclosures: NEMA 250, Type 3R or Type 4, unless otherwise indicated.

Indoor Installations:

1. Exposed: EMT except in wet or damp locations, use IMC.
2. Concealed in Walls or Ceilings: EMT.
3. In Concrete Slab: RNC.
4. Below Slab on Grade or in Crawlspace: RNC.
5. Connection to Vibrating Equipment: FMC; except in wet or damp locations: LFMC.
6. Boxes and Enclosures: NEMA 250, Type 1, unless otherwise indicated.

RACEWAY AND CABLE INSTALLATION

Conceal raceways and cables, unless otherwise indicated, within finished walls, ceilings, and floors.

Exposed conduits shall be installed with runs arranged perpendicular to walls and ceilings.

Keep legs of raceway bends in the same plane and keep straight legs of offsets parallel.

Install pull wires in empty raceways. Leave at least 12 inches of slack at each end of pull wires.

Connect motors and equipment subject to vibration, noise transmission, or movement with a maximum of 72-inches flexible metallic conduit. Install LFMC in wet or damp locations. Install separate ground conductor across flexible connections.

Set floor boxes level and trim after installation to fit flush to finished floor surface.

Unless a larger size is indicated, raceways, troughs, and junction boxes shall be sized in accordance with the fill requirements of the NEC.

Provide color-coding of wires and mark panels in accordance with NEC article 210.5 (C) and NEC article 215.12 (C) when more than one voltage is present for branch circuits.

WIRING METHODS FOR POWER, LIGHTING, AND CONTROL CIRCUITS

Application: Use wiring methods specified below to the extent permitted by applicable codes as interpreted by authorities having jurisdiction.

Exposed Feeders: Insulated single conductors in raceway

Concealed Feeders in Ceilings, Walls, and Gypsum Board Partitions: Insulated single conductors in raceway.

Concealed Feeders in Concrete: Insulated single conductors in raceway.

Exposed Branch Circuits: Insulated single conductors in raceway.

Concealed Branch Circuits in Ceilings, Walls, and Gypsum Board Partitions: Insulated single conductors in raceway.

Concealed Branch Circuits: Insulated single conductors in raceway.

Underground Feeders and Branch Circuits: Insulated single conductors in raceway.

Remote-Control Signaling and Power-Limited Circuits, Classes 1, 2, and 3: Insulated conductors in raceway unless otherwise indicated.

Not Allowed: NM for branch circuits.

Type MC cable shall not be acceptable.

WIRING INSTALLATION

Make splices and taps that are compatible with conductor material and that possess equivalent or better mechanical strength and insulation ratings than unspliced conductors.

No wires shall be pulled in until the conduit system is complete. Ideal “Yellow 77” or other approved pulling lubricant shall be used.

Each circuit/homerun shown shall have a separate neutral for each phase conductor. 3 or 4 wire homeruns for multiple circuits are not acceptable. This does not apply to multi-phase circuits. Do not route more than 1 multi-phase circuit in a raceway.

ELECTRICAL SUPPORTING DEVICE APPLICATION

Damp Locations and Outdoors: Hot-dip galvanized materials or nonmetallic, slotted channel system components.

Dry Locations: Steel materials.

Strength of Supports: Adequate to carry present and future loads, times a safety factor of at least four with, 200-lb minimum design load for each support element.

SUPPORT INSTALLATION

Support parallel runs of horizontal raceways together on trapeze- or bracket-type hangers.

Size supports for multiple raceways or cable runs so capacity can be increased by a 25 percent minimum in the future.

Support individual horizontal single raceways with separate, malleable-iron pipe hangers or clamps except use spring-steel fasteners for 1-1/2-inch and smaller single raceways above suspended ceilings and for fastening raceways to slotted channel and angle supports.

Install sleeves for cable and raceway penetrations of concrete slabs and walls unless core-drilled holes are used. Install sleeves for cable and raceway penetrations of masonry and fire-rated gypsum walls and of all other fire-rated floor and wall assemblies. Install sleeves during erection of concrete and masonry walls.

Secure electrical items and their supports to building structure, using the following methods unless other fastening methods are indicated:

1. Wood: Wood screws or screw-type nails.
2. Gypsum Board: Toggle bolts. Seal around sleeves with joint compound, both sides of wall.
3. Masonry: Toggle bolts on hollow block and expansion bolts on solid block. Seal around sleeves with mortar, both sides of wall.
4. New Concrete: Concrete inserts with machine screws and bolts.
5. Existing Concrete: Expansion bolts.
6. Structural Steel: Spring-tension clamps.
7. Light Steel Framing: Sheet metal screws.
8. Fasteners for Damp, Wet, or Weather-Exposed Locations: Stainless steel.
9. Light Steel: Sheet-metal screws.
10. Fasteners: Select so load applied to each fastener does not exceed 25 percent of its proof-test load.

IDENTIFICATION MATERIALS AND DEVICES

Install at locations for most convenient viewing without interference with operation and maintenance of equipment.

Coordinate names, abbreviations, colors, and other designations used for electrical identification with corresponding designations indicated in the Contract Documents or required by codes and standards. Use consistent designations throughout Project.

Install continuous underground plastic markers during trench backfilling, for exterior underground power, control, signal, and communication lines.

FIRESTOPPING

Penetrations through rated construction shall be sealed with a material capable of preventing the passage of flames and hot gases when tested in accordance with ASTM-EB14.

- a) Notify the Architect for inspection of all completed fire and/or smoke barrier walls before any construction is installed that would conceal construction and prevent a proper inspection. Access to random selected areas may be required by the Architect at the time of final inspection if this notification is not given.
- b) Provide detailed instructive cut sheets of the fire penetration sealing system used to the Architect at the time of inspection. Random selective sampling by the Contractor will be observed by the Architect and the Fire Marshall's inspector.

MOUNTING HEIGHTS

Unless otherwise noted on the drawings or required by the Architect, the following mounting heights shall apply. Unless noted otherwise, mounting heights are to the centerline of the device:

1. Receptacles 18" above floor
2. Toggle Switches 48" above floor
3. Panelboards 72" to top
4. Telephone Outlets 18" above floor
5. Data Outlets 18" above floor
6. Meter Can 60"-72" to centerline

Mounting heights may be adjusted in masonry applications to simplify installation where approved by the Architect.

Coordinate counter top outlets with the height of the back splash.

END OF SECTION 16100

SECTION 16400 - PANELBOARDS

PART 1 - GENERAL

SUMMARY

This Section includes distribution and branch-circuit panelboards.

SUBMITTALS

Product Data: For each type of panelboard, overcurrent protective device, accessory, and component indicated. Include dimensions and manufacturers' technical data on features, performance, electrical characteristics, ratings, and finishes.

Shop Drawings: For each panelboard, including the following:

1. Dimensioned plans, elevations, sections, and details. Show tabulations of installed devices, equipment features, and ratings. Include the following data:
 - a. Enclosure types and details for types other than NEMA 250, Type 1.
 - b. Bus configuration, and current, and voltage ratings.
 - c. Short-circuit current rating of panelboards and overcurrent protective devices.
 - d. Features, characteristics, ratings, and factory settings of individual overcurrent protective devices.
2. Wiring Diagrams: Power, signal, and control wiring.

Panelboard Schedules: For installation in panelboards. Submit final versions after load balancing.

Operation and maintenance data.

QUALITY ASSURANCE

Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.

Comply with NEMA PB 1.

Comply with NFPA 70.

PART 2 - PRODUCTS

MANUFACTURERS

Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

1. Siemens Energy & Automation, Inc.
2. Square D Co.
3. General Electric

FABRICATION AND FEATURES

Enclosures: Flush- and surface-mounted cabinets. NEMA PB 1, Type 1, suitable for environmental conditions at installed location.

1. Outdoor Locations: NEMA 250, Type 3R.
2. Other Wet or Damp Indoor Locations: NEMA 250, Type 4.
3. Hazardous Areas Indicated on Drawings: NEMA 250, Type 7C.

Front: Secured to box with concealed trim clamps. For surface-mounted fronts, match box dimensions; for flush-mounted fronts, overlap box.

Finish: Manufacturer's standard enamel finish over corrosion-resistant treatment or primer coat.

Directory Card: A clear plastic directory holder shall be mounted inside panelboard door.

Provide arc flash hazard warning labels on all sections.

Bus: Hard-drawn copper, 98 percent conductivity.

Equipment Ground Bus: Adequate for feeder and branch-circuit equipment ground conductors; bonded to box.

Panelboard Short-Circuit Rating: Fully rated to interrupt symmetrical short-circuit current available at terminals.

Panelboards with Main Service Disconnect: Listed for use as service equipment.

Spaces for Future Devices: Mounting brackets, bus connections, and necessary appurtenances required for future installation of devices.

Feed-through Lugs: Locate at opposite end of bus from incoming lugs or main device.

LIGHTING AND APPLIANCE BRANCH-CIRCUIT PANELBOARDS

Branch Overcurrent Protective Devices: Bolt-on circuit breakers, replaceable without disturbing adjacent units.

Doors: Front mounted with concealed hinges; secured with flush latch with tumbler lock; keyed alike.

DISTRIBUTION PANELBOARDS

Doors: Front mounted, and secured with vault-type latch with tumbler lock; keyed alike.

Branch overcurrent protective devices shall be one of the following:

1. Bolt-on circuit breakers.
2. Fused switches.

INTEGRATED TRANSIENT VOLTAGE SURGE SUPPRESSION DEVICES

Surge Protective Device (SPD)

1. SPD shall be Listed and Component Recognized in accordance with UL 1449 Second Edition to include Section 37.3 highest fault current category. SPD shall be UL 1283 listed.
2. SPD shall be installed by and shipped from the electrical distribution equipment manufacturer's factory.
3. The TVSS devices in lighting and appliance panelboards shall be bus mounted between the main and branch devices. TVSS devices bussed off the end of the panelboard are not allowed. Panelboards with TVSS will accommodate thru-feed lugs and sub-feed circuit breakers in single section and multi-section panelboards.
4. The TVSS devices in power distribution panelboards shall be cable connected.
5. SPD shall provide surge current diversion paths for all modes of protection; L-N, L-G, N-G in WYE systems.
6. SPD shall be modular in design. Each mode including N-G shall be fused with a 200kAIR UL recognized surge rated fuse and incorporate a thermal cutout device. TVSS shall safely reach an end-of-life condition when subjected to fault current levels between 0 and 200 kA, including low level fault currents from 5 to 5000 amperes.
7. Audible diagnostic monitoring shall be by way of audible alarm. This alarm shall activate upon a fault condition. An alarm on/off switch shall be provided to silence the alarm. An alarm push to test switch shall be provided.
8. SPD shall meet or exceed the following criteria:
 - a. Minimum surge current capability (single pulse rated) per phase shall be:
 - 1) Service Entrance Panelboard locations: 240kA per phase
 - 2) Distribution and lighting and Appliance Panelboard locations: 160kA per phase
 - b. UL 1449 Suppression Voltage Ratings:

<u>VOLTAGE</u>	<u>LOCATION</u>	<u>L-N</u>	<u>L-G</u>	<u>N-G</u>
208Y/120V	Distribution:	400V	400V	400V
480Y/277V	Distribution:	800V	800V	800V

9. SPD shall have a minimum EMI/RFI filtering of up to -30 dB over the range of 100 kHz to 100 MHz.
10. SPD shall be provided with one set of NO/NC dry contacts.
11. The manufacturer of the electrical equipment in which the TVSS is installed shall warrant the integrated TVSS device to be free from defects in material and workmanship for a period of ten (10) years from the date of invoice the manufacturer or its authorized sales channel.

OVERCURRENT PROTECTIVE DEVICES

Molded-Case Circuit Breaker: NEMA AB 1, with interrupting capacity to meet available fault currents.

1. Thermal-Magnetic Circuit Breakers: Inverse time-current element for low-level overloads, and instantaneous magnetic trip element for short circuits. Adjustable magnetic trip setting for circuit-breaker frame sizes 250 A and larger.
2. GFCI Circuit Breakers: Single- and two-pole configurations with 5mA trip sensitivity.
3. Application Listing: Appropriate for application; Type SWD for switching fluorescent lighting loads; Type HACR for heating, air-conditioning, and refrigerating equipment.
4. Shunt Trip: 120-V trip coil energized from separate circuit, set to trip at 55 percent of rated voltage. Verify exact voltage of shunt trip with fire alarm vendor.

Fused Switch: NEMA KS 1, Type HD; clips to accommodate indicated fuses; lockable handle.

PART 2 - EXECUTION

INSTALLATION

Install panelboards and accessories according to NEMA PB 1.1.

Mounting Heights: Top of trim 86 inches above finished floor, unless otherwise indicated. Highest switch or breaker at 72" max above finished floor.

Mounting: Plumb and rigid without distortion of box. Mount recessed panelboards with fronts uniformly flush with wall finish.

Install filler plates in unused protective device spaces.

Wiring in Panelboard Gutters: Arrange conductors into groups and bundle and wrap with wire ties after completing load balancing.

Locate panelboards so that ratings are not reduced by heat from external sources.

IDENTIFICATION

Identify field-installed conductors, interconnecting wiring, and components; provide warning signs as specified in Division 16 Section "Basic Electrical Materials and Methods."

Panelboard Nameplates: Label each panelboard with engraved metal or laminated-plastic nameplate mounted with corrosion-resistant screws.

Circuit Directory: Create a directory to indicate installed circuit loads after balancing panelboard loads. Obtain approval before installing. Use a computer or typewriter to create directory; handwritten directories are not acceptable.

FIELD QUALITY CONTROL

Testing and Inspection: After installing panelboards and after electrical circuitry has been energized, demonstrate product capability and compliance with requirements.

Balancing Loads: After Substantial Completion, but not more than 60 days after Final Acceptance, measure load balancing and make circuit changes as follows:

1. Measure as directed during period of normal system loading.
2. Perform load-balancing circuit changes outside normal occupancy/working schedule of the facility and at time directed. Avoid disrupting critical 24-hour services such as fax machines and on-line data-processing, computing, transmitting, and receiving equipment.
3. After circuit changes, recheck loads during normal load period. Record all load readings before and after changes and submit test records.
4. Tolerance: Difference exceeding 20 percent between phase loads, within a panelboard, is not acceptable. Rebalance and recheck as necessary to meet this minimum requirement.

TESTING AND ADJUSTMENTS

Provide a complete fault current coordination study and an arc flash hazard study and tag all gear accordingly. Provide labeling on all switchgear and switch boards. Adjust all trip and parameter settings in accordance with the calculations.

END OF SECTION 16400

SECTION 16800 – 150KW NATURAL GAS GENERATOR

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes packaged engine-generator sets suitable for use in applications with the features as specified and indicated where the engine generators will be used as the Standby power source for the system.

1.3 DEFINITIONS

- A. Emergency Standby Power (ESP): Per ISO 8528: The maximum power available during a variable electrical power sequence, under the stated operating conditions, for which a generating set is capable of delivering in the event of a utility power outage or under test conditions for up to 200 hours of operation per year with the maintenance intervals and procedures being carried out as prescribed by the manufacturers. The permissible average power output (Ppp) over 24 hours of operation shall not exceed 70 percent of the ESP unless otherwise agreed by the RIC engine manufacturer.
- B. Operational Bandwidth: The total variation from the lowest to highest value of a parameter over the range of conditions indicated, expressed as a percentage of the nominal value of the parameter.

1.4 ACTION SUBMITTALS

- A. Product Data: For each type of packaged engine generator indicated. Include rated capacities, operating characteristics, and furnished specialties and accessories. In addition, include the following:
 - 1. Thermal damage curve for generator.
 - 2. Time-current characteristic curves for generator protective device.
 - 3. Sound test data, based on a free field requirement.
- B. Shop Drawings: Detail equipment assemblies and indicate dimensions, weights, and location and size of each field connection.
 - 1. Dimensioned outline plan and elevation drawings of engine-generator set and other components specified.
 - 2. Wiring Diagrams: Control interconnection, Customer connections.
- C. Certifications:

1. Submit statement of compliance which states the proposed product(s) is certified to the emissions standards required by the location for EPA, stationary emergency application.

1.5 INFORMATIONAL SUBMITTALS

A. Source quality-control test reports.

1. Certified summary of prototype-unit test report. See requirements in Part 2 "Source Quality Control" Article Part A. Include statement indicating torsional compatibility of components.
2. Certified Test Report: Provide certified test report documenting factory test per the requirements of this specification, as well as certified factory test of generator set sensors per NFPA110 level 1.
3. List of factory tests to be performed on units to be shipped for this Project.
4. Report of exhaust emissions and compliance statement certifying compliance with applicable regulations.

B. Warranty:

1. Submit manufacturer's warranty statement to be provided for this Project.

1.6 QUALITY ASSURANCE

- A. Installer Qualifications: Manufacturer's authorized representative who is trained and approved for installation of units required for this Project.
- B. Manufacturer Qualifications: A qualified manufacturer. Maintain, within 25 miles of Project site, a service center capable of providing training, parts, and emergency maintenance repairs.
- C. Source Limitations: Obtain packaged generator sets and auxiliary components through one source from a single manufacturer.
- D. Comply with NFPA 37 (Standard For the Installation and Use of Stationary Combustion Engines and Gas Turbines).
- E. Comply with NFPA 70 (National Electrical Code. Equipment shall be suitable for use in systems in compliance to Article 700, 701, and 702).
- F. Comply with NFPA 110 (Emergency and Standby Power Systems) requirements for Level 1 emergency power supply system.
- G. Comply with UL 2200.

1.7 PROJECT CONDITIONS

- A. Environmental Conditions: Engine-generator system shall withstand the following environmental conditions without mechanical or electrical damage or degradation of performance capability:

1. Ambient Temperature: 0.0 deg C (32.0 deg F) to 38.0 deg C (100.0 deg F).
2. Relative Humidity: 0 to 95 percent.
3. Altitude: Sea level to 100.0 feet (30.0 m).

1.8 WARRANTY

- A. Base Warranty: Manufacturer shall provide base warranty coverage on the material and workmanship of the generator set for a minimum of twenty-four (24) months for Standby product from registered commissioning and start-up.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Manufacturers: The basis for this specification is Cummins Power Generation equipment, approved equals may be considered if equipment performance is shown to meet the requirements herein.

2.2 ENGINE-GENERATOR SET

- A. Factory-assembled and -tested, engine-generator set.
- B. Mounting Frame: Maintain alignment of mounted components without depending on concrete foundation; and have lifting attachments.
 1. Rigging Information: Indicate location of each lifting attachment, generator-set center of gravity, and total package weight in submittal drawings.
- C. Capacities and Characteristics:
 1. Power Output Ratings: Electrical output power rating for Standby operation of not less than 150.0kW, at 80 percent lagging power factor, 120/208, Parallel Wye, Three phase, 4 -wire, 60 hertz.
 2. Alternator shall be capable of accepting maximum 563.0 kVA in a single step and be capable of recovering to a minimum of 90% of rated no load voltage. Following the application of the specified kVA load at near zero power factor applied to the generator set.
 3. Nameplates: For each major system component to identify manufacturer's name and address, and model and serial number of component. The engine-generator nameplate shall include information of the power output rating of the equipment.
- D. Generator-Set Performance:
 1. Steady-State Voltage Operational Bandwidth: 1.0 percent of rated output voltage from no load to full load.
 2. Transient Voltage Performance: Not more than 13 percent variation for 50 percent step-load increase or decrease. Voltage shall recover and remain within the steady-

state operating band within 2 seconds. On application of a 100% load step the generator set shall recover to stable voltage within 10 seconds.

3. Steady-State Frequency Operational Bandwidth: 0.5 percent of rated frequency from no load to full load.
4. Steady-State Frequency Stability: When system is operating at any constant load within the rated load, there shall be no random speed variations outside the steady-state operational band and no hunting or surging of speed.
5. Transient Frequency Performance: Not more than 7 percent variation for 50 percent step-load increase or decrease. Frequency shall recover and remain within the steady-state operating band within 3 seconds. On application of a 100% load step the generator set shall recover to stable frequency within 10 seconds.
6. Output Waveform: At full load, harmonic content measured line to line or line to neutral shall not exceed 5 percent total and 3 percent for any single harmonic. Telephone influence factor, determined according to NEMA MG 1, shall not exceed 50.
7. Sustained Short-Circuit Current: (For engine-generator sets using a PMG-excited alternator) For a 3-phase, bolted short circuit at system output terminals, system shall supply a minimum of 300 percent of rated full-load current for not less than 8 seconds without damage to generator system components. For a 1-phase, bolted short circuit at system output terminals, system shall regulate both voltage and current to prevent over-voltage conditions on the non-faulted phases.
8. Start Time: Comply with NFPA 110, Level 1, Type 10, system requirements.
9. Ambient Condition Performance: Engine generator shall be designed to allow operation at full rated load in an ambient temperature under site conditions, based on highest ambient condition. Ambient temperature shall be as measured at the air inlet to the engine generator for enclosed units, and at the control of the engine generator for machines installed in equipment rooms.

2.3 ENGINE

- A. Fuel: Natural Gas
- B. Rated Engine Speed: 1800RPM.
- C. Lubrication System: The following items are mounted on engine or skid:
 1. Lube oil pump: shall be positive displacement, mechanical, full pressure pump.
 2. Filter and Strainer: Provided by the engine manufacturer of record to provide adequate filtration for the prime mover to be used.
 3. Crankcase Drain: Arranged for complete gravity drainage to an easily removable container with no disassembly and without use of pumps, siphons, special tools, or appliances.

- D. Engine Fuel System: The engine fuel system shall be installed in strict compliance to the engine manufacturer's instructions
- E. Coolant Jacket Heater: Electric-immersion type, factory installed in coolant jacket system. Comply with NFPA 110 requirements for Level 1 equipment for heater capacity and performance.
1. Designed for operation on a single 120 VAC, Single phase, 60Hz power connection. Heater voltage shall be shown on the project drawings.
 2. Installed with isolation valves to isolate the heater for replacement of the element without draining the engine cooling system or significant coolant loss.
 3. Provided with a 12VDC thermostat, installed at the engine thermostat housing
- F. Governor: Adjustable isochronous, with speed sensing. The governing system dynamic capabilities shall be controlled as a function of engine coolant temperature to provide fast, stable operation at varying engine operating temperature conditions. The control system shall actively control the fuel rate as appropriate to the state of the engine generator. Fuel rate shall be regulated as a function of starting, accelerating to start disconnect speed, accelerating to rated speed, and operating in various isochronous states.
- G. Cooling System: Closed loop, liquid cooled
1. The generator set manufacturer shall provide prototype test data for the specific hardware proposed demonstrating that the machine will operate at rated standby load in an outdoor ambient condition of 50 deg C.
 2. Coolant: Solution of 50 percent ethylene-glycol-based antifreeze and 50 percent water, with anticorrosion additives as recommended by engine manufacturer.
 3. Size of Radiator overflow tank: Adequate to contain expansion of total system coolant from cold start to 110 percent load condition.
 4. Expansion Tank: Constructed of welded steel plate and rated to withstand maximum closed-loop coolant system pressure for engine used. Equip with gage glass and petcock.
 5. Temperature Control: Self-contained, thermostatic-control valve modulates coolant flow automatically to maintain optimum constant coolant temperature as recommended by engine manufacturer.
 6. Duct Flange: Generator sets installed indoors shall be provided with a flexible radiator duct adapter flange.
- H. Muffler/Silencer: Selected with performance as required to meet sound requirements of the application, sized as recommended by engine manufacturer and selected with exhaust piping system to not exceed engine manufacturer's engine backpressure requirements. For generator sets with outdoor enclosures the silencer shall be inside the enclosure.
- I. Air-Intake Filter: Engine-mounted air cleaner with replaceable dry-filter element and restriction indicator.

- J. Starting System: 12 or 24V, as recommended by the engine manufacturer; electric, with negative ground.
1. Components: Sized so they will not be damaged during a full engine-cranking cycle with ambient temperature at maximum specified in Part 1 "Project Conditions" Article.
 2. Cranking Cycle: As required by NFPA 110 for level 1 systems.
 3. Battery Cable: Size as recommended by engine manufacturer for cable length as required. Include required interconnecting conductors and connection accessories.
 4. Battery Compartment: Factory fabricated of metal with acid-resistant finish.
 5. Battery-Charging Alternator: Factory mounted on engine with solid-state voltage regulation. The battery charging alternator shall have sufficient capacity to recharge the batteries with all parasitic loads connected within 4 hours after a normal engine starting sequence.
 6. Battery Chargers: Unit shall comply with UL 1236, provide fully regulated, constant voltage, current limited, battery charger for each battery bank. It will include the following features:
 - a. Operation: Equalizing-charging rate based on generator set manufacturer's recommendations shall be initiated automatically after battery has lost charge until an adjustable equalizing voltage is achieved at battery terminals. Unit shall then be automatically switched to a lower float-charging mode and shall continue to operate in that mode until battery is discharged again.
 - b. Automatic Temperature Compensation: Adjust float and equalize voltages for variations in ambient temperature from minus 20 deg C to plus 40 deg C to prevent overcharging at high temperatures and undercharging at low temperatures.
 - c. Automatic Voltage Regulation: Maintain constant output voltage regardless of input voltage variations up to plus or minus 10 percent.
 - d. Safety Functions: Sense abnormally low battery voltage and close contacts providing low battery voltage indication on control and monitoring panel. Sense high battery voltage and loss of ac input or dc output of battery charger. Either condition shall close contacts that provide a battery-charger malfunction indication at system control and monitoring panel.
 - e. Provide LED indication of general charger condition, including charging, faults, and modes. Provide a LCD display to indicate charge rate and battery voltage. Charger shall provide relay contacts for fault conditions as required by NFPA110.
 - f. Enclosure and Mounting: NEMA, Type 1, wall-mounted cabinet.

2.4 CONTROL AND MONITORING

- A. Engine generator control shall be microprocessor based and provide automatic starting, monitoring, protection and control functions for the unit.
- B. Automatic Starting System Sequence of Operation: When mode-selector switch on the control and monitoring panel is in the automatic position, remote-control contacts in one or more separate automatic transfer switches initiate starting and stopping of generator set. When mode-selector switch is switched to the on position, generator set starts. The off position of same switch initiates generator-set shutdown. (Switches with different configurations but equal functions are acceptable.) When generator set is running, specified system or equipment failures or derangements automatically shut down generator set and initiate alarms. Operation of the local (generator set-mounted) and/or remote emergency-stop switch also shuts down generator set.
- C. Manual Starting System Sequence of Operation: Switching on-off switch on the generator control panel to the on position starts generator set. The off position of same switch initiates generator-set shutdown. When generator set is running, specified system or equipment failures or derangements automatically shut down generator set and initiate alarms. Operation of the local (generator set-mounted) and/or remote emergency-stop switch also shuts down generator set.
- D. Configuration: Operating and safety indications, protective devices, system controls, engine gages and associated equipment shall be grouped in a common control and monitoring panel. Mounting method shall isolate the control panel from generator-set vibration. AC output power circuit breakers and other output power equipment shall not be mounted in the control enclosure.
- E. Indicating and Protective Devices and Controls: As required by NFPA 110 for Level 1 system, and the following:
 - 1. AC voltmeter (3-phase, line to line and line to neutral values).
 - 2. AC ammeter (3-phases).
 - 3. AC frequency meter.
 - 4. AC kVA output (total and for each phase). Display shall indicate power flow direction.
 - 5. Ammeter-voltmeter displays shall simultaneously display conditions for all three phases.
 - 6. Emergency Stop Switch: Switch shall be a red “mushroom head” pushbutton device complete with lock-out/tag-out provisions. Depressing switch shall cause the generator set to immediately stop the generator set and prevent it from operating.
 - 7. Fault Reset Switch: Supply a dedicated control switch to reset/clear fault conditions.
 - 8. DC voltmeter (alternator battery charging).
 - 9. Engine-coolant temperature gage.
 - 10. Engine lubricating-oil pressure gage.

11. Running-time meter.
 12. Generator-voltage and frequency digital raise/lower switches. Rheostats for these functions are not acceptable. The control shall adjustment of these parameters in a range of plus or minus 5% of the voltage and frequency operating set point (not nominal voltage and frequency values.)
 13. AC Protective Equipment: The control system shall include over/under voltage, over current, short circuit, loss of voltage reference, and over excitation shut down protection. There shall be an overload warning, and overcurrent warning alarm.
 14. Status LED indicating lamps to indicate remote start signal present at the control, existing alarm condition, not in auto, and generator set running.
 15. A graphical display panel with appropriate navigation devices shall be provided to view all information noted above, as well as all engine status and alarm/shutdown conditions (including those from an integrated engine emission control system). The display shall also include integrated provisions for adjustment of the gain and stability settings for the governing and voltage regulation systems.
 16. Panel lighting system to allow viewing and operation of the control when the generator room or enclosure is not lighted.
 17. DC control Power Monitoring: The control system shall continuously monitor DC power supply to the control, and annunciate low or high voltage conditions. It shall also provide an alarm indicating imminent failure of the battery bank based on degraded voltage recover on loading (engine cranking).
- F. Remote Alarm Annunciator: Comply with NFPA 110. An LED labeled with proper alarm conditions shall identify each alarm event and a common audible signal shall sound for each alarm condition.

2.5 GENERATOR, EXCITER, AND VOLTAGE REGULATOR

- A. Comply with NEMA MG 1.
- B. Drive: Generator shaft shall be directly connected to engine shaft. Exciter shall be rotated integrally with generator rotor.
- C. Electrical Insulation: Class H
- D. Temperature Rise: 105 / Class H environment.
- E. Construction shall prevent mechanical, electrical, and thermal damage due to vibration, over speed up to 125 percent of rating, and heat during operation at 110 percent of rated capacity.
- F. Shunt Excitation
- G. Enclosure: Drip-proof.
- H. Voltage Regulator: SCR type, Separate from exciter, providing performance as specified. The voltage regulation system shall be microprocessor-controlled, full wave rectified, and

provide a pulse-width modulated signal to the exciter. No exceptions or deviations to these requirements will be permitted.

- I. Windings: Two-thirds pitch stator winding and fully linked amortisseur winding.
- J. Subtransient Reactance: 15 percent maximum, based on the rating of the engine generator set.

2.6 OUTDOOR GENERATOR-SET ENCLOSURE

- A. Description: Sound Attenuated Aluminum housing. Multiple panels shall be lockable and provide adequate access to components requiring maintenance. Instruments, control, and battery system shall be mounted within enclosure.
- B. Construction:
 - 1. Hinged Doors: With padlocking provisions. Restraint/Hold back hardware to prevent door to keep door open at 180 degrees during maintenance. Rain lips over all doors.
 - 2. Exhaust System:
 - a. Muffler Location: Within enclosure.
 - 3. Hardware: All hardware and hinges shall be stainless steel.
 - 4. Wind Rating: Wind rating shall be 180 mph
 - 5. Mounting Base: Suitable for mounting on sub-base fuel tank or housekeeping pad.
 - 6. A weather protective enclosure shall be provided which allows the generator set to operate at full rated load with a static pressure drop equal to or less than 0.5 inches of water.
- C. Engine Cooling Airflow through Enclosure: Housing shall provide ample airflow for engine generator operation at rated load in an ambient temperature of 50 deg C.
- D. Sound Performance: Reduce the sound level of the engine generator while operating at full rated load to a maximum of 72 dBA measured at any location 7 m from the engine generator in a free field environment.
- E. Site Provisions:
 - 1. Lifting: Complete assembly of engine generator, enclosure shall be designed to be lifted into place as a single unit, using spreader bars.

2.7 VIBRATION ISOLATION DEVICES

- A. Vibration Isolation: Generators installed on grade shall be provided with elastomeric isolator pads integral to the generator, unless the engine manufacturer requires use of spring isolation.

2.8 FINISHES

- A. Indoor and Outdoor Enclosures and Components: Powder-coated and baked over corrosion-resistant pretreatment and compatible primer. Manufacturer's standard color or as directed on the drawings.

2.9 SOURCE QUALITY CONTROL

- A. Prototype Testing: Factory test engine-generator set using same engine model, constructed of identical or equivalent components and equipped with identical or equivalent accessories.
 - 1. Tests: Comply with NFPA 110, Level 1 Energy Converters. In addition, the equipment engine, skid, cooling system, and alternator shall have been subjected to actual prototype tests to validate the capability of the design under the abnormal conditions noted in NFPA110. Calculations and testing on similar equipment which are allowed under NFPA110 are not sufficient to meet this requirement.
- B. Project-Specific Equipment Tests: Before shipment, factory test engine-generator set manufactured specifically for this Project. Perform tests at rated load and power factor. Include the following tests:
 - 1. Test engine generator set manufactured for this Project to demonstrate compatibility and functionality.
 - 2. Full load run.
 - 3. Maximum power.
 - 4. Voltage regulation.
 - 5. Steady-state governing.
 - 6. Single-step load pickup.
 - 7. Simulated safety shutdowns.
 - 8. Provide 14 days' advance notice of tests and opportunity for observation of tests by Owner's representative.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Comply with packaged engine-generator manufacturers' written installation, application, and alignment instructions and with NFPA 110.
- B. Equipment shall be installed by the contractor in accordance with final submittals and contract documents. Installation shall comply with applicable state and local codes as required by the authority having jurisdiction. Install equipment in accordance with manufacturer's instructions and instructions included in the listing or labeling of UL listed products.
- C. Installation of equipment shall include furnishing and installing all interconnecting wiring between all major equipment provided for the on-site power system. The contractor shall

also perform interconnecting wiring between equipment sections (when required), under the supervision of the equipment supplier.

- D. Equipment shall be installed on concrete housekeeping pads. Equipment shall be permanently fastened to the pad in accordance with manufacturer's instructions and seismic requirements of the site.
- E. Equipment shall be initially started and operated by representatives of the manufacturer. All protective settings shall be adjusted as instructed by the consulting engineer.
- F. All equipment shall be physically inspected for damage. Scratches and other installation damage shall be repaired prior to final system testing. Equipment shall be thoroughly cleaned to remove all dirt and construction debris prior to initial operation and final testing of the system.
- G. On completion of the installation by the electrical contractor, the generator set supplier shall conduct a site evaluation to verify that the equipment is installed per manufacturer's recommended practice.

3.2 ON-SITE ACCEPTANCE TEST

- A. The complete installation shall be tested to verify compliance with the performance requirements of this specification following completion of all site work. Testing shall be conducted by representatives of the manufacturer, with required fuel supplied by Contractor. The Engineer shall be notified in advance and shall have the option to witness the tests. The generator set manufacturer shall provide a site test specification covering the entire system. Tests shall include:
- B. Prior to start of active testing, all field connections for wiring, power conductors, and bus bar connections shall be checked for proper tightening torque.
- C. Installation acceptance tests to be conducted on site shall include a "cold start" test, a two hour full load (resistive) test, and a one-step rated load pickup test in accordance with NFPA 110. Provide a resistive load bank and make temporary connections for full load test, if necessary.
- D. Perform a power failure test on the entire installed system. This test shall be conducted by opening the power supply from the utility service, and observing proper operation of the system for at least 2 hours. Coordinate timing and obtain approval for start of test with site personnel.

3.3 FIELD QUALITY CONTROL

- A. Manufacturer's Field Service: Engage a factory-authorized service representative to inspect components, assemblies, and equipment installations, including connections, and to assist in testing.

3.4 SERVICE AND SUPPORT

- A. The generator set supplier shall maintain service parts inventory for the entire power system at a central location which is accessible to the service location 24 hours per day, 365 days per year. The inventory shall have a commercial value of \$3 million or more.

The manufacturer of the generator set shall maintain a central parts inventory to support the supplier, covering all the major components of the power system, including engines, alternators, control systems, paralleling electronics, and power transfer equipment.

- B. The generator set shall be serviced by a local service organization that is trained and factory certified in generator set service. The supplier shall maintain an inventory of critical power system replacement parts in the local service location. Service vehicles shall be stocked with critical replacement parts. The service organization shall be on call 24 hours per day, 365 days per year. The service organization shall be physically located within 25 miles of the site.
- C. The manufacturer shall maintain model and serial number records of each generator set provided for at least 20 years.

END OF SECTION

SECTION 16850 – AUTOMATIC TRANSFER SWITCHES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes transfer switches rated 600 V and less, including the following:
 - 1. Automatic transfer switches
 - 2. Remote annunciation systems
- B. Related Sections include the following:

1.3 SUBMITTALS

- A. Product Data: For each type of product indicated. Include rated capacities, weights, operating characteristics, furnished specialties, and accessories.
 - 1. Technical data on all major components of all transfer switches and other products described in this section. Data is required for the transfer switch mechanism, control system, cabinet, and protective devices specifically listed for use with each transfer switch. Include steady state and fault current ratings, weights, operating characteristics, and furnished specialties and accessories.
 - 2. Single Line Diagram: Show connections between transfer switch, power sources and load
- B. Shop Drawings: Dimensioned plans, elevations, sections, and details showing minimum clearances, conductor entry provisions, gutter space, installed features and devices, and material lists for each switch specified.
 - 1. Dimensioned outline drawings of assembly, including elevations, sections, and details including minimal clearances, conductor entry provisions, gutter space, installed features and devices and material lists for each switch specified.
 - 2. Internal electrical wiring and control drawings.
 - 3. Interconnection wiring diagrams, showing recommended conduit runs and point-to-point terminal connections to generator set.
 - 4. Installation and mounting instructions, including information for proper installation of equipment to meet seismic requirements.
- C. Manufacturer and Supplier Qualification Data

1. The transfer switch manufacturer shall be certified to ISO 9001 International Quality Standard and shall have third party certification verifying quality assurance in design/development, production, installation, and service, in accordance with ISO 9001. The transfer switches shall be provided by the generator manufacturer.
 2. The manufacturer of this equipment shall have produced similar equipment for a minimum period of 10 years. When requested, an acceptable list of installations with similar equipment shall be provided demonstrating compliance with this requirement.
- D. Operation and Maintenance Data: For each type of product to include in emergency, operation, and maintenance manuals. In addition to items specified in Division 01 Section "Operation and Maintenance Data," include the following:
1. Features and operating sequences, both automatic and manual.
 2. List of all factory settings of relays, timers and protective devices; provide setting and calibration instructions where applicable.
- E. Warranty documents demonstrating compliance with the project's contract requirements.

1.4 QUALITY ASSURANCE

- A. Manufacturer Qualifications: The equipment supplier shall maintain a service center capable of providing training, parts, maintenance and emergency repairs to equipment, including transfer switch generator sets and remote monitoring equipment (if applicable) at the site within a response period of less than (eight hours or appropriate time period designated for Project) from time of notification.
1. The transfer switch shall be serviced by technicians employed by, and specially trained and certified by, the generator set supplier and the supplier shall have a service organization that is factory-certified in both generator set and transfer switch service. The supplier shall maintain an inventory of critical replacement parts at the local service organization, and in service vehicles. The service organization shall be on call 24 hours per day, 365 days per year.
 2. Submit names, experience level, training certifications, and locations for technicians that will be responsible for servicing equipment at this site.
 3. The manufacturer shall maintain model and serial number records of each transfer switch provided for at least 20 years.
- B. Source Limitations: All transfer switches are to be obtained through one source from a single manufacturer. The generator set manufacturer shall warrant transfer switches to provide a single source of responsibility for products provided.
- C. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked as suitable for use in emergency, legally required or optional standby use as appropriate for the connected load.

- D. The automatic transfer switch installation and application shall conform to the requirements of the following codes and standards:
1. Transfer switches and enclosures shall be UL 1008 listed and labeled as suitable for use in emergency, legally required, and optional standby applications.
 2. CSA 282, Emergency Electrical Power Supply for Buildings, and CSA C22.2, No. 14-M91 Industrial Control Equipment
 3. NFPA 70, National Electrical Code. Equipment shall be suitable for use in systems in compliance with Articles 700, 701 and 702.
 4. Comply with NEMA ICS 10-1993 AC Automatic Transfer Switches
 5. IEEE 446 – Recommended Practice for Emergency and Standby Power Systems for Commercial and Industrial Applications
 6. EN55011, Class B Radiated Emissions and Class B Conducted Emissions
 7. IEC 1000-4-5 (EN 61000-4-5); AC Surge Immunity
 8. IEC 1000-4-4 (EN 61000-4-4) Fast Transients Immunity
 9. IEC 1000-4-2 (EN 61000-4-2) Electrostatic Discharge Immunity
 10. IEC 1000-4-3 (EN 61000-4-3) Radiated Field Immunity
 11. IEC 1000-4-6 Conducted Field Immunity
 12. IEC 1000-4-11 Voltage Dip Immunity
 13. IEEE 62.41, AC Voltage Surge Immunity
 14. IEEE 62.45, AC Voltage Surge Testing
- E. Comply with NFPA 99 – Essential Electrical Systems for Healthcare Facilities
- F. Comply with NFPA 110 – Emergency and Standby Power Systems. The transfer switch shall meet all requirements for Level 1 systems, regardless of the actual circuit level.
- G. The manufacturer shall warrant the material and workmanship of the transfer switch equipment for a minimum of two (2) year from the warranty start date. The warranty start date is the date of registered commissioning and start up or eighteen (18) months from date of shipment, whichever is sooner.
- H. The warranty shall be comprehensive. No deductibles shall be allowed for travel time, service hours, repair parts cost, and etc. during the minimum noted warranty period described above.

1.5 PROJECT CONDITIONS

- A. Interruption of Existing Electrical Service: Do not interrupt electrical service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary electrical service:
 - 1. Notify (Architect/Construction Manager/Owner) no fewer than (insert appropriate number) days in advance of proposed interruption of electrical service.
 - 2. Do not proceed with interruption of electrical service without (Architect/Construction Manager/Owner's) written permission.
 - 3. Do not energize any new service or distribution equipment without notification and permission of the (Architect/Construction Manager/Owner).

1.6 COORDINATION

- A. Size and location of concrete bases and anchor bolt inserts shall be coordinated. Concrete, reinforcement and formwork must meet the requirements specified in Division 03. See section "INSTALLATION" for additional information on installation

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Manufacturers: The basis for this specification is Cummins Power Generation equipment.
- B. Switches manufactured by other manufacturers that meet the requirement of this specification are acceptable, prior to the scheduled bid date. Proposals must include a line-by-line compliance statement based on this specification.
- C. Transfer switches utilizing molded case circuit breakers do not meet the requirements of this specification and will not be accepted.

2.2 GENERAL TRANSFER-SWITCH PRODUCT REQUIREMENTS

- A. Provide transfer switches in the number and ratings that are shown on the drawings.
- B. Indicated Current Ratings: Apply as defined in UL 1008 for continuous loading and total system transfer.
- C. Fault-Current Closing and Withstand Ratings: UL 1008 WCR ratings must be specifically listed as meeting the requirements for use with protective devices at installation locations, under specified fault conditions. Withstand and closing ratings shall be based on use of the same set of contacts for the withstand test and the closing test.
- D. Solid-State Controls: All settings should be accurate to +/- 2% or better over an operating temperature range of - 40 to + 60 degrees C (- 40 to + 140 degrees F).
- E. Resistance to Damage by Voltage Transients: Components shall meet or exceed voltage-surge withstand capability requirements when tested according to IEEE C62.41. Components shall meet or exceed voltage-impulse withstand test of NEMA ICS 1.

- F. Electrical Operation: Accomplished by a non-fused, momentarily energized solenoid or electric motor operator mechanism, mechanically and electrically interlocked in both directions (except that mechanical interlock is not required for closed transition switches).
- G. Switch Characteristics: Designed for continuous-duty repetitive transfer of full-rated current between active power sources.
1. Switches using molded-case switches or circuit breakers, or insulated case circuit breaker components are not acceptable.
 2. Transfer switches shall be double-throw, electrically and mechanically interlocked, and mechanically held in the Source 1 and Source 2 positions.
 3. Main switch contacts shall be high pressure silver alloy. Contact assemblies shall have arc chutes for positive arc extinguishing. Arc chutes shall have insulating covers to prevent inter-phase flashover.
 4. Contacts shall be operated by a high-speed electrical mechanism that causes contacts to open or close within three electrical cycles from signal.
 5. Transfer switch shall be provided with flame retardant transparent covers to allow viewing of switch contact operation but prevent direct contact with components that could be operating at line voltage levels.
 6. The transfer switch shall include the mechanical and control provisions necessary to allow the device to be field-configured for operating speed. Transfer switch operation with motor loads shall be as is recommended in NEMA MG1.
 - a. Phase angle monitoring/timing equipment is not an acceptable substitute for this functionality
 7. Transfer switches designated on the drawings as "3-pole" shall have a full current-rated neutral bar with lugs.
 8. Transfer switches designated on the drawings as "service entrance" switches shall meet the requirements of section "SERVICE ENTRANCE TRANSFER SWITCHES" of this specification.
- H. Factory wiring: Transfer switch internal wiring shall be composed of pre-manufactured harnesses that are permanently marked for source and destination. Harnesses shall be connected to the control system by means of locking disconnect plug(s), to allow the control system to be easily disconnected and serviced without disconnecting power from the transfer switch mechanism
- I. Terminals: Terminals shall be pressure type and appropriate for all field wiring. Control wiring shall be equipped with suitable lugs, for connection to terminal strips.
- J. Enclosures: All enclosures shall be third-party certified for compliance to NEMA ICS 6 and UL 508, unless otherwise indicated:

1. The enclosure shall provide wire bend space in compliance to the latest version of NFPA70, regardless of the direction from which the conduit enters the enclosure.
2. Exterior cabinet doors shall provide complete protection for the system's internal components. Doors must have permanently mounted key-type latches. Bolted covers or doors are not acceptable.
3. Transfer switches shall be provided in enclosures that are third party certified for their intended environment per NEMA requirements.

2.3 AUTOMATIC TRANSFER SWITCHES

- A. Comply with requirements for Level 1 equipment according to NFPA 110.
- B. Indicated current ratings:
 1. Refer to the Project drawings for specifications on the sizes and types of transfer switch equipment, withstand and closing ratings, number of poles, voltage and ampere ratings, enclosure type, and accessories.
 2. Main contacts shall be rated for 600 VAC minimum.
 3. Transfer switches shall be rated to carry 100% of rated current continuously in the enclosure supplied, in ambient temperatures of -40 to +60 degrees C (-40 to +140 degrees F), relative humidity up to 95% (non-condensing), and altitudes up to 10,000 feet (3000 meters).
- C. Relay Signal: Control shall include provisions for addition of a pre-transfer relay signal, adjustable from 0 to 60 seconds, to be provided if necessary for elevator operation, based on equipment provided for the project.
- D. Transfer switches that are designated on the drawings as 3-pole shall be provided with a neutral bus and lugs. The neutral bus shall be sized to carry 100% of the current designated on the switch rating.
- E. Automatic Transfer Switch Control Features
 1. The transfer switch control system shall be configurable in the field for any operating voltage level up to 600 VAC. Voltage sensing shall be monitored based on the normal voltage at the site. Systems that utilize voltage monitoring based on standard voltage conditions that are not field configurable are not acceptable.
 2. All transfer switch sensing shall be configurable from an operator panel or from a Windows XP or later PC-based service tool. Designs utilizing DIP switches or other electromechanical devices are not acceptable.
 3. The transfer switch shall be configurable to accept a relay contact signal and a network signal from an external device for load shedding purposes. On receipt of this signal, the transfer switch shall switch to a neutral position when connected to Source 2. If Source 1 is available when the load-shed signal is received, the transfer switch shall connect to Source 1.

4. The transfer switch shall provide a relay contact signal prior to transfer or re-transfer. The time period before and after transfer shall be adjustable in a range of 0 to 60 seconds.
 5. The control system shall be designed and prototype tested for operation in ambient temperatures from - 40 degrees C to + 60 degrees C (- 40 to +140 degrees F). It shall be designed and tested to comply with the requirements of the noted voltage and RFI/EMI standards.
 6. The control shall have optically isolated logic inputs, high isolation transformers for AC inputs and relays on all outputs, to provide optimum protection from line voltage surges, RFI and EMI.
 7. The transfer switch network monitoring equipment, when supplied, shall be provided with a battery-based auxiliary power supply to allow monitoring of the transfer switch when both AC power sources are non-operational.
- F. Transfer Switch Control Panel: The transfer switch shall have a microprocessor-based control with a sealed membrane panel incorporating pushbuttons for operator-controlled functions, and LED lamps for system status indicators. The panel shall also include an alphanumeric display for detailed system information. Panel display and indicating lamps shall include permanent labels.
1. The indicator panel LEDs shall display:
 - a. Which source the load is connected to (Source 1 or Source 2)
 - b. Which source or sources are available
 - c. When switch is not set for automatic operation, the control is disabled
 - d. When the switch is in test/exercise mode
 2. The indicator shall have pushbuttons that allow the operator to activate the following functions:
 - a. Activate pre-programmed test sequence
 - b. Override programmed delays, and immediately go to the next operation
 - c. Reset the control by clearing any faults
 - d. Test all of the LEDs by lighting them simultaneously
 3. The alphanumeric digital display shall be vacuum fluorescent-type, clearly visible in both bright sunlight and no-light conditions over an angle of 120 degrees, and shall display the following:
 - a. AC voltage for all phases, normal and emergency
 - b. Source status: connected or not connected.

- c. Load data, including voltage, AC current, frequency, KW, KVA, and power factor.
- 4. The display panel shall be password-protected, and allow the operator to view and make adjustments:
 - a. Set nominal voltage and frequency for the transfer switch
 - b. Adjust voltage and frequency sensor operation set points
 - c. Set up time clock functions
 - d. Set up load sequence functions
 - e. Enable or disable control functions including program transition
 - f. View real-time clock data, operation log (hours connected, times transferred, failures) and service history

G. Control Functions: Functions managed by the control shall include:

- 1. Software adjustable time delays:
 - a. Engine start (prevents nuisance genset starts in the event of momentary power fluctuation): 0 to 120 seconds (default 3 sec)
 - b. Transfer normal to emergency (allows genset to stabilize before load is transferred): 0 to 120 seconds (default 3 sec)
 - c. Re-transfer emergency to normal (allows utility to stabilize before load is transferred from genset): 0 to 30 minutes (default 3 sec)
 - d. Engine cooldown: 0 to 30 minutes (default 10 min)
 - e. Programmed transition: 0 to 60 seconds (default 3 sec)
- 2. Voltage imbalance sensing:
 - a. Dropout: 2 to 10% (default 4%)
 - b. Pickup: 90% of dropout
 - c. Time delay: 2.0 to 20 seconds (default 5 sec)
- 3. Phase rotation sensing:
 - a. Time delay: 100 msec
- 4. Loss of single-phase detection:
 - a. Time delay: 100 msec

H. Control features shall include:

1. Programmable genset exerciser: A field-programmable control shall periodically start and run the generator with or without transferring the load for a preset time period, then re-transfer and shut down the generator after a preset cool-down period.
2. In event of a loss of power to the control, all control settings, real-time clock setting and the engine start-time delay setting will be retained.
3. The system continuously logs information including the number of hours each source has been connected to the load, the number of times transferred, and the total number of times each source has failed. An event recorder stores information, including time and date-stamp, for up to 50 events.
4. Re-Transfer Inhibit Switch: Inhibits automatic re-transfer control so automatic transfer switch will remain connected to emergency power source as long as it is available regardless of condition of normal source.
5. Transfer Inhibit Switch: Inhibits automatic transfer control so automatic transfer switch will remain connected to normal power source regardless of condition of emergency source.

I. Control Interface

1. Provide one set Form C auxiliary contacts on both sides, operated by transfer switch position, rated 10 amps 250 VAC.

J. Engine Starting Contacts

1. One isolated and normally closed pair of contacts rated 10A at 32 VDC minimum.

2.4 SERVICE ENTRANCE TRANSFER SWITCHES

- A. Transfer switches must be specifically intended for service entrance applications, and labeled "Suitable for service entrance use only"
- B. Transfer switch shall meet NEC requirements for emergency, legally required and standby applications as specified in UL 1008.
- C. Entire transfer switch including enclosure must be listed and labeled to UL 1008; switches with only the mechanism listed are not acceptable.
- D. Molded case circuit breaker must be UL 489 listed.

2.5 REMOTE ANNUNCIATOR SYSTEM

- A. Functional Description: Remote annunciator panel shall annunciate conditions for indicated transfer switches. Annunciation shall include the following:
 1. Sources available, as defined by actual pickup and dropout settings of transfer-switch controls.
 2. Switch position.

3. Switch in test mode.
 4. Failure of communication link.
- B. Annunciator Panel: LED-lamp type with audible signal and silencing switch.
1. Indicating Lights: Grouped for each transfer switch monitored.
 2. Label each group, indicating transfer switch it monitors, location of switch, and identity of load it serves.
 3. Switch in test mode.
 4. Lamp Test: Push-to-test or lamp-test switch on front panel.
- C. Malfunction of annunciator or communication link shall not affect functions of automatic transfer switch. In the event of failure of communication link, automatic transfer switch automatically reverts to stand-alone, self-contained operation.
- D. Automatic transfer-switch sensing, controlling, or operating function shall not depend on remote panel for proper operation. The remote annunciation system shall not prevent transfer to the alternate source when the primary power source fails, nor prevent return to the primary source if the alternate source fails

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Design each fastener and support to carry load indicated by seismic requirements and according to seismic-restraint details. See Division 26 Section "Vibration and Seismic Controls for Electrical Systems."
- B. Floor-Mounting Switch: Anchor to floor by bolting.
1. Floor-mounted transfer switches (except drawout switches supported by wheeled carriages, which must be rolled out at floor level) shall be mounted on concrete bases complying with the following requirements:
 - a. Concrete Bases: 4 inches (100 mm) high, reinforced, with chamfered edges. Extend base no more than 4 inches (100 mm) in all directions beyond the maximum dimensions of switch, unless otherwise indicated or unless required for seismic support. Construct concrete bases according to Division 26 Section "Hangers and Supports for Electrical Systems."
- C. Annunciator Panel Mounting: Flush in wall, unless otherwise indicated.
- D. Identify components according to Division 26 Section "Identification for Electrical Systems."
- E. Set field-adjustable intervals and delays, relays, and engine exerciser clock.

3.2 CONNECTIONS

- A. Wiring to Remote Components: Match type and number of cables and conductors to control and communication requirements of transfer switches as recommended by manufacturer. Increase raceway sizes at no additional cost to Owner if necessary to accommodate required wiring.
- B. Field control connections shall be made on a common terminal block that is clearly and permanently labeled.
- C. Transfer switch shall be provided with AL/CU mechanical lugs sized to accept the full output rating of the switch. Lugs shall be suitable for the number and size of conductors shown on the drawings.
- D. Ground equipment according to Division 26 Section "Grounding and Bonding for Electrical Systems."
- E. Connect wiring according to Division 26 Section "Low-Voltage Electrical Power Conductors and Cables."

3.3 SOURCE QUALITY CONTROL

- A. Prior to shipping, factory shall test and inspect components, assembled switches, and associated equipment to ensure proper operation.
- B. Factory shall check transfer time and voltage, frequency, and time-delay settings for compliance with specified requirements.
- C. Factory shall perform dielectric strength test complying with NEMA ICS 1.

3.4 FIELD QUALITY CONTROL

- A. Manufacturer's Field Service: The supplier of the transfer switch(es) and associated equipment shall inspect, test, and adjust components, assemblies, and equipment installations, including connections, and report results in writing.
- B. Manufacturer's representative shall perform tests and inspections and prepare test reports.
- C. After installing equipment and after electrical circuitry has been energized, installer shall test for compliance with requirements.
 - 1. Perform recommended installation tests as recommended in manufacturer's installation and service manuals.
 - 2. After energizing circuits, demonstrate interlocking sequence and operational function for each switch.
 - a. Simulate power failures of normal source to automatic transfer switches and of emergency source with normal source available.
 - b. Verify time-delay settings.
 - c. Verify that the transfer switch is accurately metering AC voltage and current.

- d. Verify proper sequence and correct timing of automatic engine starting, transfer time delay, retransfer time delay on restoration of normal power, and engine cool-down and shutdown.
- D. Infrared Scanning: After Substantial Completion, but not more than 60 days after Final Acceptance, perform an infrared scan of each switch. Remove all access panels so joints and connections are accessible to portable scanner.
1. Follow-up Infrared Scanning: Perform an additional follow-up infrared scan of each switch 11 months after date of Substantial Completion.
 2. Instrument: Use an infrared scanning device designed to measure temperature or to detect significant deviations from normal values. Provide calibration record for device.
 3. Record of Infrared Scanning: Prepare a certified report that identifies switches checked and that describes scanning results. Include notation of deficiencies detected, remedial action taken, and observations after remedial action.

3.5 DEMONSTRATION

- A. After generator set installation, the generator and transfer switch supplier shall conduct a complete operation, basic maintenance, and emergency service seminar covering generator set and transfer switch equipment, for up to 10 people employed by the Owner.
1. The seminar shall include instruction on operation of the transfer equipment, normal testing and exercise, adjustments to the control system, use of the PC based service and maintenance tools provided under this contract, and emergency operation procedures.
 2. The class duration shall be at least 8 hours in length, and include practical operation with the installed equipment.

3.6 SERVICE AND SUPPORT

- A. The manufacturer shall supply the Service Provider with a complete set of the service and maintenance software required to support the product. The software shall be provided at a training class attended by the user, to qualify the user in proper use of the software. The software shall have the following features and capabilities:
1. The software shall allow adjustment of all functions described herein, adjustment of operating levels of all protective functions, and programming of all optional functions in the controller. Adjustments shall be possible over modem from a facility that is remote from the generator set.
 2. The software shall be capable of storing and displaying data for any function monitored by the generator set control. This data shall be available in common file formats, and on graphical "strip chart" displays.
 3. The software shall automatically record all control operations and adjustments performed by any operator or software user, for tracking of changes to the control.

4. The software shall display all warning, shutdown, and status changes programmed into transfer switch controller. For each event, the control shall provide information on the nature of the event, when it last occurred, and how many times it has occurred.



CENTRALBIDDING
FROM CENTRAL AUCTION HOUSE

**5000147321-Labor, Equipment and Materials needed to Supply and Install
a Generator for the Jefferson Parish Department of Recreation. Project #
23015**

Jefferson Parish Government

Project documents obtained from www.CentralBidding.com

13-Mar-2025 10:53:22 AM

JEFFERSON PARISH, LOUISIANA

EAST BANK RECREATION OFFICE GENERATOR

6921 SAINTS DRIVE
METAIRIE, LA 70003

PROJECT # 23015


PARISH PRESIDENT

CYNTHIA LEE—SHENG

COUNCIL MEMBERS

- COUNCIL MEMBER — AT LARGE DIV A JENNIFER VAN VRANCKEN
- COUNCIL MEMBER — AT LARGE DIV B SCOTT WALKER
- COUNCIL MEMBER — DISTRICT 1 MARION F. EDWARDS
- COUNCIL MEMBER — DISTRICT 2 DEANO BONANO
- COUNCIL MEMBER — DISTRICT 3 BYRON LEE
- COUNCIL MEMBER — DISTRICT 4 ARITA M.L. BOHANNAN
- COUNCIL MEMBER — DISTRICT 5 HANS J. LILJEBERG

INDEX TO DRAWINGS		
SHT.	DESCRIPTION	DWG.
1	COVER SHEET: INDEX TO DRAWINGS	1
2	ELECTRICAL PLAN	2
3	GAS PLAN	3

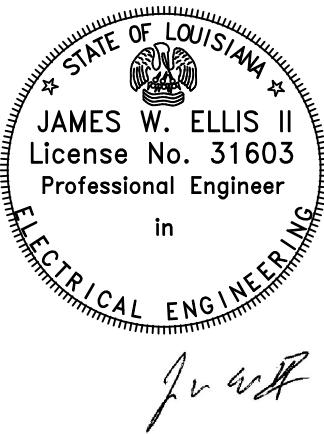

ELLIS ENGINEERING, LLC

525 BREWSTER RD., MADISONVILLE, LA 70447

DESIGNED BY:
JWE

DATE:
12/23/24

JEFFERSON PARISH RECREATION DEPARTMENT
EAST BANK RECREATION OFFICE GENERATOR

SHEET NO.
1

DRAWN BY:
JWE

JEFFESON PARISH, LA

OF

CHECKED BY:
JWE

JOB NO.
23015


TITLE SHEET

GENERAL NOTES THIS SHEET


- A. SEAL ALL PENETRATIONS AND MAKE WEATHER PROOF FOR ALL CONDUIT REMOVED.
- B. PROVIDE GALVANIZED C CHANNEL FRAMING AS NECESSARY TO SUPPORT GEAR.
- C. COORDINATE ANY OUTAGES WITH ENTERGY AND OWNER.
- D. INSTALL GENERATOR AND ATS IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
- E. PROVIDE SIGNAGE AS REQUIRED BY NFPA 70, ART 702.7.
- F. ENTERGY EQUIPMENT SHALL BE INSTALLED TO ENTERGY STANDARDS.
- G. PROVIDE REMOTE ANNUNCIATOR IN LOBBY OF OFFICE BUILDING AT THE DIRECTION OF ENGINEER. PATCH AND PAINT ANY DAMAGES TO THE SATISFACTION OF THE ENGINEER.

SPECIFIC NOTES THIS SHEET


- 1 EXISTING METER AND C.T. CABINET TO BE REMOVED. REFEED AS SHOWN.
- 2 EXISTING TO REMAIN.
- 3 4 - 350 KCMIL AND 1#3 GRD IN 3" C. CONTINUE TO EXISTING TROUGH AND MAKE CONNECTIONS TO EXISTING CABLING. REPLACE TROUGH IF NECESSARY.
- 4 ENTERGY METER. COORDINATE TYPE, C.T. OR METER SOCKET, WITH ENTERGY PRIOR TO ROUGHIN.
- 5 600A, 22K AIC, SERVICE ENTRANCE RATED, NEMA 3R, 120/208V, 3 PHASE, 4W, AUTOMATIC TRANSFER SWITCH BY GENERATOR MANUFACTURER.
- 6 600A, 22K AIC, NEMA 3R, 120/208V, 3 PHASE, 4W, DISTRIBUTION PANEL, PROVIDE 1 - 300A, 3P, ADJUSTABLE, ELECTRONIC TRIP, BREAKER FOR WAREHOUSE AND 1 - 400A, 3P, ADJUSTABLE, ELECTRONIC TRIP, BREAKER FOR OFFICE BUILDING AND 2 - 200A SPACES.
- 7 #2/0 AWG GRD TO 2-3/4"x10' COPPER BONDED, DRIVEN, GROUND ROD. BOND TO NEUTRAL BUS IN ATS. CONNECT TO GROUND BUS WITH #2/0 GRD OR MANUFACTURER'S EQUIVALENT. GROUND IN ACCORDANCE WITH NFPA 70.
- 8 4 - 600 KCMIL AND 1#3 GRD IN 4" C. MAKE CONNECTIONS TO OFFICE BUILDING SERVICE. EXISTING JUNCTION BOX CAN BE USED IF THE CORRECT SIZE AND IN GOOD CONDITION.
- 9 2 - 4" C ROUTED MIN 25' UP ENTERGY POLE.
- 10 150 KW GENERATOR WITH 600A, 3P, OUTPUT BREAKER
- 11 4 - 350 KCMIL AND 1#2/0 GRD IN EACH OF 2 - 4" C.
- 12 EXISTING WAREHOUSE SERVICE.
- 13 EXISTING OFFICE SERVICE.
- 14 ROUTE 2" CONDUIT FROM INSIDE OFFICE BUILDING TO GENERATOR FOR GENERATOR CONTROL PANEL. PROVIDE ALL NECESSARY CABLING AND MAKE ALL TERMINATIONS IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
- 15 THERE ARE 4 - 4" AND 2 -2" CONDUITS BURIED BELOW SIDEWALK FOR SERVICE, CONTROLS, AND FEEDER. COORDINATE WITH ENGINEER PRIOR TO STARTING WORK.

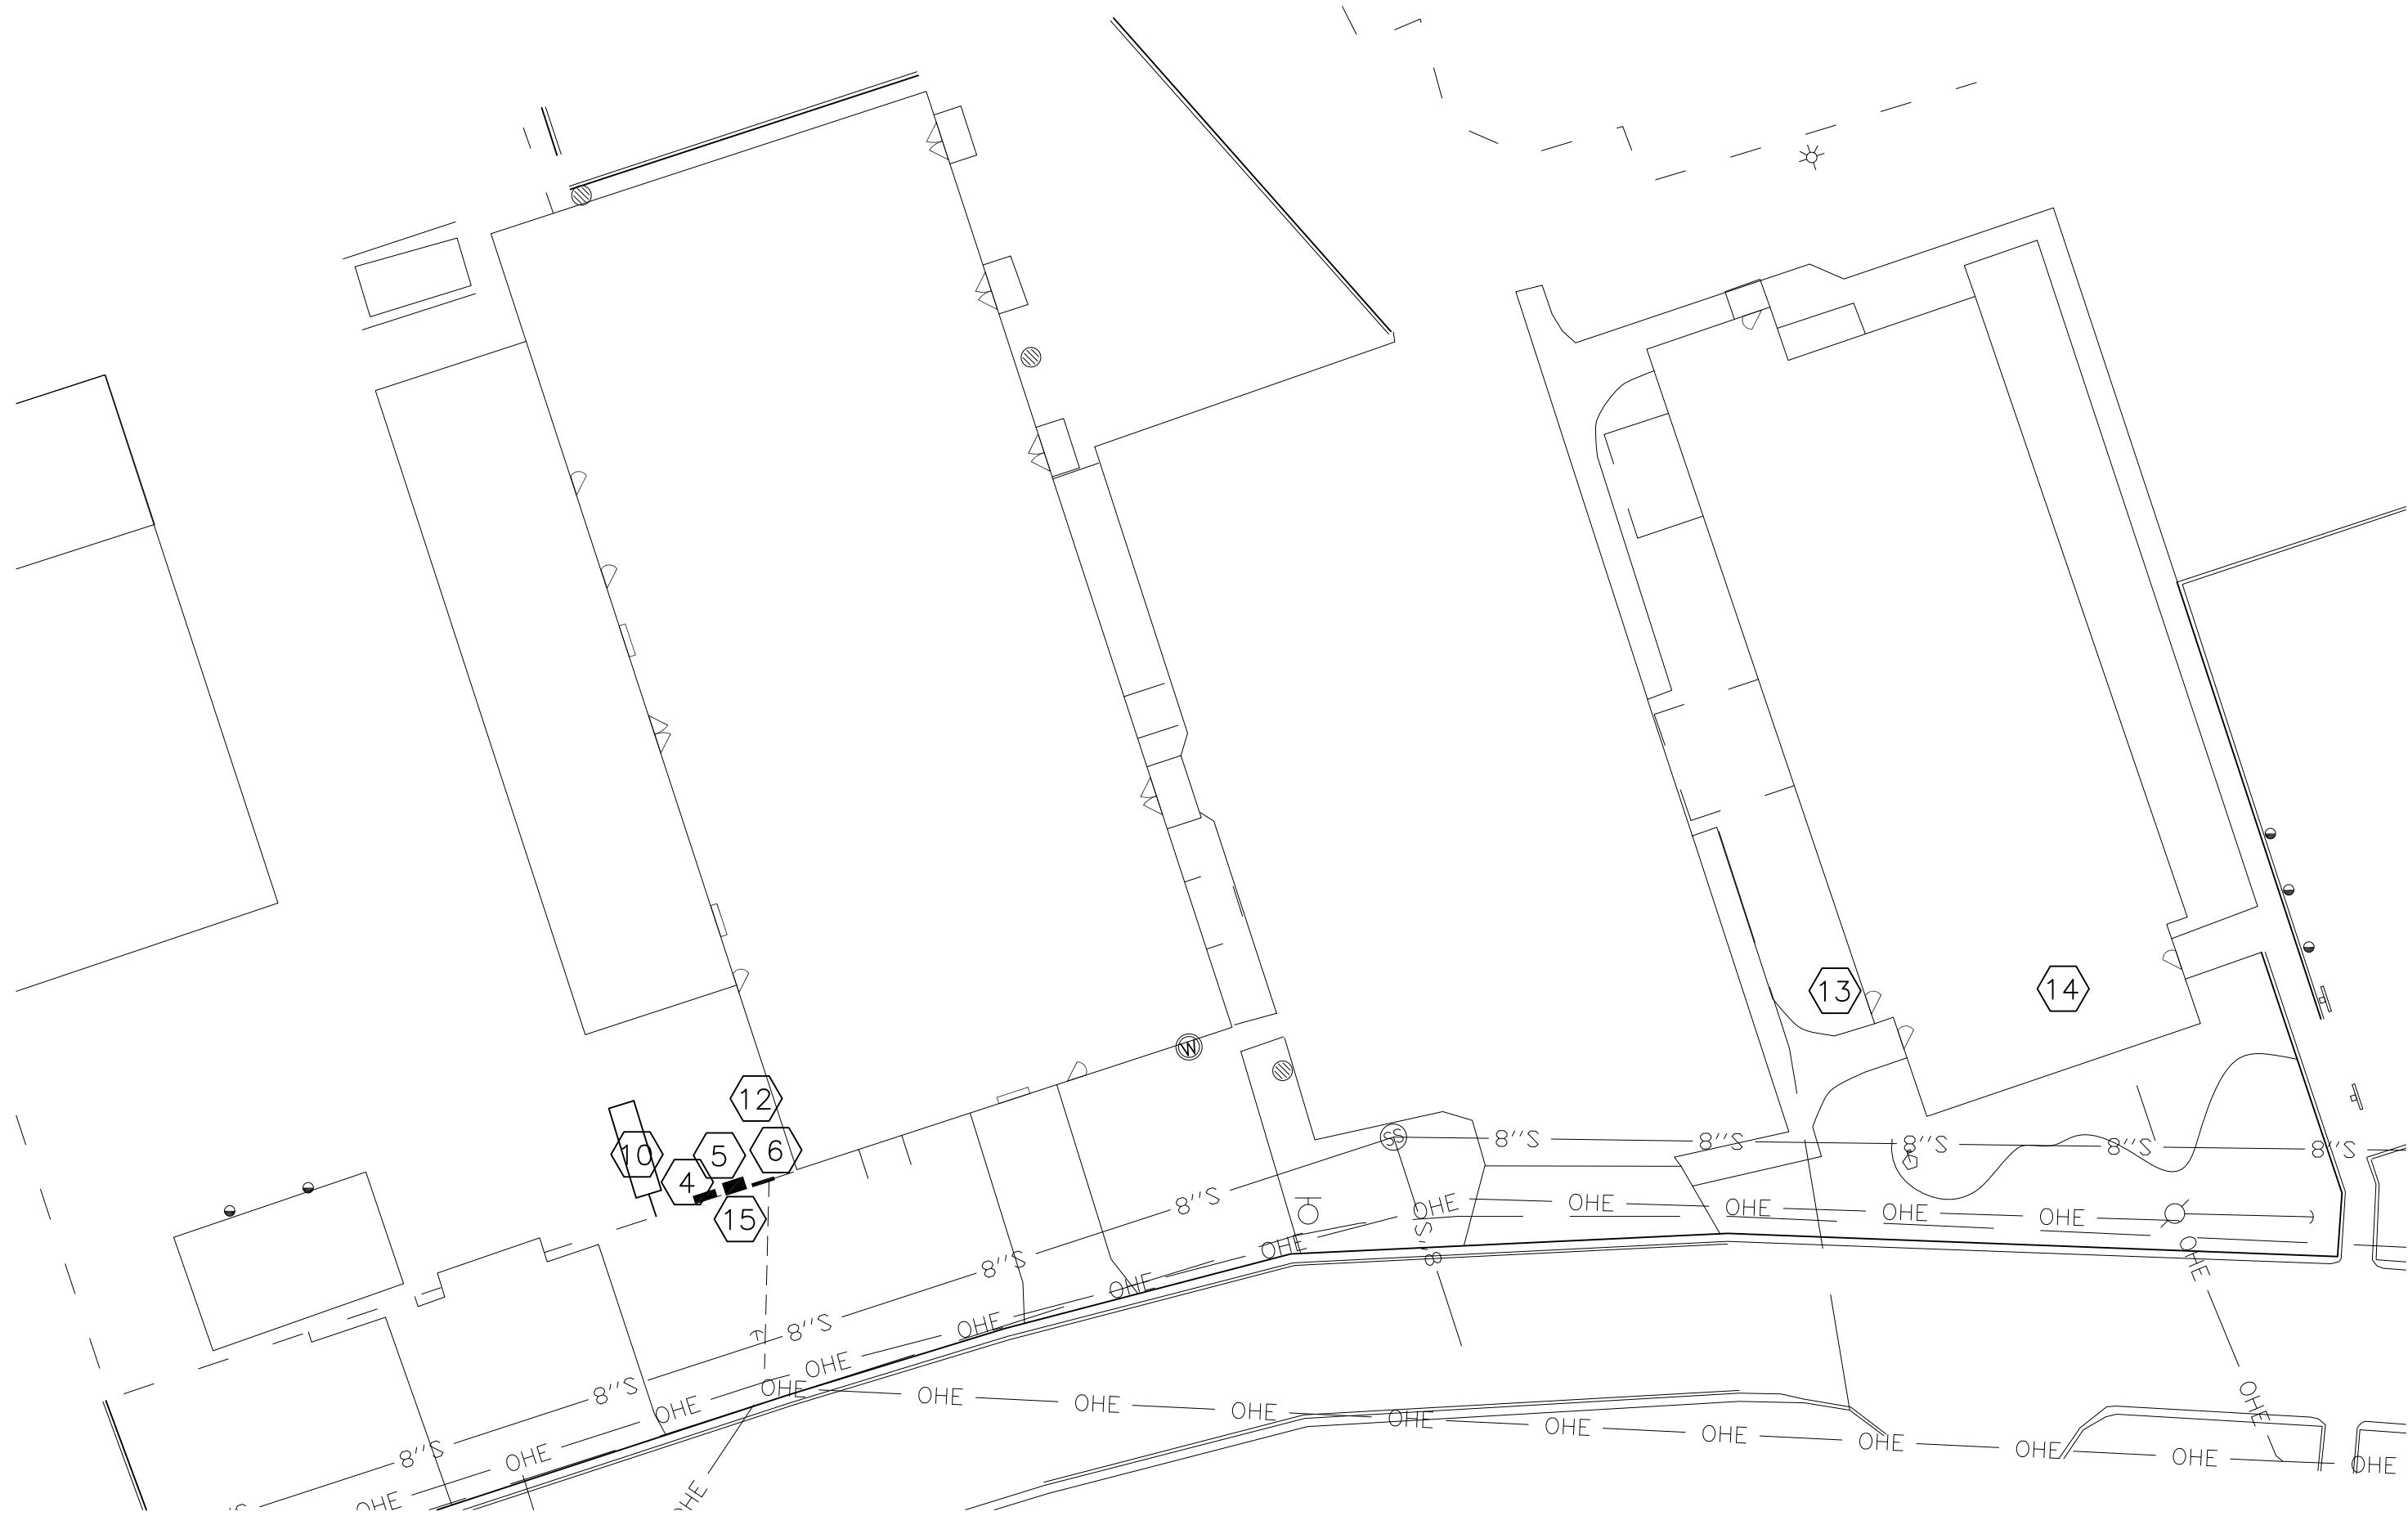

ELECTRICAL SITE PLAN
SCALE: 1"=20'

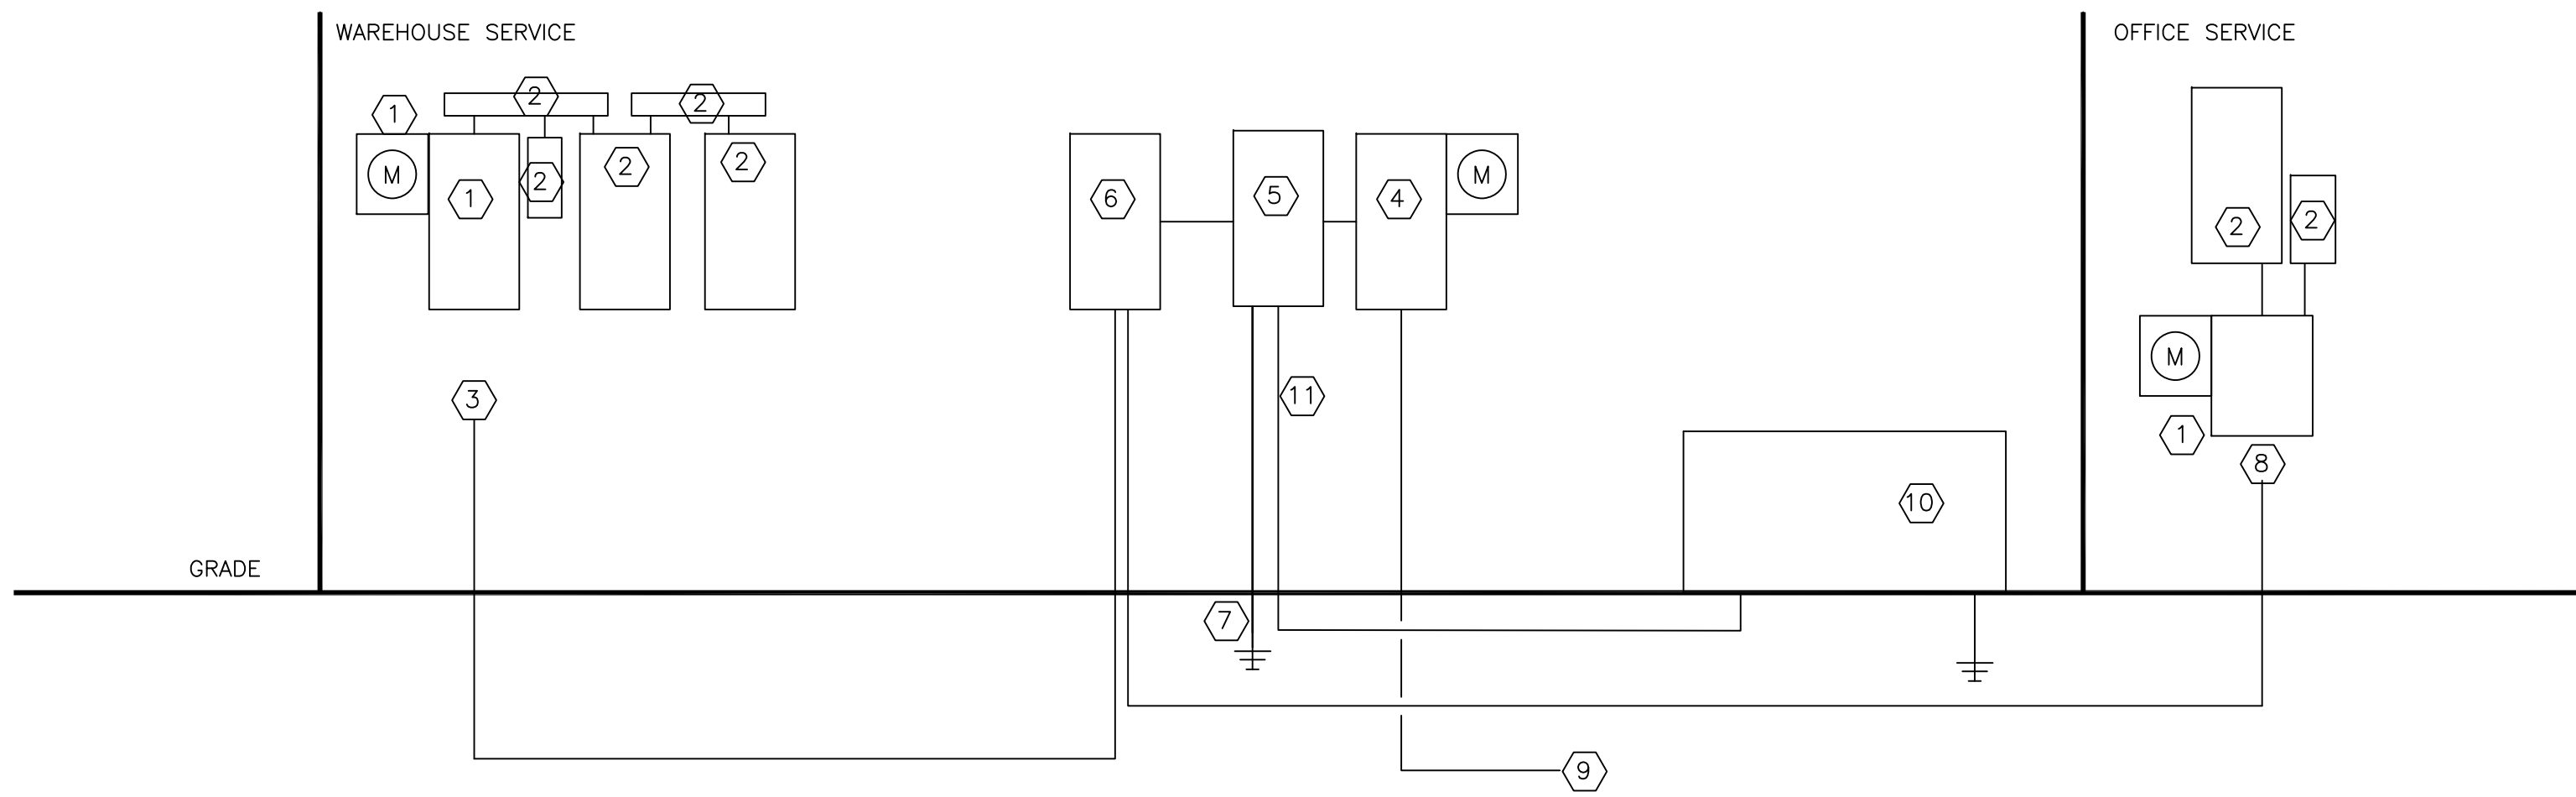

ELECTRICAL FEEDER DIAGRAM
NO SCALE

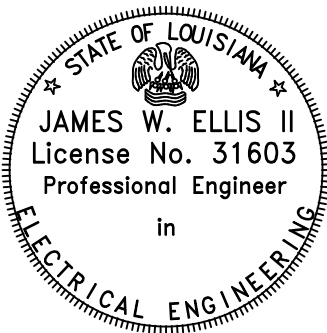


ELLIS ENGINEERING, LLC
525 BREWSTER RD., MADISONVILLE, LA 70447


DESIGNED BY:	JWE
DATE:	12/23/24
DRAWN BY:	JWE
CHECKED BY:	JWE
JOB NO.	23015

JEFFERSON PARISH RECREATION DEPARTMENT
EAST BANK RECREATION OFFICE GENERATOR
JEFFERSON PARISH, LA

ELECTRICAL PLAN

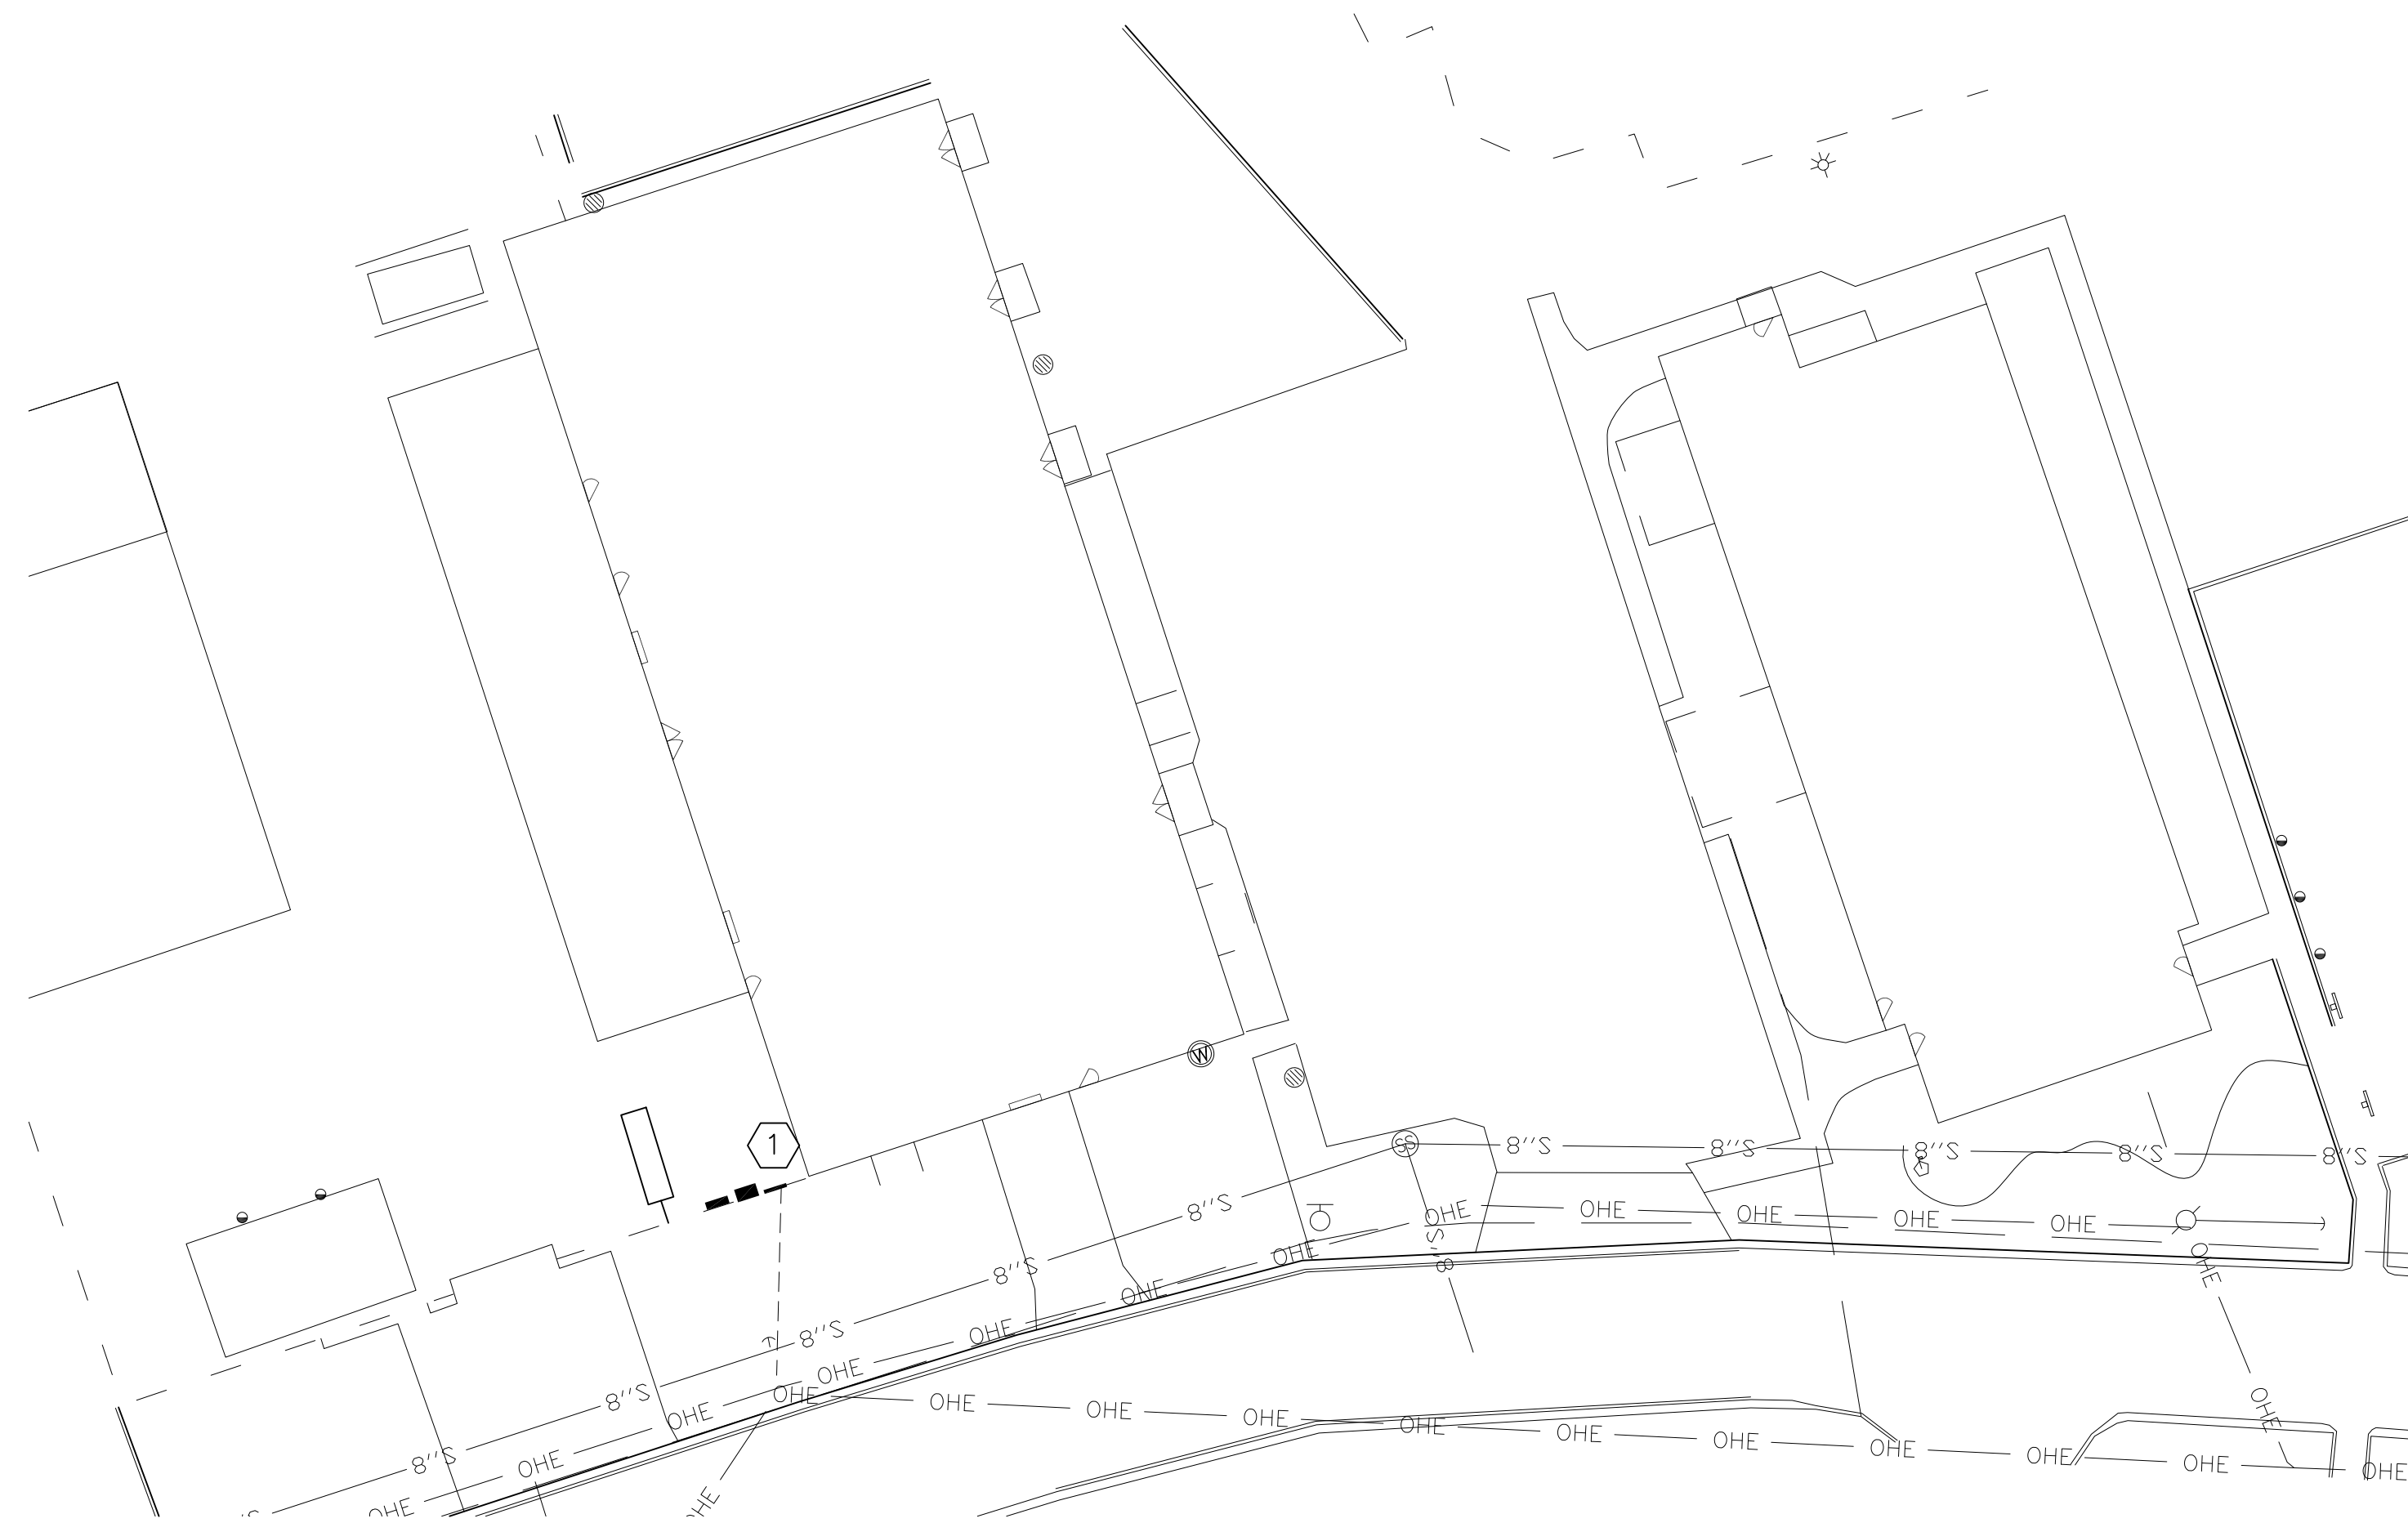

GAS SITE PLAN
SCALE: 1"=20'

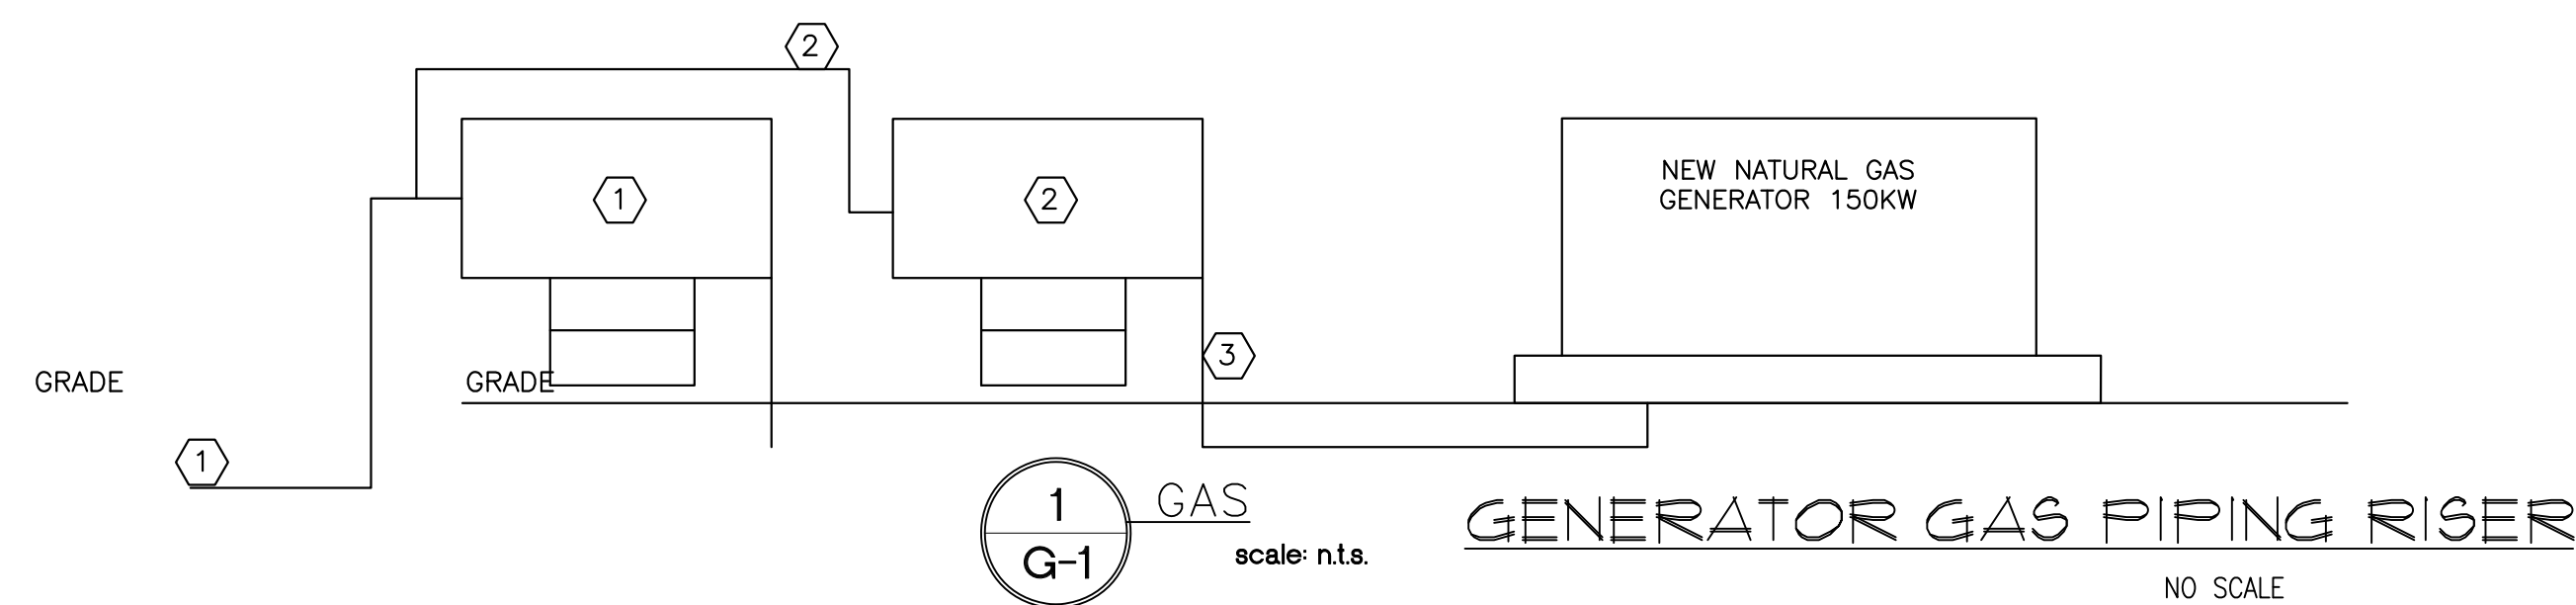


GENERATOR GAS PIPING RISER
scale: n.t.s. NO SCALE

GENERAL NOTES THIS SHEET

- COORDINATE NEW GAS METER AND NEW SERVICE REQUIREMENTS WITH SERVICE PROVIDER.
- ALL WORK SHALL BE DONE IN ACCORDANCE WITH IGC AND NFPA 54.
- COORDINATE ALL OUTAGES WITH THE OWNER A MINIMUM OF 30 DAYS PRIOR TO THE REQUIRED TIME. ALL OUTAGES SHALL OCCUR AT A TIME CONVENIENT TO THE OWNER, WHICH COULD BE EITHER ON WEEKENDS OR HOLIDAYS. COORDINATE ALL OUTAGES WITH THE SERVICE PROVIDER AND PAY ANY AND ALL ASSOCIATED COSTS.
- ALL WORK SHALL BE IN ACCORDANCE WITH STATE CODES AND THE LOCAL AHJ.
- THE CONTRACTOR SHALL ARRANGE FOR AND PAY ALL COSTS ASSOCIATED WITH ALL PERMITTING.
- ALL WORK SHALL BE IN ACCORDANCE WITH STATE CODES AND THE LOCAL AHJ.
- PROVIDE DRIP LEG AFTER GAS METER.
- PROVIDE GAS SHUTOFF VALVE AT GENERATOR.
- VERIFY GAS PRESSURE FOR EXISTING LOAD AND GENERATOR WHEN BOTH LOADS ARE OPERATING AT THE SAME TIME. ONE GENERATOR SHALL BE AT IDLE AND THE OTHER LOADED WITH THE BUILDING LOAD WHEN EXISTING LOADS ARE TESTED.
- COORDINATE WITH OTHER ALL TRADES TO PROVIDE A NEAT AND COMPLETE INSTALLATION. PROVIDE ALL NECESSARY EQUIPMENT AND PARTS FOR A COMPLETE INSTALLATION.

SPECIFIC NOTES THIS SHEET

- EXISTING GAS SERVICE TO BE MODIFIED TO MEET PROJECT CAPACITY/PRESSURE REQUIREMENTS. CONTRACTOR SHALL COMPLY WITH AND BE RESPONSIBLE FOR ATMOS ENERGY'S REQUIREMENTS AND COSTS/FEES ASSOCIATED WITH NEW METER AS REQUIRED TO MEET NEW TOTAL GAS LOAD. INSTALL NEW METER IN ACCORDANCE WITH UTILITY COMPANY'S REQUIREMENTS AND STANDARDS. EXISTING GAS MAIN SHALL BE MODIFIED AS NECESSARY FOR NEW GENERATOR. EXISTING METER SHALL REMAIN AS IS.
- NEW 2 PSI MINIMUM, GAS METER. PROVIDE NEW GAS METER SIZED FOR NEW GENERATOR LOAD OF 2000 SCFH AT 8-13" W.C., PROVIDE ADJUSTABLE REGULATORS AS REQUIRED TO ACCOMMODATE PRESSURE AND VOLUME. PROVIDE GAS SHUTOFF VALVE FOR FEEDER. EXISTING METER SHALL REMAIN FOR EXISTING LOAD. ADJUST EXISTING PIPING AS REQUIRED FOR NEW METER. CONNECT NEW METER WITH 1 1/2" GAS PIPE.
- PROVIDE ADJUSTABLE GAS REGULATOR TO PROVIDE 2000 SCFH MINIMUM AT 8-13" W.C. IN 3" GAS PIPE AND MAKE CONNECTIONS TO NEW GENERATOR. MAKE CONNECTIONS THROUGH A SHUTOFF VALVE AND IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.

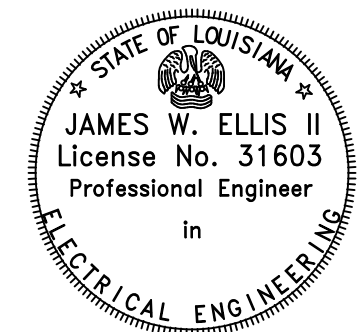

ELLIS ENGINEERING, L.L.C.	525 BREWSTER RD. MADISONVILLE, LA 70447 (504) 415-7670
	PROJECT No. 19005 JAMES W. ELLIS II, P.E., LOUISIANA LICENSE # 31603

ELLIS ENGINEERING, LLC
525 BREWSTER RD., MADISONVILLE, LA 70447

JEFFERSON PARISH RECREATION DEPARTMENT EAST BANK RECREATION OFFICE GENERATOR JEFFERSON PARISH, LA	DATE: 12/23/24	DESIGNED BY: JWE
		DRAWN BY: JWE
	JOB NO. 23015	CHECKED BY: JWE
GAS PLAN		
SHEET NO. 3		OF

Ellis Engineering, LLC

525 Brewster Rd., Madisonville, LA 70447 (504) 415-7670

JEFFERSON PARISH RECREATION DEPARTMENT

BID PROPOSAL NO. 50-00147321

ADDENDUM #1

PAGE 1 OF 4

CONTRACT DOCUMENTS, SPECIFICATIONS
AND
CONTRACT DRAWINGS

FOR
Labor, Equipment and Materials needed to Install a Generator
for the Jefferson Parish Department of Recreation.
Project # 23015
JEFFERSON PARISH DEPARTMENT OF PARKS AND RECREATION

ADDENDUM NO. 1

DATE ISSUED: April 1, 2025

BID DUE DATE: April 24th, 2025 AT 2:00 PM

BID OPENING LOCATION: Jefferson Parish General Government Building
Jefferson Parish Purchasing Dept., Suite 4400
200 Derbigny St., Gretna, LA 70053

This addendum shall be part of the Contract Documents as provided in the instructions to Bidders.

The following items are issued to add to, modify, and clarify the Contract Documents. These items shall have full force and effect as the Contract Documents, and the cost involved shall be included in the bid prices.

Acknowledge receipt of the addendum by inserting its number on the Bid Form of the Bid Documents. Failure to do so will subject the bidder to rejection.

The Addendum No. 1 Consist of 3 pages including sign in sheets.

We received the following question at the prebid meeting.

Question from bidder:

Where should power be derived for the generator water jacket heater and battery charger?

Response:

POWER FOR GENERATOR HEATER AND BATTERY CHARGER SHALL BE DERIVED FROM THE SIEMENS PANEL ON THE INSIDE WALL OF THE WAREHOUSE BUILDING BEHIND THE GAS METER. PROVIDE 120V, 20A, 10K AIC, BREAKER(S) IN SPACE AVAILABLE. PROVIDE BLANK COVERS FOR OPEN SPACES THAT EXIST.

Item 2, the below items were discussed at the pre-bid meeting by the owner:

- 1) The deadline for Questions is Monday, April 14th at 12:00 p.m.
- 2) The 1st Addendum will be posted no later than Tuesday, April 1st, by 4:00 p.m.
- 3) The last Addendum will be posted no later than Monday, April 21st, by 2:00 p.m.
- 4) Prior Approvals shall be marked. If not they will be rejected.
- 5) We discussed the installation of the conduits which are noted on the of the drawings. These may need to be reworked as necessary.
- 6) Questions about bidding documents, email Shanna Folse @ shanna.folse@jeffparish.gov
- 7) Questions about Technical Specifications, email James Ellis @ james@ellisengineers.com and copy Leo Webb @ leo.webb@jeffparish.gov and Shanna Folse @ shanna.folse@jeffparish.gov

PRE-BID CONFERENCE SIGN-IN SHEET

DESCRIPTION: Labor, Equipment and Materials needed to Supply and Install a Generator for the Jefferson Parish Department of Recreation. Project # 23015

BID #: 50-00147321

LOCATION: EB Recreation 6921 Saints Drive, Metairie, LA 70003

DATE AND TIME: 3/27/2025, 10:00 A.M.

START TIME: 10:00 AM STOP TIME: 10:13

COMPANY NAME/ADDRESS	COMPANY REPRESENTATIVE	PHONE	EMAIL ADDRESS	SIGN-IN TIME
Jefferson Parish Purchasing	Shanna Folse	504-364-2680	shanna.folse@jeffparish.gov	9:50
FRANK ELECTRICAL S. LLC	Franklin Oliva	504-483 0919	frankelectricalservicesllc@gmail.com	9:50
MCR Construction LLC	Martin Corral	504 481 4817	mcrconstructionllc@gmail.com	9:50
Gage	JD. Wild	225-753-4243	jwild@gage.telephone.com	9:50
H3 ELECTRIC LLC	HERBERT Hartman 3rd	504 ³⁰⁵ 805 4304	H3ElectricLLC@bnt.com	9:55 am
Frischhertz Elec	David Bush	504-915-2016	David@Frischhertz.com	9:55 am
ARC mechanical	Rene Ostarly Jr	985-661-9191	rostarly@ArcMechanical.net	9:55 am
JPRD	LEO WEBB	504-736-6984	Leo.webb@jeffparish.gov	9:55 AM
ELLIS Engineering	JAMES Ellis	504-415-7670	JAMES@ELLISENGINEERS.COM	9:55 AM
Torch Hatheway	Ray Gen Services	504-858-7445	thatheway@raygenservices.com	9:55 am

PRE-BID CONFERENCE SIGN-IN SHEET

[illegible]

Ellis Engineering, LLC

525 Brewster Rd., Madisonville, LA 70447 (504) 415-7670

JEFFERSON PARISH RECREATION DEPARTMENT
BID PROPOSAL NO. 50-00147321
ADDENDUM #2
PAGE 1 OF 4

CONTRACT DOCUMENTS, SPECIFICATIONS
AND
CONTRACT DRAWINGS

FOR
Labor, Equipment and Materials needed to Install a Generator
for the Jefferson Parish Department of Recreation.
Project # 23015
JEFFERSON PARISH DEPARTMENT OF PARKS AND RECREATION

ADDENDUM NO. 2

DATE ISSUED: April 14, 2025

BID DUE DATE: April 24th, 2025 AT 2:00 PM

BID OPENING LOCATION: Jefferson Parish General Government Building
Jefferson Parish Purchasing Dept., Suite 4400
200 Derbigny St., Gretna, LA 70053

This addendum shall be part of the Contract Documents as provided in the instructions to Bidders.

The following items are issued to add to, modify, and clarify the Contract Documents. These items shall have full force and effect as the Contract Documents, and the cost involved shall be included in the bid prices.

Acknowledge receipt of the addendum by inserting its number on the Bid Form of the Bid Documents. Failure to do so will subject the bidder to rejection.

The Addendum No. 2 Consist of 4 pages.

JEFFERSON PARISH RECREATION DEPARTMENT
BID PROPOSAL NO. 50-00147321
ADDENDUM #2
PAGE 1 OF 4

ADDENDUM #2
BID #50-00147321

We received the following questions:

Question from bidder:

Do you have a drawing with materials to build the service framework that will be needed along the fence line?

Answer:

No drawing. See general note B, sheet 2.

Question from bidder:

What will happen to the existing service metering once the two building services are connected to one meter?

Answer:

See specifications division 16010-5 and 16010-6. Return Entergy equipment to Entergy.

Question from bidder:

Will a slab or foundation be required to set the generator on?

Answer:

Yes. See attached drawing sheet 4 which is added to the drawings. The exact location of the foundation shall be coordinated with the engineer and generator placement.

Question from bidder:

Will the generator be required to be elevated off of the ground on a stand?

Answer:

See attached sheet 4 which is added to the drawings. The contractor shall ensure that the generator provided is coordinated with the slab size.

Question from bidder:

When either service needs to be disconnected to run any new wires, what days of the week and/or what hours of the day will this be allowed?

Answer:

Work will need to be done on weekends, after hours, or on Parish holidays.

Question from bidder:

As per referencing note #8 on sheet #2. Can the 4in conduit be reduced above or below the ground to fit better in the bottom of the distribution panel?

Answer:

Yes. The conduit will more than likely need to be reworked at each end. The owner placed the conduit for the purpose of avoiding cutting the new sidewalks and parking lot. Coordination of the equipment, gear, and meters will need to be done on site with the successful low bidder and the engineer.

Question from bidder:

Is Generac and Cummins an acceptable brand for the generator and ATS?

Answer:

Cummins is the basis for design for the generator and ATS.

Question from bidder:

By generator control on sheet #2 note 14. Does this refer to an annunciator or will there be a remote start/stop control located in the building?

Answer:

Annunciator. It shall be placed in the reception area of the office building and coordinated with the engineer.

Question from bidder:

Does the 2in conduit being run into the building have to be a complete conduit run inside the building or can the conduit be stubbed above an accessible ceiling and control wires exposed to the location of the control/annunciator?

Answer:

Yes. See specifications 16100-5

Question from bidder:

Will we be required to provide an isolated load test and/or any other timed test once the generator is installed?

Answer:

Yes. See specifications 16800 for requirements.

Question from bidder:

will a service pad be required around the new service?

Answer:

See specifications 16800 for requirements.

Prior Approvals: The following manufacturers have submitted for prior approval and **do not** meet the requirements set forth in the contract documents:


Generac

Add the following sheet 4, generator slab plan, to the drawings.

The deadline for questions has expired.

JEFFERSON PARISH RECREATION DEPARTMENT
BID PROPOSAL NO. 50-00147321
ADDENDUM #2
PAGE 3 OF 4

ADDED PER ADDENDA 2

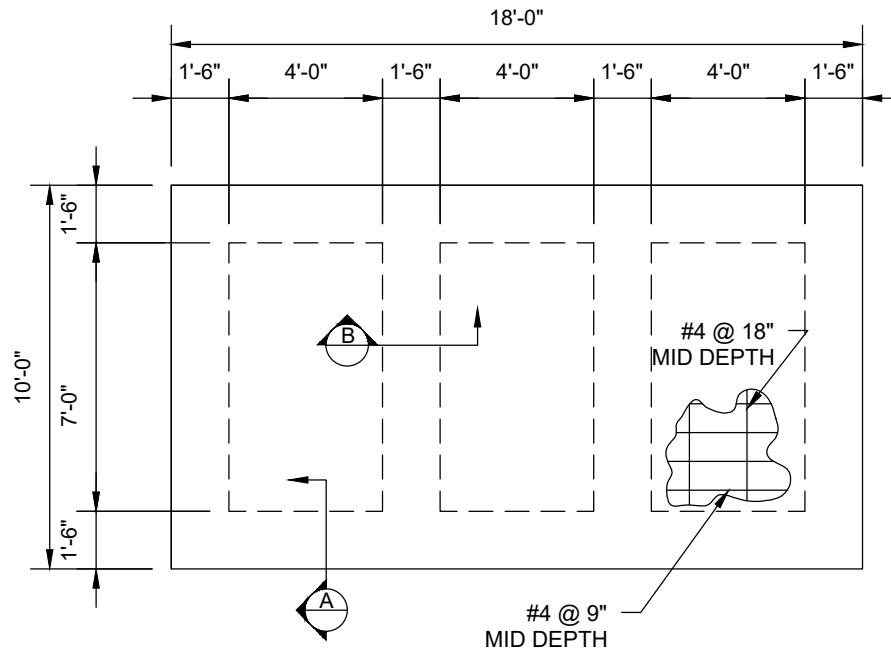


GENERATOR SLAB PLAN
SCALE: 1" = 5'-0"

CONCRETE NOTES:


1. CONCRETE WORK SHALL BE IN ACCORDANCE WITH ACI 305-05.
2. CONCRETE SHALL BE NORMAL WEIGHT (150 PCF), f_c AT 28 DAYS = 4000PSI.

REINFORCING NOTES:

1. REINFORCING STEEL SHALL BE DEFORMED STEEL BARS CONFORMING TO ASTM A615 INCLUDING SUPPLEMENTARY REQUIREMENT (S1). LATEST EDITION, AND SHALL HAVE A MINIMUM YIELD STRENGTH (FY) OF 60,000 PSI.
2. ALL DETAILING, FABRICATING, AND PLACEMENT OF REINFORCING STEEL, UNLESS OTHERWISE NOTED, SHALL BE IN ACCORDANCE WITH THE MANUAL OF STANDARD PRACTICE FOR DETAILING REINFORCED CONCRETE STRUCTURES, ACI 305, LATEST EDITION.
3. SPREAD REINFORCING STEEL AROUND ALL INSERTS, SLEEVES, OPENINGS, ETC. PROVIDE ADDITIONAL SLAB AND WALL REINFORCEMENT AT ALL OPENINGS, CUTOUTS, AND/OR PENETRATIONS OF ANY STRUCTURE. HOOK TOP AND BOTTOM BARS AT ENDS USING STANDARD HOOKS.
4. AS A MINIMUM, ALL SPLICES SHALL BE CLASS B, IN ACCORDANCE WITH ACI 350-08. DO NOT SPLICE IN AREAS OF MAXIMUM STRESS.
5. MINIMUM CONCRETE COVER FOR REINFORCING STEEL SHALL BE IN ACCORDANCE WITH SECTION 7.7 OF ACI 350-08.
6. REINFORCING STEEL AND ACCESSORIES SHALL NOT BE IN CONTACT WITH ANY PIPE, PIPE FLANGE, OR METAL PARTS EMBEDDED IN CONCRETE, A MINIMUM OF TWO (2) INCHES CLEARANCE SHALL BE PROVIDED AT ALL TIMES.

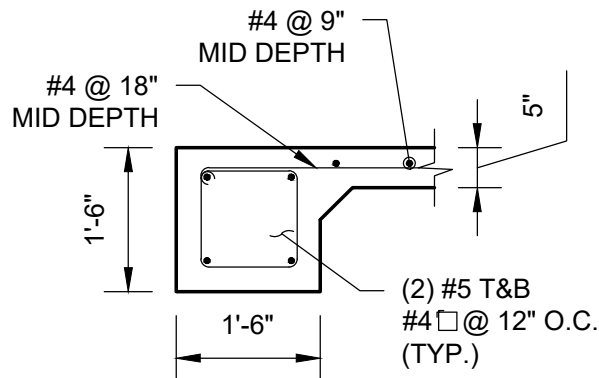

A SECTION
*** SCALE: 1/2" = 1'-0"

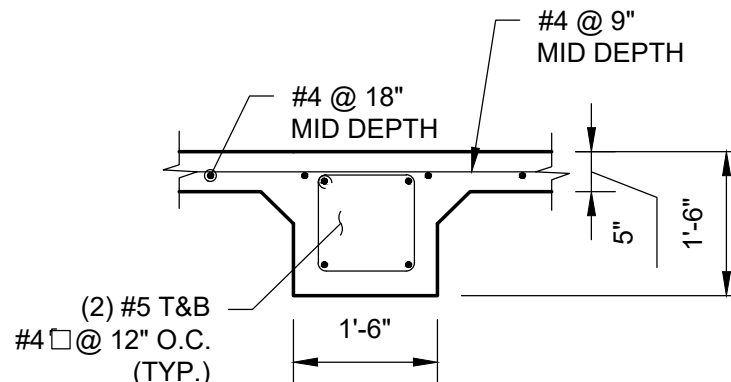

B SECTION
*** SCALE: 1/2" = 1'-0"



ELLIS ENGINEERING, LLC
525 BREWSTER RD., MADISONVILLE, LA 70447

DESIGNED BY:	JWE	CHECKED BY:	JWE
DATE:	12/23/24	JOB NO.:	23015
DRAWN BY:	JWE	SHEET NO.:	4
JEFFERSON PARISH RECREATION DEPARTMENT EAST BANK RECREATION OFFICE GENERATOR JEFFERSON PARISH, LA		GENERATOR SLAB PLAN - ADER PER ADDENDUM 2	
		of 4	