



CENTRALBIDDING
FROM CENTRAL AUCTION HOUSE

**5000134664 ONE (1) YEAR CONTRACT FOR SUPPLY OF CLAMPS,
SADDLES AND TAPPING SLEEVES FOR THE JEFFERSON PARISH
DEPARTMENT OF PUBLIC WORKS – WATER AND ALL JEFFERSON
PARISH AGENCIES AND MUNICIPALITIES.**

Jefferson Parish Government

Project documents obtained from www.CentralBidding.com

25-Jun-2021 08:39:58 AM



Bid Number 50-00134664

One (1) year contract for supply of clamps, saddles and tapping sleeves for the Jefferson Parish Department of Public Works – Water and all Jefferson Parish Agencies and Municipalities.

BID DUE: July 1, 2021 AT 2:00 PM

ATTENTION VENDORS!!!

Please review all pages and respond accordingly, complying with all provisions in the technical specifications and Jefferson Parish Instructions for Bidders and General Terms and Conditions. All bids must be received on the Purchasing Department's eProcurement site, www.jeffparishbids.net, by the bid due date and time. Late bids will not be accepted.

**Jefferson Parish Purchasing Department
200 Derbigny Street
General Government Building, Suite 4400
Gretna, LA 70053
Donna Reamey
Email: Dreamey@jeffparish.net
Phone: 504-364-2684**

CLAMP, SADDLES, AND TAPPING SLEEVES

CONTRACT

ITEMS INCLUDED IN THIS CONTRACT:

1. FULL CIRCLE CLAMP (SINGLE BAND CLAMP)
2. FULL CIRCLE CLAMP (DOUBLE BAND CLAMP)
3. FULL CIRCLE CLAMP (SINGLE BAND CLAMP WITH TAP)
4. FULL CIRCLE CLAMP (DOUBLE BAND CLAMP WITH TAP)
5. DOUBLE STRAP SERVICE SADDLE CLAMP WITH TAP

CONTRACT TERMS:

THIS IS A ONE YEAR CONTRACT FOR SUPPLY OF CLAMPS, SADDLES, AND TAPPING SLEEVES FOR THE DEPARTMENT OF WATER AND SEWER, AND ALL JEFFERSON PARISH AGENCIES AND MUNICIPALITIES.

WARRANTY:

PRODUCTS SHALL BE WARRANTED THAT THEY ARE MANUFACTURED IN ACCORDANCE WITH THE APPLICABLE MATERIAL SPECIFICATIONS AND ARE FREE FROM DEFECTS IN WORKMANSHIP AND MATERIALS FOR ONE YEAR AFTER DELIVERY. ANY DEFECTIVE ITEMS SOLD UNDER THIS CONTRACT SHALL BE REPLACED AT NO COST TO THE PURCHASER.

GENERAL SPECIFICATIONS:

THIS SPECIFICATION IS PREPARED FOR A ONE (1) YEAR CONTRACT FOR A SUPPLY OF CLAMPS, SADDLES, AND TAPPING SLEEVES FOR THE PARISH OF JEFFERSON, DEPARTMENT OF SEWERAGE, EAST AND WEST BANK.

THE QUANTITIES SHOWN ON THE PROPOSAL GUIDE ARE APPROXIMATE QUANTITIES TO BE ACQUIRED BY JEFFERSON PARISH OVER A ONE (1) YEAR PERIOD. ACTUAL USAGE WILL BE ON AN "AS NEEDED" BASIS.

ALL PERTINENT TECHNICAL SPECIFICATIONS AND LITERATURE MAY BE REQUIRED UPON REQUEST. SHOULD TECHNICAL SPECIFICATIONS AND LITERATURE BE REQUESTED, BIDDER(S) WILL BE REQUIRED TO SUBMIT SAID TECHNICAL SPECIFICATIONS AND LITERATURE WITHIN TEN (10) DAYS OF THE REQUEST.

BID PRICE SHALL INCLUDE ALL FREIGHT AND DELIVERY COSTS TO JEFFERSON PARISH WAREHOUSE LOCATIONS ON THE EAST AND WEST BANKS OF JEFFERSON PARISH.

THE SUCCESSFUL BIDDER SHALL NOT SUBSTITUTE ANY ITEMS ON THIS BID THROUGHOUT THE ONE (1) YEAR PERIOD WITHOUT THE WRITTEN CONSENT OF THE JEFFERSON PARISH ENGINEERING DEPT.

TECHNICAL SPECIFICATIONS:

I. FULL CIRCLE CLAMP (SINGLE BAND CLAMP):

THE CLAMP IS TO HAVE AN ANTIOXIDANT/ANTIOZANANT AGENT TO EXCEED SHELF LIFE, TO MEET OR EXCEED ASTM D2000 AA415 STANDARDS. THE CLAMP IS TO BE FULLY PASSIVATED AND IS TO HAVE A WORKING PRESSURE OF 150 PSI.

CLAMPS SHALL BE AVAILABLE FOR NOMINAL PIPE SIZES OF 2 INCH TO 12 INCH AND THE WIDTHS SHALL RANGE FROM 6 INCHES TO 20 INCHES.

OUTSIDE DIAMETER (O.D.) RANGES ARE TO BE MET OR EXCEEDED.

- **SHELL/BAND:**

SHELL/BAND SHALL BE MADE OF 18-8 24 GA STAINLESS STEEL FOR ½" THROUGH 2 INCH, 22 GA FOR 2-1/2 INCH THROUGH 4 INCH, 20 GA FOR 6 INCH, 18 GA FOR 8 INCH THROUGH 20 INCH, AND 16 GA FOR 24 INCH AND ABOVE. BRIDGE PLATE IS TO BE GLUED, RECESSED AND FLUSH FORMED INTO THE GASKET DURING MOLDING.

- **LUGS:**

LUGS SHALL BE 18-8, 8 GA STAINLESS STEEL.

- **BAR:**

BAR SHALL BE 18-8, 10 GA STAINLESS STEEL.

- **PLATE:**

PLATE SHALL BE 18-8, 12 GA STAINLESS STEEL.

- **STUD/BOLTS/NUTS:**

STUDS, BOLTS, AND NUTS SHALL BE 18-8 STAINLESS STEEL OF AT LEAST 5/8 INCH-11 XYLON OR TEFLON COATED, BAKED TEFLON COATED COR-TEN NUT.

- **WASHER:**

WASHERS SHALL BE 1/16 INCH BY 1-1/4 INCH NYLON.

- **GASKET:**

GASKETS ARE RECOMMENDED FOR USE ON POTABLE WATER LINES, LAP TYPE FINE GRIDDLE VIRGIN SBR RUBBER MATERIAL WITH TAPERED ENDS FOR USE IN SALTY AND ACIDIC SOILS WITH TEMPERATURE RANGES OF -40 DEGREES TO 150 DEGREES FAHRENHEIT.

- **MARKINGS:**

EACH CLAMP IS TO HAVE THE MANUFACTURER'S NAME, PART NUMBER WITH FULL O.D. RANGE, AND DATE OF MANUFACTURE.

II. **FULL CIRCLE CLAMP (DOUBLE BAND CLAMP):**

THE CLAMP IS TO HAVE AN ANTIOXIDANT/ANTIOZANANT AGENT TO EXCEED SHELF LIFE, TO MEET OR EXCEED ASTM D2000 AA415 STANDARDS. THE CLAMP IS TO BE FULLY PASSIVATED AND IS TO HAVE A WORKING PRESSURE OF 150 PSI.

CLAMPS SHALL BE AVAILABLE FOR NOMINAL PIPE SIZES OF 12 INCH TO 26 INCH AND THE WIDTHS SHALL RANGE FROM 20 INCHES TO 24 INCHES.

OUTSIDE DIAMETER (O.D.) RANGES ARE TO BE MET OR EXCEEDED.

- **SHELL/BAND:**

SHELL/BAND SHALL BE MADE OF 18-8 24 GA STAINLESS STEEL FOR 1/2" THROUGH 2 INCH, 22 GA FOR 2-1/2 INCH THROUGH 4 INCH, 20 GA FOR 6 INCH, 18 GA FOR 8 INCH THROUGH 20 INCH, AND 16 GA FOR 24 INCH AND ABOVE. BRIDGE PLATE IS TO BE GLUED, RECESSED AND FLUSH FORMED INTO THE GASKET DURING MOLDING.

- **LUGS:**

LUGS SHALL BE 18-8, 8 GA STAINLESS STEEL.

- **BAR:**

BAR SHALL BE 18-8, 10 GA STAINLESS STEEL.

- **PLATE:**

PLATE SHALL BE 18-8, 12 GA STAINLESS STEEL.

- **STUD/BOLTS/NUTS:**

STUDS, BOLTS, AND NUTS SHALL BE 18-8 STAINLESS STEEL OF AT LEAST 5/8 INCH- Xylan OR TEFLON COATED, BAKED TEFLON COATED COR-TEN NUT.

- **WASHER:**

WASHERS SHALL BE 1/16 INCH BY 1-1/4 INCH NYLON.

- **GASKET:**

GASKETS ARE RECOMMENDED FOR USE ON POTABLE WATER LINES, LAP TYPE FINE GRIDDLE VIRGIN SBR RUBBER MATERIAL WITH TAPERED ENDS FOR USE IN SALTY AND ACIDIC SOILS WITH TEMPERATURE RANGES OF -40 DEGREES TO 150 DEGREES FAHRENHEIT.

- **MARKINGS:**

EACH CLAMP IS TO HAVE THE MANUFACTURER'S NAME, PART NUMBER WITH FULL O.D. RANGE, AND DATE OF MANUFACTURE.

III. **FULL CIRCLE CLAMP WITH TAP (SINGLE BAND CLAMP):**

THE CLAMP IS TO HAVE AN ANTIOXIDANT/ANTIOZANANT AGENT TO EXCEED SHELF LIFE, TO MEET OR EXCEED ASTM D2000 AA415 STANDARDS. THE CLAMP IS TO BE FULLY PASSIVATED AND IS TO HAVE A WORKING PRESSURE OF 150 PSI.

CLAMPS SHALL BE AVAILABLE FOR NOMINAL PIPE SIZES OF 1-1/2 INCH TO 12 INCH AND THE WIDTHS SHALL RANGE FROM 12 INCHES TO 20 INCHES. CLAMPS SHALL BE AVAILABLE IN A 3/4, 1, AND 2 INCH TAP.

OUTSIDE DIAMETER (O.D.) RANGES ARE TO BE MET OR EXCEEDED.

- **SHELL/BAND:**

SHELL/BAND SHALL BE MADE OF 18-8 24 GA STAINLESS STEEL FOR ½" THROUGH 2 INCH, 22 GA FOR 2-1/2 INCH THROUGH 4 INCH, 20 GA FOR 6 INCH, 18 GA FOR 8 INCH THROUGH 20 INCH, AND 16 GA FOR 24 INCH AND ABOVE. BRIDGE PLATE IS TO BE GLUED, RECESSED AND FLUSH FORMED INTO THE GASKET DURING MOLDING.

- **LUGS:**

LUGS SHALL BE 18-8, 8 GA STAINLESS STEEL.

- **BAR:**

BAR SHALL BE 18-8, 10 GA STAINLESS STEEL.

- **PLATE:**

PLATE SHALL BE 18-8, 12 GA STAINLESS STEEL.

- **STUD/BOLTS/NUTS:**

STUDS, BOLTS, AND NUTS SHALL BE 18-8 STAINLESS STEEL OF AT LEAST 5/8 INCH- XYLAN OR TEFLON COATED, BAKED TEFLON COATED COR-TEN NUT.

- **WASHER:**

WASHERS SHALL BE 1/16 INCH BY 1-1/4 INCH NYLON.

- **GASKET:**

GASKETS ARE RECOMMENDED FOR USE ON POTABLE WATER LINES, LAP TYPE FINE GRIDDLE VIRGIN SBR RUBBER MATERIAL WITH TAPERED ENDS FOR USE IN SALTY AND ACIDIC SOILS WITH TEMPERATURE RANGES OF -40 DEGREES TO 150 DEGREES FAHRENHEIT.

- **MARKINGS:**

EACH CLAMP IS TO HAVE THE MANUFACTURER'S NAME, PART NUMBER WITH FULL O.D. RANGE, AND DATE OF MANUFACTURE.

IV. FULL CIRCLE CLAMP WITH TAP (DOUBLE BAND CLAMP):

THE CLAMP IS TO HAVE AN ANTIOXIDANT/ANTIOZANANT AGENT TO EXCEED SHELF LIFE, TO MEET OR EXCEED ASTM D2000 AA415 STANDARDS. THE CLAMP IS TO BE FULLY PASSIVATED AND IS TO HAVE A WORKING PRESSURE OF 150 PSI.

CLAMPS SHALL BE AVAILABLE FOR NOMINAL PIPE SIZES OF 2 INCH TO 14 INCH AND THE WIDTHS SHALL RANGE FROM 6 INCHES TO 20 INCHES. CLAMPS SHALL BE AVAILABLE IN A ¾, 1, AND 2 INCH TAP.

OUTSIDE DIAMETER (O.D.) RANGES ARE TO BE MET OR EXCEEDED.

- **SHELL/BAND:**

SHELL/BAND SHALL BE MADE OF 18-8 24 GA STAINLESS STEEL FOR ½" THROUGH 2 INCH, 22 GA FOR 2-1/2 INCH THROUGH 4 INCH, 20 GA FOR 6 INCH, 18 GA FOR 8 INCH THROUGH 20 INCH, AND 16 GA FOR 24 INCH AND ABOVE. BRIDGE PLATE IS TO BE GLUED, RECESSED AND FLUSH FORMED INTO THE GASKET DURING MOLDING.

- **LUGS:**

LUGS SHALL BE 18-8, 8 GA STAINLESS STEEL.

- **BAR:**

BAR SHALL BE 18-8, 10 GA STAINLESS STEEL.

- **PLATE:**

PLATE SHALL BE 18-8, 12 GA STAINLESS STEEL.

- **STUD/BOLTS/NUTS:**

STUDS, BOLTS, AND NUTS SHALL BE 18-8 STAINLESS STEEL OF AT LEAST 5/8 INCH- XYLAN OR TEFLON COATED, BAKED TEFLON COATED COR-TEN NUT.

- **WASHER:**

WASHERS SHALL BE 1/16 INCH BY 1-1/4 INCH NYLON.

- **GASKET:**

GASKETS ARE RECOMMENDED FOR USE ON POTABLE WATER LINES, LAP TYPE FINE GRIDDLE VIRGIN SBR RUBBER MATERIAL WITH TAPERED ENDS FOR USE IN SALTY AND ACIDIC SOILS WITH TEMPERATURE RANGES OF -40 DEGREES TO 150 DEGREES FAHRENHEIT.

- **MARKINGS:**

EACH CLAMP IS TO HAVE THE MANUFACTURER'S NAME, PART NUMBER WITH FULL O.D. RANGE, AND DATE OF MANUFACTURE.

V. SADDLE, DOUBLE STRAP CLAMP WITH TAP:

THE FOLLOWING ARE ALL STAINLESS STEEL DOUBLE STRAP SERVICE SADDLES (DSC) AND FULL FACED GASKET WITH DOUBLE BOLTS. SADDLES SHALL BE TIG WELDED TO MEET ASTM A380.

THE CLAMP IS TO HAVE AN ANTIOXIDANT/ANTIOZANANT AGENT TO EXCEED SHELF LIFE, TO MEET OR EXCEED ASTM D2000 AA415 STANDARD WITH ¾ INCH TAP. THE CLAMP IS TO BE FULLY PASSIVATED AND IS TO HAVE A WORKING PRESSURE OF 150 PSI.

CLAMPS SHALL BE AVAILABLE FOR NOMINAL PIPE SIZES OF 4 INCH TO 16 INCH AND THE WIDTHS SHALL BE 8 INCHES. CLAMPS SHALL BE AVAILABLE IN A ¾, 1, AND 2 INCH TAP.

OUTSIDE DIAMETER (O.D.) RANGES ARE TO BE MET OR EXCEEDED.

- **OUTLET/TAP:**

OUTLET AND TAP SHALL BE 18-8 STAINLESS, CC/AWWA TAPER THREADS WITH TEFLON COATINGS TO PREVENT GALLING.

- **SADDLE:**

SADDLE SHALL BE 18-8, 16 GA STAINLESS STEEL.

- **BANDS:**

BANDS SHALL BE 18-8 STAINLESS STEEL 2 INCH WIDE, 20 GA UP TO 10 INCH AND 18 GA FOR LARGER DIAMETERS.

- **LUGS:**

LUGS SHALL BE 18-8, 8 GA STAINLESS STEEL.

- **BAR:**

BAR SHALL BE 18-8, 10 GA STAINLESS STEEL.

- **PLATE:**

PLATE SHALL BE 18-8, 12 GA STAINLESS STEEL.

- **STUD/BOLTS/NUTS:**

STUDS, BOLTS, AND NUTS SHALL BE 18-8 STAINLESS STEEL OF AT LEAST 5/8 INCH-11 XYLAN OR TEFLON COATED, BAKED TEFLON COATED COR-TEN NUTS.

- **WASHER:**

WASHERS SHALL BE 1/16 INCH BY 1-1/4 INCH NYLON.

- **GASKET:**

GASKETS ARE RECOMMENDED FOR USE ON POTABLE WATER LINES, LAP TYPE FINE GRIDDLE VIRGIN SBR RUBBER MATERIAL WITH TAPERED ENDS FOR USE IN SALTY AND ACIDIC SOILS WITH TEMPERATURE RANGES OF -40 DEGREES TO 150 DEGREES FAHRENHEIT.

- **MARKINGS:**

EACH CLAMP IS TO HAVE THE MANUFACTURER'S NAME, PART NUMBER WITH FULL O.D. RANGE, AND DATE OF MANUFACTURE.

DATE: 6/16/2021
BID NO.: 50-00134664

INVITATION TO BID
THIS IS NOT AN ORDER

Page: 1

JEFFERSON PARISH

PURCHASING DEPARTMENT
P.O. BOX 9
GRETN, LA. 70054-0009
504-364-2678

BUYER: DREAMEY@jeffparish.net

BIDS WILL BE RECEIVED ONLINE VIA WWW.JEFFPARISHBIDS.NET UNTIL 2:00 PM, 7/01/2021 AND PUBLICLY OPENED THEREAFTER IN THE WEST BANK PURCHASING DEPT, SUITE 4400, JEFFERSON PARISH GENERAL GOVERNMENT BUILDING, 200 DERBIGNY STREET, GRETN, LA 70053. At no charge, bidders are to submit via Jefferson Parish's electronic procurement page by visiting www.jeffparishbids.net to register for this free site. Additional instructions are included in the text box highlighting electronic procurement.

LATE BIDS WILL NOT BE ACCEPTED

NOTE: ONLY BIDS WRITTEN IN INK OR TYPEWRITTEN, AND PROPERLY SIGNED BY A MEMBER OF THE FIRM OR AUTHORIZED REPRESENTATIVE, WILL BE ACCEPTED. PENCIL AND/OR PHOTOSTATIC FIGURES OR SIGNATURES SHALL RESULT IN BID REJECTION. HOWEVER, ELECTRONIC SIGNATURES AS DEFINED IN LSA - R.S. 9:2620(8) ARE ACCEPTABLE. SIGNATURE MUST BE A SECURED DIGITAL SIGNATURE.

INSTRUCTIONS FOR BIDDERS AND GENERAL CONDITIONS
THE FOLLOWING INSTRUCTIONS APPLY TO ALL BIDS

All bids submitted are subject to these instructions and general conditions and any special conditions and specifications contained herein, all of which are made part of this bid proposal reference. By submitting a bid, vendor agrees to comply with all provisions of Louisiana Law as well be in compliance with the Jefferson Parish Code of Ordinances, Louisiana Code of Ethics, applicable Jefferson Parish ethical standards and Jefferson Parish Resolution No. 113646 and/or Resolution No. 113647 as amended.

Jefferson Parish adheres to the Louisiana Code of Governmental Ethics, contained in Louisiana Revised Statutes Annotated, R.S. 42:1101, et seq. Vendor/Proposer by this submission, warrants that there are no "conflicts of interest" related to this procurement that would violate applicable Louisiana Law. Violation of the Louisiana Code of Governmental Ethics may result in rescission of contract, permit or licenses, and the imposition of fines and/or penalties, without contractual liability to the public in accordance with applicable law.

All vendors submitting bids should register as a Jefferson Parish vendor if not already yet registered. Registration forms may be downloaded from <http://purchasing.jeffparish.net> and by clicking on Vendor Information. Current W-9 forms with respective Tax Identification numbers and vendor applications may be submitted at any time; however, if your company is not registered and/or a current W-9 form is not on file, vendor registration is mandatory. Vendors may experience a delay in payment if your company is not a registered vendor with Jefferson Parish.

All quotations shall be based on F.O.B. Agency warehouse or job site, anywhere within the Parish as designated by the Purchasing Department. This provision does not apply to public works projects

JEFFERSON PARISH requires all products to be new (current) and all work must be performed according to standard practices for the project. Unless otherwise specified, no aftermarket parts will be accepted. Unless otherwise specified, all workmanship and materials must have at least one (1) year guaranty, in writing, from the date of delivery and/or acceptance of the project. Any deviations or alterations from the specifications must be indicated and/or supporting documentation supplied with bid submission.

Bidders should submit all questions in writing via email to the buyer's email address as indicated above, no later than Five (5) working days prior to the bid opening. Bid numbers should be mentioned in all requests. If submitting online, vendors may send questions via the E-Procurement site no later than Five (5) working days prior to the bid opening.

If this bid requires a pre-bid conference (see Additional Requirements section), bidders are advised that such conference will be held to allow bidders the opportunity to identify any discrepancies in the bid specifications and seek further clarification regarding instructions. The Purchasing Department will issue a written response to bidders' questions in the form of an Addendum. Please note that all official communication will be expressed in the form of an addendum.

Visit our website at [HTTP://PURCHASING.JEFFPARISH.NET](http://PURCHASING.JEFFPARISH.NET)

DATE: 6/16/2021

BID NO.: 50-00134664

Page: 2

All formal Addenda require written acknowledgement on the bid form by the bidder. Failure to acknowledge an Addendum on the bid form shall cause the bid to be rejected. JEFFERSON PARISH reserves the right to award bid to next lowest responsive and responsible bidder in this event.

JEFFERSON PARISH will accept one price for each item unless otherwise indicated. Two or more prices for one item will result in bid rejection. Bidders are required to complete, sign and return the bid form and/or complete and return the associated line item pricing forms as indicated. Vendors must not alter the bid forms. Doing so will cause the bid to be rejected.

A corporate resolution or written evidence of the individual signing the bid having such authority must be submitted with the bid. Failure to comply will cause bid to be rejected. For corporate entities, such written evidence may be a printout of the Louisiana Secretary of State's website listing the signatory as an officer. Such printout shall be included with the bid submission. Bids submitted by Owners or Sole Proprietorships must include certification that he or she owns the entity for which the bid is signed. This documentation must be submitted with the bid. Failure to do so will result in bid rejection.

NOTE: A sample corporate resolution can be downloaded from our website <http://purchasing.jeffparish.net> or you may provide your own document. A sample certification of sole proprietorship can also be downloaded from our website <http://purchasing.jeffparish.net> or you may provide your own document.

INSTRUCTIONS FOR BIDDERS AND GENERAL CONDITIONS

A. AWARD OF CONTRACT: JEFFERSON PARISH reserves the right to award contracts or place orders on a lump sum or individual item basis, or such combination, as shall in its judgment be in the best interest of JEFFERSON PARISH. Every contract or order shall be awarded to the LOWEST RESPONSIVE AND RESPONSIBLE BIDDER, taking into consideration the CONFORMITY WITH THE SPECIFICATIONS and the DELIVERY AND/OR COMPLETION DATE. SPLIT AWARDS MADE TO SEVERAL VENDORS WILL ONLY BE GRANTED TO THOSE DEEMED RESPONSIVE AND RESPONSIBLE.

All bid prices shall remain valid for 45 days. Jefferson Parish and the lowest responsive and responsible bidder(s) by mutual written consent may mutually agree to extend the deadline for award by one (1) or more extensions of thirty (30) calendar days.

PROTESTS: Only those vendors that submit bids in response to this solicitation may protest any element of the procurement, in writing to the Director of the Purchasing Department. Written protest must be received within 48 hours of the release of the bid tabulation by the Purchasing Department. After consultation, the Parish Attorney's Office will then respond to protests in writing. (For more information, please see Chapter 2, Article VII, Division 2, Sec. 2-914.1 of the Jefferson Parish Code of Ordinances.)

PREFERENCE: Unless federal funding is directly spent by Jefferson Parish for this purchase, preference is hereby given to materials, supplies, and provisions produced, manufactured or grown in Louisiana, quality being equal to articles offered by competitors outside the state. "LSA - R.S. 38:2251-2261"

B. USE OF BRAND NAMES AND STOCK NUMBERS: Where brand names and stock numbers are specified, it is for the purpose of establishing certain minimum standards of quality. Bids may be submitted for products of equal quality, provided brand names and stock numbers are specified. Complete product data may be required prior to award.

C. CANCELLATION OF CONTRACT: JEFFERSON PARISH reserves the right to cancel all or any part if not shipped promptly. No charges will be allowed for parking or cartage unless specified in quotation. The order must not be filled at a higher price than quoted. JEFFERSON PARISH reserves the right to cancel any contract at anytime and for any reason by issuing a THIRTY (30) day written notice to the contractor.

For good cause and as consideration for executing a contract with Jefferson Parish, vendor conveys, sells, assigns and transfers to Jefferson Parish or its assigns all rights, title and interest in and to all causes of action it may now or hereafter acquire under the antitrust laws of the United States and the State of Louisiana, relating to the particular good or services purchased or acquired by Jefferson Parish.

D. PRICES: Jefferson Parish is exempt from paying sales tax under LSA-R.S. 47:301 (8)(c). All prices for purchases by Jefferson Parish of supplies and materials shall be quoted in the unit of measure specified and unless otherwise specified, shall be exclusive of state and local taxes. The price quoted for work shall be stated in figures. In the event there is a difference in unit prices and totals, the unit price shall prevail.

Quantities listed are for bidding purposes only. Actual requirements may be more or less than quantities listed.

Bidders are not to exclude from participation in, deny the benefits of, or subject to discrimination under any program or activity, any person in the United States on the grounds of race, color, national origin, or sex; nor discriminate on the basis of age under the Age Discrimination Act of 1975, or with respect to an otherwise qualified handicapped individual as provided in Section 504 of the Rehabilitation Act of 1973, or on the basis of religion, except that any exemption from such prohibition against discrimination on the basis of religion as provided in the Civil Rights Act of 1964, or Title VI and VII of the Act of April 11, 1968, shall also apply. This assurance includes compliance with the administrative requirements of the Revenue Sharing final handicapped discrimination provisions contained in Section 51.55 (c), (d), (e), and (k)(5) of the Regulations. New construction or renovation projects must comply with Section 504 of the 1973 Rehabilitation Act, as amended, in accordance with the American National Standard Institute's specifications (ANSI A17.1-1961).

DATE: 6/16/2021

BID NO.: 50-00134664

Page: 3

INSTRUCTIONS FOR BIDDERS AND GENERAL CONDITIONS

Jefferson Parish and its partners as the recipients of federal funds are fully committed to awarding a contract(s) to firm(s) that will provide high quality services and that are dedicated to diversity and to containing costs. Thus, Jefferson Parish strongly encourages the involvement of minority and/or woman-owned business enterprises (DBE's, including MBE's, WBE's and SBE's) to stimulate participation in procurement and assistance programs.

The purpose and intention of this invitation to bid is to afford all suppliers an equal opportunity to bid on all construction, maintenance, repair, operating supplies and/or equipment listed in this bid proposal. JEFFERSON PARISH WILL ACCEPT ONE BID ONLY FROM EACH VENDOR. Items bid must meet specifications.

Advertised bids will be tabulated and a copy of the tabulation will be forwarded to each responding bidder.

IN ACCORDANCE WITH STATE REGULATIONS JEFFERSON PARISH OFFERS ELECTRONIC PROCUREMENT TO ALL VENDORS

This electronic procurement system allows vendors the convenience of reviewing and submitting bids online. This is a secure site and authorized personnel have limited read access only. Bidders are to submit electronically using this free service; while the website accepts various file types, one single PDF file containing all appropriate and required bid documents is preferred. Bidders submitting uploaded images of bid responses are solely responsible for clarity. If uploaded images/documents are not legible, then bidder's submission will be rejected. Please note all requirements contained in this bid package for electronic bid submission.

Please visit our E-Procurement Page at www.jeffparishbids.net to register and view Jefferson Parish solicitations. For more information, please visit the Purchasing Department page at <http://purchasing.jeffparish.net>.

The general specifications for construction projects and the purchase of materials, services and/or supplies are those adopted by the JEFFERSON PARISH Council by Resolution No. 113646 or 113647 as amended. The general conditions adopted by this resolution shall be considered as much a part of this document as if they were written wholly herein. A copy may be obtained from the Office of the Parish Clerk, Suite 6700, Jefferson Parish General Government Building, 200 Derbigny Street, Gretna, LA 70053. You may also obtain a copy by visiting the Purchasing Department webpage at <http://purchasing.jeffparish.net> and clicking on Online Forms.

ADDITIONAL REQUIREMENTS FOR THIS BID

PLEASE MATCH THE NUMBERS PRINTED IN THIS BOX WITH THE CORRESPONDING INSTRUCTIONS BELOW.

10,12,13,15

1. All bidders must attend the MANDATORY pre-bid conference and will be required to sign in and out as evidence of attendance. In accordance with LSA R.S. 38:2212(I), all prospective bidders shall be present at the beginning of the MANDATORY pre-bid conference and shall remain in attendance for the duration of the conference. Any prospective bidder who fails to attend the conference or remain for the duration shall be prohibited from submitting a bid for the project.
2. Attendance to this pre-bid conference is optional. However, failure to attend the pre-bid conference shall not relieve the bidder of responsibility for information discussed at the conference. Furthermore, failure to attend the pre-bid conference and inspection does not relieve the successful bidder from the necessity of furnishing materials or performing any work that may be required to complete the work in accordance with the specification with no additional cost to the owner.
3. Contractor must hold current applicable JEFFERSON PARISH licenses with the Department of Inspection and Code Enforcement. Contractor shall obtain any and all permits required by the JEFFERSON PARISH Department of Inspection and Code Enforcement. The contractor shall be responsible for the payment of these permits. All permits must be obtained prior to the start of the project. Contractor must also hold any and all applicable Federal and State licenses. Contractor shall be responsible for the payment of these permits and shall obtain them prior to the start of the project.

INSTRUCTIONS FOR BIDDERS AND GENERAL CONDITIONS

4. A LA State Contractor's License will be required in accordance with LSA R.S. 37-2150 et. seq. and such license number will be shown on the outside of the bid electronic envelope. Failure to comply will cause the bid to be rejected. When submitting the bid electronically, the license number must be entered in the appropriate field in the electronic procurement system. Failure to comply will cause the bid to be rejected.
5. It is the bidder's responsibility to visit the job site and evaluate the job before submitting a bid.
6. Job site must be clean and free of all litter and debris daily and upon completion of the contract. Passageways must be kept clean and free of material, equipment, and debris at all times. Flammable material must be removed from the job site daily because storage will not be permitted on the premises. Precaution must be exercised at all times to safeguard the welfare of JEFFERSON PARISH and the general public.
7. PUBLIC WORKS BIDS: All awards for public works in excess of \$5,000.00 will be reduced to a formal contract which shall be recorded at the contractor's expense with the Clerk of Court and Ex-Officio Recorder of Mortgages for the Parish of Jefferson. A price list of recordation costs may be obtained from the Clerk of Court and Ex-Officio Recorder of Mortgages for the Parish of Jefferson. All awards in excess of \$25,000.00 will require both a performance and a payment bond. Unless otherwise stated in the bid specifications, the performance bond requirements shall be 100% of the contract price. Unless otherwise stated in the bid specifications, the payment bond requirements shall be 100% of the contract price. Both bonds shall be supplied at the signing of the contract.
8. NON-PUBLIC WORKS BIDS: A performance bond will be required for this bid. The amount of the bond will be 100% of the contract price unless otherwise indicated in the specifications. The performance bond shall be supplied at the signing of the contract.
9. NON-PUBLIC WORKS BIDS: A payment bond will be required for this bid. The amount of the bond will be 100% of the contract price unless otherwise indicated in the specifications. The payment bond shall be supplied at the signing of the contract.
10. All bidders must comply with the requirements stated in the attached "Standard Insurance Requirements" sheet attached to this bid solicitation. Failure to comply with this instruction will result in bid rejection.
11. A bid bond will be required with bid submission in the amount of 5% of the total bid, unless otherwise stated in the bid specifications. All sureties must be in original format (no copies) When submitting a bid online, vendors must submit an electronic bid bond through the respective online clearinghouse bond management system(s) as indicated in the electronic bid solicitation on Central Auction House. No scanned paper copies of any bid bond will be accepted as part of the electronic bid submission.
12. This is a requirements contract to be provided on an as needed basis. JEFFERSON PARISH makes no representations on warranties with regard to minimum guaranteed quantities unless otherwise stated in the bid specifications.
13. Freight charges should be included in total cost when quoting. If not quoted FOB DELIVERED, freight must be quoted as a separate item. Bid may be rejected if not quoted FOB DELIVERED or if freight charges are not indicated on bid form.
14. PUBLIC WORKS BIDS - Completed, Signed and Properly Notarized Affidavits Required; This applies to all solicitations for construction, alteration or demolition of public buildings or projects, in conformity with the provisions contained in LSA-RS 38:2212.9, LSA-RS 38:2212.10, LSA-RS 38:2224, and Sec 2-923.1 of the Jefferson Parish Code of Ordinances. For bidding purposes, all bidders must submit with bid submission COMPLETED, SIGNED and PROPERLY NOTARIZED Affidavits, including: Non-Conviction Affidavit, Non-Collusion Affidavit, Campaign Contribution Affidavit, Debt Disclosures Affidavit and E-Verify Affidavit. For the convenience of vendors, all affidavits have been combined into one form entitled PUBLIC WORKS BID AFFIDAVIT. This affidavit must be submitted in its original format, and without material alteration, in order to be compliant and for the bid to be considered responsive. A scanned copy of the completed, signed and properly notarized affidavit may be submitted with the bid, however, the successful bidder must submit the original affidavit in its original format and without material alteration upon contract execution. Failure to comply will result in the bid submission being rejected as non-responsive. The Parish reserves the right to award bid to the next lowest responsive and responsible bidder in this event.

INSTRUCTIONS FOR BIDDERS AND GENERAL CONDITIONS

15. NON PUBLIC WORK BIDS - Completed, Signed and Properly Notarized Affidavits Required in conformity with the provisions contained in LSA – RS 38:2224 and Sec 2-923.1 of the Jefferson Parish Code of Ordinances. For bidding purposes, all bidders must submit with bid submission COMPLETED, SIGNED and PROPERLY NOTARIZED Affidavits, including: Non-Collusion Affidavit, Debt Disclosures Affidavit and Campaign Contribution Affidavit. For the convenience of vendors, all affidavits have been combined into one form entitled NON PUBLIC WORKS BID AFFIDAVIT. This affidavit must be submitted in its original format, and without material alteration, in order to be compliant and for the bid to be considered responsive. A scanned copy of the completed, signed and properly notarized affidavit may be submitted with the bid, however, the successful bidder must submit the original affidavit in its original format and without material alteration upon contract execution. Failure to comply will result in the bid submission being rejected as non-responsive. The Parish reserves the right to award bid to the next lowest responsive and responsible bidder in this event.

16. The ensuing contract for this bid solicitation may be eligible for FEMA reimbursement and/or Federal funding/reimbursement. As such, the referenced appendix will be applicable accordingly and shall be considered a part of the bid documents. All applicable certifications must be duly completed, signed and submitted with bid submission. Failure to submit applicable certifications with bid submission will result in bid rejection.

17. For this project, the Contractor shall not pay any state or local sales or use taxes on materials and equipment which are affixed and made part of the immovable property of the project or which is permanently incorporated in the project (hereinafter referred to as "applicable materials and equipment."). All purchases of applicable materials or equipment shall be made by the contractor on behalf of and as the agent of Jefferson Parish (Owner), a political subdivision of the State of Louisiana. No state and local sales and use taxes are owed on applicable materials and equipment under the provisions of Act 1029 of the 1991 Regular Session - Louisiana Revised Statute 47:301(8)(c). Owner will furnish to contractor a certificate form which certifies that Owner is not required to pay such state or local sales and use taxes, and contractor shall furnish a copy of such certificate to all vendors or suppliers of the applicable materials and equipment, and report to Owner the amount of taxes not incurred.

It shall be the duty of every parish officer, employee, department, agency, special district, board, and commission: and the duty of every contractor, subcontractor, and licensee of the parish, and the duty of every applicant for certification of eligibility for a parish contract or program, to cooperate with the Inspector General in any investigation, audit, inspection, performance review, or hearing pursuant to JPCO 2-155.10(19). By signing this document, every corporation, partnership, or person contracting with PARISH, whether by cooperative endeavor, intergovernmental agreement, bid, proposal, application or solicitation for a parish contract, and every application for certification of eligibility for a parish contract or program, attests that it understands and will abide by all provisions of JPCO 2-155.10.

DATE: 6/16/2021

Page: 6

BID NO.: 50-00134664

BID FORM
Non Public Works

All Public Work Projects are required to use the Louisiana Uniform Public Work Bid Form

All prices must be held firm unless an escalation provision is requested in this bid. Jefferson Parish will allow one escalation during the term of the contract, which may not exceed the U.S. Bureau of Labor Statistics National Index for all Urban Consumers, unadjusted 12 month figure. The most recently published figure issued at the time an adjustment is requested will be used. A request must be made in writing by the vendor, and the escalation will only be applied to purchases made after the request is made.

Are you requesting an escalation provision?

YES _____ NO ☒

MAXIMUM ESCALATION PERCENTAGE REQUESTED _____%

INITIAL BID PRICES WILL REMAIN FIRM THROUGH THE DATE OF _____

For the purposes of comparison of bids when an escalation provision is requested, Jefferson Parish will apply the maximum escalation percentage quoted by the bidder to the period to which it is applied in the bid. The initial price and the escalation will be used to calculate the total bid price. It will be assumed, for comparison of prices only, that an equal amount of material or labor is purchased each month throughout the entire contract.

DELIVERY: FOB JEFFERSON PARISH

INDICATE DELIVERY DATE ON EQUIPMENT AND SUPPLIES

2-3 weeks

LOUISIANA CONTRACTOR'S LICENSE NO.: (if applicable) _____

THIS SECTION MUST BE COMPLETED BY BIDDER:

FIRM NAME: Ferguson Enterprises
DBA Louisiana Utilities Supply Co.
ADDRESS: 901 S. Labarre Rd, Suite 206
Metairie, La 70001

CITY, STATE: _____ ZIP: _____

TELEPHONE: (504) 831-1106 FAX: (504) 831-4179

EMAIL ADDRESS: Cathy.McCarthy@ferguson.com

In the event that addenda are issued with this bid, bidders MUST acknowledge all addenda on the bid form. Bidder must acknowledge receipt of an addendum on the bid form by placing the addendum number as indicated. Failure to acknowledge any addendum on the bid form will result in bid rejection.

Acknowledge Receipt of Addenda: NUMBER: _____
NUMBER: _____
NUMBER: _____
NUMBER: _____

TOTAL PRICE OF ALL BID ITEMS: \$ 91,430.00

AUTHORIZED SIGNATURE: Cathy A. McCarthy

TITLE: Branch Manager

Cathy A. McCarthy
Printed Name

SIGNING INDICATES YOU HAVE READ AND COMPLY WITH THE INSTRUCTIONS AND CONDITIONS.

NOTE: All bids should be returned with the BID NUMBER and BID OPENING DATE indicated on the outside of the envelope submitted to the Purchasing Department.

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00134664

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
			ONE (1) YEAR CONTRACT FOR SUPPLY OF CLAMPS, SADDLES & TAPPING SLEEVES FOR THE JEFFERSON PARISH DEPARTMENT OF PUBLIC WORKS - WATER AND ALL JEFFERSON PARISH AGENCIES AND MUNICIPALITIES.		
1	13.00	EA	0010 SADDLE, FLEXIBLE TAPPING, FOR 8 INCH SEWER PIPE WITH 6 INCH WYE OUTLET	53.00	689.00
			STAINLESS STEEL STRAPS STOCK NO. 00-132550		
2	35.00	EA	0020 SADDLE, BRONZE, 2 INCH X INCH CC TAP, O.D. 2.13 FOR CTS, NO LEAD	41.00	1435.00
			BRASS GASKET IS SBR TWINSEAL DUAL O-RING STOCK NO. 00-0160360		
3	15.00	EA	0030 SADDLE, BRONZE, 2 INCH X 1 INCH CC TAP, O.D. 2.13 FOR CTS. NO LEAD	41.00	615.00
			BRASS, GASKET IS SBR TWINSEAL DUAL O-RING STOCK NO 00-0160370		
4	20.00	EA	0040 SADDLE, DOUBLE STRAP, 4 INCH X INCH CC TAP, 8 INCH WIDTH, 2 INCH	59.00	1180.00
			PAGE 2 WIDE STRAPS, ALL STAINLESS STEEL O.D. RANGE 04.36 - 05.6 STOCK NO. 00-0160400		
5	6.00	EA	0050 SADDLE, DOUBLE STRAP, 4 INCH X 1 INCH CC TAP, 8 INCH WIDTH, 2 INCH	59.00	354.00
			STRAPS STOCK NO. 00-0160500		
6	5.00	EA	0060 SADDLE, DOUBLE STRAP CLAMP, 4 IN X 2 IN CC TAP, O.D. RANGE 04.40 -	86.00	430.00
			05.70, (S, CI & T) STOCK NO. 00-0160550		
7	54.00	EA	0070 SADDLE, DOUBLE STRAP, 6 INCH X 3/4 INCH CC TAP, O.D. RANGE 06.45 TO	67.00	3618.00
			07.75, ALL STAINLESS STEEL STOCK NO. 00-0160850		
8	73.00	EA	0080 SADDLE, DOUBLE STRAP, 6 INCH X 1 INCH CC TAP, 8 INCH WIDTH, 2 INCH	67.00	4891.00

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00134664

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
9	24.00	EA	STRAPS ALL STAINLESS, O.D. 06.43 - 07.73 STOCK NO. 00-0160900 0090 SADDLE, DOUBLE STRAP, 6 INCH X 2 INCH CC TAP, O.D. RANGE 06.45 TO 07.75	93. ⁰⁰	2232. ⁰⁰
10	295.00	EA	ALL STAINLESS STEEL STOCK NO. 00-0161150 0100 SADDLE, DOUBLE STRAP, 8 INCH X 3/4 INCH CC TAP, 8 INCH WIDTH, 2 INCH	72. ⁰⁰	21,240. ⁰⁰
11	132.00	EA	STRAPS ALL STAINLESS, O.D. RANGE 08.52 - 09.82 STOCK NO. 161200 0110 SADDLE, DOUBLE STRAP, 8 INCH X 1 INCH CC TAP, 8 INCH WIDTH, 2 INCH STRAPS	72. ⁰⁰	9504. ⁰⁰
12	30.00	EA	ALL STAINLESS, O.D. RANGE 08.52 - 09.82 STOCK NO. 00-161400 0120 SADDLE, DOUBLE STRAP, 8 INCH X 2 INCH CC TAP, 8 IN WIDTH, 2 INCH WIDE	98. ⁰⁰	2940. ⁰⁰
13	2.00	EA	STRAPS, ALL STAINLESS STEEL O.D. RANGE 08.52 - 09.82 STOCK NO. 00-0161450 0130 SADDLE, DOUBLE STRAP, 10 INCH X 3/4 INCH CC TAP, O.D. RANGE 10.70 - 12.00	73. ⁰⁰	146. ⁰⁰
14	7.00	EA	ALL STAINLESS STEEL STOCK NO. 00-0161800 0140 SADDLE, DOUBLE STRAP CLAMP, 10 INCH X 1 INCH, O.D. RANGE 10.70 - 12.00 INCH	73. ⁰⁰	511. ⁰⁰
15	40.00	EA	CI & T STOCK NO. 00-0161900 0150 SADDLE, DOUBLE STRAP, 12 INCH X 3/4 INCH CC TAP, 8 INCH WIDTH, 2 INCH	75. ⁰⁰	3000. ⁰⁰
16	1.00	EA	STRAPS STAINLESS, GRADE 30 GASKET, O.D. RANGE 13.14 - 14.44 STOCK NO. 00-0162100 0160 SADDLE, DOUBLE STRAP, 12 INCH X 1 INCH CC TAP, 8 INCH WIDTH, 2 INCH WIDE	75. ⁰⁰	75. ⁰⁰

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00134664

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
17	21.00	EA	STRAPS, ALL STAINLESS STEEL, O.D. RANGE 12.00 - 13.30 STOCK NO. 00-0162400 0170 SADDLE, DOUBLE STRAP, 12 INCH X 1 INCH CC TAP, 8 INCH WIDTH, 2 INCH WIDE	75.00	1575. ⁰⁰
18	3.00	EA	STRAPS, ALL STAINLESS STEEL, O.D. RANGE 13.14 - 14.44 STOCK NO. 00-0162450 0180 SADDLE, DOUBLE STRAP, 12 INCH X 2 INCH CC TAP, 8 INCH WIDTH, 2 INCH WIDE	111.00	333. ⁰⁰
19	3.00	EA	STRAPS, ALL STAINLESS STEEL, O.D. RANGE 12.30 - 13.60 STOCK NO. 00-0162500 0190 SADDLE, DOUBLE STRAP (DSC), 12 INCH X 2 INCH CC TAP, 8 INCH WIDTH, 2 INCH	111.00	333. ⁰⁰
20	14.00	EA	WIDE STRAPS, ALL STAINLESS STEEL, O.D. RANGE 13.30 - 14.60 STOCK NO. 00-0162650 0200 SADDLE, DOUBLE STRAP, 12 INCH X 2 INCH CC TAP, 8 INCH WIDTH, 2 INCH WIDE	111.00	1554. ⁰⁰
21	1.00	EA	STRAPS, ALL STAINLESS STEEL, O.D. RANGE 13.14 - 14.44 STOCK NO. 00-0162660 0210 SADDLE, DOUBLE STRAP CLAMP, 14 INCH X 1 INCH CC, O.D. RANGE 15.40 INCH - 16.70 INCH STOCK NO 00-0162730	115.00	115. ⁰⁰
22	4.00	EA	0220 SADDLE, DOUBLE STRAP, 16 INCH X 3/4 INCH CC TAP, O.D. RANGE 17.20 - 18.50 ALL STAINLESS STEEL STOCK NO. 00-0162800	121. ⁰⁰	484. ⁰⁰
23	3.00	EA	0230 SADDLE, DOUBLE STRAP CLAMP, 16 INCH X 1 INCH CC TAP, O.D. RANGE 17.20 - 18. 50 CAST IRON & TRANSITE STOCK NO 00-0162900	121.00	363. ⁰⁰
24	1.00	EA	0240 SADDLE, DOUBLE STRAP, 20 INCH X 1 INCH CC TAP, O.D. RANGE 22.95 - 24.35, ALL STAINLESS STEEL	127. ⁰⁰	127. ⁰⁰

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00134664

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
			STOCK NO. 00-0163040		
25	1.00	EA	0250 SADDLE, DOUBLE STRAP, 36 INCH X 3/4 INCH NPT OUTLET, 8 INCH WIDTH, O.D.	385.00	385.00
			RANGE 37.90 - 39.10, ALL STAINLESS STEEL TYPE T-304 STOCK NO. 00-0170240		
26	19.00	EA	0260 CLAMP, 2 INCH X 3/4 INCH CC TAP X 8 INCH LONG, ALL STAINLESS, 2.35 - 2.63	44.00	836.00
			RANGE, FULL GASKET STOCK NO. 00-0160200		
27	21.00	EA	0270 CLAMP, SINGLE BAND, 2 INCH X 3/4 INCH CC X 8 INCH WIDE, ALL STAINLESS	44.00	924.00
			FULL FACED GASKET, O.D. RANGE 2.10 - 2.30 STOCK NO. 00-0160250		
28	10.00	EA	0280 CLAMP, 2 INCH X 1 INCH CC TAP X 8 INCH LONG, ALL STAINLESS STEEL, 1.99 -	44.00	440.00
			2.15 RANGE, FULL GASKET STOCK NO. 00-0160300		
29	26.00	EA	0290 CLAMP, SINGLE STRAP CLAMP, 2 INCH X 3/4 INCH CC TAP, STAINLESS STEEL, O.D	44.00	1144.00
			RANGE 02.35 - 02.50 STOCK NO. 00-016030A		
30	5.00	EA	0300 CLAMP, 2 INCH X 1 CC TAP X 8 INCH LONG, ALL STAINLESS, 2.32 - 2.63 RANGE	44.00	220.00
			FULL GASKET, CASCADE #CRT1-2.38-8-1CC STOCK NO. 00-0160350		
31	1.00	EA	0310 CLAMP, BELL JOINT, FOR 36 INCH CAST IRON PIPE, STAINLESS STEEL BOLTS	1525.00	1525.00
			AND NUTS STOCK NO. 00-016390		
32	7.00	EA	0320 CLAMP, FULL CIRCLE, 6 INCH, SINGLE BAND, 12 IN WIDTH, O.D. RANGE 06.85 -	71.00	497.00
			07.25 INCH, CI & T STOCK NO. 00-0165110		
33	10.00	EA	0330 CLAMP FULL CIRCLE STAINLESS STEEL 6 X 15 O.D. RANGE 5.85 - 6.35 SEW	84.00	840.00

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00134664

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
34	4.00	EA	STOCK NO. 00-0165120 0340 CLAMP, 6 INCH X 16 INCH WIDE, O.D. RANGE 06.55 - 06.95, ALL STAINLESS STEEL	88. ⁰⁰	352. ⁰⁰
35	4.00	EA	FULL CIRCLE STOCK NO. 00-0165140 0350 CLAMP, SINGLE BAND, 6 INCH (FCC) 12 INCH WIDTH O.D. RANGE 06.45 - 06.85	72. ⁰⁰	288. ⁰⁰
36	2.00	EA	INS STOCK NO. 00-0165160 0360 CLAMP, SINGLE BAND, 6 INCH (FCC), 12 INCH WIDTH, O.D. RANGE 07.25 - 07.65	72. ⁰⁰	144. ⁰⁰
37	4.00	EA	T STOCK NO. 00-0165170 0370 CLAMP, FULL CIRCLE (FCC), SINGLE BAND, ALL STAINLESS STEEL, 6 INCH X 15	88. ⁰⁰	352. ⁰⁰
38	14.00	EA	INCH WIDTH, O.D. RANGE 07.25 - 07.65 T STOCK NO. 00-0165180 0380 CLAMP, 6 INCH X 15 INCH LONG, ALL STAINLESS, 7.25 - 7.65 O.D. RANGE,	88. ⁰⁰	1232. ⁰⁰
39	26.00	EA	SINGLE BAND, FULL GASKET STOCK NO. 00-0165190 0390 CLAMP, PIPE REPAIR, 8 INCH X 15 INCH LONG, SINGLE BAND, ALL STAINLESS	106. ⁰⁰	2650. ⁰⁰
40	17.00	EA	O.D. RANGE 08.99 - 09.39, BUNA FULL FACED GASKET STOCK NO. 00-0165500 0400 CLAMP, PIPE REPAIR, 8 INCH X 16 INCH LONG, SINGLE BAND, ALL STAINLESS	108. ⁰⁰	1836. ⁰⁰
41	4.00	EA	STEEL, O.D. RANGE 09.40 - 09.80, FULL FACED GASKET STOCK NO. 00-0165900 0410 CLAMP, FULL CIRCLE, SINGLE BAND 10 INCH X 16 INCH LONG, O.D. RANGE 10.95 -	138. ⁰⁰	552. ⁰⁰
42	3.00	EA	11.35, STAINLESS STEEL STOCK NO. 00-0166010 0420 CLAMP, SINGLE BAND, 10 INCH (FCC) 15 INCH WIDTH, O.D. RANGE 11.75 - 12.15T	138. ⁰⁰	414. ⁰⁰

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00134664

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
43	2.00	EA	STOCK NO. 00-0166100 0430 CLAMP, DOUBLE BAND, 20 INCH X 24 INCH, O.D. RANGE 23.14 - 24.34 STAINLESS STEEL STOCK NO. 00-0167810	500. ⁰⁰	1000. ⁰⁰
44	46.00	EA	0440 CLAMP, PIPE REPAIR, 6 INCH X 1 INCH CC TAP X 15 INCH LONG, ALL STAINLESS 06.84 - 07.24 RANGE, SINGLE BAND FULL GASKET STOCK NO. 00-0170100	111.00	5106. ⁰⁰
45	5.00	EA	0450 CLAMP, PIPE REPAIR, 8 INCH X 3/4 INCH CC TAP X 15 INCH LONG, ALL STAINLESS, 08.99 - 09.39 O.D. RANGE, SINGLE BAND, FULL GASKET STOCK NO. 00-0170120	130. ⁰⁰	650. ⁰⁰
46	5.00	EA	0460 CLAMP, SINGLE BAND, 6 INCH X 3/4 INCH CC TAP X 16 INCH LONG, ALL STAINLESS, 07.25 - 07.65 O.D. RANGE FULL GASKET STOCK NO. 00-0170400	110.00	550.00
47	4.00	EA	0470 CLAMP, 2 INCH X 12 INCH LONG, ALL STAINLESS STEEL, 02.35 - 02.83 RANGE, FULL GASKET STOCK NO. 00-016460A	48. ⁰⁰	192. ⁰⁰
48	1.00	EA	0480 CLAMP, BELL JOINT, 8 IN, STAINLESS BOLTS/NUTS, SHOPCOAT STOCK NO. 00-016320	212. ⁰⁰	212. ⁰⁰
49	3.00	EA	0490 CLAMP, BELL JOINT, 12 IN, FOR SHOULDERLESS CAST IRON/DUCTILE IRON PIPE, TO HAVE BAKED ON BLUE TEFLON, STOCK NO. 00-0163400	310. ⁰⁰	630. ⁰⁰
50	2.00	EA	0500 CLAMP, 1-1/2 INCH X 8 INCH LONG, 1.88 - 1.92 RANGE, ALL STAINLESS STEEL, FULL GASKET STOCK NO. 00-0164550	44. ⁰⁰	88. ⁰⁰
51	6.00	EA	0510 CLAMP, 1-1/2 IN X 1 CC TAP X 8 IN LONG, ALL STAINLESS, 1.90 OD. FOR	70. ⁰⁰	420. ⁰⁰

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00134664

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
52	24.00	EA	FOR GALVANIZED PIPE, STOCK NO. 00-0164570 0520 CLAMP, 2 INCH X 6 INCH LONG, ALL STAINLESS, 2.35 - 2.63 RANGE, FULL	43.00	1032.00
53	8.00	EA	GASKET STOCK NO. 00-0164600 0530 CLAMP, 4 INCH X 15 INCH LONG, SINGLE BAND, ALL STAINLESS STEEL, O.D.	74.00	592.00
54	50.00	EA	RANGE 04.45 - 04.73 BUNA FULL FACE, STOCK NO. 00-0164940 0540 CLAMP, 6 INCH X 15 INCH LONG, ALL STAINLESS, 6.84 - 7.24 RANGE, SINGLE	92.00	4600.00
55	3.00	EA	BAND FULL GASKET STOCK NO. 00-016510 0550 SADDLE, DOUBLE STRAP, 6 INCH X INCH CC TAP, O.D. RANGE 06.45 - 07.75,	N/A	—
56	5.00	EA	ALL STAINLESS STEEL STOCK NO. 00-0165940 <i>Not enough information</i>	236.00	1180.00
57	1.00	EA	0560 CLAMP, 12 INCH X 20 INCH LONG, SINGLE BAND, ALL STAINLESS STEEL INCLUDING BOLTS/NUTS, O.D. RANGE 13.10 - 13.50, SBR STOCK NO. 00-0166600	545.00	545.00
58	1.00	EA	0570 CLAMP, 18 IN X 20 IN LONG, ALL STAINLESS, 19.23 - 19.98 RANGE, FULL GASKET STOCK. NO. 00-0167700	106.00	106.00
59	1.00	EA	0580 CLAMP, 4 INCH X 2 INCH CC TAP X 12 INCH LONG, ALL STAINLESS, 4.75 - 5.15 RANGE, DOMESTIC STOCK NO. 00-0170080	92.00	92.00
60	2.00	EA	0590 CLAMP, 6 INCH X INCH CC TAP X 15 INCH LONG, ALL STAINLESS, 6.84 TO 7.24 RANGE, SINGLE BAND, FULL GASKET STOCK NO. 00-0170090	140.00	280.00
			0600 CLAMP, PIPE, SINGLE BAND, 8 INCH X 1 INCH CC TAP X 16 INCH LONG, ALL		

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00134664

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
61	5.00	EA	STAINLESS, 9.00 - 9.40 RANGE, FULL GASKET STOCK NO. 00-0170130 0610 CLAMP, PIPE, 6 INCH X 1 INCH CC TAP X 15 INCH LONG, ALL STAINLESS, 7.25 TO 7.65 RANGE, SINGLE BAND, FULL GASKET STOCK NO. 00-0170410	108. ⁰⁰	540. ⁰⁰
62	5.00	EA	0620 CLAMP, PIPE, 8 INCH X 1 INCH CC TAP X 15 INCH LONG, ALL STAINLESS, 9.40 TO 9.80 RANGE, SINGLE BAND, FULL GASKET, STOCK NO. 00-0170440	140. ⁰⁰	700. ⁰⁰
63	2.00	EA	0630 CLAMP, SINGLE BAND, 12 IN X CC TAP X 20 IN LONG, ALL STAINLESS, 13.55 - 13.95 RANGE STOCK NO. 00-0170500	270. ⁰⁰	540. ⁰⁰
64	3.00	EA	0640 CLAMP, PATCH, 1 INCH X 8 INCH LONG, ALL STAINLESS, 1.12 TO 1.32 O.D., TAPERED WAFFLE GASKET, FULL CIRCLE, STOCK NO. 00-0184500 <i>Patch Clamps Do not have a Range</i>	N/A	—

**SECRETARIAL CERTIFICATE
OF
AUTHORIZATION**


The undersigned Assistant Secretary of Ferguson Enterprises, LLC., a Virginia limited liability company (the "Company"), hereby certifies that: i) certain of the Company's facilities in Louisiana are doing business as Louisiana Utilities Supply Company, and ii) Cathy McCarthy is Branch Manager in Louisiana and iii) that the resolutions adopted by the Company's Board of Directors effective July 31, 2020, duly authorize certain of the Company's officers, including the Assistant Secretary, to designate, and I hereby do so designate Cathy McCarthy as an authorized representative of the Company to act for and on behalf of the Company to prepare and submit bids and proposals to the Company's customers, to enter into contracts, agreements or other documents, and to execute such documents and undertake all such acts as may be deemed in the best interest of the Company, including the execution of bonds and in doing so, to contractually bind the Company. Unless withdrawn sooner, this certification of authorization shall be effective until January 31, 2022.

Dated: 12/22/2020

FERGUSON ENTERPRISES, LLC

By: _____

Wesley E. Rice, Assistant Secretary

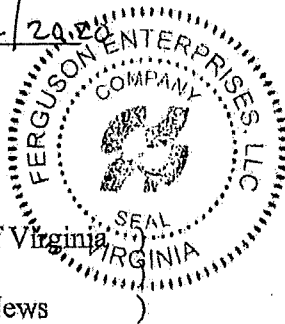


Commonwealth of Virginia)

City of Newport News)

Sworn to subscribed and acknowledged before me this 22nd day of December, 2020, by Wesley E. Rice, personally known to me, in his capacity as Assistant Secretary of Ferguson Enterprises, LLC, a Virginia Company, on behalf of such Company.

Notary - Casey Mehlhoff

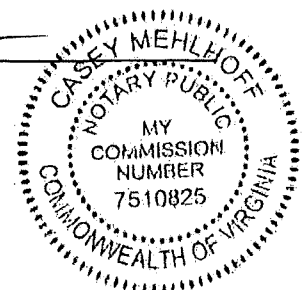

My commission expires: 7/31/2022

CORPORATE RESOLUTION

EXCERPT FROM MINUTES OF MEETING OF THE BOARD OF DIRECTORS OF

INCORPORATED.

AT THE MEETING OF DIRECTORS OF _____
INCORPORATED, DULY NOTICED AND HELD ON _____,
A QUORUM BEING THERE PRESENT, ON MOTION DULY MADE AND SECONDED. IT
WAS:

RESOLVED THAT _____, BE AND IS HEREBY
APPOINTED, CONSTITUTED AND DESIGNATED AS AGENT AND ATTORNEY-IN-
FACT OF THE CORPORATION WITH FULL POWER AND AUTHORITY TO ACT ON
BEHALF OF THIS CORPORATION IN ALL NEGOTIATIONS, BIDDING, CONCERNS
AND TRANSACTIONS WITH THE PARISH OF JEFFERSON OR ANY OF ITS AGENCIES,
DEPARTMENTS, EMPLOYEES OR AGENTS, INCLUDING BUT NOT LIMITED TO, THE
EXECUTION OF ALL BIDS, PAPERS, DOCUMENTS, AFFIDAVITS, BONDS, SURETIES,
CONTRACTS AND ACTS AND TO RECEIVE ALL PURCHASE ORDERS AND NOTICES
ISSUED PURSUANT TO THE PROVISIONS OF ANY SUCH BID OR CONTRACT, THIS
CORPORATION HEREBY RATIFYING, APPROVING, CONFIRMING, AND ACCEPTING
EACH AND EVERY SUCH ACT PERFORMED BY SAID AGENT AND ATTORNEY-IN-
FACT.

I HEREBY CERTIFY THE FOREGOING TO BE
A TRUE AND CORRECT COPY OF AN
EXCERPT OF THE MINUTES OF THE ABOVE
DATED MEETING OF THE BOARD OF
DIRECTORS OF SAID CORPORATION, AND
THE SAME HAS NOT BEEN REVOKED OR
RESCINDED.

SECRETARY-TREASURER

DATE

Non-Public Works Bid Affidavit Instructions

- Affidavit is supplied as a courtesy to Affiants, but it is the responsibility of the affiant to insure the affidavit they submit to Jefferson Parish complies, in both form and content, with federal, state and parish laws.
- Affidavit must be signed by an authorized representative of the entity or the affidavit will not be accepted.
- Affidavit must be notarized or the affidavit will not be accepted.
- Notary must sign name, print name, and include bar/notary number, or the affidavit will not be accepted.
- Affiant **MUST** select either A or B when required or the affidavit will not be accepted.
- Affiants who select choice A must include an attachment or the affidavit will not be accepted.
- If both choice A and B are selected, the affidavit will not be accepted.
- Affidavit marked N/A will not be accepted.
- It is the responsibility of the Affiant to submit a new affidavit if any additional campaign contributions are made after the affidavit is executed but prior to the time the council acts on the matter.

Instruction sheet may be omitted when submitting the affidavit

Non-Public Works Bid

AFFIDAVIT

STATE OF LA

PARISH/COUNTY OF Jefferson

BEFORE ME, the undersigned authority, personally came and appeared: Cathy A
McCarthy, (Affiant) who after being by me duly sworn, deposed and said that
he/she is the fully authorized Branch Manager of Ferguson LLC DBA Louisiana
Utilities Supply (Entity),
the party who submitted a bid in response to Bid Number 5000134641 to the Parish of
Jefferson.

Affiant further said:

Campaign Contribution Disclosures

(Choose A or B, if option A is indicated please include the required
attachment):

Choice A _____ Attached hereto is a list of all campaign contributions, including
the date and amount of each contribution, made to current or
former elected officials of the Parish of Jefferson by Entity,
Affiant, and/or officers, directors and owners, including
employees, owning 25% or more of the Entity during the two-year
period immediately preceding the date of this affidavit or the
current term of the elected official, whichever is greater. Further,
Entity, Affiant, and/or Entity Owners have not made any
contributions to or in support of current or former members of the
Jefferson Parish Council or the Jefferson Parish President through
or in the name of another person or legal entity, either directly or
indirectly.

Choice B ☒ there are NO campaign contributions made which would require
disclosure under Choice A of this section.

Debt Disclosures

(Choose A or B, if option A is indicated please include the required attachment):

Choice A _____ Attached hereto is a list of all debts owed by the affiant to any elected or appointed official of the Parish of Jefferson, and any and all debts owed by any elected or appointed official of the Parish to the Affiant.

Choice B ☒ There are NO debts which would require disclosure under Choice A of this section.

Affiant further said:

That Affiant has employed no person, corporation, firm, association, or other organization, either directly or indirectly, to secure the public contract under which he received payment, other than persons regularly employed by the Affiant whose services in connection with the construction, alteration or demolition of the public building or project or in securing the public contract were in the regular course of their duties for Affiant; and

[The remainder of this page is intentionally left blank.]

That no part of the contract price received by Affiant was paid or will be paid to any person, corporation, firm, association, or other organization for soliciting the contract, other than the payment of their normal compensation to persons regularly employed by the Affiant whose services in connection with the construction, alteration or demolition of the public building or project were in the regular course of their duties for Affiant.

Cathy A. McCarthy
Signature of Affiant

Cathy A. McCarthy
Printed Name of Affiant

SWORN AND SUBSCRIBED TO BEFORE ME

ON THE 30th DAY OF June, 2021.

Shawn M. Laree
Notary Public

Shawn M LAREE
Printed Name of Notary

129314
Notary/Bar Roll Number

My commission expires At Death



SHAWN M. LAREE
NOTARY PUBLIC
NOTARY NO. 129314
MY COMMISSION EXPIRES AT DEATH

STANDARD INSURANCE REQUIREMENTS FOR BIDDING PURPOSES

All required insurance under this bid shall conform to Jefferson Parish Resolution No. 113646 or No. 113647, as applicable. Contractors may not commence any work under any ensuing contract unless and until all required insurance and associated evidentiary requirements thereto have been met, along with any additional specifications contained in the **Invitation to Bid**. Except as where otherwise precluded by law, the Parish Attorney or his designee, with the concurrence of the Director of Risk Management or his designee, may agree on a case-by-case basis, to deviate from Jefferson Parish's standard insurance requirements, as provided in this Section. Vendors requesting deviation therefrom shall submit such requests in writing, along with compelling substantiation, to the Purchasing Department prior to the bid's due date. Any changes to the insurance requirements will be reflected in the bid specifications and addenda. Prior to contract execution and at all times thereafter during the term of such contract, contractors must provide and continuously maintain all coverages as required by the foregoing Resolutions, and the contract documents. Failure to do so shall be grounds for suspension, discontinuation or termination of the contract.

For bidding purposes, bidders must submit with bid submission a current (valid) insurance certificate evidencing the required coverages. Failure to comply will cause bid to be rejected. The current insurance certificate will be used for proof of insurance at time of evaluation. Thereafter, and prior to contract execution, the low bidder will be required to provide final insurance certificates to the Parish which shall name **the Jefferson Parish, its Districts Departments and Agencies under the direction of the Parish President and the Parish Council** as additional insureds regarding negligence by the contractor for the Commercial General Liability and the Comprehensive Automobile Liability policies. Additionally, said certificates should reflect the name of the Parish Department receiving goods and services and reference the respective Jefferson Parish bid number.

JEFFERSON PARISH REQUIRED STANDARD INSURANCE

☒ WORKER'S COMPENSATION INSURANCE

As required by Louisiana State Statute, exception; Employer's Liability, Section B shall be \$1,000,000 per occurrence when Work is to be over water and involves maritime exposures to cover all employees not covered under the State Worker's Compensation Act, otherwise this limit shall be no less than \$500,000 per occurrence.

Note: If your company is not required by law to carry workmen's compensation insurance, i.e. not a Louisiana company, sole employee of the company, then bidders must request a workmen's compensation insurance declaration affidavit prior to the bid opening date. This insurance declaration affidavit must be fully completed, signed, properly notarized and submitted with the bid. A scanned copy may be submitted with the bid; however, the successful bidder must submit the original affidavit in its original format and without material alteration upon contract execution. Failure to comply will result in the bid submission being

rejected as non-responsive. The Parish reserves the right to award bid to the next lowest responsive and responsible bidder in this event.

☒ **COMMERCIAL GENERAL LIABILITY**

Shall provide limits not less than the following: \$1,000,000.00 Combined Single Limit per Occurrence for bodily injury and property damage.

☒ **COMPREHENSIVE AUTOMOBILE LIABILITY**

Bodily injury liability \$1,000,000.00 each person; \$1,000,000.00 each occurrence.
Property Damage Liability \$1,000,000.00 each occurrence.

Note: This category may be omitted if bidders do not/will not utilize company vehicles for the project or do not possess company vehicles. Bidder must request an automobile insurance declaration affidavit prior to the bid opening date. This insurance declaration affidavit must be fully completed, signed, properly notarized and submitted with the bid. A scanned copy of the completed, signed and properly notarized affidavit may be submitted with the bid; however, the successful bidder must submit the original affidavit in its original format and without material alteration upon contract execution. Failure to comply will result in the bid submission being rejected as non-responsive. The Parish reserves the right to award bid to the next lowest responsive and responsible bidder in this event.

DEDUCTIBLES - The Parish Attorney with concurrence of the Director of Risk Management have waived the deductible section of the Terms and Conditions for all Invitations to Bid, until further notice.

UMBRELLA LIABILITY COVERAGE

An umbrella policy or excess may be used to meet minimum requirements.

FOR CONSTRUCTION AND RENOVATION PROJECTS:

The following are required if selected below. Such insurance is due upon contract execution.

☐ **OWNER'S PROTECTIVE LIABILITY**

To be for the same limits of liability for bodily injury and property damage liability established for commercial general liability.

☐ **BUILDER'S RISK INSURANCE**

The contractor shall maintain Builder's Risk Insurance at his own expense to insure both the owner (Parish of Jefferson) and contractor as their interest may appear.



JEFFERSON PARISH

DEPARTMENT OF PURCHASING

CYNTHIA LEE SHENG
PARISH PRESIDENT

RENNY SIMNO
DIRECTOR

September 2020

Changes to Jefferson Parish Bidding Information

The Jefferson Parish Purchasing Department would like to make vendors aware of the following changes:

Total Bid Price Must Include the Cost of Naming Jefferson Parish as Additional Insured:

Bidder acknowledges that Bidder recovered the cost of any required insurance in the contract price as required by La.R.S. 9:2780.1 and that Bidder recovered any such cost for the purposes of insuring an obligation to indemnify Jefferson Parish, defend Jefferson Parish, or hold Jefferson Parish harmless and that Bidder's indemnity liability is limited to the amount of the proceeds that are payable under the insurance policy or policies that Bidder has obtained.

Electronic Procurement: Beginning November 1, 2020, Jefferson Parish will no longer accept manual bid submissions; and will only accept bid submissions electronically via our e-Procurement system, Central Bidding. Central Bidding can be accessed by visiting either www.centralbidding.com or www.jeffparishbids.net. All bidders will be required to register with Central Bidding. Jefferson Parish vendors are able to register for free by accessing the following link: <https://www.centrauctionhouse.com/registration.php>.

Probable Construction Cost: Per Jefferson Parish Administrative Policy, the probable construction cost is not revealed in the Jefferson Parish Bidding Documents. Jefferson Parish Administrative Policy has changed and a range of the probable construction cost will be stated in the Jefferson Parish bidding document, entitled Important Notice to All Bidders – Bid Requirements. Per Louisiana Public Bid Law, the probable construction cost will be read at the bid opening.

Insurance Requirement: All bidders must provide proof of valid insurance in the required amounts as stated in the Standard Insurance Requirements for bidding purposes. Failure to provide the proof of valid insurance in all of the required coverage amounts will result in bid rejection.

GENERAL GOVERNMENT BLDG. – 200 DERBIGNY ST., SUITE 4400, GRETNA, LA 70053
OFFICE 504.364.2678

JOSEPH S. YENNI BLDG. – 1221 ELMWOOD PARK BLVD., SUITE 404, JEFFERSON, LA 70123
OFFICE 504.364.2678

EMAIL: PURCHASING@JEFFPARISH.NET WEBSITE: WWW.JEFFPARISH.NET



CERTIFICATE OF LIABILITY INSURANCE

Page 1 of 2

DATE (MM/DD/YYYY)
04/30/2021

THIS CERTIFICATE IS ISSUED AS A MATTER OF INFORMATION ONLY AND CONFERS NO RIGHTS UPON THE CERTIFICATE HOLDER. THIS CERTIFICATE DOES NOT AFFIRMATIVELY OR NEGATIVELY AMEND, EXTEND OR ALTER THE COVERAGE AFFORDED BY THE POLICIES BELOW. THIS CERTIFICATE OF INSURANCE DOES NOT CONSTITUTE A CONTRACT BETWEEN THE ISSUING INSURER(S), AUTHORIZED REPRESENTATIVE OR PRODUCER, AND THE CERTIFICATE HOLDER.

IMPORTANT: If the certificate holder is an ADDITIONAL INSURED, the policy(ies) must have ADDITIONAL INSURED provisions or be endorsed. If SUBROGATION IS WAIVED, subject to the terms and conditions of the policy, certain policies may require an endorsement. A statement on this certificate does not confer rights to the certificate holder in lieu of such endorsement(s).

PRODUCER Willis Towers Watson Northeast, Inc. c/o 26 Century Blvd P.O. Box 305191 Nashville, TN 372305191 USA	CONTACT NAME: Willis Towers Watson Certificate Center PHONE (A/C, No, Ext): 1-877-945-7378 FAX (A/C, No): 1-888-467-2378 E-MAIL ADDRESS: certificates@willis.com	
	INSURER(S) AFFORDING COVERAGE INSURER A: ACE American Insurance Company NAIC # 22667 INSURER B: ACE Property & Casualty Insurance Company 20699 INSURER C: Indemnity Insurance Company of North Ameri 43575 INSURER D: ACE Fire Underwriters Insurance Company 20702 INSURER E: INSURER F:	
INSURED Ferguson Enterprises, LLC and Subsidiaries (See Attached Named Insured Schedule) 12500 Jefferson Avenue Newport News, VA 23602		

COVERAGES

CERTIFICATE NUMBER: W20834451

REVISION NUMBER:

THIS IS TO CERTIFY THAT THE POLICIES OF INSURANCE LISTED BELOW HAVE BEEN ISSUED TO THE INSURED NAMED ABOVE FOR THE POLICY PERIOD INDICATED. NOTWITHSTANDING ANY REQUIREMENT, TERM OR CONDITION OF ANY CONTRACT OR OTHER DOCUMENT WITH RESPECT TO WHICH THIS CERTIFICATE MAY BE ISSUED OR MAY PERTAIN, THE INSURANCE AFFORDED BY THE POLICIES DESCRIBED HEREIN IS SUBJECT TO ALL THE TERMS, EXCLUSIONS AND CONDITIONS OF SUCH POLICIES. LIMITS SHOWN MAY HAVE BEEN REDUCED BY PAID CLAIMS.

INSR LTR	TYPE OF INSURANCE	ADDL INSD	SUBR WVD	POLICY NUMBER	POLICY EFF (MM/DD/YYYY)	POLICY EXP (MM/DD/YYYY)	LIMITS
A	<input checked="" type="checkbox"/> COMMERCIAL GENERAL LIABILITY	Y		HDO G72497466	05/01/2021	05/01/2022	EACH OCCURRENCE \$ 5,000,000
	<input type="checkbox"/> CLAIMS-MADE <input checked="" type="checkbox"/> OCCUR						DAMAGE TO RENTED PREMISES (Ea occurrence) \$ 5,000,000
							MED EXP (Any one person) \$ 5,000
							PERSONAL & ADV INJURY \$ 5,000,000
	GEN'L AGGREGATE LIMIT APPLIES PER:						GENERAL AGGREGATE \$ 10,000,000
	<input type="checkbox"/> POLICY <input checked="" type="checkbox"/> PRO-JECT <input checked="" type="checkbox"/> LOC						PRODUCTS - COMP/OP AGG \$ 10,000,000
	OTHER:						\$
A	AUTOMOBILE LIABILITY	Y		ISA H25550018	05/01/2021	05/01/2022	COMBINED SINGLE LIMIT (Ea accident) \$ 5,000,000
	<input checked="" type="checkbox"/> ANY AUTO						BODILY INJURY (Per person) \$
	<input type="checkbox"/> OWNED AUTOS ONLY <input type="checkbox"/> SCHEDULED AUTOS						BODILY INJURY (Per accident) \$
	<input checked="" type="checkbox"/> HIRED AUTOS ONLY <input checked="" type="checkbox"/> NON-OWNED AUTOS ONLY						PROPERTY DAMAGE (Per accident) \$
	<input checked="" type="checkbox"/> AUTOS ONLY self-insured <input checked="" type="checkbox"/> Physical Damage						\$
B	<input checked="" type="checkbox"/> UMBRELLA LIAB <input checked="" type="checkbox"/> OCCUR	Y		XOOG72519802 001	05/01/2021	05/01/2022	EACH OCCURRENCE \$ 2,000,000
	<input type="checkbox"/> EXCESS LIAB <input type="checkbox"/> CLAIMS-MADE						AGGREGATE \$ 2,000,000
	DED RETENTION \$						\$
C	WORKERS COMPENSATION AND EMPLOYERS' LIABILITY	N/A		WLR C67806943	05/01/2021	05/01/2022	<input checked="" type="checkbox"/> PER STATUTE <input type="checkbox"/> OTH-ER
	ANY PROPRIETOR/PARTNER/EXECUTIVE OFFICER/MEMBER EXCLUDED? (Mandatory in NH)						E.L. EACH ACCIDENT \$ 2,000,000
	If yes, describe under DESCRIPTION OF OPERATIONS below						E.L. DISEASE - EA EMPLOYEE \$ 2,000,000
							E.L. DISEASE - POLICY LIMIT \$ 2,000,000
A	Workers' Compensation & Employers Liability- AZ/CA/MA			WLR C67806980	05/01/2021	05/01/2022	E.L. Each Accident \$2,000,000
	Per Statute						E.L. Disease - Pol Lmt \$2,000,000
							E.L. Disease-Each Emp \$2,000,000

DESCRIPTION OF OPERATIONS / LOCATIONS / VEHICLES (ACORD 101, Additional Remarks Schedule, may be attached if more space is required)

Re: Resolution No. 125223

Workers Compensation Policy WLR C67806943 provides coverage for AK, AL, AR, CO, CT, DC, DE, FL, GA, HI, IA, ID, IL, IN, KS, KY, LA, MD, ME, MI, MN, MO, MS, MT, NC, NE, NH, NJ, NM, NV, NY, OK, OR, PA, RI, SC, SD, TN, TX, UT, VA, VT, WV.

SEE ATTACHED

CERTIFICATE HOLDER

The Parish of Jefferson, its Districts, Departments
Agencies under the direction of the Parish -
President and Parish Council
Engineering Department
1221 Elmwood Park Blvd., Ste. 802
Jefferson, LA 70123

CANCELLATION

SHOULD ANY OF THE ABOVE DESCRIBED POLICIES BE CANCELLED BEFORE THE EXPIRATION DATE THEREOF, NOTICE WILL BE DELIVERED IN ACCORDANCE WITH THE POLICY PROVISIONS.

AUTHORIZED REPRESENTATIVE

Michael M. Murch

© 1988-2016 ACORD CORPORATION. All rights reserved.

ACORD 25 (2016/03)

The ACORD name and logo are registered marks of ACORD

SR ID: 21028556

BATCH: 2077735

AGENCY CUSTOMER ID: _____

LOC #: _____

**ADDITIONAL REMARKS SCHEDULE**Page 2 of 2

AGENCY Willis Towers Watson Northeast, Inc.		NAMED INSURED Ferguson Enterprises, LLC and Subsidiaries (See Attached Named Insured Schedule)	
POLICY NUMBER See Page 1		12500 Jefferson Avenue Newport News, VA 23602	
CARRIER See Page 1	NAIC CODE See Page 1	EFFECTIVE DATE: See Page 1	

ADDITIONAL REMARKS

THIS ADDITIONAL REMARKS FORM IS A SCHEDULE TO ACORD FORM,

FORM NUMBER: 25 FORM TITLE: Certificate of Liability Insurance

The Parish of Jefferson, its Districts, Departments and Agencies under the direction of the Parish President and Parish Council are included as Additional Insureds under General Liability as required by written contract but only with respect to liability arising out of Named Insured's operations; Auto Liability and Umbrella/Excess Liability. Umbrella/Excess Follows Form.

INSURER AFFORDING COVERAGE: ACE Fire Underwriters Insurance Company

NAIC#: 20702

POLICY NUMBER: RWC C67807029 EFF DATE: 05/01/2021 EXP DATE: 05/01/2022

TYPE OF INSURANCE:	LIMIT DESCRIPTION:	LIMIT AMOUNT:
Workers' Compensation &	E.L. Each Accident	\$2,000,000
Employers Liability - WI	E.L. Disease -Pol Lmt	\$2,000,000
Per Statute	E.L. Disease-Each Emp	\$2,000,000

FERGUSON ENTERPRISES, LLC
ACTIVE DBA SUBSIDIARY LIST

<u>Entity Name</u>	<u>Entity Name</u>
AC Wholesalers	Ferguson HVAC – EastWest Air
ACF Environmental (effective 11/16/2020)	Ferguson HVAC – Lyon Conklin
Action Automation, a Wolseley Industrial Group company (eff 8/20/2018)	Ferguson Integrated Services
Action Plumbing Supply (effective 7/15/2019)	Ferguson International
ADL (effective 7/16/2018)	Ferguson Panama, S.A.
Alaska Pipe & Supply	Ferguson Parts & Packaging
Amerock, LLC (effective 1/11/2021)	Ferguson Valve & Automation
Amerock Holdings, Inc. (effective 1/11/2021)	Ferguson Waterworks
Andrews Lighting & Hardware Gallery	Ferguson Waterworks - Municipal Pipe
The Ar-Jay Center	Ferguson Waterworks - Red Hed
Atlantic American Fire Equipment Company	Ferguson Waterworks EPPCO
Avallon Global	Ferguson Waterworks International
BAC Appliance Center	Galleria Bath & Kitchen Showplace
Bath + Beyond	Grand Junction Pipe (effective 9/24/2018)
Bayport Partners, LLC	HM Wallace, Inc.
Blackman Plumbing Supply, LLC (effective 12/11/2018)	H. P. Products Corporation
Brock-McVey (effective 7/30/2018)	HP Logistic, Inc.
Bruce-Rogers Company	Improvement Brands Holdings, Inc.
Build.com, Inc. (fka Improvement Direct, Inc.)	Industrial Hub of the Carolinas
Cal-Steam	Innovative Soil Solutions LLC (effective 7/29/2019)
Capital Distributing (effective 10/29/2018)	James Martin Signature Vanities, LLC (effective 1/28/2019)
City Lights Design Showroom	J&G Products
CFP	Jones Stephens Corp. (effective 8/13/2018)
Clawfoot Supply, LLC	Jones Stephens Global Sourcing (Wuxi) Ltd. (effective 8/13/2018)
Cline Contract Sales	J.D. Daddario Company
Columbia Pipe & Supply LLC (eff 3/13/2020)	Joseph G. Pollard Co.
Custom Lighting & Hardware	JWIT Hydrotherapy Bath Solutions (effective 3/16/2020)
Davies Water	Karl's Appliances
DBS Holdings, Inc.	Kitchen Art (effective 2/4/2019)
Dealernet	Lakeland Plumbing Supply, LLC
Duhig Stainless (effective 3/12/2018)	Lighting Design Center
Energy & Process Corporation	Lighting Unlimited
Equarius Waterworks, Meter & Automation Group	Lincoln Products
Factory Direct Appliance	Linwood Pipe and Supply
Ferguson Bath & Kitchen Gallery	Living Direct, Inc.
Ferguson Bath, Kitchen & Lighting Gallery	Louisiana Utilities Supply Company
Ferguson.com	LUSCO
Ferguson CESCO, Inc.	Mahwah Realty, LLC
Ferguson Direct	Maskir Properties Inc.
Ferguson CeSCO, Inc.	Matera Paper Company, Inc.
Ferguson Enterprises, Inc.	Max Industries, Ltd. (effective 1/28/2019)
Ferguson Enterprises, LLC	McFarland Supply
Ferguson Enterprises of Virginia, LLC	MFP Design (effective 3/25/2020)
Ferguson Facilities Supply (FEI)	Michigan Meter
Ferguson Facilities Supply (for Matera Paper -TX only)	Millennium Lighting, Inc. (effective 8/27/2018)
Ferguson Facilities Supply, Dogwood Building Supply Division (eff 10/22/18)	Mission Valley Pipe (effective 6/3/2019)
Ferguson Fire & Fabrication, Inc.	Mississippi Utility Supply Co. (MUSCO)
Ferguson Fire & Fabrication International	Myers HVAC Supply
Ferguson Heating & Cooling	National Fire Products
Ferguson Hospitality Sales	New Jersey Plumbing Group, LLC
Ferguson HVAC – Air Cold	New York Plumbing Designs, LLC

FERGUSON ENTERPRISES, LLC
ACTIVE DBA SUBSIDIARY LIST

PAGE 2 - DBA & SUBSIDIARY LIST	
<u>Entity Name</u>	<u>Entity Name</u>
	Wolseley de Puerto Rico, Inc.
North Point Plumbing Supply, LLC	Wolseley Financial Services
Orange County Plumbing Group, LLC	Wolseley Industrial Group
Palm Designs LLC	Wolseley Integrated de Mexico S.A. de C.V.
PCS Industries	Wolseley Investments North America, Inc.
PL Sourcing	Wolseley Investments, Inc.
Plumb Source	Wolseley NA Construction Services, LLC
Plumbing Décor	Wolseley NA Finance, Inc.
Plumbing Holdings Corp.	Wolseley Staffing de Mexico S.A. de C.V.
Pollardwater	WPCC Forwarding
Powell Pipe & Supply Co.	Wright Plumbing Supply
Power Equipment Direct Inc.	
Process Instruments & Controls, LLC (effective 9/9/2019)	
Professional's Bath Source	
PV Sullivan Supply	
Ramapo Wholesalers	
RB Huntington Realty, LLC	
Rencor Controls (effective 3/16/2020)	
Robertson Supply (effective 11/19/2018)	
Rocky Hollow Realty, LLC	
Renwes Sales	
Redlon & Johnson	
Reese Kitchen, Bath & Lighting Gallery	
S.W. Anderson Sales Corporation (effective 11/11/2019)	
Safe Step Walk in Tub, LLC (effective 7/31/2018)	
SG Supply Co.	
Ship-Pac	
Signature Hardware	
SimplyPlumbing, LLC	
SOS Sales	
Southampton Realty Corp.	
Stock Loan Services, LLC	
Supply.com	
Tarpon Wholesale Supplies	
The Davidson Group	
The Plumbing Source	
The Stock Market	
Tinkar Realty, LLC	
TotalFab, LLC	
TPW Kitchen & Bath	
Wallwork (effective 12/10/2018)	
Wanlyn Realty Corp.	
Waterworks Industries	
Webb Distributors	
Western Air Supply	
Westfield Lighting	
Wholesale Group	
Wholesale Group Operations, Inc.	
Wolseley (Barbados) Ltd	


Items #2 + #3

Model 3402 Bronze Saddle for tubing copper pipe




Features and Benefits

1. Unique, dual-lipped resilient rubber gasket assures watertight seal without excessive clamping pressure.
2. Brass material does not crush pipe out-of-round.
3. Simple bolt-and-nut clamping speeds assembly.
4. Water pressure in the main actually increases tightness of the seal.
5. Resiliency accommodates the plastic flow caused by changing temperature and pressure conditions.
6. Impossible to over torque due to screw head bolt design – no damaged pipe.
7. Provide full support around the circumference of the pipe.
8. Provide a bearing area of sufficient width along the axis of the pipe, 2 in (50 mm) minimum, insuring that the pipe will not be distorted when the saddle is tightened.

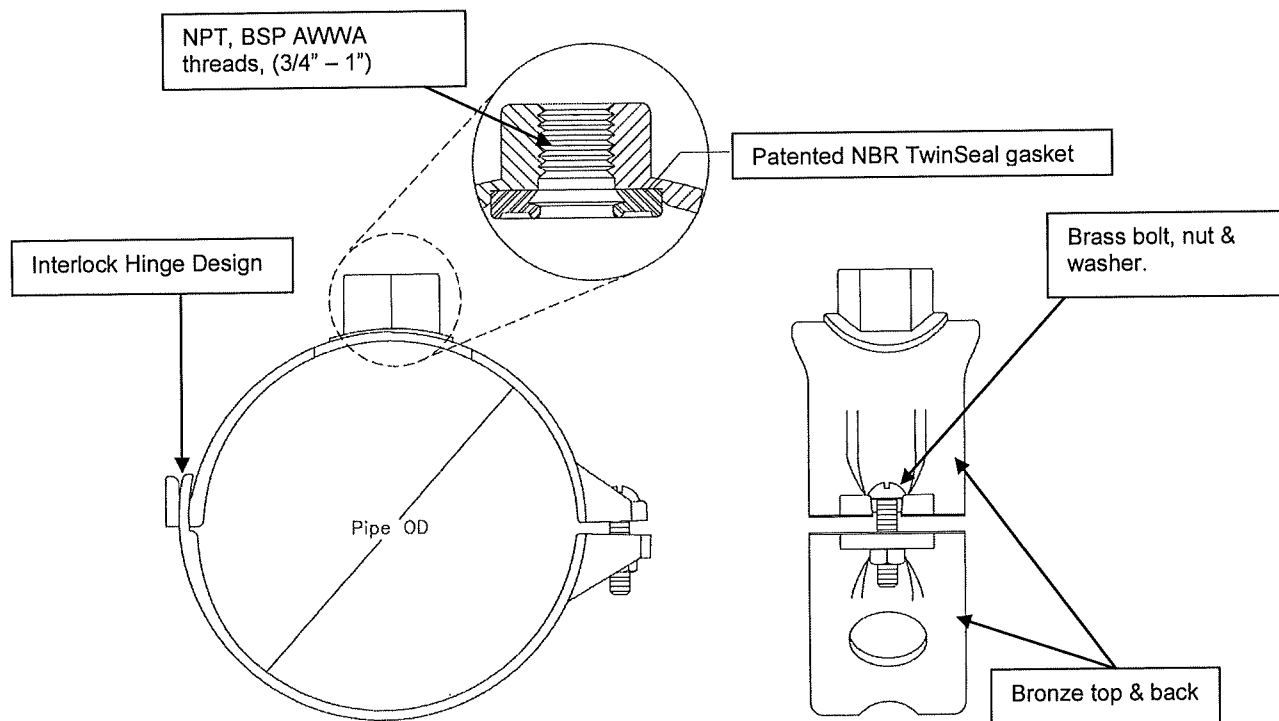

Pipe Size		Pipe OD		Bolts
in.	mm.	in.	mm.	SIZE
2	50	2.13	60	5/16" X 1.5"
2.5	65	2.63	73	5/16" X 1.5"
3	80	3.13	84	3/8" X 2"

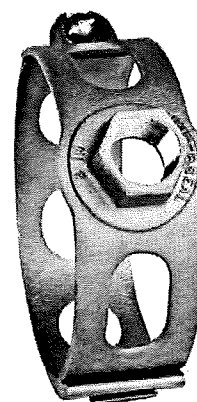

Scope

The intent of the specification is to receive a 2" – 3" diameter bronze saddle to fit tubing copper pipe. The saddle furnished shall be equivalent to model 3402 as manufactured by PowerSeal Pipeline Products Corporation.

Design and Material Specification

- The bronze saddle shall meet or exceed all material specifications as listed below:
 1. Top & back saddle parts are cast bronze and shall be attached by way of cast part hinge assembly, subsequently attached to the pipe by way of tightening bolt & nut assembly with screw driver only.
 2. There shall be no paper or plastic adhesive labels attached to the saddle, any information appearing on the saddle shall be stenciled.
 3. The body of the saddle shall be bronze (85-5-5) AWWA C800, top and back.
 4. The saddle shall have a twinseal NBR gasket ASTM D2000.
 - Self-energizing dual lip compressive gasket affords additional positive sealing under hydrostatic pressure.
 - Requires less clamping pressure than a circular solid bead type of gasket
 - Gasket continues to open and seal with any pipe movement or change in pressure.
 5. Fully complies with AWWA C800.
 6. 3402 saddles are AIS compliant.

Material Specifications		
Part Name	Material	Mat. specs
Saddle Top	Waterworks Bronze	AWWA C800
Saddle Bottom	Waterworks Bronze	AWWA C800
Bolts	Silicon Bronze	ASTM B98
Nuts	Silicon Bronze	ASTM B98
TwinSeal	NBR	ASTM D2000

PowerSeal brass tapping saddles provide the easiest and best way to make services taps on PVC and copper pipe. The cast brass saddle provides rigidity and strength without deforming the pipe. The dual-bead resilient rubber gasket assures positive sealing and the seal becomes tighter under the pressure of water in the main. Proved in thousands of installations.


Items 4 through 25

ALL STAINLESS SADDLE 3422AS
Certified to NSF/ANSI-61




Features and Benefits

1. Materials do not compromise the integrity of the pipeline.
2. Captive finger stud sub-assembly design makes installation easy and eliminates loose pieces in the field.
3. Due to stainless steel panel construction saddles can be manufactured to fit any pipe diameter.
4. Saddles are available with NPT, BSP or AWWA (CC) tapped outlets $\frac{1}{2}$ " - 3".
5. Patented NBR tapered end O-ring mat gasket design ensures a watertight seal to all classes of pipe.
6. Stainless steel finger stud sub-assembly fitted with stainless steel washerbar to support nuts, and special Delrin washers for extra lubrication.
7. Wide range capability.

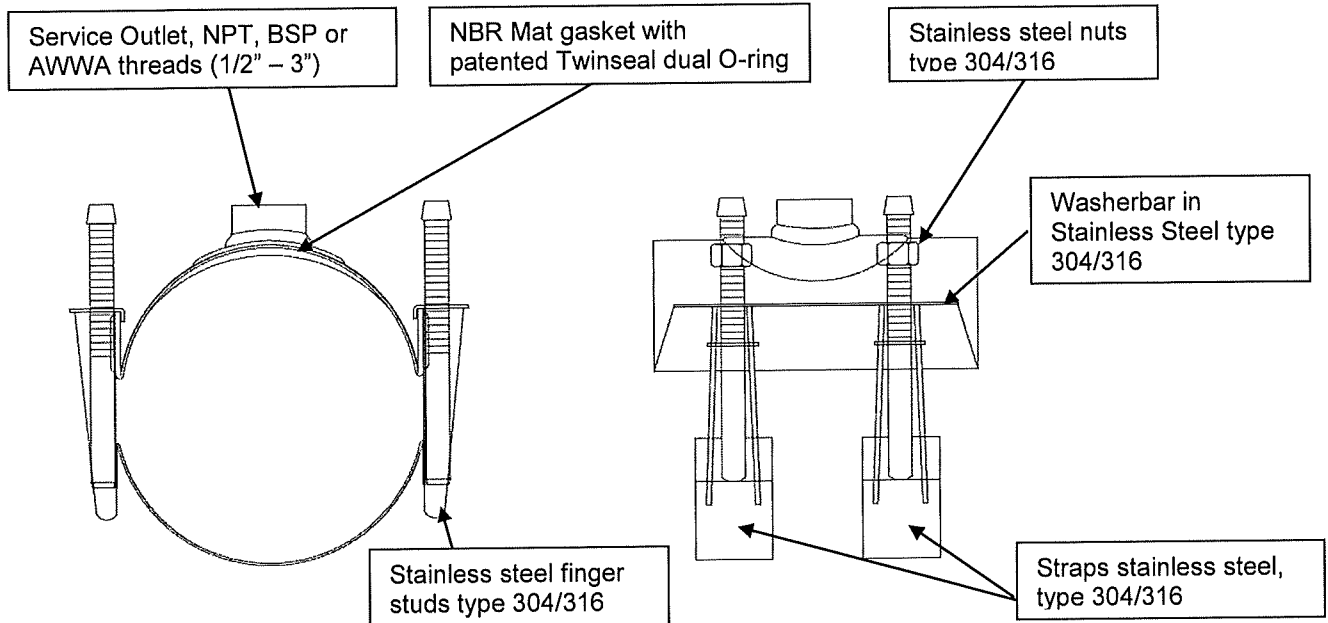

3422 AS				
Pipe Size		Pipe OD Range		Strap width
in.	mm.	in.	mm.	in.
4	100	4.35 - 5.65	111 - 144	2" for all sizes
5	125	5.40 - 6.40	137 - 163	
6	150	6.45 - 7.75	164 - 197	
8	200	8.50 - 9.80	216 - 249	
10A	250	10.25 - 11.55	260 - 292	
10B	250	10.95 - 12.35	278 - 314	
12A	300	12.30 - 13.60	312 - 345	
12B	300	13.14 - 14.44	334 - 367	
14A	350	14.00 - 15.30	356 - 389	
14B	350	15.40 - 16.70	391 - 424	
16A	400	16.20 - 17.50	412 - 445	
16B	400	17.90 - 19.20	455 - 488	
18	150	19.20 - 20.40	488 - 518	
20	500	21.50 - 22.80	546 - 579	
24	600	25.70 - 27.00	653 - 686	

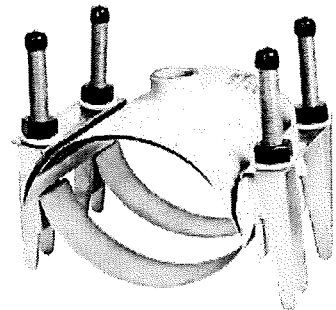

Scope

The intent of the specification is to receive a 4" – 24" diameter stainless steel saddle. The saddle furnished shall be equivalent to model 3422AS as manufactured by PowerSeal Pipeline Products Corporation.

Design and Material Specification

The stainless steel saddle shall meet or exceed all material specifications as listed below:

1. The exterior band of the saddle shall be Type 304/316 (18-8) stainless steel.
2. The saddle shall have an O-ring mat gasket with tapered ends permanently attached to the panel at the factory.
The O-ring mat gasket shall be our patented design in NBR. It shall be free from porous areas, foreign material, and visible defects, all made from 100% new rubber. The NBR resists temperatures of -25 to +248°F.
3. Finger stud sub-assembly shall be permanently attached by way of welding during manufacture at the factory. The weld shall be fully passivated.
4. The stainless steel female outlet shall be permanently attached to the saddle via a fully passivated weld during manufacture at the factory.
5. There shall be no paper or plastic adhesive labels attached to the saddle, any information appearing on the saddle shall be stenciled.
6. Fully complies with AWWA C800 and NSF 61.

Material Specifications		
Part Name	Material	Mat. specs
Panel	Stainless Steel type 304	ASTM A240
Base Plates	Stainless Steel type 304	ASTM A240
Bolts	Stainless Steel type 304	ASTM A193
Nuts	Stainless Steel type 304	ASTM A194
Twinsal Matt	NBR	ASTM D2000
Washerbar	Stainless Steel type 304	ASTM A240
Friction Washer	Delrin Plastic	MIL-A50424




Items 26-30 + 44-46

3131AS
ALL STAINLESS STEEL REPAIR CLAMP
Certified to NSF/ANSI-61




Features and Benefits

1. Materials do not compromise the integrity of the pipeline.
2. 5/8" stud bolts MIG welded to lug plates (captive design) makes installation easy and eliminates loose pieces in the field.
3. Due to stainless steel panel construction clamps can be manufactured in range to fit any pipe diameter.
4. Clamps are available with NPT or AWWA (CC) tapped outlets 1/2" -3" for repairing damaged service connections.
5. Gasket design makes sealing on pitted or corroded pipe possible and lessens bolt torque required to attain leak stoppage.
6. Heavy hex nut with fusion bonded coating to prevent seizing and galling.
7. Lifter bar acts as bearing surface for nuts, special design lip holds position while tightening.
8. Plastic washers reduce friction between lifter bars and nuts
9. Long life capability due to totally 304/316 stainless design.

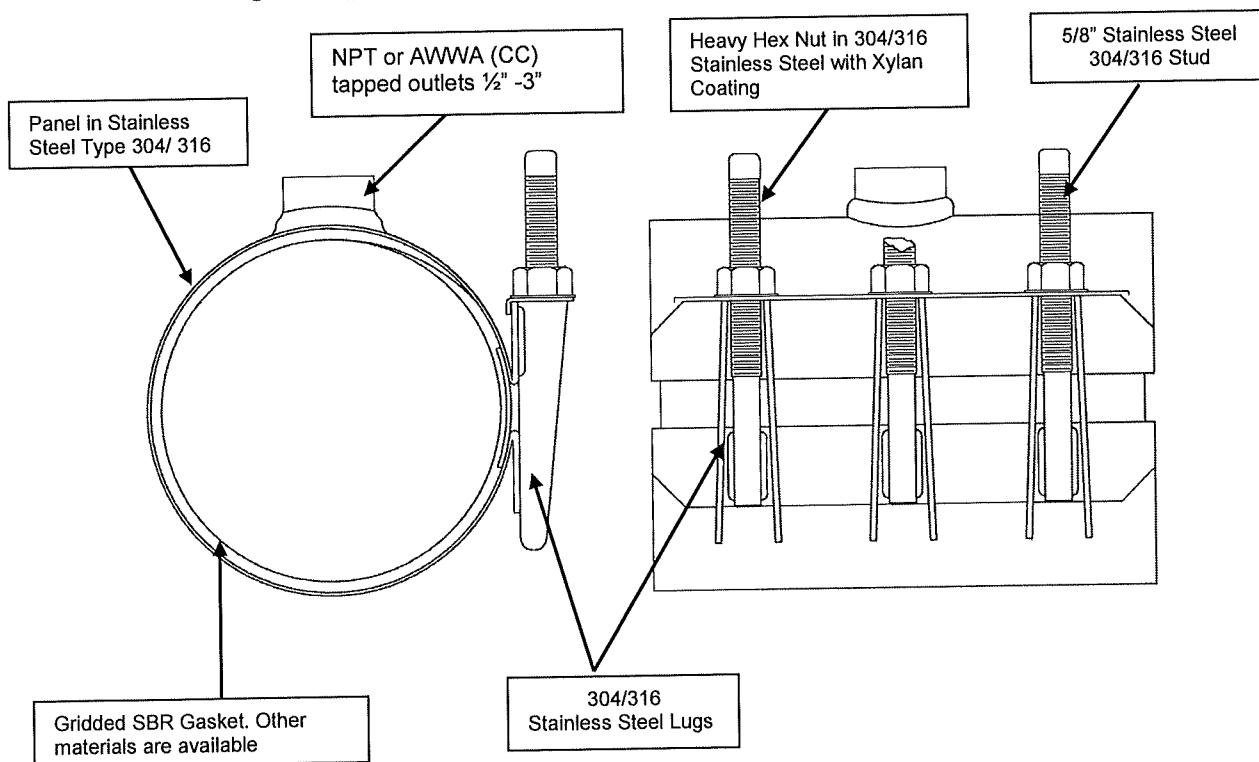

*The pressure rating depends on the installation and the extent of damage of the pipe as well as the condition of the pipe.



Scope

The intent of the specification is to receive 1 1/4" and up diameter all stainless steel repair clamps capable of repairing leaks in all pressure classes of steel, cast and ductile iron, PVC, and asbestos cement pipes. The repair clamp furnished shall be equivalent to Model 3131AS as manufactured by PowerSeal Pipeline Products Corporation

Design and Material Specification

The full circle repair clamp shall meet or exceed all material specifications as listed below:

1. The exterior band of the repair clamp shall be type 304 or 316 stainless steel.
2. The repair clamp shall have a complete circle gasket permanently attached to the panel at the factory.

The complete circle gasket shall be our gridded design in SBR. It shall be free from porous areas, foreign material, and visible defects, all made from 100% new rubber. The SBR resists temperatures of -25 to +200°F. The armor plate shall be made of stainless steel. It shall be recessed and vulcanized into the gasket. Other materials are available.

3. There shall be no paper or plastic adhesive labels attached to the repair clamp, any information appearing on the clamps shall be stenciled.

Fully complies with AWWA C800 and NSF 61

Material Specifications		
Part Name	Material	Mat. specs
Panel	Stainless Steel type 304/316	ASTM A240
Armor Plate	Stainless Steel type 304/316	ASTM A240
Lugs	Stainless Steel type 304/316	ASTM A240
Bolts	Stainless Steel type 304/316	ASTM A193
Nuts	Stainless Steel type 304/316	ASTM A194
Gasket	SBR	ASTM D2000


Item #31

Model 3232
Ductile Iron Bell Joint Leak Clamp
Certified to NSF/ANSI-61



Features and Benefits

1. Materials do not compromise the integrity of the pipeline.
2. Heavy duty ductile iron construction.
3. Notched rivets in each casting allow for easy adjustments.
4. Dovetail gasket plug supplied to allow for on-site adjustment.
5. NBR gasket that is produced from 100 % new rubber
6. Standard epoxy coating applied to ductile iron spigot castings to increase corrosion resistance.

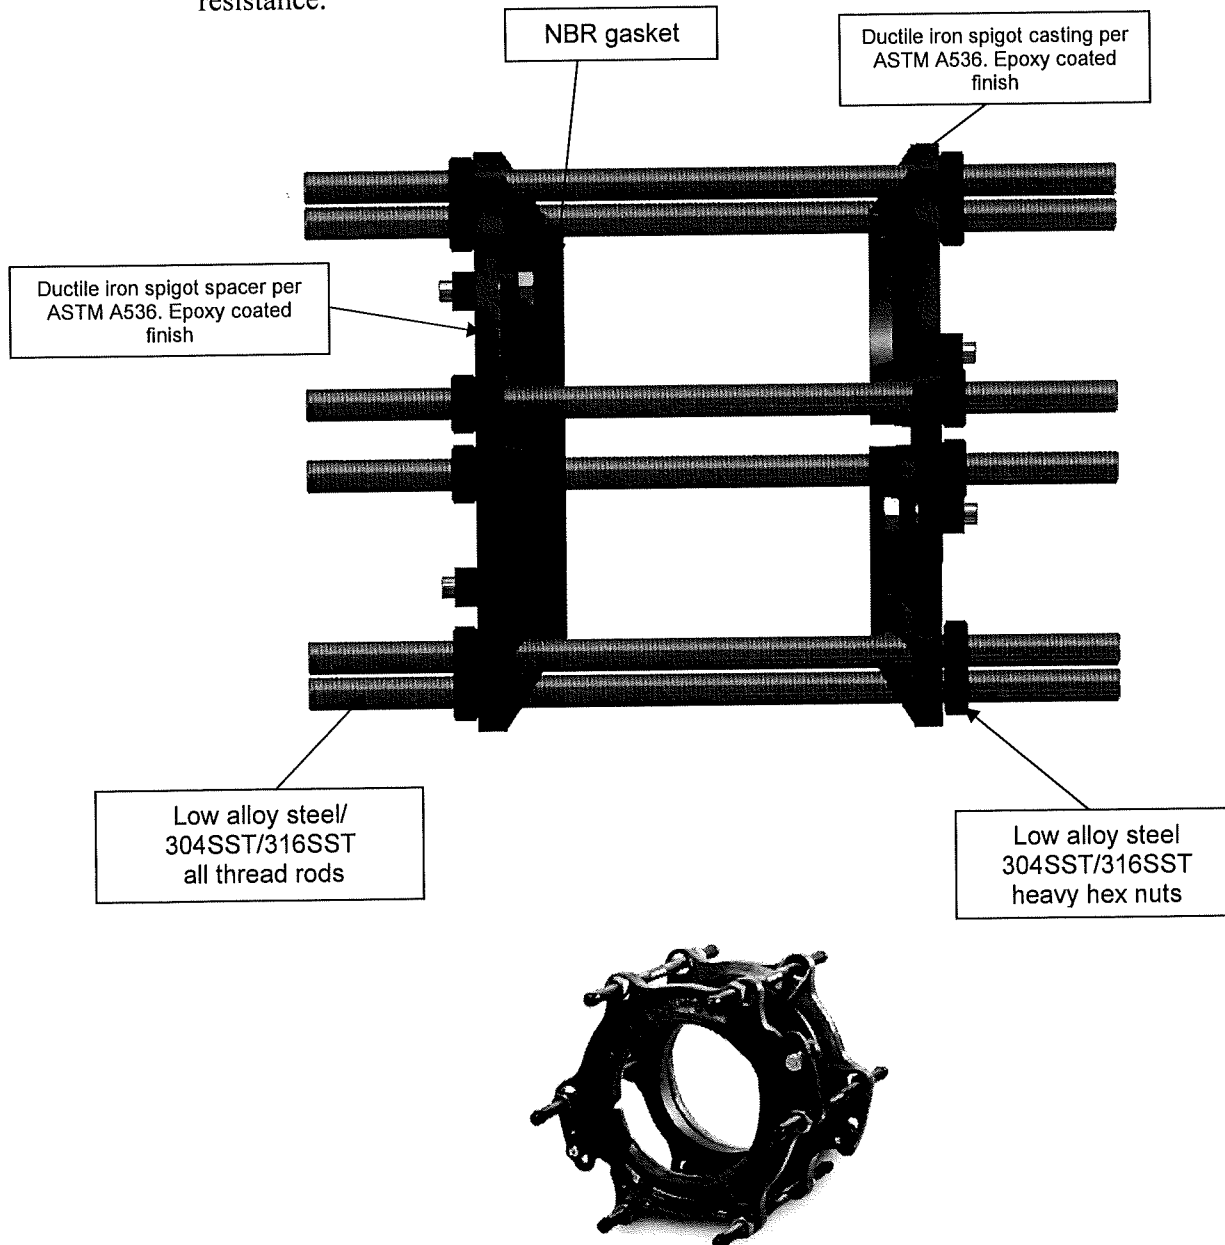

Model 3232
Ductile Iron Bell Joint Leak Clamp
Certified to NSF/ANSI-61



Scope

The intent of the specification is to receive a 3" – 30" diameter ductile iron bell joint leak clamp to seal a leak on a collar joint. The clamp furnished shall be equivalent to Model 3232 as manufactured by PowerSeal Pipeline Products Corporation

Design and Material Specification

- The ductile iron bell joint leak clamp shall meet or exceed all material specifications as listed below:
 1. The spigot castings are to be ductile iron as per ASTM A536.
 2. The ductile iron bell joint leak clamp gasket shall be NBR made of 100% new rubber gasket to ensure performance under varying pressures, with superior storage characteristics. Suitable for oil, mild acids, water, salt media, and most aliphatic hydrocarbon fluids with a temperature range of -40 to +248°F.
 3. All thread rod shall be low alloy steel per ASTM A325. Other materials are available.
 4. The nuts shall be low alloy steel as per ASTM A563. Other materials are available.
 5. The spigot spacer shall be ductile iron as per ASTM A536.
 6. There shall be no paper or plastic adhesive labels attached to the saddle, any information appearing on the saddle shall be ink stenciled.

MODEL 3232						
Pipe Size		Pipe OD Ranges		Spigot Casting QTY	Approx. Weight	
Inches	mm	Inches	mm		lbs.	kgs.
3	80	3.80-3.96	97 -101	4	23	10
4	100	4.80-5.00	122 - 127	4	25	11
6	150	6.90-7.10	175 - 180	4	37	17
8	200	9.05-9.30	230 - 236	4	45	20
10	250	11.10-11.40	282 -290	4	69	31
12	300	13.20-13.50	335 - 343	6	85	38
14	350	15.30-15.65	385 - 393	6	103	47
16	400	17.40-17.80	442 - 452	6	115	52
18	450	19.50-19.92	492 - 502	6	138	63
20	500	21.60-22.06	549 - 560	8	157	71
24	600	25.80-26.32	665 - 669	8	199	90
30	750	31.74-32.00	806 - 813	8	300	137

Note: This repair clamp is furnished with one gasket. If both ends of the joint coupling are leaking order one additional gasket.


Items 32-42

3121AS
ALL STAINLESS STEEL REPAIR CLAMP
Certified to NSF/ANSI-61




Features and Benefits

1. Materials do not compromise the integrity of the pipeline.
2. 5/8" stud bolts MIG welded to lug plates (captive design) makes installation easy and eliminates loose pieces in the field.
3. Due to stainless steel panel construction clamps can be manufactured in range to fit any pipe diameter.
4. Clamps are available with NPT or AWWA (CC) tapped outlets 1/2" -3" for repairing damaged service connections.
5. Gasket design makes sealing on pitted or corroded pipe possible and lessens bolt torque required to attain leak stoppage.
6. Heavy hex nut with fusion bonded coating to prevent seizing and galling.
7. Lifter bar acts as bearing surface for nuts, special design lip holds position while tightening.
8. Plastic washers reduce friction between lifter bars and nuts
9. Long life capability due to totally 304/316 stainless design.

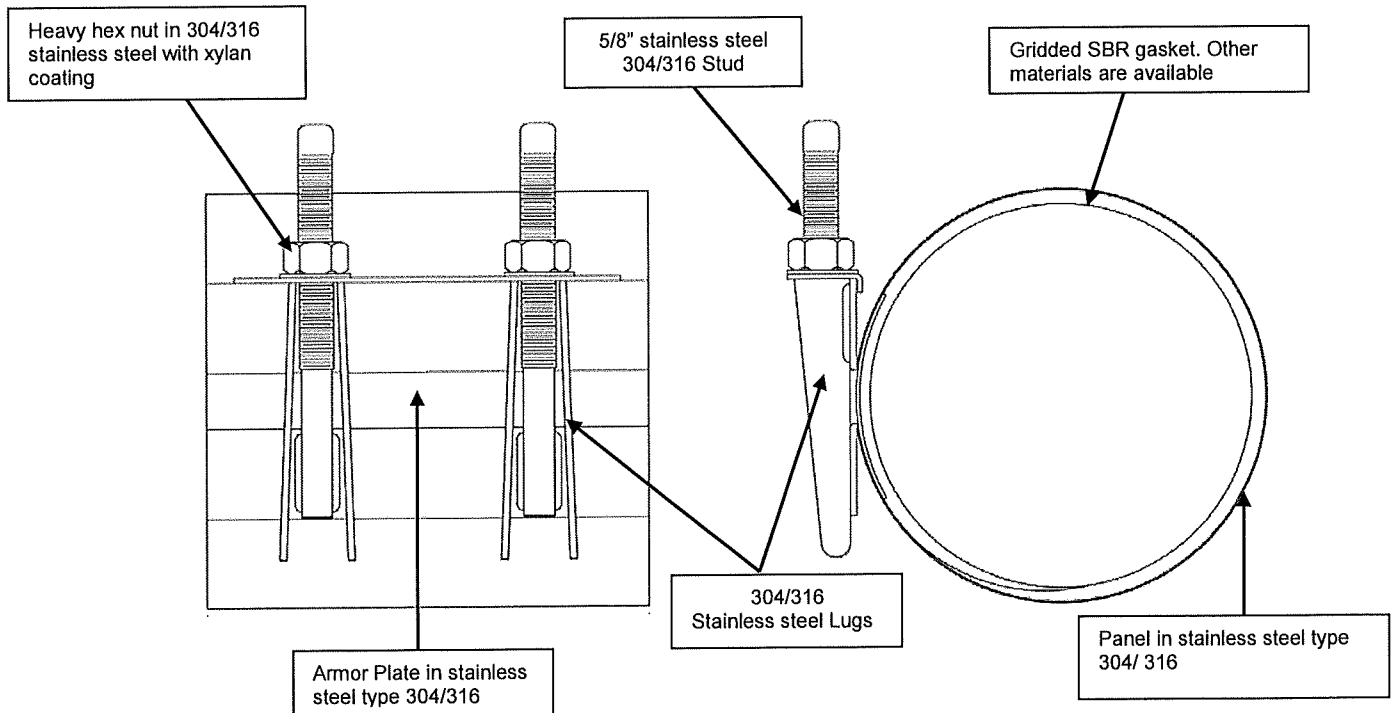

*The pressure rating depends on the installation and the extent of damage of the pipe as well as the condition of the pipe.



Scope

The intent of the specification is to receive 1 ¼" and up diameter all stainless steel repair clamps capable of repairing leaks in all pressure classes of steel, cast and ductile iron, PVC, and asbestos cement pipes. The repair clamp furnished shall be equivalent to Model 3121AS as manufactured by PowerSeal Pipeline Products Corporation.

Design and Material Specification

The full circle repair clamp shall meet or exceed all material specifications as listed below:

1. The exterior band of the repair clamp shall be type 304 or 316 stainless steel.
2. The repair clamp shall have a complete circle gasket permanently attached to the panel at the factory.

The complete circle gasket shall be our gridded design in SBR. It shall be free from porous areas, foreign material, and visible defects, all made from 100% new rubber. The SBR resists temperatures of -25 to +200°F. The armor plate shall be made of stainless steel. It shall be recessed and vulcanized into the gasket. Other materials are available.

3. There shall be no paper or plastic adhesive labels attached to the repair clamp, any information appearing on the clamps shall be stenciled.
4. Fully complies with AWWA C800 and NSF 61

Material Specifications		
Part Name	Material	Mat. specs
Panel	Stainless Steel type 304/316	ASTM A240
Armor Plate	Stainless Steel type 304/316	ASTM A240
Lugs	Stainless Steel type 304/316	ASTM A240
Bolts	Stainless Steel type 304/316	ASTM A193
Nuts	Stainless Steel type 304/316	ASTM A194
Gasket	SBR	ASTM D2000


Item #43

3122AS
ALL STAINLESS STEEL REPAIR CLAMP
Certified to NSF/ANSI-61




Features and Benefits

1. Materials do not compromise the integrity of the pipeline.
2. 5/8" stud bolts MIG welded to lug plates (captive design) makes installation easy and eliminates loose pieces in the field.
3. Due to stainless steel panel construction clamps can be manufactured in range to fit any pipe diameter.
4. Clamps are available with NPT or AWWA (CC) tapped outlets 1/2" - 3" for repairing damaged service connections.
5. Gasket design makes sealing on pitted or corroded pipe possible and lessens bolt torque required to attain leak stoppage.
6. Heavy hex nut with fusion bonded coating to prevent seizing and galling.
7. Lifter bar acts as bearing surface for nuts, special design lip holds position while tightening.
8. Plastic washers reduce friction between lifter bars and nuts
9. Long life capability due to totally 304/316 stainless design.

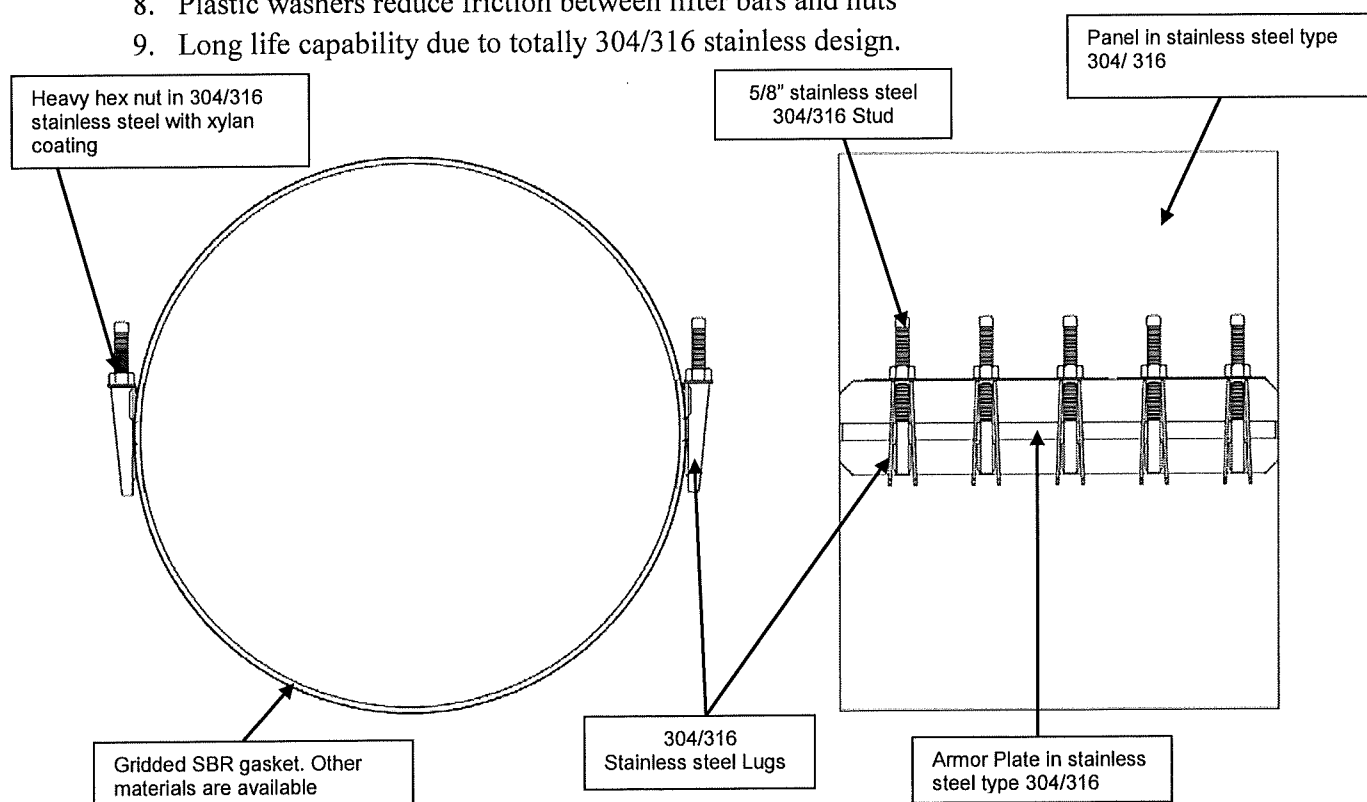

*The pressure rating depends on the installation and the extent of damage of the pipe as well as the condition of the pipe.



1-800-800-0932 940-767-5566 www.powerseal.com FITTING SOLUTIONS FOR HARSH ENVIRONMENTS



C ®

Scope

The intent of the specification is to receive 3" and up diameter all stainless steel repair clamps capable of repairing leaks in all pressure classes of steel, cast and ductile iron, PVC, and asbestos cement pipes. The repair clamp furnished shall be equivalent to Model 3122AS as manufactured by PowerSeal Pipeline Products Corporation.

Design and Material Specification

The full circle repair clamp shall meet or exceed all material specifications as listed below:

1. The exterior band of the repair clamp shall be type 304 or 316 stainless steel.
2. The repair clamp shall have a complete circle gasket permanently attached to the panel at the factory.


The complete circle gasket shall be our gridded design in SBR. It shall be free from porous areas, foreign material, and visible defects, all made from 100% new rubber. The SBR resists temperatures of -25 to +200°F. The armor plate shall be made of stainless steel. It shall be recessed and vulcanized into the gasket. Other materials are available.

3. There shall be no paper or plastic adhesive labels attached to the repair clamp, any information appearing on the clamps shall be stenciled.
4. Fully complies with AWWA C800 and NSF 61


Material Specifications		
Part Name	Material	Mat. specs
Panels	Stainless Steel type 304/316	ASTM A240
Armor Plate	Stainless Steel type 304/316	ASTM A240
Lugs	Stainless Steel type 304/316	ASTM A240
Bolts	Stainless Steel type 304/316	ASTM A193
Nuts	Stainless Steel type 304/316	ASTM A194
Gasket	SBR	ASTM D2000

Features and Benefits

1. Materials do not compromise the integrity of the pipeline.
2. 5/8" stud bolts MIG welded to lug plates (captive design) makes installation easy and eliminates loose pieces in the field.
3. Due to stainless steel panel construction clamps can be manufactured in range to fit any pipe diameter.
4. Clamps are available with NPT or AWWA (CC) tapped outlets 1/2" -3" for repairing damaged service connections.
5. Gasket design makes sealing on pitted or corroded pipe possible and lessens bolt torque required to attain leak stoppage.
6. Heavy hex nut with fusion bonded coating to prevent seizing and galling.
7. Lifter bar acts as bearing surface for nuts, special design lip holds position while tightening.
8. Plastic washers reduce friction between lifter bars and nuts
9. Long life capability due to totally 304/316 stainless design.

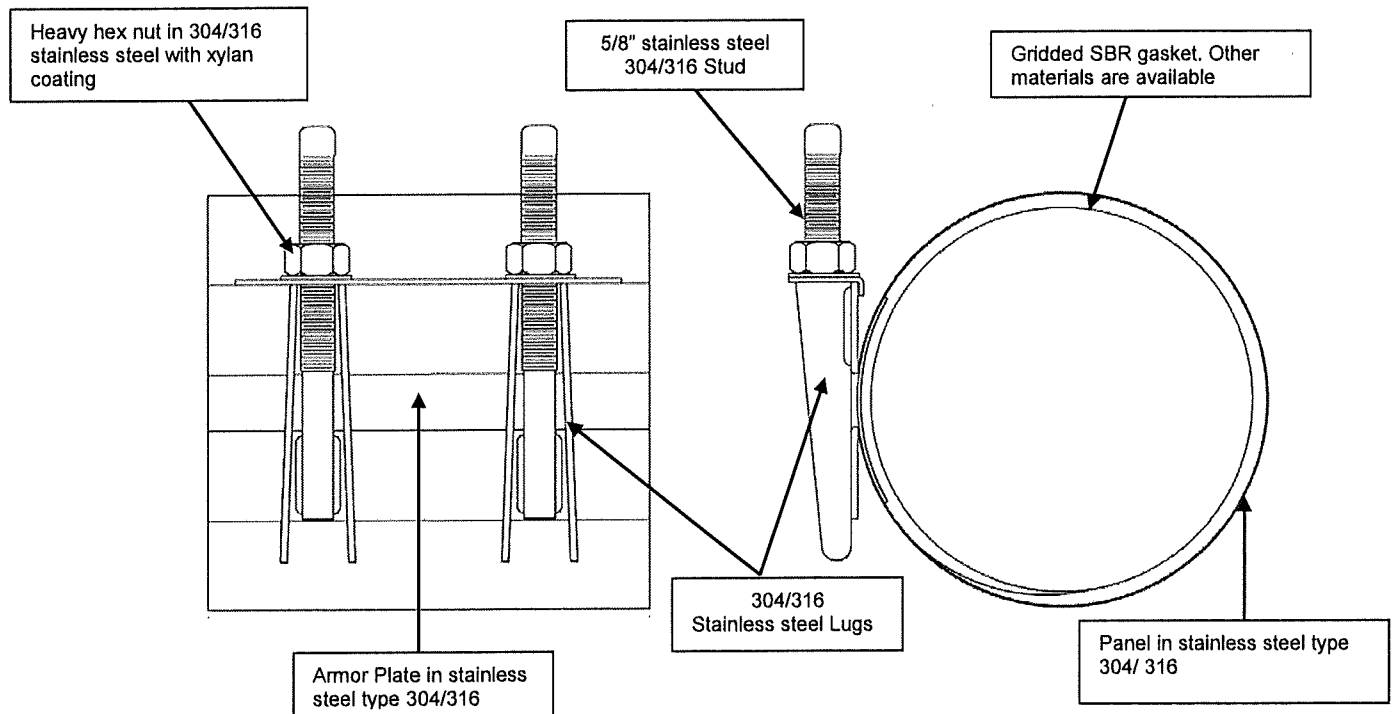

*The pressure rating depends on the installation and the extent of damage of the pipe as well as the condition of the pipe.



Scope

The intent of the specification is to receive 1 1/4" and up diameter all stainless steel repair clamps capable of repairing leaks in all pressure classes of steel, cast and ductile iron, PVC, and asbestos cement pipes. The repair clamp furnished shall be equivalent to Model 3121AS as manufactured by PowerSeal Pipeline Products Corporation.

Design and Material Specification

The full circle repair clamp shall meet or exceed all material specifications as listed below:

1. The exterior band of the repair clamp shall be type 304 or 316 stainless steel.
2. The repair clamp shall have a complete circle gasket permanently attached to the panel at the factory.

The complete circle gasket shall be our gridded design in SBR. It shall be free from porous areas, foreign material, and visible defects, all made from 100% new rubber. The SBR resists temperatures of -25 to +200°F. The armor plate shall be made of stainless steel. It shall be recessed and vulcanized into the gasket. Other materials are available.

3. There shall be no paper or plastic adhesive labels attached to the repair clamp, any information appearing on the clamps shall be stenciled.
4. Fully complies with AWWA C800 and NSF 61

Material Specifications		
Part Name	Material	Mat. specs
Panel	Stainless Steel type 304/316	ASTM A240
Armor Plate	Stainless Steel type 304/316	ASTM A240
Lugs	Stainless Steel type 304/316	ASTM A240
Bolts	Stainless Steel type 304/316	ASTM A193
Nuts	Stainless Steel type 304/316	ASTM A194
Gasket	SBR	ASTM D2000