



# JEFFERSON PARISH

Department of Purchasing

Michael S. Yenni  
Parish President

Brenda C. Patel  
Director

May 24, 2017

## ADDENDUM #1

Bid No.: 50-00119704

Bid Opening Date: May 25, 2017  
Bid Opening Postponed Until: June 1, 2017

For: One (1) year contract for a supply of couplings, restraining devices and related gaskets for Jefferson Parish Department of Public Works, Water and Sewer and all Jefferson Parish agencies and municipalities

---

### CLARIFICATION TO THE BID SPECIFICATIONS:

#### Question:

Last year I contested the award for this bid for a couple of reasons. One being the specification calling for 304SS nuts and bolts on the Ebaa series 2100 Megaflanges (highlighted). In the past they have always been supplied with Xylon coated nuts and bolts because SS galls. Would you be able to get clarification from the water department/warehouses to see which they were accepting on the last bid?

#### Answer:

The bid specifications have been revised to reflect the acceptance of Xylon or Teflon coated nuts and bolts in lieu of stainless steel nuts and bolts. This addendum hereby revises and replaces the bid specifications and is attached hereto.

### QUESTIONS AND ANSWERS:

#### Question:

Item # 113 Pipe Lubricant what size are you asking for? Is this gallons?

#### Answer:

Line item 113 should be CHANGED TO READ AS:

QUANTITY	U/M	DESCRIPTION OF ARTICLES
24	CS	1130 PIPE LUBRICANT (50180) (12 QUARTS PER CASE)



# JEFFERSON PARISH

## Department of Purchasing

**Michael S. Yenni**  
Parish President

**Brenda C. Patel**  
Director

**Question:**

Item # 119 Hymax 14x12 Reducing Coupling? Can you tell me what OD Range you are looking for?

**Answer:**

Large O.D. range 13.90-16.00, small O.D. range 12.40-13.66

**THE BID OPENING DATE HAS BEEN POSTPONED UNTIL JUNE 1, 2017, AT 2:00 P.M.**

Sincerely,

*Daphne Nelson*

Daphne Nelson, Buyer II  
Jefferson Parish Purchasing Department

**Bidders must acknowledge all addenda on the bid form. Bidder acknowledges receipt of this addendum on the bid form as indicated. Failure to do so will result in bid rejection.**

**This addendum is a part of the contract documents and modifies the original bidding documents and specifications. The contents of this addendum shall be included in the contract documents. Changes made by this addendum shall take precedence over the documents of earlier date.**



# JEFFERSON PARISH

Department of Purchasing

Michael S. Yenni  
Parish President

Brenda C. Patel  
Director

May 25, 2017

## ADDENDUM #2

Bid No.: 50-00119704

Bid Opening Date: June 1, 2017

Bid Opening Postponed Until: June 6, 2017

For: One (1) year contract for a supply of couplings, restraining devices and related gaskets for Jefferson Parish Department of Public Works, Water and Sewer and all Jefferson Parish agencies and municipalities

---

### CLARIFICATION:

Bid opening date has been postponed until June 6, 2017, at 2:00 p.m.

Sincerely,

*Daphne Nelson*

Daphne Nelson, Buyer II  
Jefferson Parish Purchasing Department

**Bidders must acknowledge all addenda on the bid form. Bidder acknowledges receipt of this addendum on the bid form as indicated. Failure to do so will result in bid rejection.**

**This addendum is a part of the contract documents and modifies the original bidding documents and specifications. The contents of this addendum shall be included in the contract documents. Changes made by this addendum shall take precedence over the documents of earlier date.**

**Couplings and Restraints**  
**Contract**

**Items Included In This Contract:**

1. Steel Body Transitional Couplings (Non-Restrained)
2. Ductile Iron Body Transitional Couplings (Non-Restrained)
3. Flange Coupling Adapter (Non-Restrained)
4. Flange Coupling Adapter (Restrained)
5. EBAA Series 1000 E-Z Flange
6. EBAA Series 1100DEC Megalug Mechanical Joint Restraint
7. EBAA Series 1500 Split Restraint Harness For C-900 Pipe Bells And Spigot (4"-12")
8. EBAA Series 1600 Split Restraint Harness For C-900 Pipe Bells And Spigot (4"-12")
9. EBAA Series 1700 Megalug Restraint Harness For Ductile Iron Bells
10. EBAA Series 2000PEC Mechanical Joint Restraint
11. Transition Gaskets (Asbestos Cement To Cast Iron)
12. Mechanical Joint Gaskets (For Ductile Iron Pipe)
13. Pipe Lubricant

**Contract Terms:**

This is a one year contract for supply of couplings, restraining devices, and the related gaskets for the Department of Water and Sewer, and all Jefferson Parish agencies and municipalities.

**Warranty:**

Products shall be warranted that they are manufactured in accordance with the applicable material specifications and are free from defects in workmanship and materials for one year after delivery. Any defective items sold under this contract shall be replaced at no cost to the purchaser.

**General Specifications:**

This specification is prepared for a one (1) year contract for a supply of couplings, restraining devices and related gaskets for the Parish of Jefferson, Department of Water and Sewerage, East and West Banks.

The quantities shown on the proposal guide are approximate quantities to be acquired by Jefferson Parish over a one (1) year period. Actual usage will be on an "as needed" basis.

Bid price shall include all freight and delivery costs to Jefferson Parish warehouse locations on the East and West Banks of Jefferson Parish.

The successful bidder shall not substitute any items on this bid throughout the one (1) year period without the written consent of the Jefferson Parish Engineering Dept.

All technical literature must be submitted with the bid. Failure to honor such request will result in the bid being considered non-responsive.

**Technical Specifications:**

**1. Steel Body Transition Couplings 2"-24" (Non-Restrained):**

Coupling shall accommodate pipe offset up to 7/16", pipe deflection up to 8 degrees, and pipe gaps up to 7.5.

Coupling shall join pipes with difference diameters up to 1.30" (2.10" in the 16" size).

Coupling shall be of the long pattern design and meet or exceed AWWA C-219 and be NSF 61 approved.

Couplings shall have a working pressure of 260 PSI with a maximum test pressure of 390 PSI with a 1.5:1 safety factor.

- **Material:**

Transition couplings shall have a lightweight middle ring that is properly flanged with confined steel followers. Transition coupling shall have an epoxy coating of 10-12 mils in thickness.

- **Follower Track (Spanners):**

Follower track (spanners) shall be type 304 stainless steel with two (2) type 304 stainless steel carriage-type, compression bolts and nuts with corresponding stainless steel retainers (one at each end) located on the top of the coupling. Nuts shall be coated to prevent galling.

- **Gaskets:**  
Gaskets shall be wide range, multi-layered EDPM peel-off hydraulically pressure assisted, superior dual seal gaskets (seals mechanically and hydraulically) for permanently sealed joints.
- **Assembly:**  
Coupling shall be totally assembled as in integral unit having stab-on feature, with bolts staved to prevent disassembly and required no disassembly during installation.

Coupling shall be "Hymax" or approved equal.

**2. Ductile Iron Body Transition Couplings 4"-12" (Non-Restrained):**

Coupling shall accommodate pipe deflection up to 8 degrees (4 degrees on each end).

Coupling shall have an extended range up to 1.25".

Coupling coating shall be center ring fusion bonded epoxy in accordance with AWWA C213 and NSF 61 certified. End rings shall be e-coated epoxy.

Couplings shall have a working pressure of 260 PSI.

- **Material:**  
Transition coupling components (end rings, center ring, and bolt guides) shall be ductile iron, meeting or exceeding the requirements of ASTM A536, Grade 65-45-12.
- **Follower Track (Spanners):**  
Follower track (spanners) shall be type 304 stainless steel with two (2) type 304 stainless steel carriage-type, compression bolts and nuts with corresponding stainless steel retainers (one at each end) located on the top of the coupling. Nuts shall be coated to prevent galling.
- **Gaskets:**  
Gaskets shall be formed from virgin nitrile butadiene rubber (NBR) compounded for water and sewer service in accordance with ASTM D2000.
- **Assembly:**  
Coupling shall be totally assembled as in integral. End rings shall be segmented and joined with an integrated hinge.

Coupling shall be Macro™ by Romac or an approved equal.

**3. Flanged Coupling Adapters (Non-Restrained):**

Adapter shall meet or exceed AWWA c-219 and be NSF 61 approved, but shall have one compression end with one nut and bolt, and one flanged end which complies with AWWA C-207-94 or ANSI B16-5.

Please note that the 2" flanged coupling adapter shall be available in 2" oval meter flanged size.

Flanged coupling adapter shall be "Hymax Flanged Adapter" or an approved equal.

**Note to Vendor:**

The coating system for all restraining devices shall be mega bond by EBAA Iron, Inc. or an approved (factory applied, fusion bonded epoxy) equal.

**4. Flange Coupling Adapters (Restrained) (Ductile/Cast Iron Pipe, 3"-60"; Steel Pipe, 3"-12"):**

Pipe Material	DR Rating	Sizes Available
IPS OD PVC Pipe	All SDR's	3"-12"
C-900	14	4"-12"
C-900	18	4"-20"
C-900	25	4"-24"
C-900	32.5	14"-24"

For PVC pipe, the flange adapter shall have a pressure rating equal to the pipe.

For ductile iron pipe, the flange adapter shall have a safety factor of 2:1 minimum.

The flange adapter shall be UL listed 3"-12" for above and below ground use on schedule 40 steel pipes, and below-ground on all classes of listed ductile iron pipe.

The flange adapter shall be FM approved for use on C-900 Class 150 (DR-18) and class 200 (DR-14 PVC pipe, 4"-12", and on all classes of listed ductile iron pipe, and for above ground flanged pipe systems (treatment plants, pumping stations, or underground).

- **Restrained Gland And Gasket Ring:**  
The flange adapter restrained gland and gasket ring shall be made of grade 60-42-12 ductile iron, which exceeds the minimum requirements of ASTM A-536-84, and shall have flange bolts circles that are compatible with ANSI/AWWA C-115/1-21.15. The flange adapter gasket ring shall be fusion-bonded epoxy coated inside and out.
- **Flange Adapter Restraint Ring:**  
The flange adapter restraint ring shall consist of a plurality of individual actuated gripping wedges to maximize restraint capability. Torque-limiting actuated screws shall be used to ensure proper initial set of the gripping wedges.
- **Assembly:**  
The flange adapter shall be capable of deflecting during assembly, or permit lengths of pipe to be field cut to allow a minimum of 0.6" of gap through 2.0" of gap (depending on pipe diameter) between the end of the pipe and the mating flange without affecting the integrity of the seal.
- **Nuts and Bolts:**  
The flange adapters shall be furnished with type Xylan or Teflon coated machined bolts and nuts.

Flange adapter shall be EBAA Series 2100 "Megaflange" adapter, or an approved equal.

5. **EBAA Series 1000 E-Z Flange:**

The flange adapter shall be used in lieu of threaded or welded flanges on plain end ductile iron and steel pipe.

These flanges shall be cast from 60-42-10 ductile iron per ASTM A536 and shall have bolt circles and bolt holes to meet ANSI/AWWA C100/A21.10.

These flanges shall contain set screws made from ductile iron which have a Rockwell hardness of C40-45 converted from Brinnell.

Flange adapters shall be as manufactured by EBAA Iron, Inc. or an approved equal.

6. **Series 1100DEC Megalug Mechanical Joint Restraint:**

The wedges shall be ductile iron heat treated to a minimum hardness of 370 BHN. Dimensions of the gland shall be such that it can replace the standardized mechanical joint gland, and can be used with the standardized mechanical joint bell conforming to ANSI/AWWA C111/a21.11 and ANSI/AWWA C153/A.21.53 of the latest revision.

The mechanical joint restraint shall be available in the 3" through 48" sizes. They shall have a rated working pressure of 350 PSI in sizes 16" and smaller and 250 PSI in sizes 18" through 48" with 2 to 1 minimum safety factor. The devices shall be listed by Underwriter's Laboratories up through 24" size and approved by factory mutual up through 12" size.

All restraints shall be packaged. The package is to include the gland, EBAA-seal improved mechanical joint gasket and adequate lubricate for gasket lubrication, necessary quantity, size and length of t-bolts and nuts made from a low-alloy steel conforming to AWWA C-111 and be blue flora polymer coated equal to xylon coating.

The EBAA-seal gasket shall deflect 30% during assembly of the mechanical joint, improving sealing capabilities and shall meet in design and material, ANSI/AWWA C110/A21.10, C111/A21.11 or C153/A21.53, section 11-6.4 or latest revision.

The restraint shall be the series 110DEC Megalug restraint produced by EBAA Iron, Inc. or approved equal.

- **Mechanical Joint Restraint For Ductile Iron Pipe:**  
Mechanical joint restraint for ductile iron pipe shall be incorporated into the design of the follower gland. The restraining mechanism shall consist of a plurality of individual actuated wedges that increase their resistance to pullout as internal pressure or external forces increase; the device shall be capable of full mechanism joint deflection during assembly and the flexibility of the joint shall be maintained after burial. The joint restraint ring and its wedging components shall be made of grade 60-42-12 ductile iron, which exceeds minimum requirements of ASTM A536-84.
- **Flange Adapter Restraint Ring:**  
The flange adapter restraint ring shall consist of a plurality of individual actuated gripping wedges to maximize restraint capability. Torque-limiting actuated screws shall be used to ensure proper initial set of the gripping wedges.
- **Assembly:**  
The flange adapter shall be capable of deflecting during assembly, or permit lengths of pipe to be field cut to allow a minimum of 0.6" of gap through 2.0" of gap (depending on pipe diameter) between the end of the pipe and the mating flange without affecting the integrity of the seal.
- **Nuts and Bolts:**  
The flange adapters shall be furnished with type Xylan or Teflon coated machined bolts and nuts.

**7. Series 1500 Split Restraint Harness For C-900 Pipe Bells and Spigot (4"-12"):**

All rings and components shall be made of grade 60-42-12 ductile iron, which exceeds minimum requirements of ASTM A536. A split ring shall be utilized behind the pipe bell. A split serrated ring shall be utilized to grip the pipe.

- **Tie Bolts:**  
A sufficient quantity, size and length of tie bolts which shall be made from a low-alloy steel conforming to AWWA C111. Tie bolts shall be used to connect the bell ring and gripping ring.
- **Side Bolts:**  
The side bolts shall be grade 5 machine bolts and be blue flora polymer coated equal to xylon coating.
- **Harness Restraint Device:**  
The harness restraint device shall have a minimum working pressure rating of 150 psi, and be tested with a minimum of 4 to 1 safety factor. All sizes shall be FM approved for class 150 (DR 18) PVC pipe. All sizes rated to 200 PSI class 200 (DR 14) PVC pipe shall have a 3 to 1 safety factor, and shall be EBAA Series 1500 or an approved equal.

**8. Series 1600 Split Restraint Harness For C-900 Pipe Bells And Spigot (4"-12"):**

All rings and components shall be made of grade 60-42-12 ductile iron, which exceeds minimum requirements of ASTM A536. A split ring shall be utilized behind the pipe bell. A split serrated ring shall be utilized to grip the pipe.

- **Tie Bolts:**  
A sufficient quantity, size and length of tie bolts which shall be made from a low-alloy steel conforming to AWWA C111. Tie bolts shall be used to connect the bell ring and gripping ring.
- **Side Bolts:**  
The side bolts shall be grade 5 machine bolts and be blue flora polymer coated equal to xylon coating.
- **Harness Restraint Device:**  
The harness restraint device shall have a minimum working pressure rating of 150 PSI, and be tested with a minimum of 4 to 1 safety factor. All sizes shall be FM approved for class 150 (DR 18) PVC pipe. All sizes rated to 200 PSI class 200 (DR 14) PVC pipe shall have a 3 to 1 safety factor, and shall be EBAA series 1600 or an approved equal.

**9. Series 1700 Megalug Restraint Harness for Ductile Iron Bells:**

Ductile iron pipe bell restraint shall consist of a wedge action restraint ring on the spigot and joined to a ductile iron pipe follower gland behind the bell. The restraint ring shall have individually-actuated wedges that increase their resistance to pull out as pressure or external forces increases.

- **Restraint Ring and Wedging Components:**

The restraint ring and its wedging components shall be made of ductile iron grade 60-42-12, which exceeds minimum requirements of ASTM A536.

- **Wedges:**

The wedges shall be heat-treated to a minimum hardness of 370 BHN. Torque limiting twist off nuts shall be used to ensure proper actuation of the restraining wedges.

- **Follower Gland:**

The follower gland shall be made of the same grade ductile iron as previously mentioned. The connecting tie rods that join the two rings shall be of low alloy steel, which conforms to ANSI/AWWA C111/A21.11.

- **Assembly:**

The assembly shall have a rated pressure with a minimum 2:1 safety factor for 350 PSI in sizes 16" and below, and 250 psi in sizes 18" through 36".

- **Harness:**

Harness shall be series 1700 Megalug restraint harness manufacture by EBAA Iron, or an approved equal.

- **Nuts and Bolts:**

**The flange adapters shall be furnished with type Xylan or Teflon coated machined bolts and nuts.**

**10. Series 2000 PEC Mechanical Joint Restraint:**

The mechanical joint restraint shall be available in 3" through 36" sizes. The restraining joint gland shall have a pressure rating and safety factor equal to that of the pipe on which it is used.

Mechanical joint restraint for PVC pipe shall be incorporated into the design of the follower gland. The restraint mechanism shall consist of a plurality of individually-actuated gripping wedges that increases their resistance to pullout as internal pressure or external forces increase. This evenly distributes the thrust forces around the circumference of the pipe, and is for use on all sizes of IPS diameter PVC pipe in 3" through 12" sizes, and all sizes of AWWA C-900

and C-905 pipe (4"through 36"). The device shall be capable of full mechanical joint deflection during assembly and flexibility of the joint shall be maintained after burial. The joint restraint ring and its wedging components shall be made of grade 60-42-12 ductile iron, which exceeds minimum requirements of ASTM A536.

Dimensions of the gland shall be such that it replaces the standardized mechanical joint gland and can be used with the standardized mechanical joint bell conforming to ANSI/AWWA C111/A21.11 and ANSI/AWWA C153/A21.53 of latest revision. Torque limiting twist off nuts shall be used to insure proper actuating of restraining wedges.

- **Restraining Gland:**

The restraining glands shall have been tested to ASTM F1674, and all sizes shall be rated at the full pressure capacity of the pipe. The mechanical joint restraint shall be listed by Underwriter's Laboratories, and approved by factory mutual (4"-12").

- **Packaging:**

All restraints shall be packaged. The package is to include gland, EBAA-seal(tm) improved mechanical joint gasket with adequate lubricant for gasket, necessary quantity, size and length of t-bolts and nuts made from a low-alloy steel conforming to AWWA C111 and be blue flora polymer coated equal to nylon coating.

- **EBAA-Seal™ Gasket:**

The EBAA-Seal™ gasket shall deflect 30% during assembly of the mechanical joint improving sealing capabilities and shall meet in design and material the ANSI/AWWA C110/A21.10, C111/A21.11, or C153/A21.53, section 11-6.4 or latest revision.

The restraint shall be the series 2000 PEC Megalug restraint produced by EBAA Iron, Inc. or approved equal.

#### **11. Transition Gaskets (Asbestos Cement to Cast Iron):**

Transition gaskets shall go from asbestos cement (ac) size down to cast iron size to be used on potable water and sewer lines, made from virgin SBR rubber material for use in salty and acidic soils with a temperature range of -65 degrees to 180 degrees Fahrenheit. Transition gaskets shall conform to the latest revision of ASTM D2000 3 BA715 to work with class 100, 150, and 200 machined "AC" pipe and ductile iron pipe Class 53.

Transition gaskets shall be manufactured by Romac Industries or an approved equal.

**12. Mechanical Joint Gaskets (For Ductile Iron Pipe):**

Mechanical joint gaskets for ductile iron pipe shall be used on potable water and sewer lines. Virgin SBR rubber material for the use in salty and acidic soils with a temperature range of -40 degrees to 150 degrees Fahrenheit, meet or exceed ASTM D2000 3 BA715, and to fit ANSI/AWWA A21.11/C111 and ANSI/AWWA A21.53/C153 latest revision standard, 250 PSI working pressure.

**13. Pipe Lubricant:**

Pipe lubricant shall be used for potable and waste water applications. Pipe lubricant shall be non-toxic, odorless, tasteless, and not be able to support bacterial growth. Lubricant shall come in one quart containers and be used to assemble "push-on" pipe and fittings.



**CENTRALBIDDING**  
FROM CENTRAL AUCTION HOUSE

**5000119704 ONE (1) YEAR CONTRACT FOR A SUPPLY OF COUPLINGS,  
RESTRAINING DEVICES AND RELATED GASKETS**  
Jefferson Parish Government

Project documents obtained from [www.CentralBidding.com](http://www.CentralBidding.com)

17-May-2017 12:13:51 PM



# JEFFERSON PARISH

## Department of Purchasing

Michael S. Yenni  
Parish President

Brenda C. Patel  
Director

### CHANGES TO JEFFERSON PARISH BIDDING PROCEDURES

The East bank Office of Purchasing is now open! We are located in the Joseph S. Yenni Building, 1221 Elmwood Park Blvd., Suite 404, Jefferson, LA 70123. Bidders may submit bid responses at this location, pending authorization in each bid package. **Bidders should carefully read and must respond accordingly per the requirements of the bid packages. NOTE: Bidders submitting bids on the day of bid opening, bidders must submit at the West Bank location only.**

---

#### **Other Changes Continued:**

- For all advertised bids, corporate resolutions and/or written evidence of signature authority must be included with bid submission.
- Effective June 1, 2017, bidders may no longer send bid responses via facsimile, as some bid solicitations may provide. Vendors responding to bid solicitations may only submit via USPS, courier service, hand delivery or via online by registering free of charge at [www.jeffparishbids.net](http://www.jeffparishbids.net). For more information, please contact the Purchasing Department or visit [jeffparish.net](http://jeffparish.net).
- Current W9 Forms and vendor applications may be submitted at any time; however, if your company is not registered and/or a current W-9 form is not on file, a current W-9 form must be supplied upon contract execution, should you be awarded a contract and/or issued a purchase order.
- Upon contract execution, successful bidder must continue producing final insurance certificates per standard Jefferson Parish insurance requirements. Proof of insurance is required for bidding purposes. Bidders must read the insurance requirements attachment included in each bid package for specific instructions.

**Bidders should reference the "Additional Requirements" section of the bid instructions and/or the "Important Notice to Bidders" included in the bid package for specific requirements to respond accordingly.**

For more information, please call Jefferson Parish Purchasing at 504-364-2678.

General Government Bldg. – 200 Derbigny St – Suite 4400 - Gretna, LA 70053

Office 504.364.2678 – Fax 504.364.2693

Email: [Purchasing@jeffparish.net](mailto:Purchasing@jeffparish.net) Website: [www.jeffparish.net](http://www.jeffparish.net)

# Couplings and Restraints

## Contract

### Items Included In This Contract:

1. Steel Body Transitional Couplings (Non-Restrained)
2. Ductile Iron Body Transitional Couplings (Non-Restrained)
3. Flange Coupling Adapter (Non-Restrained)
4. Flange Coupling Adapter (Restrained)
5. EBAA Series 1000 E-Z Flange
6. EBAA Series 1100DEC Megalug Mechanical Joint Restraint
7. EBAA Series 1500 Split Restraint Harness For C-900 Pipe Bells And Spigot (4"-12")
8. EBAA Series 1600 Split Restraint Harness For C-900 Pipe Bells And Spigot (4"-12")
9. EBAA Series 1700 Megalug Restraint Harness For Ductile Iron Bells
10. EBAA Series 2000PEC Mechanical Joint Restraint
11. Transition Gaskets (Asbestos Cement To Cast Iron)
12. Mechanical Joint Gaskets (For Ductile Iron Pipe)
13. Pipe Lubricant

### Contract Terms:

This is a one year contract for supply of couplings, restraining devices, and the related gaskets for the Department of Water and Sewer, and all Jefferson Parish agencies and municipalities.

### Warranty:

Products shall be warranted that they are manufactured in accordance with the applicable material specifications and are free from defects in workmanship and materials for one year after delivery. Any defective items sold under this contract shall be replaced at no cost to the purchaser.

### General Specifications:

This specification is prepared for a one (1) year contract for a supply of couplings, restraining devices and related gaskets for the Parish of Jefferson, Department of Water and Sewerage, East and West Banks.

The quantities shown on the proposal guide are approximate quantities to be acquired by Jefferson Parish over a one (1) year period. Actual usage will be on an "as needed" basis.

Bid price shall include all freight and delivery costs to Jefferson Parish warehouse locations on the East and West Banks of Jefferson Parish.

The successful bidder shall not substitute any items on this bid throughout the one (1) year period without the written consent of the Jefferson Parish Engineering Dept.

All technical literature must be submitted with the bid. Failure to honor such request will result in the bid being considered non-responsive.

### **Technical Specifications:**

---

**1. Steel Body Transition Couplings 2"-24" (Non-Restrained):**

Coupling shall accommodate pipe offset up to 7/16", pipe deflection up to 8 degrees, and pipe gaps up to 7.5.

Coupling shall join pipes with difference diameters up to 1.30" (2.10" in the 16" size).

Coupling shall be of the long pattern design and meet or exceed AWWA C-219 and be NSF 61 approved.

Couplings shall have a working pressure of 260 PSI with a maximum test pressure of 390 PSI with a 1.5:1 safety factor.

- **Material:**

Transition couplings shall have a lightweight middle ring that is properly flanged with confined steel followers. Transition coupling shall have an epoxy coating of 10-12 mils in thickness.

- **Follower Track (Spanners):**

Follower track (spanners) shall be type 304 stainless steel with two (2) type 304 stainless steel carriage-type, compression bolts and nuts with corresponding stainless steel retainers (one at each end) located on the top of the coupling. Nuts shall be coated to prevent galling.

- **Gaskets:**  
Gaskets shall be wide range, multi-layered EDPM peel-off hydraulically pressure assisted, superior dual seal gaskets (seals mechanically and hydraulically) for permanently sealed joints.
- **Assembly:**  
Coupling shall be totally assembled as in integral unit having stab-on feature, with bolts staved to prevent disassembly and required no disassembly during installation.

Coupling shall be "Hymax" or approved equal.

**2. Ductile Iron Body Transition Couplings 4"-12" (Non-Restrained):**

Coupling shall accommodate pipe deflection up to 8 degrees (4 degrees on each end).

---

Coupling shall have an extended range up to 1.25".

Coupling coating shall be center ring fusion bonded epoxy in accordance with AWWA C213 and NSF 61 certified. End rings shall be e-coated epoxy.

Couplings shall have a working pressure of 260 PSI.

- **Material:**  
Transition coupling components (end rings, center ring, and bolt guides) shall be ductile iron, meeting or exceeding the requirements of ASTM A536, Grade 65-45-12.
- **Follower Track (Spanners):**  
Follower track (spanners) shall be type 304 stainless steel with two (2) type 304 stainless steel carriage-type, compression bolts and nuts with corresponding stainless steel retainers (one at each end) located on the top of the coupling. Nuts shall be coated to prevent galling.
- **Gaskets:**  
Gaskets shall be formed from virgin nitrile butadiene rubber (NBR) compounded for water and sewer service in accordance with ASTM D2000.
- **Assembly:**  
Coupling shall be totally assembled as in integral. End rings shall be segmented and joined with an integrated hinge.

Coupling shall be Macro™ by Romac or an approved equal.

**3. Flanged Coupling Adapters (Non-Restrained):**

Adapter shall meet or exceed AWWA c-219 and be NSF 61 approved, but shall have one compression end with one nut and bolt, and one flanged end which complies with AWWA C-207-94 or ANSI B16-5.

Please note that the 2" flanged coupling adapter shall be available in 2" oval meter flanged size.

Flanged coupling adapter shall be "Hymax Flanged Adapter" or an approved equal.

**Note to Vendor:**

The coating system for all restraining devices shall be mega bond by EBAA Iron, Inc. or an approved (factory applied, fusion bonded epoxy) equal.

---

**4. Flange Coupling Adapters (Restrained) (Ductile/Cast Iron Pipe, 3"-60"; Steel Pipe, 3"-12"):**

Pipe Material	DR Rating	Sizes Available
IPS OD PVC Pipe	All SDR's	3"-12"
C-900	14	4"-12"
C-900	18	4"-20"
C-900	25	4"-24"
C-900	32.5	14"-24"

For PVC pipe, the flange adapter shall have a pressure rating equal to the pipe.

For ductile iron pipe, the flange adapter shall have a safety factor of 2:1 minimum.

The flange adapter shall be UL listed 3"-12" for above and below ground use on schedule 40 steel pipes, and below-ground on all classes of listed ductile iron pipe.

The flange adapter shall be FM approved for use on C-900 Class 150 (DR-18) and class 200 (DR-14 PVC pipe, 4"-12"), and on all classes of listed ductile iron pipe, and for above ground flanged pipe systems (treatment plants, pumping stations, or underground).

- **Restrained Gland And Gasket Ring:**  
The flange adapter restrained gland and gasket ring shall be made of grade 60-42-12 ductile iron, which exceeds the minimum requirements of ASTM A-536-84, and shall have flange bolts circles that are compatible with ANSI/AWWA C-115/1-21.15. The flange adapter gasket ring shall be fusion-bonded epoxy coated inside and out.
  
- **Flange Adapter Restraint Ring:**  
The flange adapter restraint ring shall consist of a plurality of individual actuated gripping wedges to maximize restraint capability. Torque-limiting actuated screws shall be used to ensure proper initial set of the gripping wedges.
  
- **Assembly:**  
The flange adapter shall be capable of deflecting during assembly, or permit lengths of pipe to be field cut to allow a minimum of 0.6" of gap through 2.0" of gap (depending on pipe diameter) between the end-of-the-pipe-and-the-mating-flange-without-affecting-the-integrity-of-the-seal.
  
- **Nuts and Bolts:**  
The flange adapters shall be furnished with type 304 stainless steel machined bolts and nuts.

Flange adapter shall be EBAA Series 2100 "Megaflange" adapter, or an approved equal.

5. **EBAA Series 1000 E-Z Flange:**

The flange adapter shall be used in lieu of threaded or welded flanges on plain end ductile iron and steel pipe.

These flanges shall be cast from 60-42-10 ductile iron per ASTM A536 and shall have bolt circles and bolt holes to meet ANSI/AWWA C100/A21.10.

These flanges shall contain set screws made from ductile iron which have a Rockwell hardness of C40-45 converted from Brinnell.

Flange adapters shall be as manufactured by EBAA Iron, Inc. or an approved equal.

6. **Series 1100DEC Megalug Mechanical Joint Restraint:**

The wedges shall be ductile iron heat treated to a minimum hardness of 370 BHN. Dimensions of the gland shall be such that it can replace the standardized mechanical joint gland, and can be used with the standardized mechanical joint bell conforming to ANSI/AWWA C111/a21.11 and ANSI/AWWA C153/A.21.53 of the latest revision.

The mechanical joint restraint shall be available in the 3" through 48" sizes. They shall have a rated working pressure of 350 PSI in sizes 16" and smaller and 250 PSI in sizes 18" through 48" with 2 to 1 minimum safety factor. The devices shall be listed by Underwriter's Laboratories up through 24" size and approved by factory mutual up through 12" size.

All restraints shall be packaged. The package is to include the gland, EBAA-seal improved mechanical joint gasket and adequate lubricate for gasket lubrication, necessary quantity, size and length of t-bolts and nuts made from a low-alloy steel conforming to AWWA C-111 and be blue flora polymer coated equal to xylon coating.

The EBAA-seal gasket shall deflect 30% during assembly of the mechanical joint, improving sealing capabilities and shall meet in design and material, ANSI/AWWA C110/A21.10, C111/A21.11 or C153/A21.53, section 11-6.4 or latest revision.

---

The restraint shall be the series 110DEC Megalug restraint produced by EBAA Iron, Inc. or approved equal.

- **Mechanical Joint Restraint For Ductile Iron Pipe:**  
Mechanical joint restraint for ductile iron pipe shall be incorporated into the design of the follower gland. The restraining mechanism shall consist of a plurality of individual actuated wedges that increase their resistance to pullout as internal pressure or external forces increase; the device shall be capable of full mechanism joint deflection during assembly and the flexibility of the joint shall be maintained after burial. The joint restraint ring and its wedging components shall be made of grade 60-42-12 ductile iron, which exceeds minimum requirements of ASTM A536-84.
- **Flange Adapter Restraint Ring:**  
The flange adapter restraint ring shall consist of a plurality of individual actuated gripping wedges to maximize restraint capability. Torque-limiting actuated screws shall be used to ensure proper initial set of the gripping wedges.
- **Assembly:**  
The flange adapter shall be capable of deflecting during assembly, or permit lengths of pipe to be field cut to allow a minimum of 0.6" of gap through 2.0" of gap (depending on pipe diameter) between the end of the pipe and the mating flange without affecting the integrity of the seal.
- **Nuts and Bolts:**  
The flange adapters shall be furnished with type 304 stainless steel machined bolts and nuts.

7. **Series 1500 Split Restraint Harness For C-900 Pipe Bells and Spigot (4"-12"):**

All rings and components shall be made of grade 60-42-12 ductile iron, which exceeds minimum requirements of ASTM A536. A split ring shall be utilized behind the pipe bell. A split serrated ring shall be utilized to grip the pipe.

- **Tie Bolts:**

A sufficient quantity, size and length of tie bolts which shall be made from a low-alloy steel conforming to AWWA C111. Tie bolts shall be used to connect the bell ring and gripping ring.

- **Side Bolts:**

The side bolts shall be grade 5 machine bolts and be blue flora polymer coated equal to xylon coating.

- **Harness Restraint Device:**

The harness restraint device shall have a minimum working pressure rating of 150 psi, and be tested with a minimum of 4 to 1 safety factor. All sizes shall be FM approved for class 150 (DR 18) PVC pipe. All sizes rated to 200 PSI class 200 (DR 14) PVC pipe shall have a 3 to 1 safety factor, and shall be EBAA Series 1500 or an approved equal.

8. **Series 1600 Split Restraint Harness For C-900 Pipe Bells And Spigot (4"-12"):**

All rings and components shall be made of grade 60-42-12 ductile iron, which exceeds minimum requirements of ASTM A536. A split ring shall be utilized behind the pipe bell. A split serrated ring shall be utilized to grip the pipe.

- **Tie Bolts:**

A sufficient quantity, size and length of tie bolts which shall be made from a low-alloy steel conforming to AWWA C111. Tie bolts shall be used to connect the bell ring and gripping ring.

- **Side Bolts:**

The side bolts shall be grade 5 machine bolts and be blue flora polymer coated equal to xylon coating.

- **Harness Restraint Device:**

The harness restraint device shall have a minimum working pressure rating of 150 PSI, and be tested with a minimum of 4 to 1 safety factor. All sizes shall be FM approved for class 150 (DR 18) PVC pipe. All sizes rated to 200 PSI class 200 (DR 14) PVC pipe shall have a 3 to 1 safety factor, and shall be EBAA series 1600 or an approved equal.

9. **Series 1700 Megalug Restraint Harness for Ductile Iron Bells:**

Ductile iron pipe bell restraint shall consist of a wedge action restraint ring on the spigot and joined to a ductile iron pipe follower gland behind the bell. The restraint ring shall have individually-actuated wedges that increase their resistance to pull out as pressure or external forces increases.

- **Restraint Ring and Wedging Components:**  
The restraint ring and its wedging components shall be made of ductile iron grade 60-42-12, which exceeds minimum requirements of ASTM A536.
  
- **Wedges:**  
The wedges shall be heat-treated to a minimum hardness of 370 BHN. Torque limiting twist off nuts shall be used to ensure proper actuation of the restraining wedges.
  
- **Follower Gland:**  
The follower gland shall be made of the same grade ductile iron as previously mentioned. The connecting tie rods that join the two rings shall be of low alloy steel, which conforms to ANSI/AWWA C111/A21.11.
  

---

- **Assembly:**  
The assembly shall have a rated pressure with a minimum 2:1 safety factor for 350 PSI in sizes 16" and below, and 250 psi in sizes 18" through 36".
  
- **Harness:**  
Harness shall be series 1700 Megalug restraint harness manufacture by EBAA Iron, or an approved equal.

**10. Series 2000 PEC Mechanical Joint Restraint:**

The mechanical joint restraint shall be available in 3" through 36" sizes. The restraining joint gland shall have a pressure rating and safety factor equal to that of the pipe on which it is used.

Mechanical joint restraint for PVC pipe shall be incorporated into the design of the follower gland. The restraint mechanism shall consist of a plurality of individually-actuated gripping wedges that increases their resistance to pullout as internal pressure or external forces increase. This evenly distributes the thrust forces around the circumference of the pipe, and is for use on all sizes of IPS diameter PVC pipe in 3" through 12" sizes, and all sizes of AWWA C-900 and C-905 pipe (4" through 36"). The device shall be capable of full mechanical joint deflection during assembly and flexibility of the joint shall be maintained after burial. The joint restraint ring and its wedging components shall be made of grade 60-42-12 ductile iron, which exceeds minimum requirements of ASTM A536.

Dimensions of the gland shall be such that it replaces the standardized mechanical joint gland and can be used with the standardized mechanical joint bell conforming to ANSI/AWWA C111/A21.11 and ANSI/AWWA C153/A21.53 of latest revision. Torque limiting twist off nuts shall be used to insure proper actuating of restraining wedges.

- **Restraining Gland:**  
The restraining glands shall have been tested to ASTM F1674, and all sizes shall be rated at the full pressure capacity of the pipe. The mechanical joint restraint shall be listed by Underwriter's Laboratories, and approved by factory mutual (4"-12").
  - **Packaging:**  
All restraints shall be packaged. The package is to include gland, EBAA-seal(tm) improved mechanical joint gasket with adequate lubricant for gasket, necessary quantity, size and length of t-bolts and nuts made from a low-alloy steel conforming to AWWA C111 and be blue flora polymer coated equal to xylon coating.
  - **EBAA-Seal™ Gasket:**  
The EBAA-Seal™ gasket shall deflect 30% during assembly of the mechanical joint improving sealing capabilities and shall meet in design and material the ANSI/AWWA C110/A21.10, C111/A21.11, or C153/A21.53, section 11-6.4 or latest revision.
- 

The restraint shall be the series 2000 PEC Megalug restraint produced by EBAA Iron, Inc. or approved equal.

**11. Transition Gaskets (Asbestos Cement to Cast Iron):**

Transition gaskets shall go from asbestos cement (ac) size down to cast iron size to be used on potable water and sewer lines, made from virgin SBR rubber material for use in salty and acidic soils with a temperature range of -65 degrees to 180 degrees Fahrenheit. Transition gaskets shall conform to the latest revision of ASTM D2000 3 BA715 to work with class 100, 150, and 200 machined "AC" pipe and ductile iron pipe Class 53.

Transition gaskets shall be manufactured by Romac Industries or an approved equal.

**12. Mechanical Joint Gaskets (For Ductile Iron Pipe):**

Mechanical joint gaskets for ductile iron pipe shall be used on potable water and sewer lines. Virgin SBR rubber material for the use in salty and acidic soils with a temperature range of -40 degrees to 150 degrees Fahrenheit, meet or exceed ASTM D2000 3 BA715, and to fit ANSI/AWWA A21.11/C111 and ANSI/AWWA A21.53/C153 latest revision standard, 250 PSI working pressure.

**13. Pipe Lubricant:**

Pipe lubricant shall be used for potable and waste water applications. Pipe lubricant shall be non-toxic, odorless, tasteless, and not be able to support bacterial growth. Lubricant shall come in one quart containers and be used to assemble "push-on" pipe and fittings.

DATE: 5/10/2017  
BID NO.: 50-00119704

INVITATION TO BID  
THIS IS NOT AN ORDER

Page: 1

## JEFFERSON PARISH

PURCHASING DEPARTMENT  
P.O. BOX 9  
GRETNA, LA. 70054-0009  
504-364-2678

BUYER: DNELSON@jeffparish.net

BIDS WILL BE RECEIVED IN THE WEST BANK PURCHASING DEPT, SUITE 4400, JEFFERSON PARISH GENERAL GOVERNMENT BUILDING, 200 DERBIGNY STREET, GRETNA, LA 70053 UNTIL 2:00 PM, 5/25/2017 AND PUBLICLY OPENED THEREAFTER.

For convenience, bidders may also submit bids in the East Bank Purchasing Department, Suite 404, Jefferson Parish Joseph S. Yenni Building, 1221 Elmwood Park Blvd., Jefferson LA 70123. However, if submitting bids on the day of bid opening, bidders must submit at the West Bank location only. All bids will be publicly opened at the West Bank location.

At no charge, bidders may also submit via Jefferson Parish's electronic procurement page by visiting [www.jeffparishbids.net](http://www.jeffparishbids.net) to register for this free site. Additional instructions are included in the text box highlighting electronic procurement.

### LATE BIDS WILL NOT BE ACCEPTED

Unless submitting via online (see Page 3), each bid must be submitted in a sealed envelope bearing on the outside; the name of the Bidder, his address, and the name of the project for which the bid is submitted and the bid number.

**NOTE: ONLY BIDS WRITTEN IN INK OR TYPEWRITTEN, AND PROPERLY SIGNED BY A MEMBER OF THE FIRM OR AUTHORIZED REPRESENTATIVE, WILL BE ACCEPTED. PENCIL AND/OR PHOTOSTATIC FIGURES OR SIGNATURES SHALL RESULT IN BID REJECTION.**

### INSTRUCTIONS FOR BIDDERS AND GENERAL CONDITIONS

#### THE FOLLOWING INSTRUCTIONS APPLY TO ALL BIDS

All bids submitted are subject to these instructions and general conditions and any special conditions and specifications contained herein, all of which are made part of this bid proposal reference. By submitting a bid, vendor agrees to comply with all provisions of Louisiana Law as well be in compliance with the Jefferson Parish Code of Ordinances, Louisiana Code of Ethics, applicable Jefferson Parish ethical standards and Jefferson Parish Resolution No. 113646 and/or Resolution No. 113647.

All vendors submitting bids should register as a Jefferson Parish vendor if not already yet registered. Registration forms may be downloaded from <http://purchasing.jeffparish.net> and by clicking on Vendor Information. Current W-9 forms with respective Tax Identification numbers and vendor applications may be submitted at any time; however, if your company is not registered and/or a current W-9 form is not on file, vendor registration is mandatory. Further, a current W-9 form and respective Tax Identification number must be supplied upon contract execution, should you be awarded a contract and/or issued purchase order. Failure to do so may result in delay of payment.

All quotations shall be based on F.O.B. Agency warehouse or job site, anywhere within the Parish as designated by the Purchasing Department. This provision does not apply to public works projects

JEFFERSON PARISH requires all products to be new (current) and all work must be performed according to standard practices for the project. Unless otherwise specified, no aftermarket parts will be accepted. Unless otherwise specified, all workmanship and materials must have at least one (1) year guaranty, in writing, from the date of delivery and/or acceptance of the project. Any deviations or alterations from the specifications must be indicated and/or supporting documentation supplied with bid submission.

Bidders should submit all questions in writing and fax them to the Purchasing Department at (504) 364-2693 no later than FIVE (5) working days prior to bid opening. Bid numbers should be mentioned in all requests. Questions may also be emailed to the buyer for this bid at the email address listed above. If submitting online, vendors may send questions via the E-Procurement site no later than Five (5) working days prior to the bid opening.

If this bid requires a pre-bid conference (see Additional Requirements section), bidders are advised that such conference will be held to allow bidders the opportunity to identify any discrepancies in the bid specifications and seek further clarification regarding instructions. The Purchasing Department will issue a written response to bidders' questions in the form of an Addendum. Please note that all official communication will be expressed in the form of an addendum.

All formal Addenda require written acknowledgement on the bid form by the bidder. Failure to acknowledge an Addendum on the bid form shall cause the bid to be rejected. JEFFERSON PARISH reserves the right to award bid to next lowest responsive and responsible bidder in this event.

The purpose and intention of this invitation to bid is to afford all suppliers an equal opportunity to bid on all construction, maintenance, repair, operating supplies and/or equipment listed in this bid proposal. JEFFERSON PARISH WILL ACCEPT ONE BID ONLY FROM EACH VENDOR. Items bid must meet specifications.

Visit our website at [HTTP://PURCHASING.JEFFPARISH.NET](http://PURCHASING.JEFFPARISH.NET)

DATE: 5/10/2017

BID NO.: 50-00119704

Page: 2

JEFFERSON PARISH will accept one price for each item unless otherwise indicated. Two or more prices for one item will result in bid rejection. Bidders are required to complete, sign and return the bid form and/or complete and return the associated line item pricing forms as indicated. Vendors must not alter the bid forms. Doing so will cause the bid to be rejected.

A corporate resolution or written evidence of the individual signing the bid having such authority must be submitted with the bid. Failure to comply will cause bid to be rejected. For corporate entities, such written evidence may be a printout of the Louisiana Secretary of State's website listing the signatory as an officer. Such printout shall be included with the bid submission. Bids submitted by Owners or Sole Proprietorships must include certification that he or she owns the entity for which the bid is signed. This documentation must be submitted with the bid. Failure to do so will result in bid rejection.

NOTE: A sample corporate resolution can be downloaded from our website <http://purchasing.jeffparish.net> or you may provide your own document. A sample certification of sole proprietorship can also be downloaded from our website <http://purchasing.jeffparish.net> or you may provide your own document.

## INSTRUCTIONS FOR BIDDERS AND GENERAL CONDITIONS

A. AWARD OF CONTRACT: JEFFERSON PARISH reserves the right to award contracts or place orders on a lump sum or individual item basis, or such combination, as shall in its judgment be in the best interest of JEFFERSON PARISH. Every contract or order shall be awarded to the LOWEST RESPONSIVE and RESPONSIBLE BIDDER, taking into consideration the CONFORMITY WITH THE SPECIFICATIONS and the DELIVERY AND/OR COMPLETION DATE. SPLIT AWARDS MADE TO SEVERAL VENDORS WILL ONLY BE GRANTED TO THOSE DEEMED RESPONSIVE AND RESPONSIBLE.

All bid prices shall remain valid for 45 days. Jefferson Parish and the lowest responsive and responsible bidder(s) by mutual written consent may mutually agree to extend the deadline for award by one (1) or more extensions of thirty (30) calendar days.

PROTESTS: Only those vendors that submitted a bid in response to this solicitation may submit a protest in writing to the Director of the Purchasing within 48 hours of bid opening. The Purchasing Director will review it in connection with the Parish Attorney's Office which will then respond in writing as soon as possible.

PREFERENCE: Unless federal funding is directly spent by Jefferson Parish for this purchase, preference is hereby given to materials, supplies, and provisions produced, manufactured or grown in Louisiana, quality being equal to articles offered by competitors outside the state. "LSA - R.S. 38:2251-2261"

B. USE OF BRAND NAMES AND STOCK NUMBERS: Where brand names and stock numbers are specified, it is for the purpose of establishing certain minimum standards of quality. Bids may be submitted for products of equal quality, provided brand names and stock numbers are specified. Complete product data may be required prior to award.

C. CANCELLATION OF CONTRACT: JEFFERSON PARISH reserves the right to cancel all or any part if not shipped promptly. No charges will be allowed for parking or cartage unless specified in quotation. The order must not be filled at a higher price than quoted. JEFFERSON PARISH reserves the right to cancel any contract at anytime and for any reason by issuing a THIRTY (30) day written notice to the contractor.

For good cause and as consideration for executing a contract with Jefferson Parish, vendor conveys, sells, assigns and transfers to Jefferson Parish or its assigns all rights, title and interest in and to all causes of action it may now or hereafter acquire under the antitrust laws of the United States and the State of Louisiana, relating to the particular good or services purchased or acquired by Jefferson Parish.

D. PRICES: Jefferson Parish is exempt from paying sales tax under LSA-R.S. 47:301 (8)(c). All prices for purchases by Jefferson Parish of supplies and materials shall be quoted in the unit of measure specified and unless otherwise specified, shall be exclusive of state and Parish taxes. The price quoted for work shall be stated in figures. In the event there is a difference in unit prices and totals, the unit price shall prevail.

Quantities listed are for bidding purposes only. Actual requirements may be more or less than quantities listed.

Bidders are not to exclude from participation in, deny the benefits of, or subject to discrimination under any program or activity, any person in the United States on the grounds of race, color, national origin, or sex; nor discriminate on the basis of age under the Age Discrimination Act of 1975, or with respect to an otherwise qualified handicapped individual as provided in Section 504 of the Rehabilitation Act of 1973, or on the basis of religion, except that any exemption from such prohibition against discrimination on the basis of religion as provided in the Civil Rights Act of 1964, or Title VI and VII of the Act of April 11, 1968, shall also apply. This assurance includes compliance with the administrative requirements of the Revenue Sharing final handicapped discrimination provisions contained in Section 51.55 (c), (d), (e), and (k)(5) of the Regulations. New construction or renovation projects must comply with Section 504 of the 1973 Rehabilitation Act, as amended, in accordance with the American National Standard Institute's specifications (ANSI A17.1-1961).

Jefferson Parish and its partners as the recipients of federal funds are fully committed to awarding a contract(s) to firm(s) that will provide high quality services and that are dedicated to diversity and to containing costs. Thus, Jefferson Parish strongly encourages the involvement of minority and/or woman-owned business enterprises (DBE's, including MBE's, WBE's and SBE's) to stimulate participation in procurement and assistance programs.

**INSTRUCTIONS FOR BIDDERS AND GENERAL CONDITIONS**

Advertised bids will be tabulated and a copy of the tabulation will be forwarded to each responding bidder.

**IN ACCORDANCE WITH STATE REGULATIONS JEFFERSON PARISH OFFERS ELECTRONIC PROCUREMENT TO ALL VENDORS**

This electronic procurement system allows vendors the convenience of reviewing and submitting bids online. This is a secure site and authorized personnel have limited read access only. Bidders are encouraged to submit electronically using this free service; while the website accepts various file types, one single PDF file containing all appropriate and required bid documents is preferred. Bidders submitting uploaded images of bid responses are solely responsible for clarity. If uploaded images/documents are not legible, then bidder's submission will be rejected. Please note all requirements contained in this bid package for electronic bid submission.

Please visit our E-Procurement Page at [www.jeffparishbids.net](http://www.jeffparishbids.net) to register and view Jefferson Parish solicitations. For more information, please visit the Purchasing Department page at <http://purchasing.jeffparish.net>.

The general specifications for construction projects and the purchase of materials, services and/or supplies are those adopted by the JEFFERSON PARISH Council by Resolution No. 113646 or 113647 dated 12/09/09. The general conditions adopted by this resolution shall be considered as much a part of this document as if they were written wholly herein. A copy may be obtained from the Office of the Parish Clerk, Suite 6700, Jefferson Parish General Government Building, 200 Derbigny Street, Gretna, LA 70053. You may also obtain a copy by visiting the Purchasing Department webpage at <http://purchasing.jeffparish.net> and clicking on Online Forms.

**ADDITIONAL REQUIREMENTS FOR THIS BID**

PLEASE MATCH THE NUMBERS PRINTED IN THIS BOX WITH THE CORRESPONDING INSTRUCTIONS BELOW.

**10,12,13,15**

1. All bidders must attend the MANDATORY pre-bid conference and will be required to sign in and out as evidence of attendance. In accordance with LSA R.S. 38:2212(I), all prospective bidders shall be present at the beginning of the MANDATORY pre-bid conference and shall remain in attendance for the duration of the conference. Any prospective bidder who fails to attend the conference or remain for the duration shall be prohibited from submitting a bid for the project.
2. Attendance to this pre-bid conference is optional. However, failure to attend the pre-bid conference shall not relieve the bidder of responsibility for information discussed at the conference. Furthermore, failure to attend the pre-bid conference and inspection does not relieve the successful bidder from the necessity of furnishing materials or performing any work that may be required to complete the work in accordance with the specification with no additional cost to the owner.
3. Contractor must hold current applicable JEFFERSON PARISH licenses with the Department of Inspection and Code Enforcement. Contractor shall obtain any and all permits required by the JEFFERSON PARISH Department of Inspection and Code Enforcement. The contractor shall be responsible for the payment of these permits. All permits must be obtained prior to the start of the project. Contractor must also hold any and all applicable Federal and State licenses. Contractor shall be responsible for the payment of these permits and shall obtain them prior to the start of the project.
4. A LA State Contractor's License will be required in accordance with LSA R.S. 37-2150 et. seq. and such license number will be shown on the outside of the bid envelope. Failure to comply will cause the bid to be rejected. Additionally if submitting the bid electronically, then the license number must be entered in the appropriate field in the Electronic Procurement system. Failure to comply will cause the bid to be rejected.
5. It is the bidder's responsibility to visit the job site and evaluate the job before submitting a bid.
6. Job site must be clean and free of all litter and debris daily and upon completion of the contract. Passageways must be kept clean and free of material, equipment, and debris at all times. Flammable material must be removed from the job site daily because storage will not be permitted on the premises. Precautions must be exercised at all times to safeguard the welfare of JEFFERSON PARISH and the general public.

**INSTRUCTIONS FOR BIDDERS AND GENERAL CONDITIONS**

7. PUBLIC WORKS BIDS: All awards for public works in excess of \$5,000.00 will be reduced to a formal contract which shall be recorded at the contractor's expense with the Clerk of Court and Ex-Officio Recorder of Mortgages for the Parish of Jefferson. A price list of recordation costs may be obtained from the Clerk of Court and Ex-Officio Recorder of Mortgages for the Parish of Jefferson. All awards in excess of \$25,000.00 will require both a performance and a payment bond. Unless otherwise stated in the bid specifications, the performance bond requirements shall be 100% of the contract price. Unless otherwise state in the bid specifications, the payment bond requirements shall be 100% of the contract price. Both bonds shall be supplied at the signing of the contract.
8. NON-PUBLIC WORKS BIDS: A performance bond will be required for this bid. The amount of the bond will be 100% of the contract price unless otherwise indicated in the specifications. The performance bond shall be supplied at the signing of the contract.
9. NON-PUBLIC WORKS BIDS: A payment bond will be required for this bid. The amount of the bond will be 100% of the contract price unless otherwise indicated in the specifications. The payment bond shall be supplied at the signing of the contract.
10. Unless otherwise stated in the bid specifications, the successful bidder will be required to procure standard insurance policies evidencing Parish-mandated insurance requirements as indicated on the attached "insurance requirements" sheet. All bidders must comply with the instructions in this sheet. Failure to comply will cause bid to be rejected.
11. A bid bond will be required with bid submission in the amount of 5% of the total bid, unless otherwise stated in the bid specifications. Acceptable forms shall be limited to cashier's check, certified check, or surety bid bond. All sureties must be in original format (no copies) If submitting a bid online, vendors must submit an electronic bid bond through the respective online clearinghouse bond management system(s) as indicated in the electronic bid solicitation on Central Auction House. No scanned paper copies of any bid bond will be accepted as part of the electronic bid submission.
12. This is a requirements contract to be provided on an as needed basis. JEFFERSON PARISH makes no representations on warranties with regard to minimum guaranteed quantities unless otherwise stated in the bid specifications.
13. Freight charges should be included in total cost when quoting. If not quoted FOB DELIVERED, freight must be quoted as a separate item. Bid may be rejected if not quoted FOB DELIVERED or if freight charges are not indicated on bid form.
14. PUBLIC WORKS BIDS - Completed, Signed and Properly Notarized Affidavits Required; This applies to all solicitations for construction, alteration or demolition of public buildings or projects, in conformity with the provisions contained in LSA-RS 38:2212.9, LSA-RS 38:2212.10, LSA-RS 38:2224, and Sec 2-923.1 of the Jefferson Parish Code of Ordinances. For bidding purposes, all bidders must submit with bid submission COMPLETED, SIGNED and PROPERLY NOTARIZED Affidavits, including: Non-Collusion Affidavit, Non-Collusion Affidavit, Campaign Contribution Affidavit, Debt Disclosures Affidavit and E-Verify Affidavit. For the convenience of vendors, all affidavits have been combined into one form entitled PUBLIC WORKS BID AFFIDAVIT. This affidavit must be submitted in its original format, and without material alteration, in order to be compliant and for the bid to be considered responsive. A scanned copy of the completed, signed and properly notarized affidavit may be submitted with the bid, however, the successful bidder must submit the original affidavit in its original format and without material alteration upon contract execution. Failure to comply will result in the bid submission being rejected as non-responsive. The Parish reserves the right to award bid to the next lowest responsive and responsible bidder in this event.
15. NON PUBLIC WORK BIDS - Completed, Signed and Properly Notarized Affidavits Required in conformity with the provisions contained in LSA - RS 38:2224 and Sec 2-923.1 of the Jefferson Parish Code of Ordinances. For bidding purposes, all bidders must submit with bid submission COMPLETED, SIGNED and PROPERLY NOTARIZED Affidavits, including: Non-Collusion Affidavit, Debt Disclosures Affidavit and Campaign Contribution Affidavit. For the convenience of vendors, all affidavits have been combined into one form entitled NON PUBLIC WORKS BID AFFIDAVIT. This affidavit must be submitted in its original format, and without material alteration, in order to be compliant and for the bid to be considered responsive. A scanned copy of the completed, signed and properly notarized affidavit may be submitted with the bid, however, the successful bidder must submit the original affidavit in its original format and without material alteration upon contract execution. Failure to comply will result in the bid submission being rejected as non-responsive. The Parish reserves the right to award bid to the next lowest responsive and responsible bidder in this event.
16. The ensuing contract for this bid solicitation may be eligible for FEMA reimbursement and/or Federal funding/reimbursement. As such, the referenced appendix will be applicable accordingly and shall be considered a part of the bid documents. All applicable certifications must be duly completed, signed and submitted with bid submission. Failure to submit applicable certifications with bid submission will result in bid rejection.
17. For this project, the Contractor shall not pay any state or local sales or use taxes on materials and equipment which are affixed and made part of the immovable property of the project or which permanently incorporated in the project (hereinafter referred to as "applicable materials and equipment"). All purchases of applicable materials or equipment shall be made by the contractor on behalf of and as the agent of Jefferson Parish (Owner), a political subdivision of the State of Louisiana. No state and local sales and use taxes are owned on applicable materials and equipment under the provisions of Act 1029 of the 1991 Regular Session - Louisiana Revised Statute 47:301(B)(c). Owner will furnish contractor a certificate form which certifies that Owner is not required to pay such state or local sales and use taxes, and contractor shall furnish a copy of such certificate to all vendors or suppliers of the applicable materials and equipment

It shall be the duty of every parish officer, employee, department, agency, special district, board, and commission: and the duty of every contractor, subcontractor, and licensee of the parish, and the duty of every applicant for certification of eligibility for a parish contract or program, to cooperate with the Inspector General in any investigation, audit, inspection, performance review, or hearing pursuant to Jefferson Parish Code of Ordinances Section 2-155.10(19). By submitting a bid, vendor acknowledges this and will abide by all provisions of the referenced Jefferson Parish Code of Ordinances.

**All Public Work Projects are required to use the Louisiana Uniform Public Work Bid Form**

All prices must be held firm unless an escalation provision is requested in this bid. Jefferson Parish will allow one escalation during the term of the contract, which may not exceed the U.S. Bureau of Labor Statistics National Index for all Urban Consumers, unadjusted 12 month figure. The most recently published figure issued at the time an adjustment is requested will be used. A request must be made in writing by the vendor, and the escalation will only be applied to purchases made after the request is made.

Are you requesting an escalation provision?

YES \_\_\_\_\_ NO

MAXIMUM ESCALATION PERCENTAGE REQUESTED \_\_\_\_\_%

INITIAL BID PRICES WILL REMAIN FIRM THROUGH THE DATE OF \_\_\_\_\_.

For the purposes of comparison of bids when an escalation provision is requested, Jefferson Parish will apply the maximum escalation percentage quoted by the bidder to the period to which it is applied in the bid. The initial price and the escalation will be used to calculate the total bid price. It will be assumed, for comparison of prices only, that an equal amount of material or labor is purchased each month throughout the entire contract.

**DELIVERY: FOB JEFFERSON PARISH**

INDICATE DELIVERY DATE ON EQUIPMENT AND SUPPLIES

*Stock - 3 weeks*

LOUISIANA CONTRACTOR'S LICENSE NO.: (if applicable) \_\_\_\_\_

**THIS SECTION MUST BE COMPLETED BY BIDDER:**

FIRM NAME: \_\_\_\_\_

**Ferguson Enterprises  
DBA Louisiana Utilities Supply  
901 S Labarre Rd, Suite 206  
Metairie LA 70001**

ADDRESS: \_\_\_\_\_

CITY, STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_

TELEPHONE: *504)834-1106* FAX: *504)831-4179*

EMAIL ADDRESS: *Cathy.McCarthy@ferguson.com*

In the event that addenda are issued with this bid, bidders MUST acknowledge all addenda on the bid form. Bidder must acknowledge receipt of an addendum on the bid form as indicated. Failure to acknowledge any addendum on the bid form will result in bid rejection.

Acknowledge Receipt of Addenda: NUMBER: 1 5/24/17  
NUMBER: 2 5/25/17  
NUMBER: \_\_\_\_\_  
NUMBER: \_\_\_\_\_

TOTAL PRICE OF ALL BID ITEMS: \$ 259,614.64

AUTHORIZED SIGNATURE: *Cathy A. McCarthy*

*Cathy A. McCarthy*  
Printed Name

TITLE: *Salesperson*

SIGNING INDICATES YOU HAVE READ AND COMPLY WITH THE INSTRUCTIONS AND CONDITIONS.

NOTE: All bids should be returned with the BID NUMBER and BID OPENING DATE indicated on the outside of the envelope submitted to the Purchasing Department.

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00119704

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
			ONE (1) YEAR CONTRACT FOR A SUPPLY OF COUPLINGS, RESTRAINING DEVICES, AND THE RELATED GASKETS FOR THE JEFFERSON PARISH DEPARTMENT OF PUBLIC WORKS WATER & SEWER & ALL J.P. AGENCIES AND MUNICIPALITIES		
1	2.00	EA	0010 3 INCH FLANGE RESTRAINER PART #1003 (38418)	18.50	37.00
2	2.00	EA	0020 4 INCH FLANGE RESTRAINER PART #1004 (38417)	25.00	50.00
3	2.00	EA	0030 6 INCH FLANGE RESTRAINER PART #1006 (38415)	26.80	53.60
4	2.00	EA	0040 8 INCH FLANGE RESTRAINER PART #1008 (38416)	37.40	74.80
5	2.00	EA	0050 10 INCH FLANGE RESTRAINER PART #1010 (38419)	65.00	130.00
6	2.00	EA	0060 12 INCH FLANGE RESTRAINER PART #1012 (38411)	76.00	152.00
7	2.00	EA	0070 14 INCH FLANGE RESTRAINER PART #1014 (38412)	173.00	346.00
8	2.00	EA	0080 16 INCH FLANGE RESTRAINER PART #1016 (38413)	216.00	432.00
9	2.00	EA	0090 18 INCH FLANGE RESTRAINER PART #1018 (38424)	245.00	490.00
10	2.00	EA	0100 20 INCH FLANGE RESTRAINER PART #1020 (38420)	294.00	588.00
11	2.00	EA	0110 24 INCH FLANGE RESTRAINER PART #1024 (38414)	396.00	792.00
12	2.00	EA	0120 4 INCH BELL RESTRAINT HARNESS C900 SPLIT SERRATED RING	32.50	65.00

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00119704

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
13	16.00	EA	PART #1504 (51240) 0130 6 INCH BELL RESTRAINT HARNESS C900 SPLIT SERRATED RING	38.70	619.20
14	2.00	EA	PART #1506 (51241) 0140 8 INCH BELL RESTRAINT HARNESS C900 SPLIT SERRATED RING	56.40	112.80
15	2.00	EA	PART #1508 (51242) 0150 4 INCH BELL RESTRAINT HARNESS C900 SERRATED & NON-SERRATED RING	35.70	71.40
16	2.00	EA	PART #1604 0160 6 INCH BELL RESTRAINT HARNESS C900 SERRATED & NON-SERRATED RING	41.60	83.20
17	2.00	EA	PART #1606 (51241A) 0170 8 INCH BELL RESTRAINT HARNESS C900 SERRATED & NON-SERRATED RING	63.30	126.60
18	2.00	EA	PART #1608 (51242A) 0180 10 INCH BELL RESTRAINT HARNESS C900 SERRATED & NON-SERRATED RING	109.00	218.00
19	2.00	EA	PART #1610 (51243) 0190 4 INCH BELL RESTRAINT HARNESS D.I. PART #1704	31.20	62.40
20	2.00	EA	0200 6 INCH BELL RESTRAINT HARNESS D.I. PART #1706	46.50	93.00
21	1.00	EA	0210 8 INCH BELL RESTRAINT HARNESS D.I. PART #1708	58.00	58.00
22	2.00	EA	0220 10 INCH BELL RESTRAINT HARNESS D.I. PART #1710 (51254)	102.00	204.00
23	2.00	EA	0230 12 INCH BELL RESTRAINT HARNESS D.I. PART #1712	123.00	246.00

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00119704

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
24	2.00	EA	0240 14 INCH BELL RESTRAINT HARNESS D.I. PART #1714	202.40	404.80
25	2.00	EA	0250 16 INCH BELL RESTRAINT HARNESS D.I. PART #1716 (51253)	231.00	462.00
26	2.00	EA	0260 18 INCH BELL RESTRAINT HARNESS D.I. PART #1718	248.00	496.00
27	2.00	EA	0270 20 INCH BELL RESTRAINT HARNESS D.I. PART #1720	347.00	694.00
28	2.00	EA	0280 24 INCH BELL RESTRAINT HARNESS D.I. PART #1724	450.00	900.00
29	2.00	EA	0290 30 INCH BELL RESTRAINT HARNESS D.I. PART #1730	898.00	1796.00
30	2.00	EA	0300 36 INCH BELL RESTRAINT HARNESS D.I. PART #1736	1270.00	2540.00
31	2.00	EA	0310 1.5 INCH FLANGE COUPLING ADAPTER EPOXY COATED; PART #2100-0213-260 (17980)	89.40	178.80
32	2.00	EA	0320 2 INCH FLANGE COUPLING ADAPTER EPOXY COATED; PART #2100-0303-260 (17981)	95.60	191.20
33	2.00	EA	0330 3 INCH FLANGE COUPLING ADAPTER EPOXY COATED; PART #2100-0433-260 (17982)	136.00	272.00
34	24.00	EA	0340 4 INCH FLANGE COUPLING ADAPTER EPOXY COATED; PART #2100-0563-260 (17984)	174.00	4176.00
35	12.00	EA	0350 6 INCH FLANGE COUPLING ADAPTER EPOXY COATED; PART #2100-0768-260	222.00	2664.00

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00119704

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
36	16.00	EA	(17985) 0360 8 INCH FLANGE COUPLING ADAPTER EPOXY COATED; PART #2100-0984-260	303.00	4848.00
37	2.00	EA	(17986) 0370 10 INCH FLANGE COUPLING ADAPTER EPOXY COATED; PART #2100-1226-260	507.00	1014.00
38	2.00	EA	(17988) 0380 12 INCH FLANGE COUPLING ADAPTER EPOXY COATED; PART #2100-1366-260	589.00	1178.00
39	2.00	EA	(17989) 0390 12 INCH FLANGE COUPLING ADAPTER EPOXY COATED; PART #2100-1441-260	589.00	1178.00
40	2.00	EA	(17990) 0400 3 INCH FLANGE COUPLING ADAPTER TEFLON COATED; PART #2103 (17999A)	74.00	148.00
41	2.00	EA	0410 4 INCH FLANGE COUPLING ADAPTER TEFLON COATED; PART #2104 (18000A)	74.00	148.00
42	2.00	EA	0420 6 INCH FLANGE COUPLING ADAPTER TEFLON COATED; PART #2106 (18001A)	106.00	212.00
43	2.00	EA	0430 8 INCH FLANGE COUPLING ADAPTER TEFLON COATED; PART #2108 (18002A)	159.00	318.00
44	2.00	EA	0440 10 INCH FLANGE COUPLING ADAPTER TEFLON COATED; PART #2110 (18003A)	233.00	466.00
45	2.00	EA	0450 12 INCH FLANGE COUPLING ADAPTER TEFLON COATED; PART #2112 (18004A)	291.00	582.00
46	2.00	EA	0460 14 INCH FLANGE COUPLING ADAPTER TEFLON COATED; PART #2114 (18005A)	452.00	904.00
47	2.00	EA	0470 16 INCH FLANGE COUPLING ADAPTER TEFLON COATED; PART #2116 (18006A)	665.00	1330.00

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00119704

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
48	2.00	EA	0480 18 INCH FLANGE COUPLING ADAPTER TEFLON COATED; PART #2118 (18015A)	760. <sup>00</sup>	1520. <sup>00</sup>
49	2.00	EA	0490 20 INCH FLANGE COUPLING ADAPTER TEFLON COATED; PART #2120 (18016A)	849. <sup>00</sup>	1698. <sup>00</sup>
50	2.00	EA	0500 24 INCH FLANGE COUPLING ADAPTER TEFLON COATED; PART #2124 (18017A)	1040. <sup>00</sup>	2080. <sup>00</sup>
51	2.00	EA	0510 30 INCH FLANGE COUPLING ADAPTER TEFLON COATED; PART #2130 (18018A)	1361. <sup>00</sup>	2722. <sup>00</sup>
52	2.00	EA	0520 36 INCH FLANGE COUPLING ADAPTER TEFLON COATED; PART #2136 (18019A)	2128. <sup>00</sup>	4256. <sup>00</sup>
53	2.00	EA	0530 42 INCH FLANGE COUPLING ADAPTER TEFLON COATED; PART #2142 (18014A)	5830. <sup>00</sup>	11,660. <sup>00</sup>
54	2.00	EA	0540 48 INCH FLANGE COUPLING ADAPTER TEFLON COATED; PART #2148 (18013A)	7447. <sup>00</sup>	14,894. <sup>00</sup>
55	36.00	EA	0550 1.5 INCH TRANSITION COUPLING PART #2000-0213-260 (18019)	73.60	2649.60
56	60.00	EA	0560 2 INCH TRANSITION COUPLING PART #2000-0303-260 (18020)	77.60	4656. <sup>00</sup>
57	48.00	EA	0570 4 INCH TRANSITION COUPLING PART #2000-0563-260 (18031)	131. <sup>00</sup>	6288. <sup>00</sup>
58	250.00	EA	0580 6 INCH TRANSITION COUPLING PART #2000-0768-260 (18041)	173. <sup>00</sup>	43,250. <sup>00</sup>
59	150.00	EA	0590 8 INCH TRANSITION COUPLING PART #2000-0984-260 (18151)	196. <sup>00</sup>	29,400. <sup>00</sup>
60	30.00	EA	0600 10 INCH TRANSITION COUPLING PART #2000-1226-260 (18079)	269. <sup>00</sup>	8070. <sup>00</sup>

## INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00119704

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
61	24.00	EA	0610 12 INCH TRANSITION COUPLING PART #2000-1441-260 (18155)	363.00	8712.00
62	2.00	EA	0620 14 INCH TRANSITION COUPLING PART #2000-1710-260 (18297A)	768.00	1536.00
63	2.00	EA	0630 16 INCH TRANSITION COUPLING PART #2000-1920-260 (18299)	798.00	1596.00
64	2.00	EA	0640 18 INCH TRANSITION COUPLING PART #2000-2160-260 (18300)	932.00	1864.00
65	2.00	EA	0650 20 INCH TRANSITION COUPLING PART #2000-2360-260 (18308)	1005.00	2010.00
66	2.00	EA	0660 3 INCH JOINT RESTRAINER (D.I.) PART # 1103 DEC (51799)	20.80	41.60
67	2.00	EA	0670 4 INCH JOINT RESTRAINER (D.I.) PART # 1104 DEC (51800)	23.55	47.10
68	24.00	EA	0680 6 INCH JOINT RESTRAINER (D.I.) PART # 1106 DEC (51801)	29.70	712.80
69	1.00	EA	0690 8 INCH JOINT RESTRAINER (D.I.) PART # 1108 DEC (51802)	38.50	38.50
70	2.00	EA	0700 10 INCH JOINT RESTRAINER (D.I.) PART # 1110 DEC (51803)	54.00	108.00
71	1.00	EA	0710 12 INCH JOINT RESTRAINER (D.I.) PART # 1112 DEC (51804)	72.00	72.00
72	2.00	EA	0720 14 INCH JOINT RESTRAINER (D.I.) PART # 1114 DEC (51805)	88.00	176.00
73	2.00	EA	0730 16 INCH JOINT RESTRAINER (D.I.) PART # 1116 DEC (51806)	128.00	256.00

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00119704

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
74	2.00	EA	0740 18 INCH JOINT RESTRAINER (D.I.) PART # 1118 DEC (51807)	148. <sup>00</sup>	296. <sup>00</sup>
75	6.00	EA	0750 20 INCH JOINT RESTRAINER (D.I.) PART # 1120 DEC (51808)	181. <sup>00</sup>	1086. <sup>00</sup>
76	2.00	EA	0760 24 INCH JOINT RESTRAINER (D.I.) PART # 1124 DEC (51809)	249. <sup>00</sup>	498. <sup>00</sup>
77	1.00	EA	0770 30 INCH JOINT RESTRAINER (D.I.) PART # 1130 DEC (51810)	568. <sup>00</sup>	568. <sup>00</sup>
78	1.00	EA	0780 36 INCH JOINT RESTRAINER (D.I.) PART # 1136 DEC (51811)	732. <sup>00</sup>	732. <sup>00</sup>
79	2.00	EA	0790 42 INCH JOINT RESTRAINER (D.I.) PART # 1142 DEC (51812)	1099. <sup>00</sup>	2198. <sup>00</sup>
80	2.00	EA	0800 48 INCH JOINT RESTRAINER (D.I.) PART # 1148 DEC (51813)	1388. <sup>00</sup>	2776. <sup>00</sup>
81	2.00	EA	0810 3 INCH JOINT RESTRAINER (C900) PART # 2003PEC (51819)	23. <sup>00</sup>	46. <sup>00</sup>
82	120.00	EA	0820 4 INCH JOINT RESTRAINER (C900) PART # 2004PEC (51820)	26.25	3150. <sup>00</sup>
83	300.00	EA	0830 6 INCH JOINT RESTRAINER (C900) PART # 2006PEC (51821)	33.70	10,110. <sup>00</sup>
84	200.00	EA	0840 8 INCH JOINT RESTRAINER (C900) PART # 2008PEC (51822)	44. <sup>00</sup>	8800. <sup>00</sup>
85	2.00	EA	0850 10 INCH JOINT RESTRAINER (C900) PART # 2010PEC (51823)	74. <sup>00</sup>	148. <sup>00</sup>
86	2.00	EA	0860 12 INCH JOINT RESTRAINER (C900) PART # 2012PEC (51824)	78.80	157.60

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00119704

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
87	2.00	EA	0870 14 INCH JOINT RESTRAINER (C900) PART # 2014PEC (51825)	121. <sup>00</sup>	242. <sup>00</sup>
88	2.00	EA	0880 16 INCH JOINT RESTRAINER (C900) PART # 2016PEC (51826)	155. <sup>00</sup>	310. <sup>00</sup>
89	2.00	EA	0890 18 INCH JOINT RESTRAINER (C900) PART # 2018PEC (51827)	184. <sup>00</sup>	368. <sup>00</sup>
90	2.00	EA	0900 20 INCH JOINT RESTRAINER (C900) PART # 2020PEC (51828)	223. <sup>00</sup>	446. <sup>00</sup>
91	4.00	EA	0910 24 INCH JOINT RESTRAINER (C900) PART # 2024PEC (51829)	269. <sup>00</sup>	1076. <sup>00</sup>
92	1.00	EA	0920 30 INCH JOINT RESTRAINER (C900) PART # 2030PEC (51830)	700. <sup>00</sup>	700. <sup>00</sup>
93	1.00	EA	0930 36 INCH JOINT RESTRAINER (C900) PART # 2036PEC (51831)	869. <sup>00</sup>	869. <sup>00</sup>
94	8.00	EA	0940 PIPE SIZE 6 INCH TRANSITION GASKET NOM (51132)	2.50	20.00
95	2.00	EA	0950 PIPE SIZE 8 INCH TRANSITION GASKET NOM (51133)	3.60	7.20
96	2.00	EA	0960 PIPE SIZE 10 INCH TRANSITION GASKET NOM (51134)	4.50	9.00
97	2.00	EA	0970 PIPE SIZE 12 INCH TRANSITION GASKET NOM (51135)	5.00	10.00
98	2.00	EA	0980 PIPE SIZE 3 INCH MECHANICAL JOINT GASKET; NOM: O.D. 4.875 INCH (51220)	1.75	3.50
99	2.00	EA	0990 PIPE SIZE 4 INCH MECHANICAL JOINT GASKET; NOM: O.D. 4.80 INCH (51221)	1.75	3.50

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00119704

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
100	60.00	EA	1000 PIPE SIZE 6 INCH MECHANICAL JOINT GASKET; NOM: O.D. 6.90 INCH (51222)	1.75	105.00
101	2.00	EA	1010 PIPE SIZE 8 INCH MECHANICAL JOINT GASKET; NOM: O.D. 9.05 INCH (51223)	2.10	4.20
102	2.00	EA	1020 PIPE SIZE 10 INCH MECHANICAL JOINT GASKET; NOM: O.D. 11.10 INCH (51224)	2.82	5.64
103	2.00	EA	1030 PIPE SIZE 12 INCH MECHANICAL JOINT GASKET; NOM: O.D. 13.20 INCH (51225)	3.50	7.00
104	2.00	EA	1040 PIPE SIZE 14 INCH MECHANICAL JOINT GASKET; NOM: O.D. 15.30 INCH (51226)	6.00	12.00
105	2.00	EA	1050 PIPE SIZE 16 INCH MECHANICAL JOINT GASKET; NOM: O.D. 17.40 INCH (51227)	6.00	12.00
106	2.00	EA	1060 PIPE SIZE 18 INCH MECHANICAL JOINT GASKET; NOM: O.D. 19.50 INCH (51228)	7.00	14.00
107	2.00	EA	1070 PIPE SIZE 20 INCH MECHANICAL JOINT GASKET; NOM: O.D. 21.60 INCH (51229)	7.50	15.00
108	2.00	EA	1080 PIPE SIZE 24 INCH MECHANICAL JOINT GASKET; NOM: O.D. 25.80 INCH (51230)	9.50	19.00
109	2.00	EA	1090 PIPE SIZE 30 INCH MECHANICAL JOINT GASKET; NOM: O.D. 32.00 INCH (51231)	22.50	45.00
110	2.00	EA	1100 PIPE SIZE 36 INCH MECHANICAL JOINT GASKET; NOM: O.D. 38.30 INCH (51232)	25.80	51.60
111	2.00	EA	1110 PIPE SIZE 42 INCH MECHANICAL JOINT GASKET; NOM: O.D. 44.50 INCH (51233)	53.00	106.00
112	2.00	EA	1120 PIPE SIZE 48 INCH MECHANICAL JOINT GASKET; NOM: O.D. 50.80 INCH (51234)	56.00	112.00

INVITATION TO BID FROM JEFFERSON PARISH - continued

BID NO.: 50-00119704

SEALED BID

ITEM NUMBER	QUANTITY	U/M	DESCRIPTION OF ARTICLES	UNIT PRICE QUOTED	TOTALS
113	288.00	EA	1130 PIPE LUBRICANT (50180)	3.25	936. <sup>00</sup>
114	2.00	EA	1140 4 INCH DUCTILE IRON BODY TRANSITIONAL COUPLINGS 4 - 12 INCHES (NON-RESTRAINED)	253. <sup>00</sup>	506. <sup>00</sup>
115	2.00	EA	1150 6 INCH DUCTILE IRON BODY TRANSITIONAL COUPLINGS 4 - 12 INCHES (BIB-RESTRAINED)	304. <sup>00</sup>	608. <sup>00</sup>
116	2.00	EA	1160 8 INCH DUCTILE IRON BODY TRANSITIONAL COUPLINGS 4 - 12 INCHES (NON-RESTRAINED)	333. <sup>00</sup>	666. <sup>00</sup>
117	2.00	EA	1170 10 INCH DUCTILE IRON BODY TRANSITIONAL COUPLINGS 4 - 12 INCHES (NON-RESTRAINED)	403. <sup>00</sup>	806. <sup>00</sup>
118	2.00	EA	1180 12 INCH DUCTILE IRON BODY TRANSITIONAL COUPLINGS 4 - 12 INCHES (NON-RESTRAINED)	458. <sup>00</sup>	916. <sup>00</sup>
119	24.00	EA	1190 14 INCH X 12 INCH REDUCING COUPLING HYMAX #861560315035316 (18156)	1570. <sup>00</sup>	37,680. <sup>00</sup>

Item Code	Description	
ZF2-C3	3 ZIP FLANGE EQ. UAC200-3	SIGMA
ZF2-C4	4 ZIP FLANGE EQ. UAC200-4	SIGMA
ZF2-C6	6 ZIP FLANGE EQ. UAC200-6	SIGMA
ZF2-C8	8 ZIP FLANGE EQ. UAC200-8	SIGMA
ZF2-C10	10 ZIP FLANGE EQ. UAC200-10	SIGMA
ZF2-C12	12 ZIP FLANGE EQ. UAC200-12	SIGMA
ZF4-C14	14 ZIP FLANGE EQ. UAC400-14	SIGMA
ZF4-C18	18 ZIP FLANGE EQ. UAC400-18	SIGMA
ZF4-C16	16 ZIP FLANGE EQ. UAC400-16	SIGMA
ZF4-C20	20 ZIP FLANGE EQ. UAC400-20	SIGMA
ZF4-C24	24 ZIP FLANGE EQ. UAC400-24	SIGMA
PWP-C4	4 PV-LOK RSTR C900 BELL JT	SIGMA
PWP-C6	6 PV-LOK RSTR C900 BELL JT	SIGMA
PWP-C8	8 PV-LOK RSTR C900 BELL JT	SIGMA
UFR1355C4RBU	4" C900 RESTRAINT	FORD
UFR1355C6RBU	6" C900 RESTRAINT	FORD
UFR1355C8RBU	8" C900 RESTRAINT	FORD
UFR1355C10RBU	10" C900 RESTRAINT	FORD
SLDEH4	4 WDG RSTR HARNESS DI PIPE	SIGMA
SLDEH6	6 WDG RSTR HARNESS DI PIPE	SIGMA
SLDEH8	8 WDG RSTR HARNESS DI PIPE	SIGMA
SLDEH10	10 WDG RSTR HARNESS DI PIPE	SIGMA
SLDEH12	12 WDG RSTR HARNESS DI PIPE	SIGMA
SLDEH14	14 WDG RSTR HARNESS DI PIPE	SIGMA
SLDEH16	16 WDG RSTR HARNESS DI PIPE	SIGMA
SLDEH18	18 WDG RSTR HARNESS DI PIPE	SIGMA
SLDEH20	20 WDG RSTR HARNESS DI PIPE	SIGMA
SLDEH24	24 WDG RSTR HARNESS DI PIPE	SIGMA
SLDEH30	30 WDG RSTR HARNESS DI PIPE	SIGMA
SLDEH36	36 WDG RSTR HARNESS DI PIPE	SIGMA
21000213260	1.5 FLG ADAPTER	KRAUSZ
21000303260	2 FLG ADAPTER	KRAUSZ
21000433260	3 FLG ADAPTER	KRAUSZ
21000563260	4 FLG ADAPTER	KRAUSZ
21000768260	6 FLG ADAPTER	KRAUSZ
21000984260	8 FLG ADAPTER	KRAUSZ
21001226260	10 FLG ADAPTER	KRAUSZ
21001441260	12 FLG ADAPTER	KRAUSZ
21001441260	12 FLG ADAPTER	KRAUSZ
2103	3" MEGA FLG	EBAA
2104	4" MEGA FLG	EBAA
2106	6" MEGA FLG	EBAA
2108	8" MEGA FLG	EBAA
2110	10" MEGA FLG	EBAA
2112	12" MEGA FLG	EBAA
2114	14" MEGA FLG	EBAA

2116 16" MEGA FLG	EBAA
2118 18" MEGA FLG	EBAA
2120 20" MEGA FLG	EBAA
2124 24" MEGA FLG	EBAA
2130 30" MEGA FLG	EBAA
2136 36" MEGA FLG	EBAA
2142 42" MEGA FLG	EBAA
2148 48" MEGA FLG	EBAA
20000213260 1.5 HYMAX CPLG	KRAUSZ
20000303260 2" HYMAX CPLG	KRAUSZ
20000768260 4" HYMAX CPLG	KRAUSZ
20000984260 6" HYMAX CPLG	KRAUSZ
20001226260 10" HYMAX CPLG	KRAUSZ
20001441260 12" HYMAX CPLG	KRAUSZ
20001710260 14" HYMAX CPLG	KRAUSZ
20001920260 16" HYMAX CPLG	KRAUSZ
20002160260 18" HYMAX CPLG	KRAUSZ
20002360260 20" HYMAX CPLG	KRAUSZ
UFR1400DAP3RBI 3" DI RESTRAINT	FORD
UFR1400DAP4RBI 4 DI RESTRAINT	FORD
UFR1400DAP6RBI 6 DI RESTRAINT	FORD
UFR1400DAP8RBI 8 DI RESTRAINT	FORD
UFR1400DAP10RB 10 DI RESTRAINT	FORD
UFR1400DAP12RB 12 DI RESTRAINT	FORD
UFR1400DAP14RB 14 DI RESTRAINT	FORD
UFR1400DAP16RB 16 DI RESTRAINT	FORD
UFR1400DAP18RB 18 DI RESTRAINT	FORD
UFR1400DAP20RB 20 DI RESTRAINT	FORD
UFR1400DAP24RB 24 DI RESTRAINT	FORD
UFR1400DAP30RB 30 DI RESTRAINT	FORD
UFR1400DAP36RB 36 DI RESTRAINT	FORD
UFR1400DAP42RB 42 DI RESTRAINT	FORD
UFR1400DAP48RB 48 DI RESTRAINT	FORD
UFR1500SAP3RBI 3 PVC RESTRAINT	FORD
UFR1500SAP4RBI 4 PVC RESTRAINT	FORD
UFR1500SAP6RBI 6 PVC RESTRAINT	FORD
UFR1500SAP8RBI 8 PVC RESTRAINT	FORD
UFR1500SAP10RBI 10 PVC RESTRAINT	FORD
UFR1500SAP12RBI 12 PVC RESTRAINT	FORD
UFR1500SAP14RBI 14 PVC RESTRAINT	FORD
UFR1500SAP16RBI 16 PVC RESTRAINT	FORD
UFR1500SAP18RBI 18 PVC RESTRAINT	FORD
UFR1500SAP20RBI 20 PVC RESTRAINT	FORD
UFR1500SAP24RBI 24 PVC RESTRAINT	FORD
UFR1500SAP30RBI 30 PVC RESTRAINT	FORD
UFR1500SAP36RBI 36 PVC RESTRAINT	FORD
TG6 6 MJ TRANS RUBBER GSKT	SIGMA

TG8	8 MJ TRANS RUBBER GSKT	SIGMA
TG10	10 MJ TRANS RUBBER GSKT	SIGMA
TG12	12 MJ TRANS RUBBER GSKT	SIGMA
MG3	3 MJ RUBBER GASKET	SIGMA
MG4	4 MJ RUBBER GASKET	SIGMA
MG6	6 MJ RUBBER GASKET	SIGMA
MG8	8 MJ RUBBER GASKET	SIGMA
MG10	10 MJ RUBBER GASKET	SIGMA
MG12	12 MJ RUBBER GASKET	SIGMA
MG14	14 MJ RUBBER GASKET	SIGMA
MG16	16 MJ RUBBER GASKET	SIGMA
MG18	18 MJ RUBBER GASKET	SIGMA
MG20	20 MJ RUBBER GASKET	SIGMA
MG24	24 MJ RUBBER GASKET	SIGMA
MG30	30 MJ RUBBER GASKET	SIGMA
MG36	36 MJ RUBBER GASKET	SIGMA
MG42	42 MJ RUBBER GASKET	SIGMA
MG48	48 MJ RUBBER GASKET	SIGMA
PLB-G	PIPE JOINT LUBE	SIGMA
MACRO4	4" MACRO	ROMAC
MACRO6	6" MACRO	ROMAC
MACRO8	8" MACRO	ROMAC
MACRO10	10" MACRO	ROMAC
MACRO12	12" MACRO	ROMAC

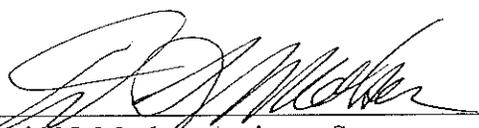
**SECRETARIAL CERTIFICATE  
OF  
AUTHORIZATION**

The undersigned Assistant Secretary of Ferguson Enterprises, Inc., a Virginia corporation (the "Corporation"), hereby certifies that: i) certain of the Corporation's facilities in the State of Louisiana are doing business as Louisiana Utilities Supply Company and ii) Cathy McCarthy is the Outside Salesperson of the New Orleans, Louisiana area and iii) that the resolutions adopted by the Corporation's Board of Directors effective July 31, 2015, duly authorize certain of the Corporation's officers, including the Assistant Secretary, to designate, and I hereby do so designate Cathy McCarthy as an authorized representative of the Corporation to act for and on behalf of the Corporation to prepare and submit bids and proposals, to enter into contracts, agreements or other documents, and to execute such documents and undertake all such acts as may be deemed in the best interest of the Corporation, including the execution of bonds and in doing so, to contractually bind the Corporation. Unless withdrawn sooner, this certification of authorization shall be effective until July 31, 2017.

Dated: July 22, 2016

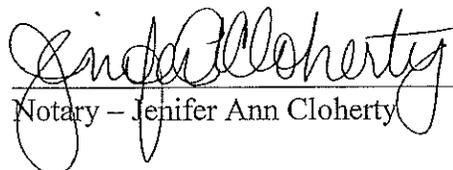


**FERGUSON ENTERPRISES, INC.**

By:   
David N. Meeker, Assistant Secretary

Commonwealth of Virginia )  
  )  
City of Newport News        )

Sworn to subscribed and acknowledged before me this 22nd day of July, 2016, by David N. Meeker, personally known to me, in his capacity as Assistant Secretary of Ferguson Enterprises, Inc., a Virginia corporation, on behalf of such corporation.

  
Notary - Jenifer Ann Cloherty



My commission expires: August 31, 2020

## CORPORATE RESOLUTION

EXCERPT FROM MINUTES OF MEETING OF THE BOARD OF DIRECTORS OF  
\_\_\_\_\_  
INCORPORATED.

AT THE MEETING OF DIRECTORS OF \_\_\_\_\_  
INCORPORATED, DULY NOTICED AND HELD ON \_\_\_\_\_,  
A QUORUM BEING THERE PRESENT, ON MOTION DULY MADE AND SECONDED. IT  
WAS:

RESOLVED THAT \_\_\_\_\_, BE AND IS HEREBY  
APPOINTED, CONSTITUTED AND DESIGNATED AS AGENT AND ATTORNEY-IN-  
FACT OF THE CORPORATION WITH FULL POWER AND AUTHORITY TO ACT ON  
BEHALF OF THIS CORPORATION IN ALL NEGOTIATIONS, BIDDING, CONCERNS  
AND TRANSACTIONS WITH THE PARISH OF JEFFERSON OR ANY OF ITS AGENCIES,  
DEPARTMENTS, EMPLOYEES OR AGENTS, INCLUDING BUT NOT LIMITED TO, THE  
EXECUTION OF ALL BIDS, PAPERS, DOCUMENTS, AFFIDAVITS, BONDS, SURETIES,  
CONTRACTS AND ACTS AND TO RECEIVE ALL PURCHASE ORDERS AND NOTICES  
ISSUED PURSUANT TO THE PROVISIONS OF ANY SUCH BID OR CONTRACT, THIS  
CORPORATION HEREBY RATIFYING, APPROVING, CONFIRMING, AND ACCEPTING  
EACH AND EVERY SUCH ACT PERFORMED BY SAID AGENT AND ATTORNEY-IN-  
FACT.

I HEREBY CERTIFY THE FOREGOING TO BE  
A TRUE AND CORRECT COPY OF AN  
EXCERPT OF THE MINUTES OF THE ABOVE  
DATED MEETING OF THE BOARD OF  
DIRECTORS OF SAID CORPORATION, AND  
THE SAME HAS NOT BEEN REVOKED OR  
RESCINDED.

\_\_\_\_\_  
**SECRETARY-TREASURER**

\_\_\_\_\_  
**DATE**

## **Non-Public Works Bid Affidavit Instructions**

- **Affidavit is supplied as a courtesy to Affiants, but it is the responsibility of the affiant to insure the affidavit they submit to Jefferson Parish complies, in both form and content, with federal, state and parish laws.**
- **Affidavit must be signed by an authorized representative of the entity or the affidavit will not be accepted.**

---

- ~~**Affidavit must be notarized or the affidavit will not be accepted.**~~
- **Notary must sign name, print name, and include bar/notary number, or the affidavit will not be accepted.**
- **Affiant MUST select either A or B when required or the affidavit will not be accepted.**
- **Affiants who select choice A must include an attachment or the affidavit will not be accepted.**
- **If both choice A and B are selected, the affidavit will not be accepted.**
- **Affidavit marked N/A will not be accepted.**
- **It is the responsibility of the Affiant to submit a new affidavit if any additional campaign contributions are made after the affidavit is executed but prior to the time the council acts on the matter.**

*Instruction sheet may be omitted when submitting the affidavit*

Non-Public Works Bid

AFFIDAVIT

STATE OF LA

PARISH/COUNTY OF Jefferson

BEFORE ME, the undersigned authority, personally came and appeared: Cathy A  
McCarthy, (Affiant) who after being by me duly sworn, deposed and said that

he/she is the fully authorized Salesperson of Ferguson Enterprises  
DBA Louisiana Utilities Supply  
901 S. L. LeBlanc Rd, Suite 206  
Metairie LA 70001

the party who submitted a bid in response to Bid Number 50119704, to the Parish of  
Jefferson.

Affiant further said:

Campaign Contribution Disclosures

**(Choose A or B, if option A is indicated please include the required attachment):**

Choice A \_\_\_\_\_ Attached hereto is a list of all campaign contributions, including the date and amount of each contribution, made to current or former elected officials of the Parish of Jefferson by Entity, Affiant, and/or officers, directors and owners, including employees, owning 25% or more of the Entity during the two-year period immediately preceding the date of this affidavit or the current term of the elected official, whichever is greater. Further, Entity, Affiant, and/or Entity Owners have not made any contributions to or in support of current or former members of the Jefferson Parish Council or the Jefferson Parish President through or in the name of another person or legal entity, either directly or indirectly.

Choice B  there are **NO** campaign contributions made which would require disclosure under Choice A of this section.

Debt Disclosures

**(Choose A or B, if option A is indicated please include the required attachment):**

Choice A  Attached hereto is a list of all debts owed by the affiant to any elected or appointed official of the Parish of Jefferson, and any and all debts owed by any elected or appointed official of the Parish to the Affiant.

Choice B  There are **NO** debts which would require disclosure under Choice A of this section.

Affiant further said:

~~That Affiant has employed no person, corporation, firm, association, or other organization, either directly or indirectly, to secure the public contract under which he received payment, other than persons regularly employed by the Affiant whose services in connection with the construction, alteration or demolition of the public building or project or in securing the public contract were in the regular course of their duties for Affiant; and~~

*[The remainder of this page is intentionally left blank.]*

That no part of the contract price received by Affiant was paid or will be paid to any person, corporation, firm, association, or other organization for soliciting the contract, other than the payment of their normal compensation to persons regularly employed by the Affiant whose services in connection with the construction, alteration or demolition of the public building or project were in the regular course of their duties for Affiant.

Cathy A. McCarthy  
Signature of Affiant

Cathy A. McCarthy  
Printed Name of Affiant

SWORN AND SUBSCRIBED TO BEFORE ME

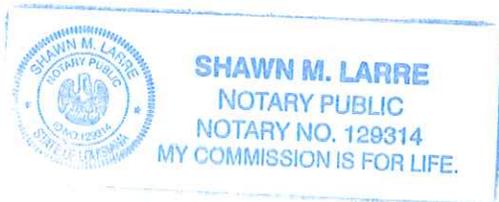
ON THE 25<sup>th</sup> DAY OF MAY, 2017.

Shawn M. Larre  
Notary Public

Shawn M. Larre  
Printed Name of Notary

129314  
Notary/Bar Roll Number

My commission expires At Death



## STANDARD INSURANCE REQUIREMENTS – PUBLICLY ADVERTISED BIDS

All required insurance under this bid shall conform to Jefferson Parish Resolution No. 113646 or No. 113647, as applicable. Contractors may not commence any work under any ensuing contract unless and until all required insurance and associated evidentiary requirements thereto have been met, along with any additional specifications contained in the advertised bid. Except as where otherwise precluded by law, the Parish Attorney or his designee, with the concurrence of the Director of Risk Management or his designee, may agree on a case-by-case basis, to deviate from Jefferson Parish's standard insurance requirements, as provided in this Section. Vendors requesting deviation therefrom shall submit such requests in writing, along with compelling substantiation, to the Purchasing Department prior to the bid's due date. Any changes to the insurance requirements will be reflected in the bid specifications and addenda. Prior to contract execution and at all times thereafter during the term of such contract, contractors must provide and continuously maintain all coverages as required by the foregoing Resolutions, and the contract documents. Failure to do so shall be grounds for suspension, discontinuation or termination of the contract.

---

~~For bidding purposes, bidders must submit with bid submission a current (valid) insurance certificate evidencing the required coverages. Failure to comply will cause bid to be rejected. The current insurance certificate will be used for proof of insurance at time of evaluation. Thereafter, and prior to contract execution, the low bidder will be required to provide final insurance certificates to the Parish which shall name the Jefferson Parish, its Districts Departments and Agencies under the direction of the Parish President and the Parish Council as additional insureds regarding negligence by the contractor for the Commercial General Liability, Workmen's Compensation Insurance and the Comprehensive Automobile Liability policies. Additionally, said certificates should reflect the name of the Parish Department receiving goods and services and reference the respective Jefferson Parish bid number.~~

---

### **JEFFERSON PARISH REQUIRED STANDARD INSURANCE**

#### **WORKER'S COMPENSATION INSURANCE**

As required by Louisiana State Statute, exception; Employer's Liability, Section B shall be \$1,000,000 per occurrence when Work is to be over water and involves maritime exposures to cover all employees not covered under the State Worker's Compensation Act, otherwise this limit shall be no less than \$500,000 per occurrence.

**Note: If your company is not required by law to carry workmen's compensation insurance, i.e. not a Louisiana company, sole employee of the company, then bidders must request a workmen's compensation insurance declaration affidavit prior to the bid opening date. This insurance declaration affidavit must be fully completed, signed, properly notarized and submitted with the bid. A scanned copy may be submitted with the bid; however, the successful bidder must submit the original affidavit in its original format and without material alteration upon contract execution. Failure to comply will result in the bid submission being rejected as non-responsive. The Parish reserves the right to award bid to the next lowest responsive and responsible bidder in this event.**

**COMMERCIAL GENERAL LIABILITY**

Shall provide limits not less than the following: \$1,000,000.00 Combined Single Limit per Occurrence for bodily injury and property damage.

**COMPREHENSIVE AUTOMOBILE LIABILITY**

Bodily injury liability \$1,000,000.00 each person; \$1,000,000.00 each occurrence.  
Property Damage Liability \$1,000,000.00 each occurrence.

**Note:** This category may be omitted if bidders do not/will not utilize company vehicles for the project or do not possess company vehicles. Bidder must request an automobile insurance declaration affidavit prior to the bid opening date. This insurance declaration affidavit must be fully completed, signed, properly notarized and submitted with the bid. A scanned copy of the completed, signed and properly notarized affidavit may be submitted with the bid; however, the successful bidder must submit the original affidavit in its original format and without material alteration upon contract execution. Failure to comply will result in the bid submission being rejected as non-responsive. The Parish reserves the right to award bid to the next lowest responsive and responsible bidder in this event.

**DEDUCTIBLES**

No insurance required shall include a deductible not greater than \$10,000.00. The cost of the deductible shall be borne by the contractor.

NOTE: If the vendor requires a change in deductibles, the request must be submitted in writing to the Purchasing Department prior to the due date of the bid. Such request shall be reviewed by the Parish Attorney's Office with the concurrence of the Director of Risk Management.

**UMBRELLA LIABILITY COVERAGE**

An umbrella policy or excess may be used to meet minimum requirements.

**FOR CONSTRUCTION AND RENOVATION PROJECTS:**

The following are required unless otherwise specified in the bid. Such insurance is due upon contract execution.

**1) OWNER'S PROTECTIVE LIABILITY**

To be for the same limits of liability for bodily injury and property damage liability established for commercial general liability.

**2) BUILDER'S RISK INSURANCE**

The contractor shall maintain Builder's Risk Insurance at his own expense to insure both the owner (Parish of Jefferson) and contractor as their interest may appear.

---



# CERTIFICATE OF LIABILITY INSURANCE

Page 1 of 2  
DATE (MM/DD/YYYY)  
04/12/2017

THIS CERTIFICATE IS ISSUED AS A MATTER OF INFORMATION ONLY AND CONFERS NO RIGHTS UPON THE CERTIFICATE HOLDER. THIS CERTIFICATE DOES NOT AFFIRMATIVELY OR NEGATIVELY AMEND, EXTEND OR ALTER THE COVERAGE AFFORDED BY THE POLICIES BELOW. THIS CERTIFICATE OF INSURANCE DOES NOT CONSTITUTE A CONTRACT BETWEEN THE ISSUING INSURER(S), AUTHORIZED REPRESENTATIVE OR PRODUCER, AND THE CERTIFICATE HOLDER.

**IMPORTANT:** If the certificate holder is an **ADDITIONAL INSURED**, the policy(ies) must have **ADDITIONAL INSURED** provisions or be endorsed. If **SUBROGATION IS WAIVED**, subject to the terms and conditions of the policy, certain policies may require an endorsement. A statement on this certificate does not confer rights to the certificate holder in lieu of such endorsement(s).

PRODUCER Willis of Pennsylvania 100 Matsonford Road Building Five, Suite 200 Radnor, PA 19087-4582	CONTACT NAME:		
	PHONE (A/C, NO, EXT):	610-964-8700	FAX (A/C, NO): 610-254-5600
	E-MAIL ADDRESS:	certificates@willis.com	
	INSURER(S) AFFORDING COVERAGE		NAIC#
	INSURER A:	National Union Fire Ins. Co. of Pittsburgh	19445-002
INSURED Ferguson Enterprises, Inc. and Subsidiaries (See Attached Named Insured Schedule) 12500 Jefferson Avenue Newport News, VA 23602	INSURER B:	National Union Fire Ins. Co. of Pittsburgh	19445-000
	INSURER C:	National Union Fire Ins. Co. of Pittsburgh	19445-001
	INSURER D:	New Hampshire Insurance Company	23841-001
	INSURER E:		
	INSURER F:		

COVERAGES      CERTIFICATE NUMBER: 25418613      REVISION NUMBER:

THIS IS TO CERTIFY THAT THE POLICIES OF INSURANCE LISTED BELOW HAVE BEEN ISSUED TO THE INSURED NAMED ABOVE FOR THE POLICY PERIOD INDICATED. NOTWITHSTANDING ANY REQUIREMENT, TERM OR CONDITION OF ANY CONTRACT OR OTHER DOCUMENT WITH RESPECT TO WHICH THIS CERTIFICATE MAY BE ISSUED OR MAY PERTAIN. THE INSURANCE AFFORDED BY THE POLICIES DESCRIBED HEREIN IS SUBJECT TO ALL THE TERMS, EXCLUSIONS AND CONDITIONS OF SUCH POLICIES. LIMITS SHOWN MAY HAVE BEEN REDUCED BY PAID CLAIMS.

INSR LTR	TYPE OF INSURANCE	ADDL INSD	SUBR WVD	POLICY NUMBER	POLICY EFF (MM/DD/YYYY)	POLICY EXP (MM/DD/YYYY)	LIMITS
A	<input checked="" type="checkbox"/> COMMERCIAL GENERAL LIABILITY <input type="checkbox"/> CLAIMS-MADE <input checked="" type="checkbox"/> OCCUR			GL712-9880	5/1/2017	5/1/2018	EACH OCCURRENCE \$ 2,000,000 DAMAGE TO RENTED PREMISES (Ea occurrence) \$ 1,000,000 MED EXP (Any one person) \$ 10,000 PERSONAL & ADV INJURY \$ 2,000,000 GENERAL AGGREGATE \$ 5,000,000 PRODUCTS - COMP/OP AGG \$ 2,000,000
	GEN'L AGGREGATE LIMIT APPLIES PER: <input type="checkbox"/> POLICY <input checked="" type="checkbox"/> PRO-JECT <input checked="" type="checkbox"/> LOC OTHER:						
B	AUTOMOBILE LIABILITY			AOS CA1921927	5/1/2017	5/1/2018	COMBINED SINGLE LIMIT (Ea accident) \$ 5,000,000
B	<input checked="" type="checkbox"/> ANY AUTO			MA CA1921928	5/1/2017	5/1/2018	BODILY INJURY (Per person) \$
C	<input type="checkbox"/> OWNED AUTOS ONLY <input type="checkbox"/> SCHEDULED AUTOS			VA CA1921929	5/1/2017	5/1/2018	BODILY INJURY (Per accident) \$
	<input checked="" type="checkbox"/> HIRED AUTOS ONLY <input checked="" type="checkbox"/> NON-OWNED AUTOS ONLY						PROPERTY DAMAGE (Per accident) \$
	<input checked="" type="checkbox"/> Self-Insured <input checked="" type="checkbox"/> Physical Damage						\$
	<input type="checkbox"/> UMBRELLA LIAB <input type="checkbox"/> OCCUR						EACH OCCURRENCE \$
	<input type="checkbox"/> EXCESS LIAB <input type="checkbox"/> CLAIMS-MADE						AGGREGATE \$
	<input type="checkbox"/> DED <input type="checkbox"/> RETENTION \$						\$
D	WORKERS COMPENSATION AND EMPLOYERS' LIABILITY ANY PROPRIETOR/PARTNER/EXECUTIVE OFFICER/MEMBER EXCLUDED? (Mandatory in NH) If yes, describe under DESCRIPTION OF OPERATIONS below	Y/N N	N/A	WC023102516	5/1/2017	5/1/2018	<input checked="" type="checkbox"/> PER STATUTE <input type="checkbox"/> OTHER E.L. EACH ACCIDENT \$ 2,000,000 E.L. DISEASE - EA EMPLOYEE \$ 2,000,000 E.L. DISEASE - POLICY LIMIT \$ 2,000,000

DESCRIPTION OF OPERATIONS / LOCATIONS / VEHICLES (ACORD 101, Additional Remarks Schedule, may be attached if more space is required)  
See Attached for Additional Workers' Compensation Policies:

Workers' Compensation - ME  
Policy No. WC023102515  
Carrier: New Hampshire Insurance Company  
Policy Period: 05/1/17 - 05/01/2018  
Statutory  
Limits:

CERTIFICATE HOLDER	CANCELLATION
	SHOULD ANY OF THE ABOVE DESCRIBED POLICIES BE CANCELLED BEFORE THE EXPIRATION DATE THEREOF, NOTICE WILL BE DELIVERED IN ACCORDANCE WITH THE POLICY PROVISIONS.
EVIDENCE OF INSURANCE	AUTHORIZED REPRESENTATIVE
:	<i>Sinda D. Swedjke</i>



**ADDITIONAL REMARKS SCHEDULE**

AGENCY Willis of Pennsylvania		NAMED INSURED Ferguson Enterprises, Inc. and Subsidiaries (See Attached Named Insured Schedule) 12500 Jefferson Avenue Newport News, VA 23602	
POLICY NUMBER See First Page		EFFECTIVE DATE: See First Page	
CARRIER See First Page	NAIC CODE		

**ADDITIONAL REMARKS**

THIS ADDITIONAL REMARKS FORM IS A SCHEDULE TO ACORD FORM,  
FORM NUMBER: 25 FORM TITLE: CERTIFICATE OF LIABILITY INSURANCE

EL Each Accident \$2,000,000  
EL Disease - Each Employee \$2,000,000  
EL Disease - Policy Limit \$2,000,000

Workers' Compensation - CA  
Policy No. WC023102514  
Carrier: American Home Assurance Company  
Policy Period: 05/1/2017-05/1/2018  
Statutory  
Limits:  
EL Each Accident \$2,000,000  
EL Disease - Each Employee \$2,000,000  
EL Disease - Policy Limit \$2,000,000

Workers' Compensation - FL  
Policy No. WC02310513  
Carrier: Illinois National Insurance Company  
Policy Period: 05/1/2017-05/1/2018  
Statutory  
Limits:  
EL Each Accident \$2,000,000  
EL Disease - Each Employee \$2,000,000  
EL Disease - Policy Limit \$2,000,000

Workers' Compensation - MA & WI  
Policy No. WC023102518  
Carrier: New Hampshire Insurance Company  
Policy Period: 05/1/2017-05/1/2018  
Statutory  
Limits:  
EL Each Accident \$2,000,000  
EL Disease - Each Employee \$2,000,000  
EL Disease - Policy Limit \$2,000,000

Workers' Compensation - AK, AZ, IL, KY, NC, NH, NJ, PA, UT, VA, VT  
Policy No. WC023102517  
Carrier: New Hampshire Insurance Company  
Policy Period: 05/1/2017-05/1/2018  
Statutory  
Limits:  
EL Each Accident \$2,000,000  
EL Disease - Each Employee \$2,000,000  
EL Disease - Policy Limit \$2,000,000

**Ferguson Enterprises, Inc. and Subsidiaries.  
List of Named Insureds**

Air Cold Supply	E & J Plumbing & Heating Supply Co.
Air Cold Supply/Webb Distributors	Economy Plumbing and Heating Supply Co.
Alamo Pipe & Supply	Endries International, Inc.
Alaska Pipe & Supply	Energy & Process Corporation
Andrews Lighting Gallery, Inc. (dba Andrews Lighting & Hardware Gallery)	Equarius, Inc. dba Equarius Waterworks, Meter & Automation Group
Arkansas Supply, Inc.	Factory Direct Appliance
Ar-Jay Building Products, Inc. (dba The Ar-Jay Center)	Ferguson Bath Kitchen and Lighting Gallery
Atlantic American Fire Equipment Company	Ferguson Enterprises IV, Inc.
Arkansas Supply	Ferguson Enterprises of Montana, Inc.
The Bath + Beyond	Ferguson Enterprises of Virginia, Inc.
Bruce-Rogers Company	Ferguson Enterprises V, Inc.
Build.com, Inc.	Ferguson Enterprises, Inc.
Builders Appliance Center, LLC	Ferguson Enterprises, Inc. dba WPCC Forwarding
CAL-STEAM, a Wolseley Company	Ferguson Enterprises, Inc. A Corp of Virginia
Camellia Valley Supply	Ferguson Enterprises NY – Metro, Inc.
Castle Supply Company, Inc.	Ferguson Fire & Fabrication, Inc.
CastleNorth	Ferguson Fire & Fabrication, Inc. (fka Action Fire Fab & Supply, Inc.)
Central Pipe & Supply	Ferguson Fire & Fabrication, Inc. (fka Sierra Craft, Inc.)
CFP	Ferguson Full Service Supply
Chadwick	Ferguson Heating & Cooling
City Lights Design Showroom	Ferguson Holdings, Inc.
Clawfoot Supply, LLC	Ferguson Hospitality Sales
Clayton Group, Inc.	Ferguson Industrial Plastics and Pump Division
Clayton International, LLC	Ferguson Integrated Systems Division, Inc.
Cline Contract Sales	Ferguson Intermountain Piping
Colgan Cabinets	Ferguson International
Colgan Distributors	Ferguson Process Services
Crow Company	Ferguson Valve & Automation
Custom Lighting Incorporated	Ferguson Waterworks
Custom Hardware and Accessories, Inc.	Ferguson Waterworks - Midwest Pipe
D & C Plumbing & Heating Supply	Ferguson Waterworks - Municipal Pipe
Davis & Warshow, Inc.	Ferguson Waterworks - Red Hed
Davidson Electric Wholesale Supply	Ferguson Waterworks EPPCO
The Davidson Corporation, a Delaware Corporation	Ferguson Waterworks International
The Davidson Group Companies, Inc	Frischkorn, Inc.
Davidson Group Leasing	Gabriel Scientific & Machine, LLC
Davidson Pipe Company Inc., a New York Corporation	Galleria Bath & Kitchen Showplace
Davidson Pipe Supply Company, Inc.	Gilmour Supply Company, Inc.
Davies Water	Global HVAC Distributors, Inc.
Dealernet, LLC dba Dealernet	Ferguson Enterprises, Inc. dba Groeniger
Decorative Product Source, Inc.	

**Ferguson Enterprises, Inc. and Subsidiaries.  
List of Named Insureds**

& Company  
Gulf Refrigeration Supply  
High Country Plumbing Supply  
Home Equipment Company, Inc.  
HP Products Corporation  
HP Logistics, Inc.  
Indiana Plumbing Supply Co., Inc.  
Industrial Hub of the Carolinas  
J&G Products  
J.D. Daddario Company  
Joseph G. Pollard Co., Inc.  
Kandall Fabricating  
Karl's Appliances, A Ferguson Enterprise  
Lane Piping Co.  
Lawrence Plumbing Supply Co.  
Lighting Unlimited, LLC  
Lincoln Products  
Linwood Pipe and Supply  
Living Direct, Inc.  
Louisiana Utilities Supply Company  
Louisiana Chemical Pipe, Valve & Fitting,  
Inc. dba Wolseley Industrial Group  
LUSCO  
Lyon Conklin & Co., Inc.  
Mastercraft Cabinets  
Matera Paper Company, Inc.  
McFarland Supply Co., Inc.  
Michigan Meter Technology  
Michigan Pipe & Valve-Flint, Inc.  
Michigan Pipe & Valve-Lansing, Inc.  
Monotube Pile Corporation  
Northern Water Works Supply, Inc.  
Onda-Lay Pipe and Rental, Inc.  
Page's Appliances  
Palermo Supply  
Park Supply  
PCS Industries d/b/a HP Products Corp.  
Pipe Products  
Plumbing Décor  
Plumb Source  
Powell Pipe & Supply Company  
Power Equipment Direct Inc.  
P.V. Sullivan Supply Co., Inc.  
R Supply Company  
Ramapo Wholesalers  
Record Supply Company  
Redlon & Johnson  
Reese Kitchen, Bath & Lighting Gallery  
RenWes Sales  
S.G. Supply Company  
  
S.G. Supply Company dba SG Supply Co.,  
a Ferguson Enterprise  
Sierra Craft, Inc.  
Signature Hardware  
Ship-Pac, Inc. d/b/a HP Products Corp.  
SOS Sales  
Specialty Pipe & Tube, Inc.  
Specialty Pipe & Tube of Texas, Inc.  
Stock Loan Services LLC  
Summer & Dunbar  
Supply North Central Group  
Tarpon Wholesale Supplies  
T & A Valve Industries, Inc.  
The Parnell-Martin Companies LLC  
The Plumbers Warehouse  
The Plumbing Source Inc.  
The Stock Market  
Tubeco Fabrication, Inc.  
Underground Pipe & Valve Inc.  
United Automatic  
Water Works Supplies  
Webb Distributors  
Western Air Systems and Controls, Inc.  
Westfield Lighting  
WIA of California, Inc.  
Wolseley Industrial Group  
Wolseley Industrial Plastics  
Wolseley Investments Acquisitions, Inc.  
Wolseley Investments, Inc.  
Wolseley NA Construction Services, LLC  
Wolseley North America, Inc.  
Wolseley North American Consulting, LLC  
Wolseley North American Services, Inc.  
WPCC Forwarding